Docusign Envelope ID: B9B77CD2-F0C1-4BAA-8538-6B315B443E44

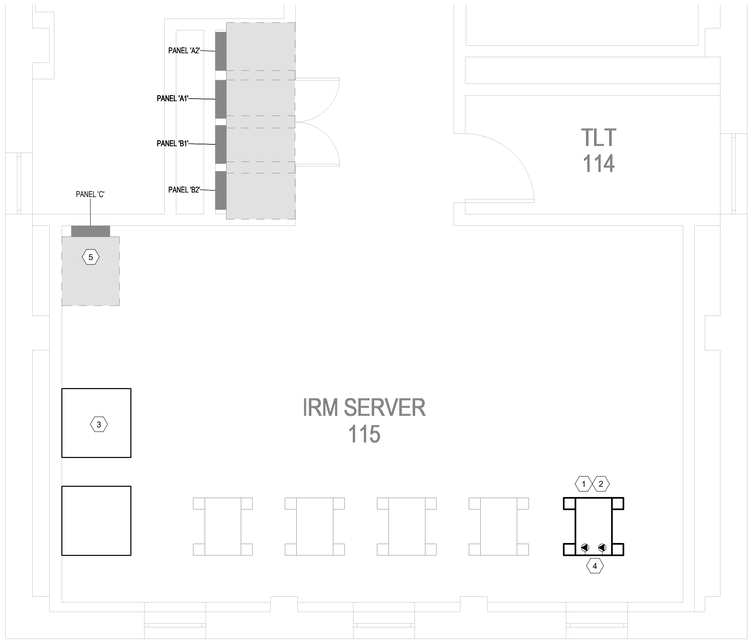

2 BUILDING 5 FIRST FLOOR IRM SERVER ROOM ENLARGED PLAN

Scale: 3/8" = 1'-0"

0 1 2 4

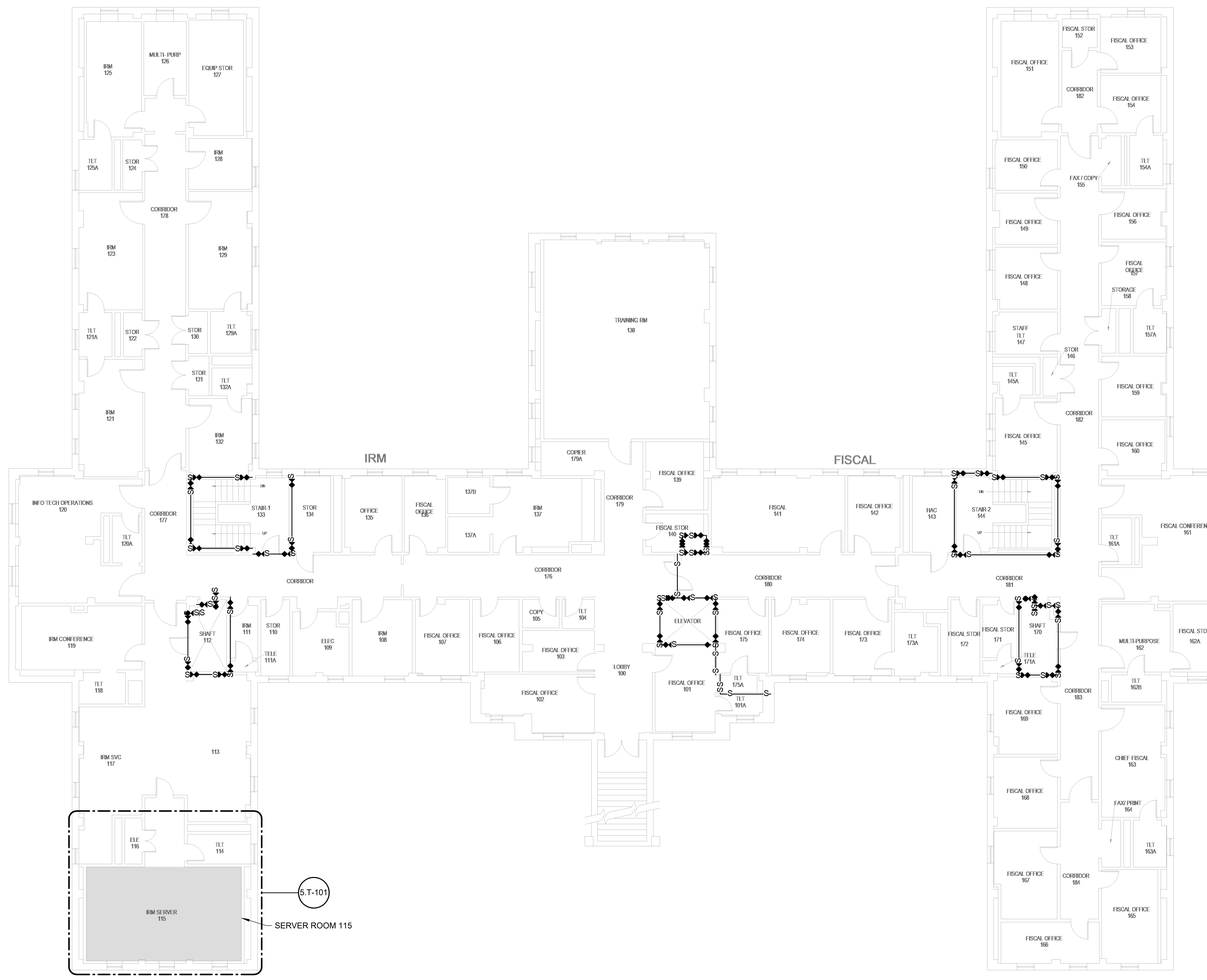

1 BUILDING 5 FIRST FLOOR SECURITY PLAN

Scale: 3/32" = 1'-0"

0 4 8 16

SHEET NOTES:

A. REFERENCE SHEET TS101 AND TS102 FOR EXTERIOR CAMERA LOCATIONS.

B. ALL EXISTING CONDITIONS ARE BASED ON THE BEST AVAILABLE INFORMATION AT THE TIME OF SURVEY.

C. NEW CCTV CABLING TO BE RUN ON J-HOOKS 2' OC ABOVE CEILING IN CORRIDORS.

D. ALL CONDUIT SHALL BE 3/4" MINIMUM. ELECTRICAL CONTRACTOR TO SIZE CONDUIT. PER THE MOST CURRENT EDITION OF THE NEC.

E. WHERE LENGTH FROM CAMERA TO RACK EQUIPMENT EXCEEDS 295' (90M) CONTRACTOR SHALL USE FIBER OPTIC CABLE.

F. COORDINATE AND CONFIRM ALL ROUTING WITH COR PRIOR TO ROUGH-IN.

G. SEE SHEET G-100 FOR ICRA MEASURES.

H. USE MOBILE CONTAINMENT CART (6/G-100) ALONG CORRIDORS.

(#) KEY NOTES:

1 PROPOSED LOCATION OF NEW CISCO 9300 SWITCH AND PATCH PANEL. VERIFY LOCATION WITH COR AND OIT REPRESENTATIVE.

2 INSTALL NEW CAMERAS. PROVIDE NEW 4 PR UTP CABLING FROM CAMERA TO NEW POE SWITCH IN TELECOM ROOM. REPAIR/ REPLACE SURFACES AFFECTED BY CAMERA EQUIPMENT INSTALLATION TO MATCH SIMILAR/EXISTING CONDITIONS. CONTRACTOR TO REPLACE DAMAGED CEILING TILE AND GRID ASSOCIATED WITH WORK AT NO ADDITIONAL COST TO GOVERNMENT.

3 EXISTING UPS WITH 120/208V POWER DISTRIBUTION PANEL.

4 NEW CCTV HEAD END EQUIPMENT TO BE MOUNTED IN NEW CABINET. COORDINATE LOCATION WITH COR.

5 PROVIDE 1P, 20A CIRCUIT BREAKER IN THE EXISTING 120/208V UPS DISTRIBUTION PANEL. RECEPTACLE AND CIRCUIT TO LOCATED UNDER RAISED FLOOR.

KEY PLAN

SCALE: NO SCALE

AREA OF WORK

FULLY SPRINKLERED

BID DOCUMENTS

#	Revisions:	Date

CONSULTANTS:

REGISTERED COMMUNICATIONS DISTRIBUTION DESIGNER
BICSI
JAMES V EZEKIEL
BICSI ID# 290762
EXPIRES 12-31-24
RCDD

NORTH CAROLINA PROFESSIONAL ENGINEER SEAL 36876 GABRIEL T. R. GROSETH 7/24/2024

PROJECT MANAGER

ACG Project Number 22-215

APOGEE Engineers | Architects

Headquarters:
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511

www.acg-pa.com 919-858-7420

© COPYRIGHT Apogee Consulting Group, P.A.

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: BUILDING 5 FIRST FLOOR SECURITY PLAN

Location: ALVIN C. YORK CAMPUS 3400 LEBANON ROAD MURFREESBORO, TN 37129

Project Title: VIDEO SURVEILLANCE SECURITY YORK

Approved:

Date: JUNE 13, 2024 | Checked: JVE | Drawn: LAS

VA PROJECT NUMBER 626A4-22-104

Building Number # 5

Drawing Number 5.T-101

Dwg 10 of 26

C:\Users\staneres\Documents\E-22-215Y-VA York-Video Sec Improv-TN_staneresCBUMB.rvt
7/23/2024 4:22:04 PM

Docusign Envelope ID: B9B77CD2-F0C1-4BAA-8538-6B315B443E44

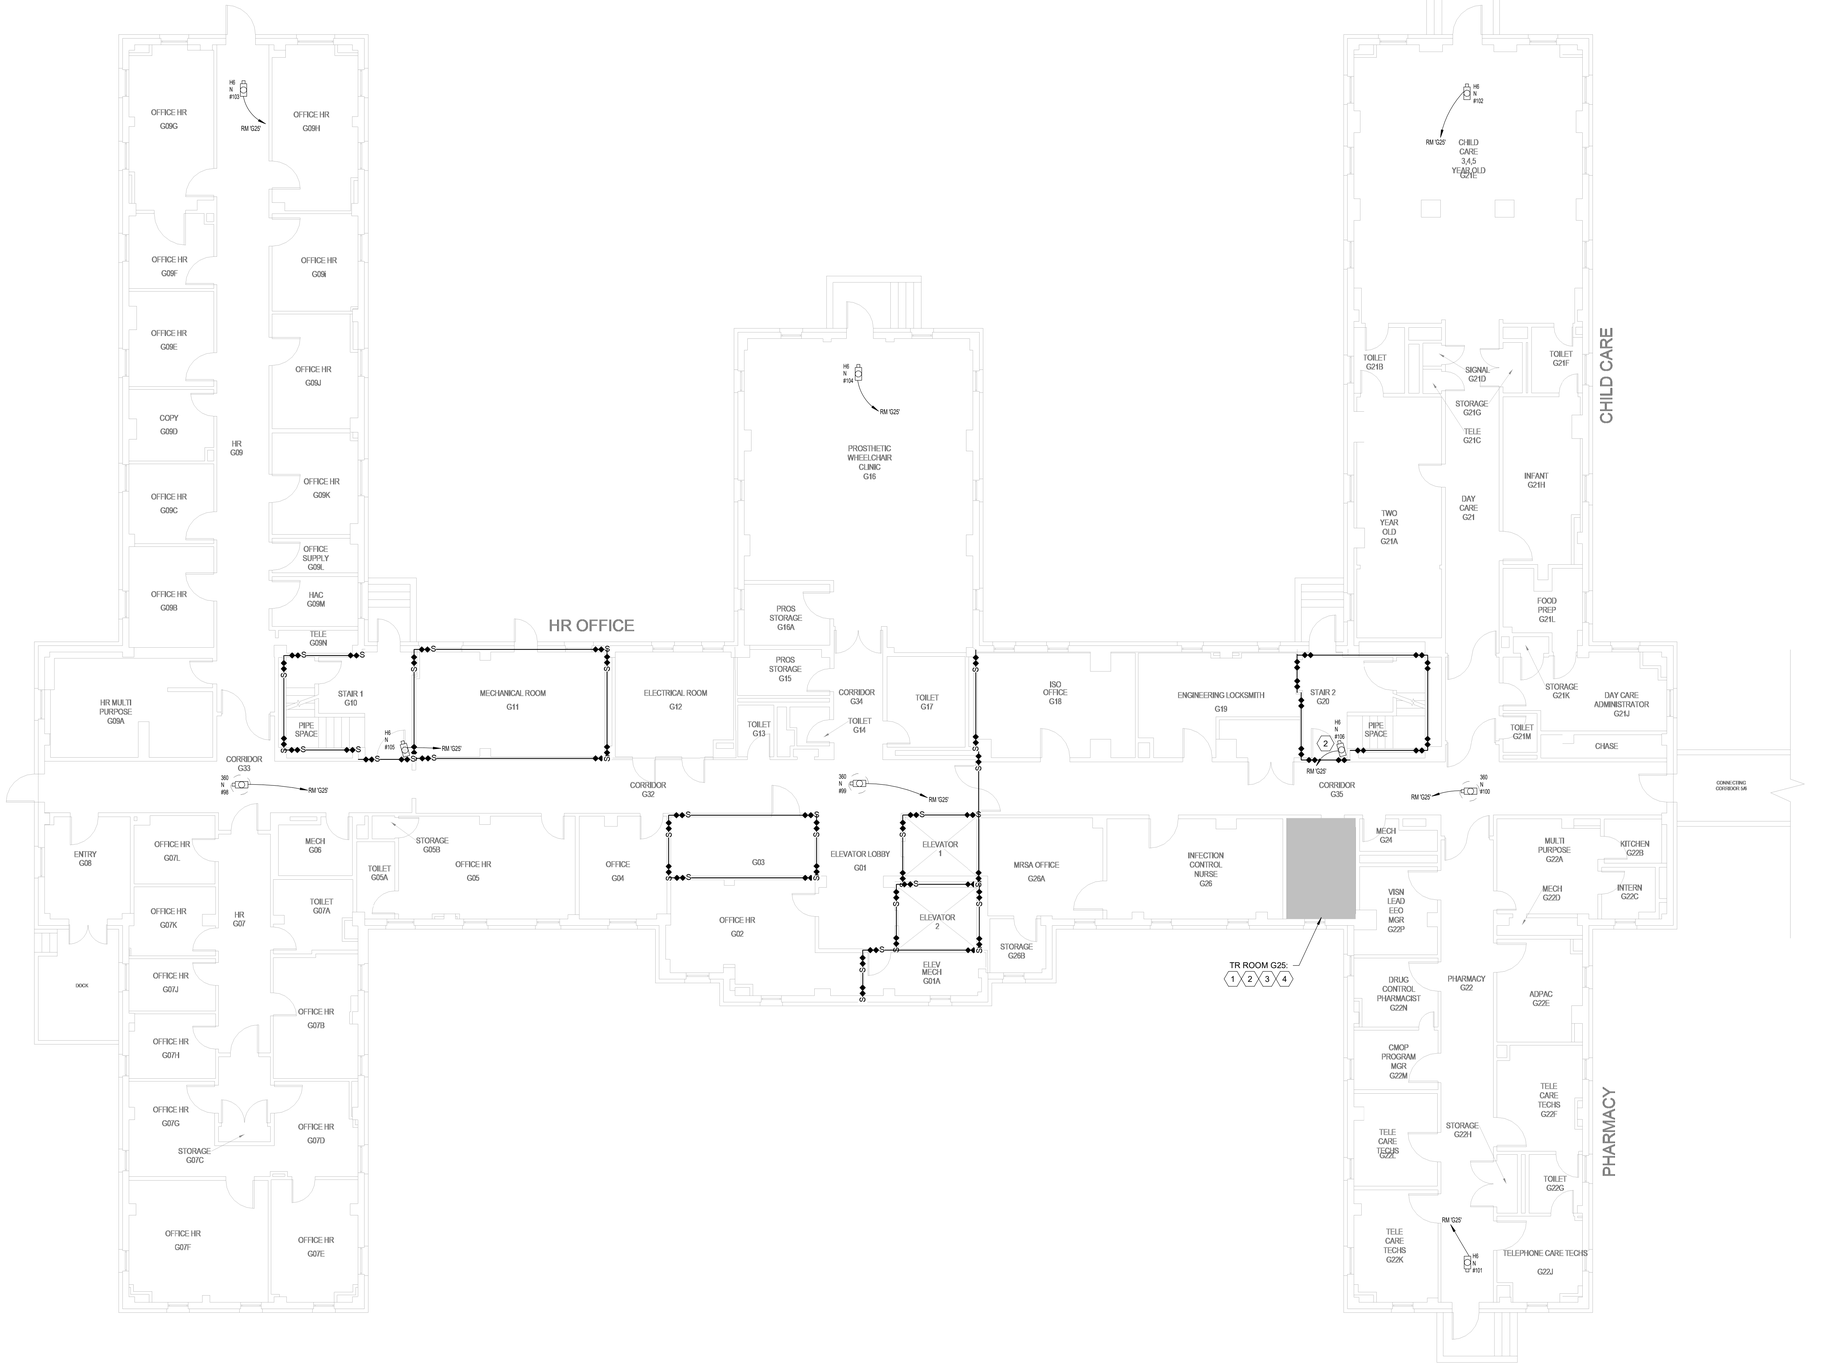

1 BUILDING 6 GROUND FLOOR SECURITY PLAN

Scale: 1/8" = 1'-0"

SHEET NOTES:

A. REFERENCE SHEET TS101 AND TS102 FOR EXTERIOR CAMERA LOCATIONS.

B. ALL EXISTING CONDITIONS ARE BASED ON THE BEST AVAILABLE INFORMATION AT THE TIME OF SURVEY.

C. NEW CCTV CABLING TO BE RUN ON J-HOOKS 2' OC ABOVE CEILING IN CORRIDORS.

D. ALL CONDUIT SHALL BE 3/4" MINIMUM. ELECTRICAL CONTRACTOR TO SIZE CONDUIT. PER THE MOST CURRENT EDITION OF THE NEC.

E. WHERE LENGTH FROM CAMERA TO RACK EQUIPMENT EXCEEDS 295' (90M) CONTRACTOR SHALL USE FIBER OPTIC CABLE.

F. COORDINATE AND CONFIRM ALL ROUTING WITH COR PRIOR TO ROUGH-IN.

G. SEE SHEET G-100 FOR ICRA MEASURES.

H. USE MOBILE CONTAINMENT CART (6/G-100) ALONG CORRIDORS.

KEY NOTES:

1 REMOVE EXISTING CAMERAS AND CABLING BACK TO SOURCE. REPAIR/REPLACE EXISTING SURFACES AFFECTED BY REMOVAL OF CAMERA EQUIPMENT TO MATCH SIMILAR EXISTING CONDITIONS.

2 INSTALL NEW CAMERAS. PROVIDE NEW 4 PR UTP CABLING FROM CAMERA TO NEW POE SWITCH IN TELECOM ROOM. REPAIR/ REPLACE SURFACES AFFECTED BY CAMERA EQUIPMENT INSTALLATION TO MATCH SIMILAR/EXISTING CONDITIONS. CONTRACTOR TO REPLACE DAMAGED CEILING TILE AND GRID ASSOCIATED WITH WORK AT NO ADDITIONAL COST TO GOVERNMENT.

3 PROPOSED LOCATION OF NEW CISCO 9300 SWITCH AND PATCH PANEL. VERIFY LOCATION WITH COR AND OIT REPRESENTATIVE.

4 ROUTE MMF FROM TELECOM ROOM TO RACKS IN BUILDING 5 SERVER ROOM.

KEY PLAN

SCALE: NO SCALE

AREA OF WORK

FULLY SPRINKLERED

BID DOCUMENTS

#	Revisions:	Date

CONSULTANTS:

JAMES V EZEKIEL
BICSI ID# 290762
EXPIRES 12-31-24

NORTH CAROLINA PROFESSIONAL SEAL 36876 ENGINEER GARRETT R. GOSSETT 7/24/2024

PROJECT MANAGER

ACG Project Number 22-215

APOGEE Engineers | Architects

Headquarters:
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420

© COPYRIGHT Apogee Consulting Group, P.A.

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: BULDING 6 GROUND FLOOR SECURITY PLAN

Project Title: VIDEO SURVEILLANCE SECURITY YORK

VA PROJECT NUMBER: 626A4-22-104

Building Number: # 6

Location: ALVIN C. YORK CAMPUS 3400 LEBANON ROAD MURFREESBORO, TN 37129

Approved

Date: JUNE 13, 2024 | Checked: JVE | Drawn: LAS

Drawing Number: 6.T-101

Dwg 11 of 26

C:\Users\lastamet\Documents\E-22-215\Y-VA York-Video Sec Improv-TN_lstametCBUMB.rvt
7/23/2024 4:22:06 PM
VA FORM 08-6231

Docusign Envelope ID: B9B77CD2-F0C1-4BAA-8538-6B315B443E44

1 BUILDING 7 GROUND FLOOR SECURITY PLAN

Scale: 1/8" = 1'-0"

0 4 8 16

SHEET NOTES:

A. REFERENCE SHEET TS101 AND TS102 FOR EXTERIOR CAMERA LOCATIONS.

B. ALL EXISTING CONDITIONS ARE BASED ON THE BEST AVAILABLE INFORMATION AT THE TIME OF SURVEY.

C. NEW CCTV CABLING TO BE RUN ON J-HOOKS 2' OC ABOVE CEILING IN CORRIDORS.

D. ALL CONDUIT SHALL BE 3/4" MINIMUM. ELECTRICAL CONTRACTOR TO SIZE CONDUIT, PER THE MOST CURRENT EDITION OF THE NEC.

E. WHERE LENGTH FROM CAMERA TO RACK EQUIPMENT EXCEEDS 295' (90M) CONTRACTOR SHALL USE FIBER OPTIC CABLE.

F. COORDINATE AND CONFIRM ALL ROUTING WITH COR PRIOR TO ROUGH-IN.

G. SEE SHEET G-100 FOR ICRA MEASURES.

H. USE MOBILE CONTAINMENT CART (6/G-100) ALONG CORRIDORS.

(#) KEY NOTES:

1 REMOVE EXISTING CAMERAS AND CABLING BACK TO SOURCE. REPAIR/REPLACE EXISTING SURFACES AFFECTED BY REMOVAL OF CAMERA EQUIPMENT TO MATCH SIMILAR EXISTING CONDITIONS.

2 INSTALL NEW CAMERAS. PROVIDE NEW 4 PR UTP CABLING FROM CAMERA TO NEW POE SWITCH IN TELECOM ROOM. REPAIR/ REPLACE SURFACES AFFECTED BY CAMERA EQUIPMENT INSTALLATION TO MATCH SIMILAR/EXISTING CONDITIONS. CONTRACTOR TO REPLACE DAMAGED CEILING TILE AND GRID ASSOCIATED WITH WORK AT NO ADDITIONAL COST TO GOVERNMENT.

3 ROUTE UTP CABLING UP TO TELECOM ROOM ABOVE.

KEY PLAN

SCALE: NO SCALE

AREA OF WORK

FULLY SPRINKLERED

BID DOCUMENTS

#	Revisions:	Date

CONSULTANTS:

REGISTERED COMMUNICATIONS DISTRIBUTION DESIGNER — Bicsi — JAMES V EZEKIEL — BICSI ID# 290762 — EXPIRES 12-31-24

NORTH CAROLINA PROFESSIONAL SEAL 36876 ENGINEER DARRELL R. GOSSETT — 7/24/2024

PROJECT MANAGER

ACG Project Number 22-215

APOGEE Engineers | Architects

Headquarters:
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511

www.acg-pa.com 919-858-7420

© COPYRIGHT Apogee Consulting Group, P.A.

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: BULDING 7 GROUND FLOOR SECURITY PLAN

Project Title: VIDEO SURVEILLANCE SECURITY YORK

VA PROJECT NUMBER: 626A4-22-104

Building Number: # 7

Location: ALVIN C. YORK CAMPUS 3400 LEBANON ROAD MURFREESBORO, TN 37129

Approved:

Drawing Number: 7.T-101

Date: JUNE 13, 2024 | Checked: JVE | Drawn: LAS

Dwg 12 of 26

C:\Users\tamres\Documents\E-22-215Y-VA York-Video Sec Improv-TN_tamresCBJMB.rvt
7/23/2024 4:22:09 PM
VA FORM 08-6231

Docusign Envelope ID: B9B77CD2-F0C1-4BAA-8538-6B315B443E44

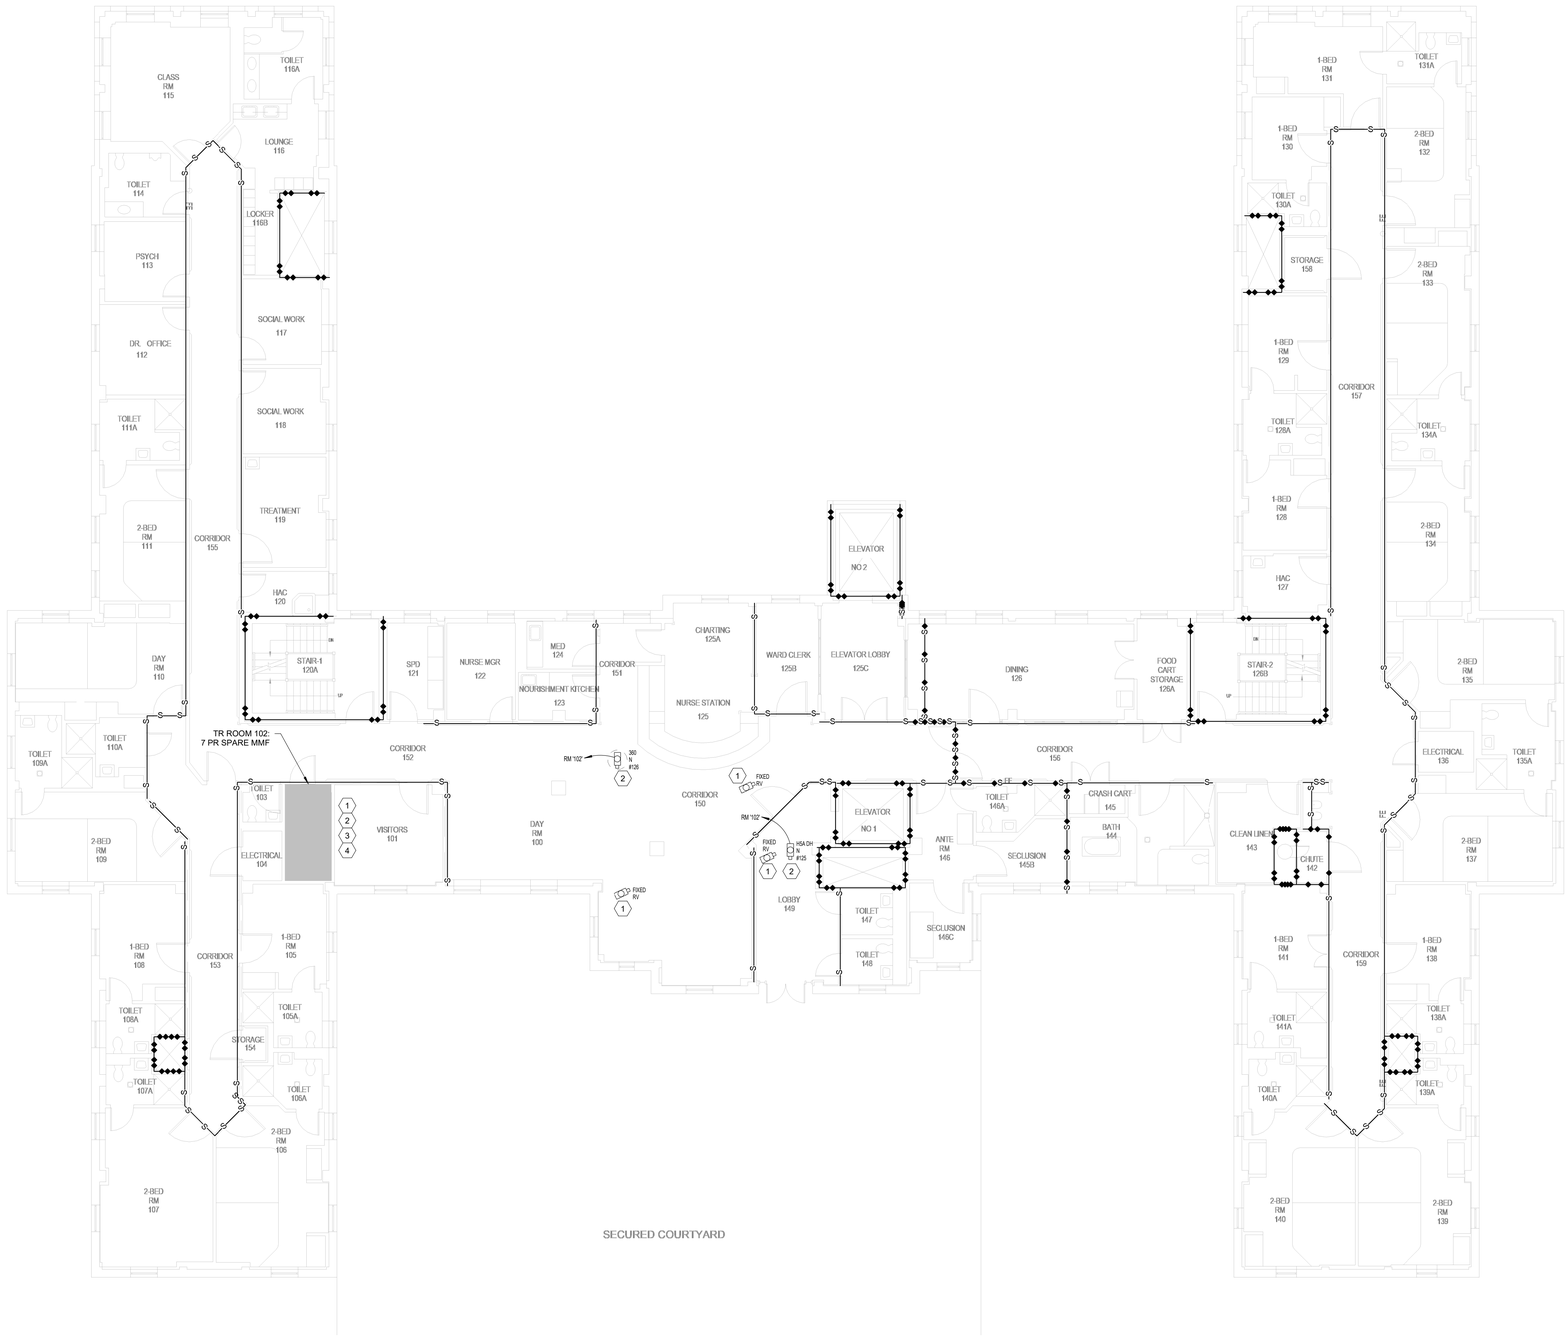

1 **BUILDING 7 FIRST FLOOR SECURITY PLAN**
Scale: 1/8" = 1'-0"

0 4 8 16 NORTH

SHEET NOTES:

A. REFERENCE SHEET TS101 AND TS102 FOR EXTERIOR CAMERA LOCATIONS.

B. ALL EXISTING CONDITIONS ARE BASED ON THE BEST AVAILABLE INFORMATION AT THE TIME OF SURVEY.

C. NEW CCTV CABLING TO BE RUN ON J-HOOKS 2' OC ABOVE CEILING IN CORRIDORS.

D. ALL CONDUIT SHALL BE 3/4" MINIMUM. ELECTRICAL CONTRACTOR TO SIZE CONDUIT. PER THE MOST CURRENT EDITION OF THE NEC.

E. WHERE LENGTH FROM CAMERA TO RACK EQUIPMENT EXCEEDS 295' (90M) CONTRACTOR SHALL USE FIBER OPTIC CABLE.

F. COORDINATE AND CONFIRM ALL ROUTING WITH COR PRIOR TO ROUGH-IN.

G. SEE SHEET G-100 FOR ICRA MEASURES.

H. USE MOBILE CONTAINMENT CART (6/G-100) ALONG CORRIDORS.

KEY NOTES:

1 REMOVE EXISTING CAMERAS AND CABLING BACK TO SOURCE. REPAIR/REPLACE EXISTING SURFACES AFFECTED BY REMOVAL OF CAMERA EQUIPMENT TO MATCH SIMILAR EXISTING CONDITIONS.

2 INSTALL NEW CAMERAS. PROVIDE NEW 4 PR UTP CABLING FROM CAMERA TO NEW POE SWITCH IN TELECOM ROOM. REPAIR/ REPLACE SURFACES AFFECTED BY CAMERA EQUIPMENT INSTALLATION TO MATCH SIMILAR/EXISTING CONDITIONS. CONTRACTOR TO REPLACE DAMAGED CEILING TILE AND GRID ASSOCIATED WITH WORK AT NO ADDITIONAL COST TO GOVERNMENT.

3 PROPOSED LOCATION OF NEW CISCO 9300 SWITCH AND PATCH PANEL. VERIFY LOCATION WITH COR AND OIT REPRESENTATIVE.

4 ROUTE MMF FROM TELECOM ROOM TO RACKS IN BUILDING 5 SERVER ROOM.

KEY PLAN
SCALE: NO SCALE

AREA OF WORK

FULLY SPRINKLERED
BID DOCUMENTS

#	Revisions:	Date

CONSULTANTS:

BICSI REGISTERED COMMUNICATIONS DISTRIBUTION DESIGNER
BICSI JAMES V EZEKIEL
BICSI ID# 290762
EXPIRES 12-31-24

NORTH CAROLINA PROFESSIONAL SEAL 36876 ENGINEER GARRETT R. GOODSELL 7/24/2024

PROJECT MANAGER
ACG Project Number 22-215

APOGEE Engineers | Architects
Headquarters:
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420
© COPYRIGHT Apogee Consulting Group, P.A.

Office of Construction and Facilities Management
VA U.S. Department of Veterans Affairs

Drawing Title: BULDING 7 FIRST FLOOR SECURITY PLAN
Location: ALVIN C. YORK CAMPUS 3400 LEBANON ROAD MURFREESBORO, TN 37129
Project Title: VIDEO SURVEILLANCE SECURITY YORK
Approved:
Date: JUNE 13, 2024
Checked: JVE
Drawn: LAS
VA PROJECT NUMBER: 626A4-22-104
Building Number: # 7
Drawing Number: 7.T-102
Dwg 13 of 26

C:\Users\staff\Documents\E-22-215\VA York-Video Sec Improv-TN_staff\mes\CBUMB.rvt
7/23/2024 4:22:16 PM
VA FORM 08-6231