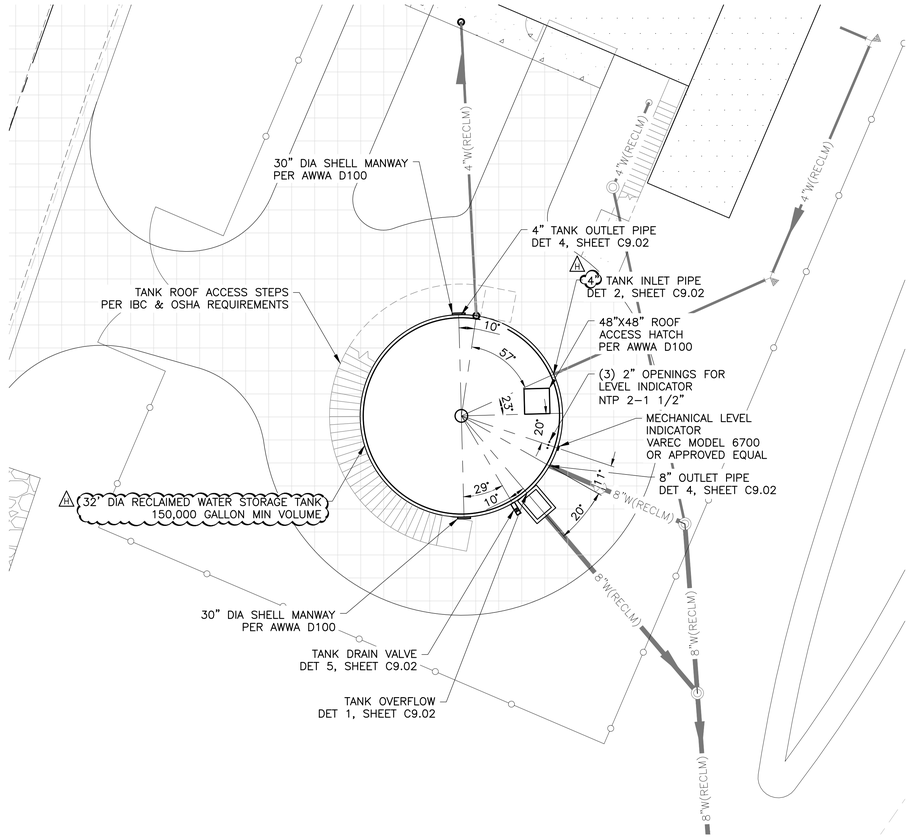

NOTE:
TANK MANUFACTURER SHALL PROVIDE SHOP DRAWINGS FOR ALL COMPONENTS, INCLUDING BUT NOT LIMITED TO THE TANK, STAIRS & RAILINGS, ALL PENETRATIONS, HATCHES AND ALL RELATED APPURTENANCES.

1 RECLAIMED WATER TANK
1"=5'

0' 2.5' 5' 10'
SCALE: 1"=5'

Plot Date: 6/18/2026 2:20 PM
G:\2024\1024034_IHS_WHITERIVER\CAD HON-DAH\C9.01 DETAILS.DWG

IHS Whiteriver Hospital
200 W Hospital Drive
Whiteriver, Arizona, 85941

IHS Project #: 131445
IHS Contract #: 75H70123R00008
IHS Award Date: 02/02/2024

BUILDING PACKAGE 3 (BP3)
HON-DAH UTILITY CAMPUS

SMITHGROUP
455 NORTH THIRD STREET
SUITE 250
PHOENIX, AZ 85004
602.265.2200
smithgroup.com

DIBBLE
1626 NORTH LITCHFIELD RD
SUITE 150
GOODYEAR, AZ 85395
623.935.2258
dibblecorp.com

ISSUED FOR	DATE
BID ADDENDUM-H	18JUN26
BID ADDENDUM-A	16APR26
FINAL CONSTRUCTION DOCUMENTS	05MAR26

SEALS AND SIGNATURES

Registered Professional Engineer (Civil)
43320
CHRISTINA SHANNON MAUCK
06/18/26
ARIZONA U.S.A.

SHEET TITLE
DETAILS

DRAWN BY: DIBBLE CHECKED BY: SM

PROJECT NUMBER
BP3 C9.01
PHASE SHEET NUMBER

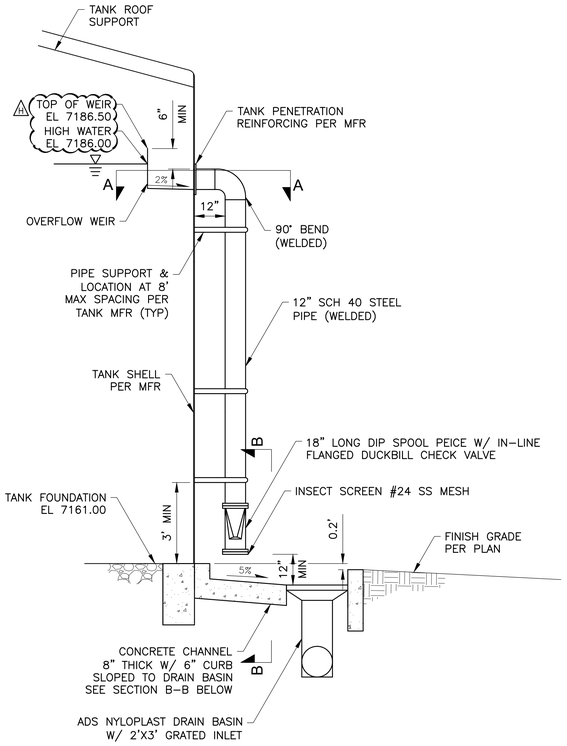

1 OVERFLOW WEIR & PIPING
1" = 2'

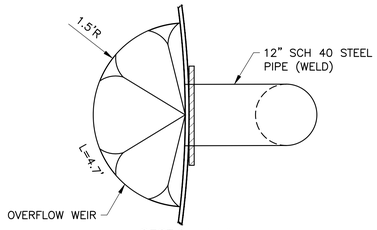

SECTION A-A
1" = 1'

NOTES:
1. OVERFLOW WEIR & PIPE SHALL PROVIDE 1000 GPM MIN CAPACITY W/4" MAX HEAD ABOVE WEIR.
2. MINIMUM OVERFLOW WEIR AND PIPE THICKNESS SHALL BE 3/16" PER AWWA D100.
3. WEIR BOX & OVERFLOW PIPING SHALL BE COATED PER TECHNICAL SPECIFICATION.



SECTION B-B
1" = 2'

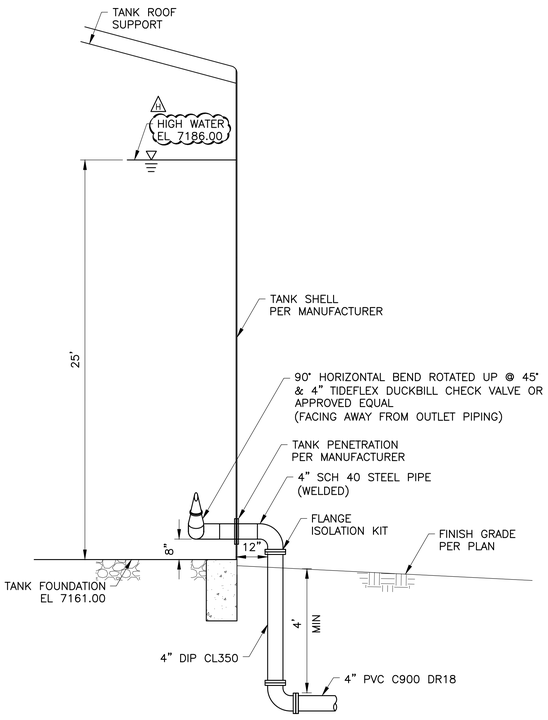

2 TANK INLET PIPING
NTS

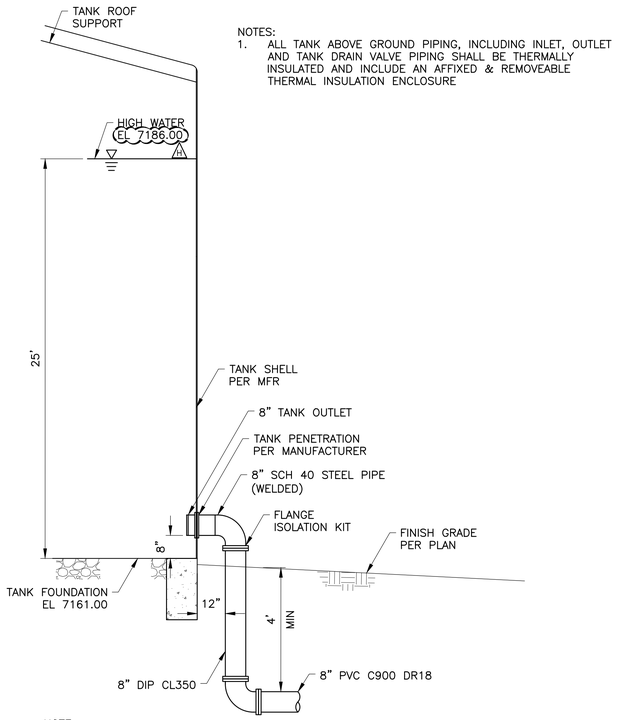

NOTES:
1. ALL TANK ABOVE GROUND PIPING, INCLUDING INLET, OUTLET AND TANK DRAIN VALVE PIPING SHALL BE THERMALLY INSULATED AND INCLUDE AN AFFIXED & REMOVEABLE THERMAL INSULATION ENCLOSURE

NOTE:
OUTLET PIPING TO THE BOOSTER PUMP WILL BE 4"

4 TANK DRAIN OUTLET PIPING
NTS

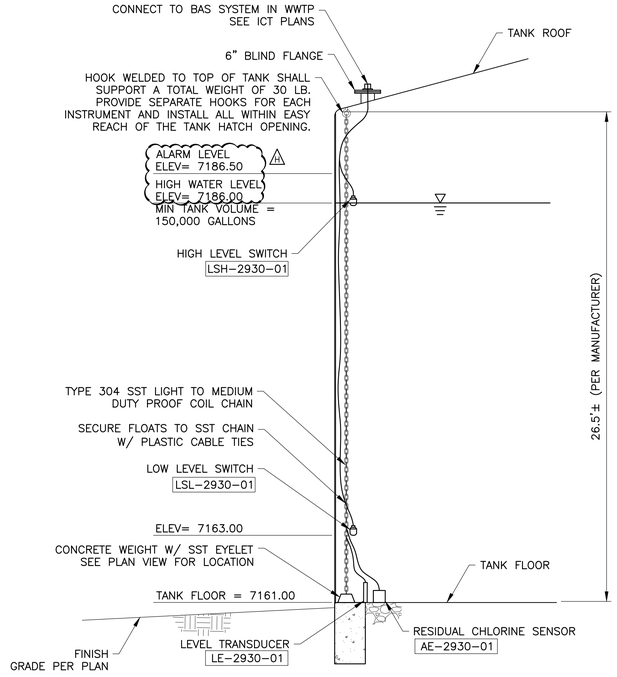

3 LEVEL PROBE
NTS

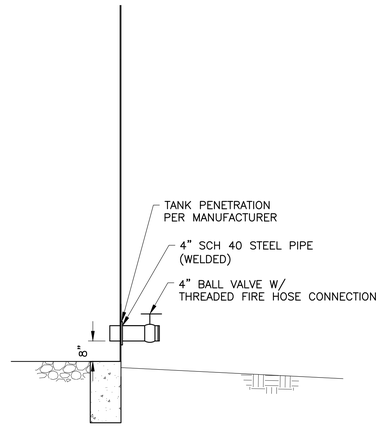

5 TANK DRAIN VALVE
NTS

IHS Whiteriver Hospital
200 W Hospital Drive
Whiteriver, Arizona, 85941

IHS Project #: 131445
IHS Contract #: 75H70123R00008
IHS Award Date: 02/02/2024

BUILDING PACKAGE 3 (BP3)
HON-DAH UTILITY CAMPUS

SMITHGROUP
455 NORTH THIRD STREET
SUITE 250
PHOENIX, AZ 85004
602.265.2200
smithgroup.com

DIBBLE
1626 NORTH LITCHFIELD RD
SUITE 150
GOODYEAR, AZ 85395
623.935.2258
dibblecorp.com

ISSUED FOR	DATE
BID ADDENDUM-H	18JUN26
BID ADDENDUM-A	16APR26
FINAL CONSTRUCTION DOCUMENTS	05MAR26

SEALS AND SIGNATURES

Registered Professional Engineer (Civil) CERTIFICATE NO. 43320 CHRISTINA SHANNON MAUCK Date Signed 06/18/26 ARIZONA U.S.A.

SHEET TITLE
DETAILS

DRAWN BY: DIBBLE CHECKED BY: SM

PROJECT NUMBER
BP3 C9.02
PHASE SHEET NUMBER

Plot Date: 6/18/2026 2:21 PM
G:\2024\1024034_IHS_WHITERIVER\CAD HON-DAH\C9.01 DETAILS.DWG