REPLACE ELEVATORS IN BLDG 7 & BLDG 9

ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA

PROJECT #: 502-24-102

DRAWING INDEX

PAGE #	SHEET #	SHEET NAME
GENERAL		
1 OF 102	G-001	COVER SHEET
2 OF 102	GS101	PHASING PLAN - BUILDING 7
3 OF 102	GS102	PHASING PLAN - BUILDING 9
ARCHITECTURAL		
4 OF 102	A-001	ARCH SYMBOLS, ABBREVIATIONS, & GENERAL NOTES
5 OF 102	AS100	BUILDING 7 - ICRA PLANS - ELEVATORS 1 & 2
6 OF 102	AS101	BUILDING 7 - ICRA PLANS - ELEVATORS 1& 2
7 OF 102	AS102	BUILDING 7 - ICRA PLANS - ELEVATOR 3 & ROOM 29
8 OF 102	AS103	BUILDING 7 - ICRA PLANS - ELEVATORS 4, 5
9 OF 102	AS104	BUILDING 7 - ICRA PLANS - ELEVATORS 4, 5
10 OF 102	AS105	BUILDING 7 - ICRA PLANS - ELEVATORS 4, 5
11 OF 102	AS106	BUILDING 7 - ICRA PLANS - MED RECORDS & SPS CARTLIFT
12 OF 102	AS107	BUILDING 7 - ICRA PLANS - PENTHOUSE
13 OF 102	AS108	BUILDING 9 - ICRA PLANS
14 OF 102	AS109	BUILDING 9 - ICRA PLANS
15 OF 102	AS110	BUILDING 9 - ICRA PLANS
16 OF 102	A-100	BUILDING 7 - BASEMENT - OVERALL FLOOR PLAN
17 OF 102	A-101	BUILDING 7 - LEVEL 01 - OVERALL FLOOR PLAN
18 OF 102	A-102	BUILDING 7 - LEVEL 02 - OVERALL FLOOR PLAN
19 OF 102	A-103	BUILDING 7 - LEVEL 03 - OVERALL FLOOR PLAN
20 OF 102	A-104	BUILDING 7 - LEVEL 04 - OVERALL FLOOR PLAN
21 OF 102	A-105	BUILDING 7 - PENTHOUSE - OVERALL FLOOR PLAN
22 OF 102	A-106	BUILDING 9 - LEVEL 01 - OVERALL FLOOR PLAN
23 OF 102	A-107	BUILDING 9 - LEVEL 02 - OVERALL FLOOR PLAN
24 OF 102	A-108	BUILDING 9 - LEVEL 03 - OVERALL FLOOR PLAN
25 OF 102	A-109	BUILDING 9 - PENTHOUSE - OVERALL FLOOR PLAN
26 OF 102	AD100	BUILDING 7 - BASEMENT - DEMO ENLARGED PLANS
27 OF 102	AD101	BUILDING 7 - LEVEL 01 - DEMO ENLARGED PLANS
28 OF 102	AD102	BUILDING 7 - LEVEL 02 - DEMO ENLARGED PLANS
29 OF 102	AD103	BUILDING 7 - LEVEL 03 - DEMO ENLARGED PLANS
30 OF 102	AD104	BUILDING 7 - LEVEL 04 - DEMO ENLARGED PLANS
31 OF 102	AD106	BUILDING 7 - PENTHOUSE - DEMO ENLARGED PLANS
32 OF 102	AD107	BUILDING 9 - LEVELS 01, 02, 03, PH. - DEMO ENLARGED PLANS
33 OF 102	AD110	BUILDING 7 - BASEMENT - DEMO ENLARGED RCP
34 OF 102	AD111	BUILDING 7 - LEVEL 01 - DEMO ENLARGED RCP
35 OF 102	AD112	BUILDING 7 - LEVEL 02 - DEMO ENLARGED RCP
36 OF 102	AD113	BUILDING 7 - LEVEL 03 - DEMO ENLARGED RCP
37 OF 102	AD114	BUILDING 7 - LEVEL 04 - DEMO ENLARGED RCP
38 OF 102	AD116	BUILDING 7 - PENTHOUSE - DEMO ENLARGED RCP
39 OF 102	AD117	BUILDING 9 - LEVELS 01, 02, 03, PH. - DEMO ENLARGED RCP
40 OF 102	AE100	BUILDING 7 - BASEMENT - ENLARGED PLANS
41 OF 102	AE101	BUILDING 7 - LEVEL 01 - ENLARGED PLANS
42 OF 102	AE102	BUILDING 7 - LEVEL 02 - ENLARGED PLANS
43 OF 102	AE103	BUILDING 7 - LEVEL 03 - ENLARGED PLANS
44 OF 102	AE104	BUILDING 7 - LEVEL 04 - ENLARGED PLANS
45 OF 102	AE105	BUILDING 7 - PENTHOUSE - ENLARGED PLANS
46 OF 102	AE106	BUILDING 9 - LEVELS 01, 02, 03, PH. - ENLARGED PLANS
47 OF 102	AC100	BUILDING 7 - BASEMENT - ENLARGED RCPS
48 OF 102	AC101	BUILDING 7 - LEVEL 01 - ENLARGED RCPS
49 OF 102	AC102	BUILDING 7 - LEVEL 02 - ENLARGED RCPS
50 OF 102	AC103	BUILDING 7 - LEVEL 03 - ENLARGED RCPS
51 OF 102	AC104	BUILDING 7 - LEVEL 04 - ENLARGED RCPS
52 OF 102	AC105	BUILDING 7 - PENTHOUSE - ENLARGED RCPS
53 OF 102	AC106	BUILDING 9 - LEVELS 01, 02, 03, PH. - ENLARGED RCPS
54 OF 102	A-601	ROOM FINISH SCHEDULE, DETAILS
55 OF 102	A-602	BLDG 7 - ELEVATOR SCOPE
56 OF 102	A-603	BLDG 7 - ELEVATOR SCOPE
57 OF 102	A-604	BLDG 7 & 9 - ELEVATOR SCOPE
FIRE PROTECTION		
58 OF 102	F-001	FIRE PROTECTION GENERAL NOTES & ABBREVIATIONS
59 OF 102	F-101	BUILDING 7 - BASEMENT OVERALL FIRE PROTECTION FLOOR PLAN
60 OF 102	F-102	BUILDING 7 - PENTHOUSE -OVERALL FIRE PROTECTION FLOOR PLAN
61 OF 102	FD401	BUILDING 7 - FIRE PROTECTION - DEMOLITION ENLARGED PLANS
62 OF 102	F-401	BUILDING 7 - FIRE PROTECTION - ENLARGED PLANS
MECHANICAL		
63 OF 102	M-001	MECHANICAL GENERAL NOTES & ABBREVIATIONS
64 OF 102	M-002	MECHANICAL LEGENDS
65 OF 102	M-101	BUILDING 7 - BASEMENT - OVERALL FLOOR PLAN
66 OF 102	M-102	BUILDING 7 - PENTHOUSE - OVERALL FLOOR PLAN
67 OF 102	M-103	BUILDING 9 - PENTHOUSE - OVERALL FLOOR PLAN
68 OF 102	MD401	BUILDING 7 - PENTHOUSE - ENLARGED DEMOLITION PLANS
69 OF 102	M-401	BUILDING 7 - BASEMENT - ENLARGED PLANS
70 OF 102	M-402	BUILDING 7 - PENTHOUSE - ENLARGED PLANS
71 OF 102	M-403	BUILDING 9 - PENTHOUSE ENLARGED FLOOR PLAN
72 OF 102	M-501	MECHANICAL DETAILS
73 OF 102	M-601	MECHANICAL SCHEDULES
ELECTRICAL		
74 OF 102	E-001	ABBREVIATIONS, GENERAL NOTES, AND SHEET INDEX
75 OF 102	E-002	ELECTRICAL LEGENDS
76 OF 102	E-100	BUILDING 07 - BASEMENT - OVERALL FLOOR PLAN
77 OF 102	E-101	BUILDING 07 - PENTHOUSE - OVERALL FLOOR PLAN
78 OF 102	E-102	BUILDING 09 - LEVEL 01 - OVERALL FLOOR PLAN
79 OF 102	E-103	BUILDING 09 - PENTHOUSE - OVERALL FLOOR PLAN

DRAWING INDEX

PAGE #	SHEET #	SHEET NAME
80 OF 102	E-401	BLDG 07 - PENTHOUSE- ENLARGED ELECTRICAL PLANS
81 OF 102	E-402	BLDG 07 - BASEMENT - ENLARGED ELECTRICAL PLANS
82 OF 102	E-403	BLDG 07 - ELECTRICAL ROOM 29 - ENLARGED ELECTRICAL PLANS
83 OF 102	E-404	BLDG 07 - BASEMENT - ENLARGED ELECTRICAL PLANS
84 OF 102	E-405	BLDG 07 - PENTHOUSE - ENLARGED ELECTRICAL PLANS
85 OF 102	E-406	BLDG 07 - BASEMENT - ENLARGED ELECTRICAL PLANS
86 OF 102	E-407	BLDG 07 - BASEMENT - ENLARGED ELECTRICAL PLANS
87 OF 102	E-408	BLDG 07 - BASEMENT - ENLARGED ELECTRICAL PLANS
88 OF 102	E-409	BLDG 9 - PENTHOUSE - ENLARGED ELECTRICAL PLANS
89 OF 102	E-410	BLDG 9 - LEVEL 01 - ENLARGED ELECTRICAL PLANS
90 OF 102	E-501	ELECTRICAL DETAILS
91 OF 102	E-502	BUILDING 07 ELECTRICAL DETAILS
92 OF 102	E-503	BUILDING 09 ELECTRICAL DETAILS
93 OF 102	EF601	FIRE ALARM RISER DIAGRAM
94 OF 102	E-601	BUILDING 07 - ONE-LINE DIAGRAMS - EXISTING - PART 1 OF 2
95 OF 102	E-602	BUILDING 07 - ONE-LINE DIAGRAMS - EXISTING - PART 2 OF 2
96 OF 102	E-603	BUILDING 09 - ONE-LINE DIAGRAMS - EXISTING
97 OF 102	E-611	BUILDING 07 - ONE-LINE DIAGRAMS - REVISED - PART 1 OF 2
98 OF 102	E-612	BUILDING 07 - ONE-LINE DIAGRAMS - REVISED - PART 2 OF 2
99 OF 102	E-613	BUILDING 09 - ONE-LINE DIAGRAMS - REVISED
100 OF 102	E-701	ELECTRICAL SCHEDULES
101 OF 102	E-702	ELECTRICAL SCHEDULES
102 OF 102	E-703	ELECTRICAL SCHEDULES

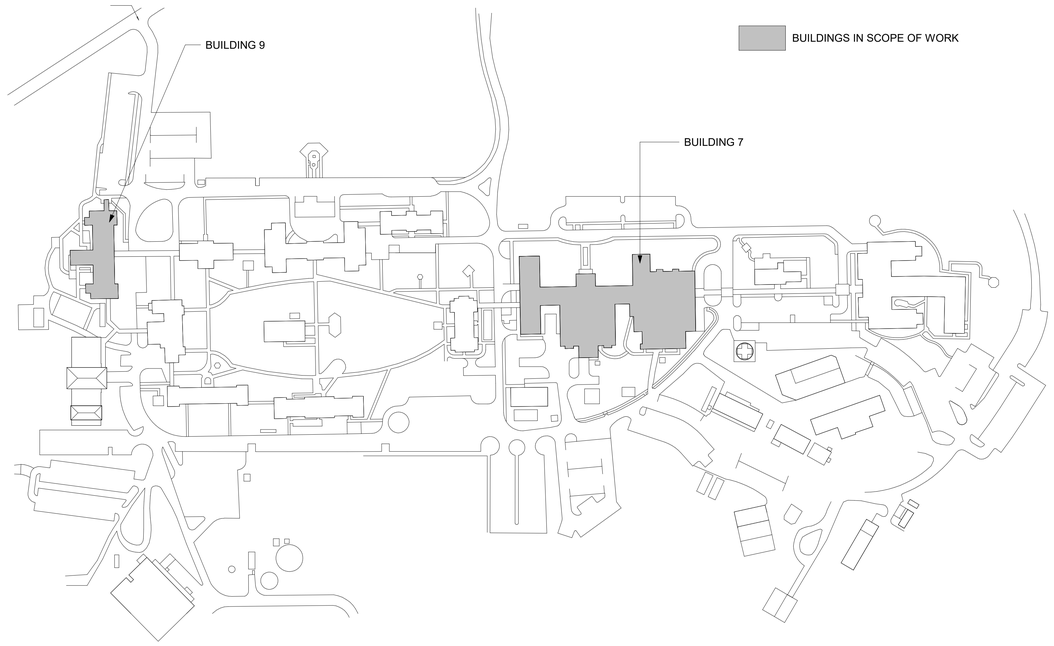

1 FACILITY SITE PLAN
NOT TO SCALE

TRUE NORTH

SIGNATURES

DIRECTOR

COR

ASSOCIATE DIRECTOR

SAFETY OFFICER

CHIEF ENGINEERING

INFECTION CONTROL

PROJECT INFORMATION

CODE ANALYSIS

STATE: LOUISIANA
COUNTY: RAPIDES PARISH
JURISDICTION: ALEXANDRIA

OWNER: GOV, VETERANS AFFAIRS

SITE ZONING: -
CONST TYPE: SEE FIRE LIFE SAFETY SHEET(S)
OCCUPANCY: SEE FIRE LIFE SAFETY SHEET(S)

ICRA CLASS REQUIREMENTS

SEE ICRA SHEET(S) & SPEC SECTION 01 35 26 - SAFETY REQUIREMENTS

APPLICABLE BUILDINGS

BUILDING 7 & BUILDING 9

PROJECT DESCRIPTION

MODERNIZATION AND REPLACEMENT OF ELEVATORS IN BUILDING 7 AND BUILDING 9 AT ALEXANDRIA VA MEDICAL CENTER.

BUILDING 7:

1. TRACTION ELEVATORS. SCOPE LIMITED TO UPGRADING THE INTERIORS AND DOORS.
2. MEDICAL RECORDS ELEVATOR - HYDRAULIC ELEVATOR THAT WILL REQUIRE RETROFIT AND MODERNIZATION.
3. STERILE PROCESSING DEPARTMENT CARTLIFT - TRACTION ELEVATOR WITH ONLY TWO STOPS AND SPANNING 5 FLOORS. ELEVATOR WILL REQUIRE RETROFIT AND MODERNIZATION.

BUILDING 9:

1. TWO HYDRAULIC ELEVATORS SERVING THE BUILDING WILL REQUIRE RETROFIT AND MODERNIZATION.

DESIGN TEAM

ARCHITECT
SPEES DESIGN BUILD
625 1ST AVE, STE 301
SEATTLE, WA 98104
PHONE: (206) 590-2118

PLUMBING
SPEES DESIGN BUILD
625 1ST AVE, STE 301
SEATTLE, WA 98104
PHONE: (206) 590-2118

MECHANICAL
SPEES DESIGN BUILD
625 1ST AVE, STE 301
SEATTLE, WA 98104
PHONE: (206) 590-2118

ELECTRICAL
SPEES DESIGN BUILD
625 1ST AVE, STE 301
SEATTLE, WA 98104
PHONE: (206) 590-2118

FIRE PROTECT
SPEES DESIGN BUILD
625 1ST AVE, STE 301
SEATTLE, WA 98104
PHONE: (206) 590-2118

ELEVATOR
NORTHBAY ELEVATOR
3715 SANTA ROSA AVE
SANTA ROSA, CA 95407
PHONE: (707) 583-3100

GENERAL NOTES

1. DO NOT SCALE DRAWINGS.

Revisions:	Date:

CONSULTANT
ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD
A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246
SDB SPEESDESIGNBUILD

STAMP
10000 REGISTERED ARCHITECT JAMES M. KING STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management
VA U.S. Department of Veterans Affairs

Drawing Title: COVER SHEET
Approved:
Phase: 100% CONSTRUCTION DOCUMENTS
FULLY SPRINKLERED
Project Title: REPLACE ELEVATORS IN BLDG 7 & BLDG 9
Location: ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA
Issue Date: 03/24/2026
Checked: MK
Drawn: AJ
Project Number: 502-24-102
Building Number: -
Drawing Number: G-001

VA FORM 08 - 6231

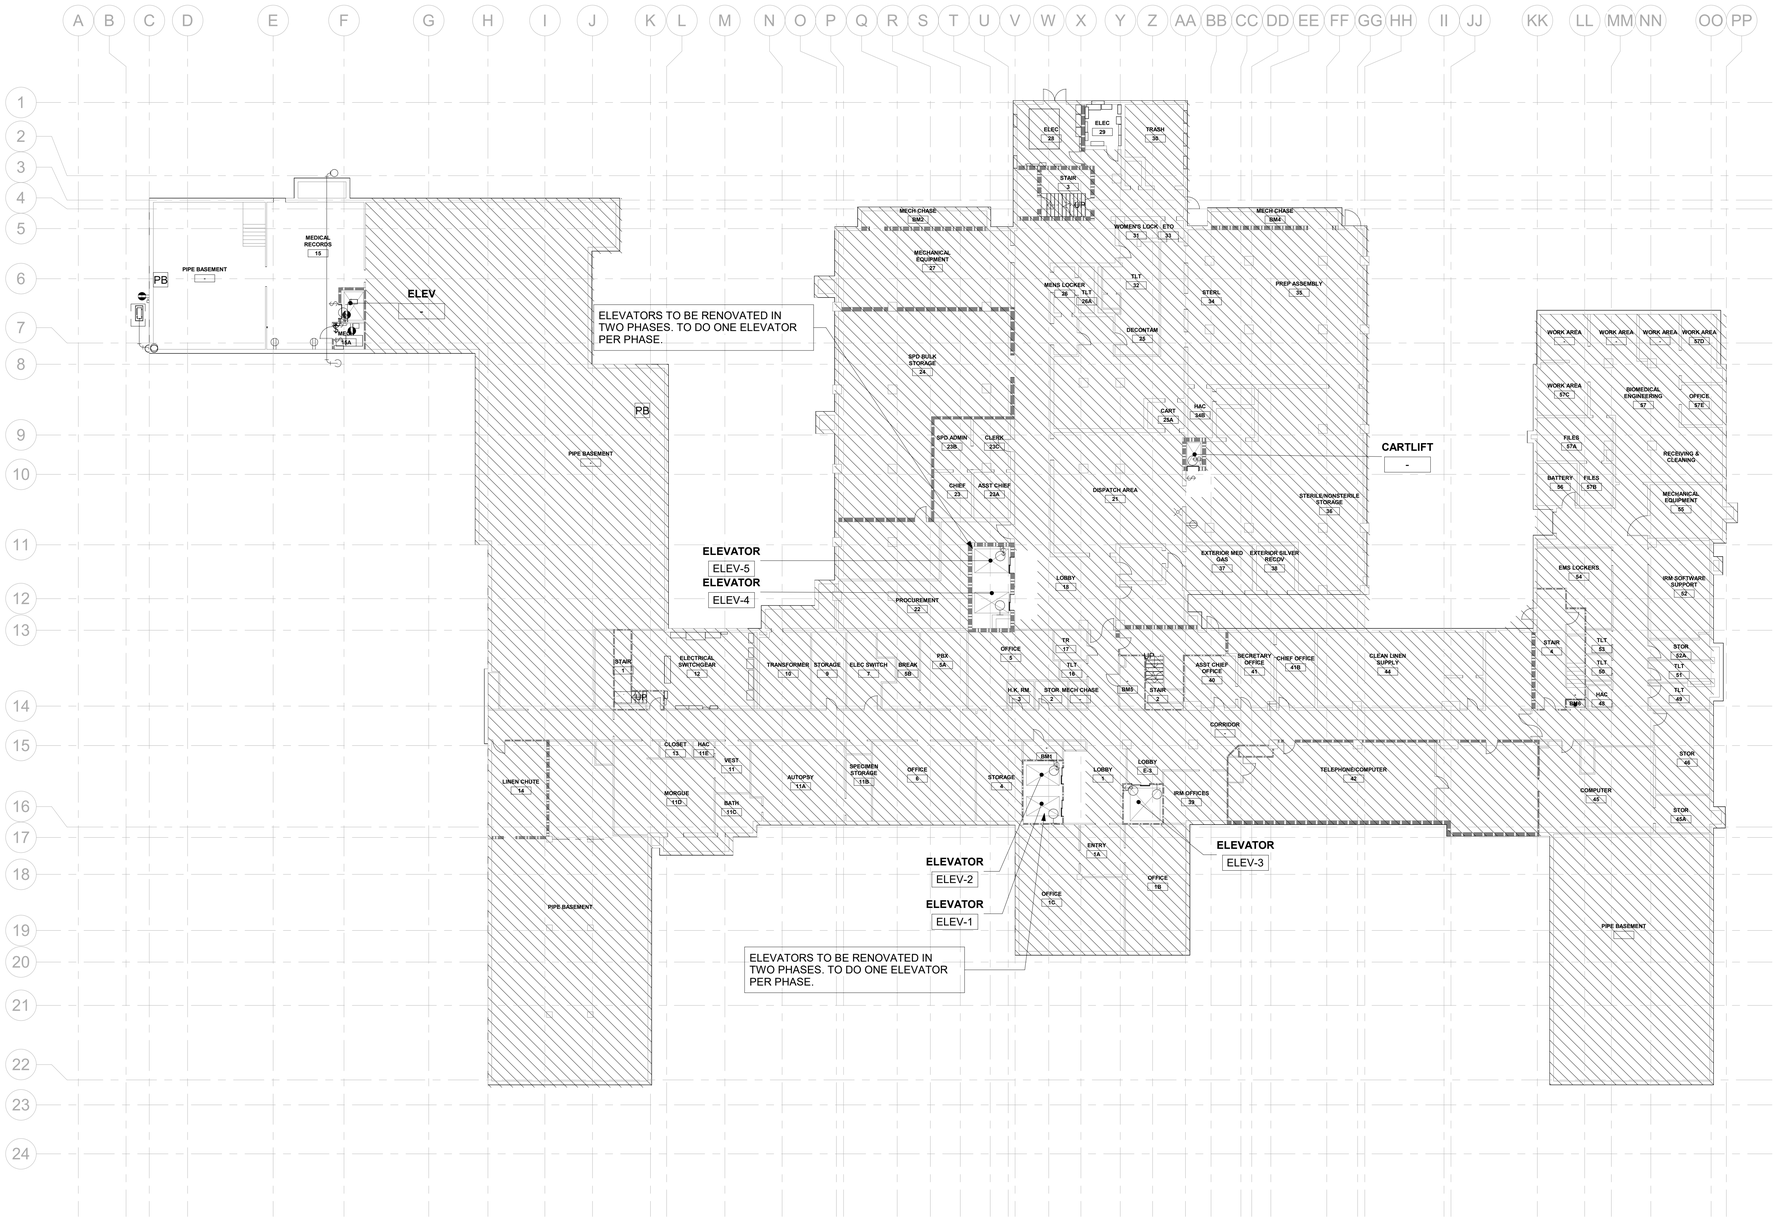

2 BUILDING 7 - BASEMENT - PHASING PLAN

1/16" = 1'-0"

PROJECT NORTH

TRUE NORTH (DASHED)

LEGEND

- OUT OF SCOPE
- 2 HR FIRE RATED WALL (EXISTING)
- 1 HR FIRE RATED WALL (EXISTING)
- SMOKE RATED WALL (EXISTING)

GENERAL NOTES

1. BOTH BUILDINGS MAY BE WORKED ON AT THE SAME TIME, BUT ONLY ONE ELEVATOR PER BUILDING MAY BE WORKED ON AT A TIME.
2. COORDINATE ORDER OF ELEVATOR PHASING WITH THE VA COR.

Revisions:	Date:

CONSULTANT

ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246

SPEESDESIGNBUILD

STAMP

10000 REGISTERED ARCHITECT JAMES M. KING STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: PHASING PLAN - BUILDING 7	Phase: 100% CONSTRUCTION DOCUMENTS
Approved:	FULLY SPRINKLERED

Project Title: REPLACE ELEVATORS IN BLDG 7 & BLDG 9	Project Number: 502-24-102
	Building Number: 7
Location: ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA	Drawing Number: GS101
Issue Date: 03/24/2026 / Checked: MK / Drawn: AJ	

VA FORM 08 - 6231

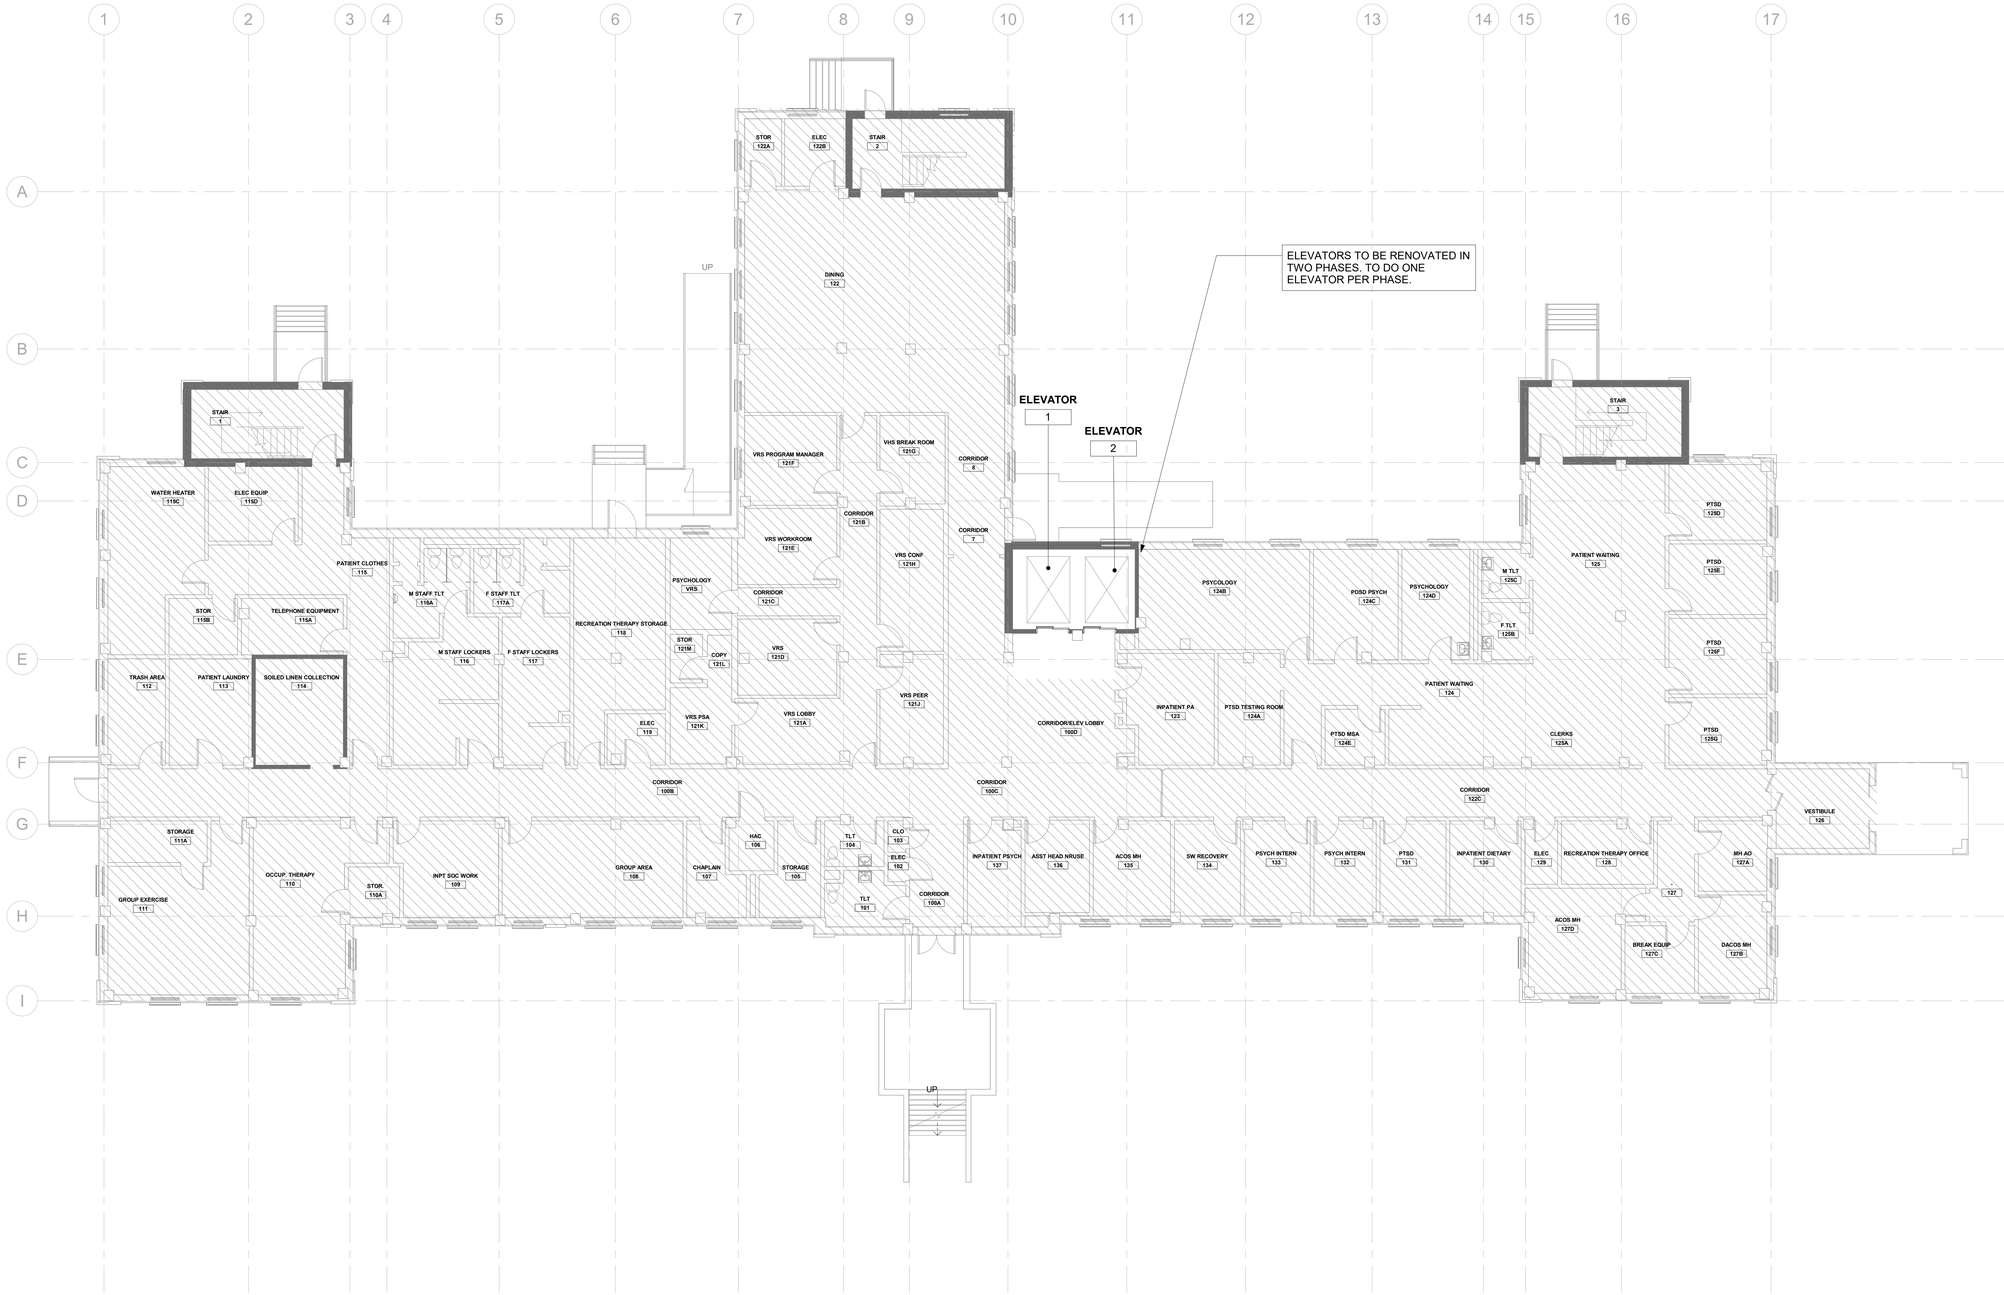

1 BUILDING 9 - PHASING PLAN

1/8" = 1'-0"

PROJECT NORTH

TRUE NORTH (DASHED)

LEGEND

- OUT OF SCOPE
- 2 HR FIRE RATED WALL (EXISTING)
- 1 HR FIRE RATED WALL (EXISTING)
- SMOKE RATED WALL (EXISTING)

GENERAL NOTES

1. BOTH BUILDINGS MAY BE WORKED ON AT THE SAME TIME, BUT ONLY ONE ELEVATOR PER BUILDING MAY BE WORKED ON AT A TIME.
2. COORDINATE ORDER OF ELEVATOR PHASING WITH THE VA COR.

Revisions:	Date:

CONSULTANT

ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246

SPEESDESIGNBUILD

STAMP

10000 REGISTERED ARCHITECT JAMES M. KING STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title	PHASING PLAN - BUILDING 9
Phase	100% CONSTRUCTION DOCUMENTS
Approved:	
	FULLY SPRINKLERED
Project Title	REPLACE ELEVATORS IN BLDG 7 & BLDG 9
Project Number	502-24-102
Building Number	9
Location	ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA
Drawing Number	GS102
Issue Date	03/24/2026
Checked	MK
Drawn	Author

VA FORM 08 - 6231

SYMBOLS

EXTERIOR ELEVATION

INTERIOR ELEVATION

BUILDING SECTION FLAG

WALL SECTION FLAG

CALLOUT FLAG

VERTICAL GRID LINE

HORIZONTAL GRID LINE

TRUE NORTH ARROW

PROJECT NORTH ARROW
(TRUE NORTH DASHED)

ELEVATION / LEVEL MARKER

KEY NOTE

ROOM TAG
(SF OPTIONAL)

CEILING HEIGHT TAG

WALL TAG

FLOOR TAG

ROOF TAG

DOOR TAG

WINDOW TAG

SPECIALTY EQUIPMENT TAG

SIGNAGE TAG

SIGNAGE KEY NOTE
(AW SHEETS ONLY)

SIGNAGE MATERIAL TAG
(AW SHEETS ONLY)

EXISTING TO REMAIN

NEW CONSTRUCTION

TO DEMOLISH
(DEMO SHEET(S) ONLY)

ABOVE

BELOW

EXISTING DOOR TO REMAIN

EXISTING DOOR TO DEMOLISH
(DEMO SHEET(S) ONLY)

NEW DOOR

AREA SHOWN ON SHEET

OUT OF SCOPE

INACCESSIBLE DURING PHASE
(ICRA SHEET(S) ONLY)

TEMPORARY ICRA BOUNDRY
(ICRA SHEET(S) ONLY)

TEMPORARY ICRA BARRIER
(ICRA SHEET(S) ONLY)

TEMPORARY ICRA DOOR
(ICRA SHEET(S) ONLY)

ADHESIVE WALK-OFF MATS
(ICRA SHEET(S) ONLY)

TEMPORARY ICRA AIR PRESSURE
(ICRA SHEET(S) ONLY)

CONTRACTOR PATH OF TRAVEL
(ICRA SHEET(S) ONLY)

SMOKE COMPARTMENT PERIMETER
(FIRE LIFE SAFETY SHEET(S) ONLY)

SMOKE RATED WALL

1 HR FIRE RATED WALL

2 HR FIRE RATED WALL

SMOKE & 1 HR FIRE RATED WALL

FIRE EXTINGUISHER CABINET
(FIRE LIFE SAFETY SHEET(S) ONLY)

EMERGENCY EGRESS ROUTE
(FIRE LIFE SAFETY SHEET(S) ONLY)

SPRINKLER PER FIRE PROTECTION

DIFFUSER PER MECHANICAL
(SIZE & PROPORTION MAY VARY)

LIGHT FIXTURE PER ELECTRICAL
(SIZE & PROPORTION MAY VARY)

MATERIALS

EARTH

SAND

BATT INSULATION

RIGID INSULATION

CONCRETE

STEEL

PLYWOOD, FIRE RATED

GYPSUM BOARD, TYPE 'X'

GYPSUM BOARD, LEAD LINED

ACOUSTICAL CEILING TILE, 2' x 2'

ACOUSTICAL CEILING TILE, 2' x 4'

ABBREVIATIONS

SYMBOLS

&	AND
∠	ANGLE
@	AT
℄	CENTERLINE
°	DEGREES
#	NUMBER

A

AB	ANCHOR BOLT
ABA	ARCHITECTURAL BARRIERS ACT
A(C)T	ACOUSTICAL (CEILING) TILE
ACM	ASBESTOS CONTAINING MATERIAL
ACW	ACOUSTICAL WALL
ADA	AMERICANS W/ DISABILITIES ACT
ADJ	ADJACENT
A/E	ARCHITECT/ENGINEER
AF	ACCESS FLOOR
AFF	ABOVE FINISH FLOOR
AGG	AGGREGATE
ALT	ALTERNATE
ALUM	ALUMINUM
APPROX	APPROXIMATELY
ARCH	ARCHITECT(URAL)
ASPH	ASPHALT
A/V	AUDIO / VIDEO

B

BARR	BARRIER
BATH	BATHROOM
BB	BACKER BOARD
BLD(G)	BUILDING
BLK(G)	BLOCK(ING)
BLW	BELOW
BM	BEAM
BMT(U)	BONE MARROW TRANSPLANT (UNIT)
BO	BOTTOM OF
BOC	BOTTOM OF CURB
BOS	BOTTOM OF SLAB
BRC	BRACE, BRACING
BRKT	BRACKET
BRNG	BEARING
BTM	BOTTOM
BTWN	BETWEEN

C

CAB	CABINET
CC	CONTRACTOR FURN, CONTRACTOR INST
CD	CONSTRUCTION / CONTRACT DOCUMENTS
CJ	CONTROL JOINT
CLG	CEILING
CLR	CLEAR(ANCE)
CMU	CONCRETE MASONRY UNIT
CO	CONTRACTING OFFICER
COL	COLUMN
COMP	COMPOSITION
CONC	CONCRETE
CONN	CONNECTION
CONST	CONSTRUCTION
CONT	CONTINUOUS
COORD	COORDINATE
COR	CONTRACTING OFFICER REPRESENTATIVE
CORR	CORRIDOR
CS	CONCRETE SEALER
CT	CERAMIC TILE
CTR	CENTER
CV	CONTRACTOR FURNISHED, VA INSTALLED

D

DB	DESIGN BUILD
DBL	DOUBLE
DC	DIRECT CURRENT
DD	DESIGN DEVELOPMENT
DEMO	DEMOLISH(ION)
DEPT	DEPARTMENT
DG	DESIGN GUIDE
DIA	DIAMETER
DIM	DIMENSION
DM	DESIGN MANUAL
DWN	DOWN
DR	DOOR
DTL	DETAIL
DWG	DRAWING(S)

E

E	EAST
EA	EACH
EJ	EXPANSION JOINT
ELEC	ELECTRIC(AL)
ELEV	ELEVATION OR ELEVATOR
ENG	ENGINEER(ING)
EOC	EDGE OF CURB
EOP	EDGE OF PAVEMENT
EPDM	ETHYLENE PROPYLENE DIENE TERPOLYMER
EQ	EQUAL
EQUIP	EQUIPMENT
ES	EACH SIDE
ETS	EXPOSED TO STRUCTURE
EX(IST)	EXISTING
EXP	EXPANSION
EXT	EXTERIOR

F

FA	FIRE ALARM
FD	FLOOR DRAIN
FE(C)	FIRE EXTINGUISHER (CABINET)
FF	FACTORY FINISH
FFB	FINISH FLOOR BREAK
FIN	FINISH(ED)
FLASH	FLASHING
FLR	FLOOR(ING)
FLRSNT	FLORESCENT
FNDN	FOUNDATION
FOC	FACE OF CONCRETE
FOF	FACE OF FINISH
FOS	FACE OF STUDS
FP	FIRE PROOF
FR	FIRE RATED
FRM	FRAME
FT	FOOT, FEET
FTG	FOOTING
FUR	FURRING
FURN	FURNISHED

G

GA	GAGE, GAUGE
GALV	GALVANIZED
GE	GENERAL ELECTRIC
G(W)B	GYPSUM (WALL) BOARD
GC	GENERAL CONTRACTOR
GL	GRID LINE
GLB	GLUE LAMINATED BEAM
GMU	GLASS MASONRY UNIT
GOV(T)	GOVERNMENT
GYP	GYPSUM BOARD

H

HAC	HOUSEKEEPING AIDES CLOSET
HDR	HEADER
H(D)W(E)	HARDWARE
HM	HOLLOW METAL
HORZ	HORIZONTAL
HPDL	HIGH PRESSURE DECORATIVE LAM
HR	HOUR
HT	HEIGHT
HVAC	HEATING, VENTILATION & AIR CONDITIONING

I

ICRA	INFECTIOUS CONTROL RISK ASSESSMENT
ID	INSIDE DIAMETER OR DIM
ILSM	INTERIM LIFE SAFETY MEASURES
INCL	INCLUDE(D,ING)
INST	INSTALL
INSUL	INSULATION
INT	INTERIOR

J

JT	JOINT

K

KV	KILOVOLT

L

LAM	LAMINATE(D)
LAV	LAVATORY
LCM	LEAD CONTAINING MATERIAL(S)
LD	LEAD
LT	LIGHT

M

MAT	MATERIAL(S)
MAX	MAXIMUM
MDF	MEDIUM-DENSITY FIBREBOARD
MECH	MECHANIC(AL)
MEP	MECHANICAL, ELECTRICAL, PLUMBING
MFR	MANUFACTURE(R)
MIN	MINIMUM
MISC	MISCELLANEOUS
MOD	MODIFIED
MTL	METAL

N

N	NORTH
N(/)A	NOT APPLICABLE
NEG	NEGATIVE
NO.	NUMBER
NOM	NOMINAL
NTS	NOT TO SCALE

O

O.C.	ON CENTER(S)
OPN(G)	OPEN(ING)
OPP	OPPOSITE
OPT	OPTION(AL)
OVHD	OVERHEAD

P

P	PAINT
PCONC	PRECAST CONCRETE
PCRA	PRE-CONSTRUCTION RISK ASSESSMENT
PL	PLATE
PLAM	PLASTIC LAMINATE
PLY(WD)	PLYWOOD
PNL	PANEL
PR	PAIR
PRFB	PREFABRICATED
PS	PLASTIC
PT	PORCELAIN TILE
PTN(S)	PARTITION(S)
PVMT	PAVEMENT
PREP	PREPAIR

Q

QTY	QUANTITY

R

RAD	RADIUS
RB	RESILIENT BASE
RCP(S)	REFLECTED CEILING PLAN(S)
REF	REFERENCE
REINF	REINFORCE(D,ING)
REP	REPRESENTATIVE
REQ(S,('')D)	REQUIRE(D,S,MENT(S))
RESIL	RESILIENT
REV	REVERSE
RF	ROOF
RM	ROOM
RMV	REMOVE
RO	ROUGH OPENING

S

S	SOUTH
SCHED	SCHEDULE
SCI(D)	SPINAL CORD INJURY (& DISABILITY)
SD	SCHEMATIC DESIGN
SDSF	SOLID SURFACE
SECT	SECTION
SF	SQUARE FEET
SFRM	SPRAY APPLIED FIRE-RESISTIVE MATERIAL
SHG	SHINGLES
SHLD(G)	SHEILD(ING)
SHT(G)	SHEET (SHEATHING)
SIM	SIMILAR
SM	SEAM
SOW	SCOPE OF WORK
SPEC	SPECIFICATION
SQ	SQUARE
SS	STAINLESS STEEL
ST	STAIN
STDG	STANDING
STF	STAFF
STL	STEEL
STOR	STORAGE
STRUCT	STRUCTURAL
SURG	SURGERY, SURGICAL
SUSP	SUSPENDED
SV	SHEET VINYL
SYS	SYSTEM

T

TBD	TO BE DETERMINED
TBL	TABLE
TEMP	TEMPORARY
T&G	TONGUE AND GROOVE
THK	THICK(NESS)
THRESH	THRESHOLD
TOC	TABLE OF CONTENTS
TOS	TOP OF SLAB
TPH	TOILET PAPER HOLDER
TRANS	TRANSITION
TS	TUBE STEEL
TYP	TYPICAL

U

UNO	UNLESS NOTED OTHERWISE
UON	UNLESS OTHERWISE NOTED

V

VA	VETERANS AFFAIRS
VAR	VARIES
VB	VAPOR BARRIER
VC	VA FURNISHED, CONTRACTOR INSTALLED
VERT	VERTICAL
VIF	VERIFY IN FIELD
VV	VA FURNISHED, VA INSTALLED

W

W	WEST
W/	WITH
WD	WOOD
WDW	WINDOW
WGHT	WEIGHT
W/O	WITHOUT
WP	WATERPROOF(ING)
WR	WATER RESISTANT
WRK	WORK

X

XRY	X-RAY

FIRE LIFE SAFETY NOTES

1. COMPLY WITH NFPA 241 FOR ALL CONSTRUCTION WORK. THIS INCLUDES REPLACING CEILING TILES AT THE END OF EACH WORK SHIFT.
2. PLEASE NOTE, AS AN AGENCY OF THE FEDERAL GOVERNMENT, THE VA IS NOT SUBJECT TO LOCAL IMPOSITIONS OF CODE ENFORCEMENT PROCEDURES (DRAWING REVIEWS, BUILDING PERMITS, INSPECTIONS, FEES, ETC). THE VA SHALL FUNCTION AS THE AUTHORITY HAVING JURISDICTION (AHJ).
3. THE BELOW CODES HAVE BEEN USED FOR ANALYSIS.
   A. NATIONAL FIRE PROTECTION AGENCY (NFPA) 101 LIFE SAFETY CODE, 2024. NFPA 101 TAKES PRECEDENCE OVER IBC.
   B. INTERNATIONAL BUILDING CODE (IBC), 2024.
4. EXISTING BUILDING CONSTRUCTION TYPES SHALL NOT BE ALTERED AS PART OF THIS PROJECT.
5. EXISTING BUILDING OCCUPANCY SHALL NOT BE ALTERED AS PART OF THIS PROJECT.
6. EXISTING EGRESS SHALL NOT BE ALTERED AS PART OF THIS PROJECT. AS SUCH, EGRESS CALCULATIONS ARE NOT PROVIDED.
7. OCCUPANT LOADS SHALL NOT BE ALTERED AS PART OF THIS PROJECT. AS SUCH, EXISTING EXIT WIDTHS SHALL NOT BE ALTERED.
8. EXISTING FIRE RATED ASSEMBLIES SHALL BE MAINTAINED. ANY EXISTING PENETRATIONS TO BE DEMOLISHED SHALL BE PATCHED TO MATCH ADJACENT EXISTING FIRE RATINGS. ANY NEW PENETRATIONS SHALL BE FIRESTOPPED.
9. ANY NEW PENETRATIONS THROUGH EXISTING FIRE RATED ASSEMBLIES SHALL BE FIRE STOPPED AND EXISTING RATING MAINTAINED.

Revisions:	Date:

CONSULTANT

ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246

SDB SPEESDESIGNBUILD

STAMP

10000 REGISTERED ARCHITECT JAMES M. KING STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title	ARCH SYMBOLS, ABBREVIATIONS, & GENERAL NOTES
Phase	100% CONSTRUCTION DOCUMENTS
Approved:	FULLY SPRINKLERED
Project Title	REPLACE ELEVATORS IN BLDG 7 & BLDG 9
Project Number	502-24-102
Building Number	-
Location	ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA
Issue Date	03/24/2026
Checked	MK
Drawn	AJ
Drawing Number	A-001

VA FORM 08 - 6231

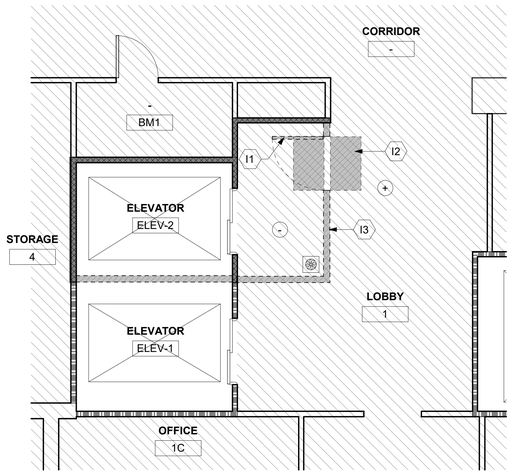

1 BLDG 7 - ELEV 1,2 - BASEMENT - ICRA PLAN - PHASE 1

1/4" = 1'-0"

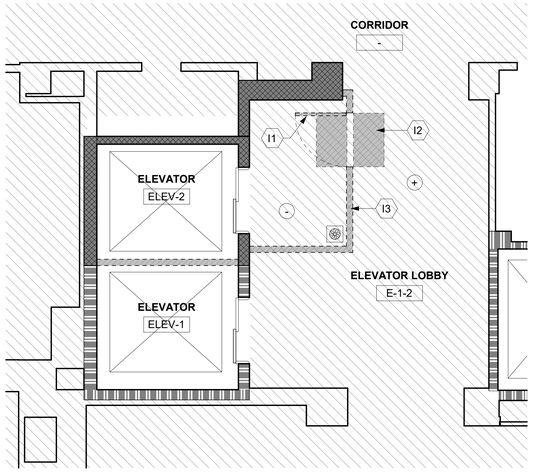

4 BUILDING 7 - ELEV 1,2 - LEVEL 01 - ICRA PLAN - PHASE 1

1/4" = 1'-0"

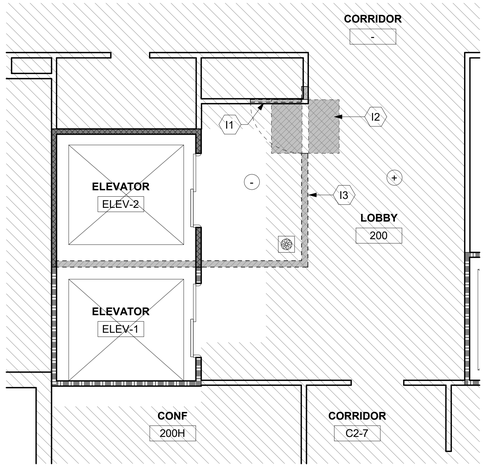

5 BUILDING 7 - ELEV 1, 2 - LEVEL 02 - ICRA PLAN - PHASE 1

1/4" = 1'-0"

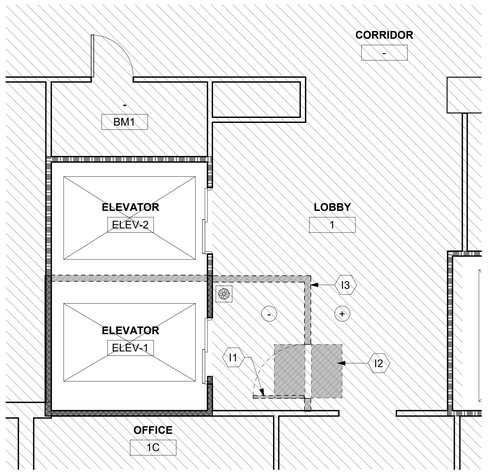

2 BLDG 7 - ELEV 1,2 - BASEMENT - ICRA PLAN - PHASE 2

1/4" = 1'-0"

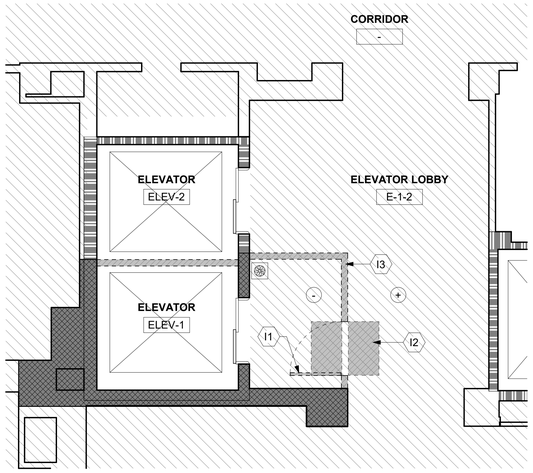

3 BUILDING 7 - ELEV 1,2 - LEVEL 01 - ICRA PLAN - PHASE 2

1/4" = 1'-0"

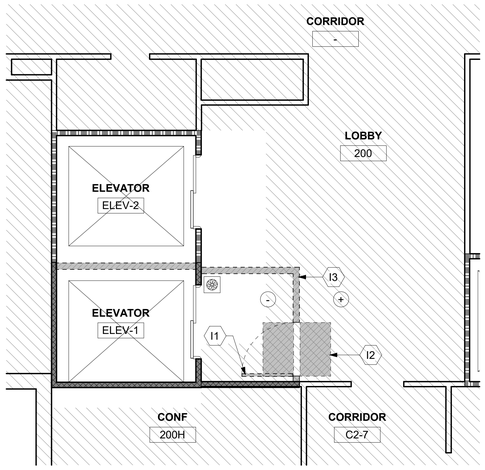

6 BUILDING 7 - ELEV 1, 2 - LEVEL 02 - ICRA PLAN - PHASE 2

1/4" = 1'-0"

LEGEND

- OUT OF SCOPE
- INACCESSIBLE DURING PHASE
- EXISTING WALL TEMPORARILY ACTING AS AN ICRA BOUNDRY. SEAL ALL OPENINGS, PENETRATIONS, & HVAC DUCTS AS REQUIRED PER SPECIFICATION SECTION 01 35 26 - SAFETY REQUIREMENTS.
- TEMPORARY ICRA BARRIER FRAMED TO STRUCTURE ABOVE. CONSTRUCT AS REQUIRED PER SPECIFICATION SECTION 01 35 26 - SAFETY REQUIREMENTS.
- TEMPORARY ICRA DOOR AND FRAME AS REQUIRED PER SPECIFICATION SECTION 01 35 26 - SAFETY REQUIREMENTS.
- TEMPORARY ICRA AIR PRESSURE
- HEPA EQUIPPED EXHAUST
- 2 HR FIRE RATED WALL (EXISTING)

KEY NOTES (THIS SHEET ONLY)

I1	TEMPORARY ICRA DOOR.
I2	TACKY MAT.
I3	TEMPORARY ICRA BARRIER.

GENERAL NOTES

1. ICRA **CLASS III** REQUIREMENTS MUST BE MET THROUGHOUT THE ENTIRE DURATION OF CONSTRUCTION.
2. COMPLY WITH ALL REQUIREMENTS IN SPECIFICATION SECTION 01 35 26 - SAFETY REQUIREMENTS.
3. CONSTRUCTION ZONE ENTRANCES AND EXITS SHALL BE LOCKED AT ALL TIMES UNLESS IN USE BY THE CONTRACTOR. WHEN IN USE, ACCESS WILL BE CONTROLLED AND MONITORED BY THE CONTRACTOR.
4. ADHESIVE WALK-OFF MATS TO BE USED AT ALL CONSTRUCTION ENTRANCES AND EXITS, INCLUDING ANTE ROOMS.
5. TEMPORARY BARRIERS AND DOORS MAY ONLY BE DEMOLISHED ONCE GIVEN FINAL APPROVAL BY THE VA COR.
6. TEMPORARY FIRE RESISTIVE SHEET PLASTIC WITH ZIPPER ACCESS MAY BE USED AS A MEANS OF DUST CONTROL WHILE CONSTRUCTING AND DEMOLISHING TEMPORARY ICRA BARRIERS.
7. CONSTRUCTION WORK TO BE DONE IN PHASES SO ONE ELEVATOR REMAINS OPERATIONAL.
8. WORK AT LEVELS 2 AND 3 FOR REPLACEMENT OF DOOR AND JAMB TO BE DONE OUTSIDE OF REGULAR BUSINESS HOURS.
9. DO NOT DISTURB FLOORING WHILE CONSTRUCTION OCCURS ON ANY FLOOR, UNLESS OTHERWISE NOTED.

KEY PLAN

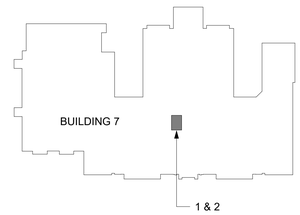

Revisions:	Date:

CONSULTANT

ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246

SPEESDESIGNBUILD

STAMP

REGISTERED ARCHITECT
10000
JAMES M. KING
STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title	BUILDING 7 - ICRA PLANS - ELEVATORS 1 & 2
Phase	100% CONSTRUCTION DOCUMENTS
Approved:	
	FULLY SPRINKLERED
Project Title	REPLACE ELEVATORS IN BLDG 7 & BLDG 9
Project Number	502-24-102
Building Number	7
Location	ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA
Drawing Number	AS100
Issue Date	03/24/2026
Checked	MK
Drawn	AJ

VA FORM 08 - 6231

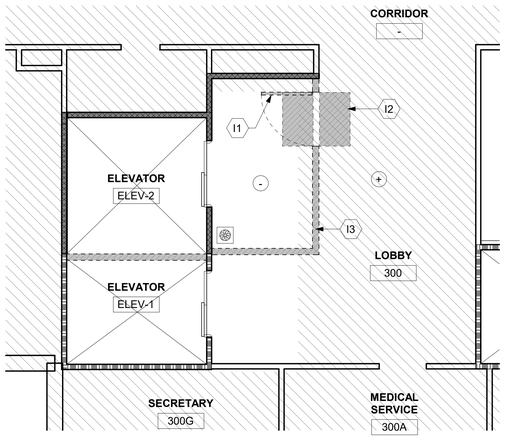

1 BUILDING 7 - ELEV 1, 2 - LEVEL 03 - ICRA PLAN - PHASE 1

1/4" = 1'-0"

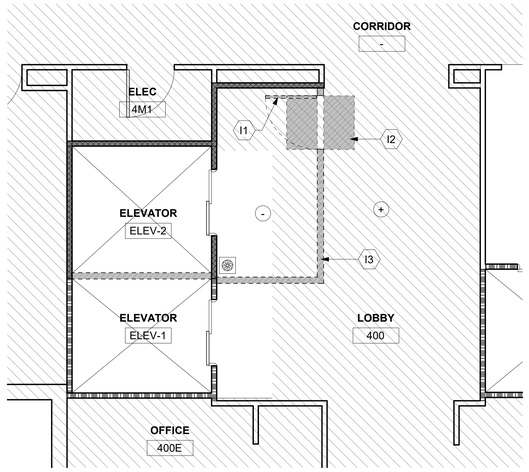

2 BUILDING 7 - ELEV 1, 2 - LEVEL 04 - ICRA PLAN - PHASE 1

1/4" = 1'-0"

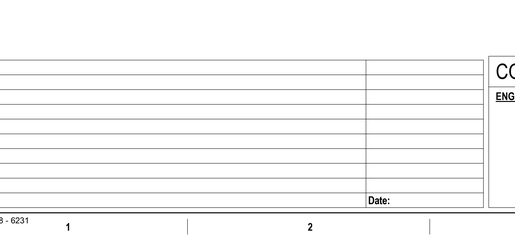

3 BUILDING 7 - ELEV 1, 2 - LEVEL 03 - ICRA PLAN - PHASE 2

1/4" = 1'-0"

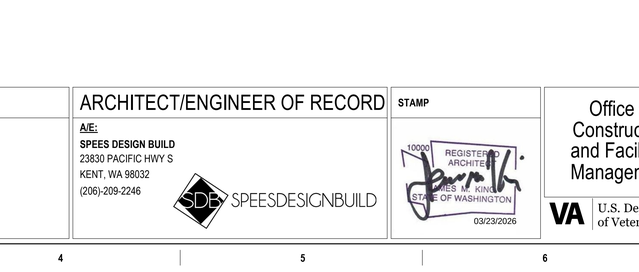

4 BUILDING 7 - ELEV 1, 2 - LEVEL 04 - ICRA PLAN - PHASE 2

1/4" = 1'-0"

LEGEND

- OUT OF SCOPE
- INACCESSIBLE DURING PHASE
- EXISTING WALL TEMPORARILY ACTING AS AN ICRA BOUNDRY. SEAL ALL OPENINGS, PENETRATIONS, & HVAC DUCTS AS REQUIRED PER SPECIFICATION SECTION 01 35 26 - SAFETY REQUIREMENTS.
- TEMPORARY ICRA BARRIER FRAMED TO STRUCTURE ABOVE. CONSTRUCT AS REQUIRED PER SPECIFICATION SECTION 01 35 26 - SAFETY REQUIREMENTS.
- TEMPORARY ICRA DOOR AND FRAME AS REQUIRED PER SPECIFICATION SECTION 01 35 26 - SAFETY REQUIREMENTS.
- -- - + TEMPORARY ICRA AIR PRESSURE
- HEPA EQUIPPED EXHAUST
- 2 HR FIRE RATED WALL (EXISTING)

KEY NOTES (THIS SHEET ONLY)

I1	TEMPORARY ICRA DOOR.
I2	TACKY MAT.
I3	TEMPORARY ICRA BARRIER.

GENERAL NOTES

1. ICRA **CLASS III** REQUIREMENTS MUST BE MET THROUGHOUT THE ENTIRE DURATION OF CONSTRUCTION.
2. COMPLY WITH ALL REQUIREMENTS IN SPECIFICATION SECTION 01 35 26 - SAFETY REQUIREMENTS.
3. CONSTRUCTION ZONE ENTRANCES AND EXITS SHALL BE LOCKED AT ALL TIMES UNLESS IN USE BY THE CONTRACTOR. WHEN IN USE, ACCESS WILL BE CONTROLLED AND MONITORED BY THE CONTRACTOR.
4. ADHESIVE WALK-OFF MATS TO BE USED AT ALL CONSTRUCTION ENTRANCES AND EXITS, INCLUDING ANTE ROOMS.
5. TEMPORARY BARRIERS AND DOORS MAY ONLY BE DEMOLISHED ONCE GIVEN FINAL APPROVAL BY THE VA COR.
6. TEMPORARY FIRE RESISTIVE SHEET PLASTIC WITH ZIPPER ACCESS MAY BE USED AS A MEANS OF DUST CONTROL WHILE CONSTRUCTING AND DEMOLISHING TEMPORARY ICRA BARRIERS.
7. CONSTRUCTION WORK TO BE DONE IN PHASES SO ONE ELEVATOR REMAINS OPERATIONAL.
8. WORK AT LEVELS 2 AND 3 FOR REPLACEMENT OF DOOR AND JAMB TO BE DONE OUTSIDE OF REGULAR BUSINESS HOURS.
9. DO NOT DISTURB FLOORING WHILE CONSTRUCTION OCCURS ON ANY FLOOR, UNLESS OTHERWISE NOTED.

KEY PLAN

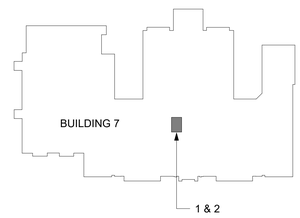

AREA SHOWN

Revisions:	Date:

CONSULTANT

ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246

SPEESDESIGNBUILD

STAMP

10000 REGISTERED ARCHITECT JAMES M. KING STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: BUILDING 7 - ICRA PLANS - ELEVATORS 1& 2

Approved:

Phase: 100% CONSTRUCTION DOCUMENTS

FULLY SPRINKLERED

Project Title: REPLACE ELEVATORS IN BLDG 7 & BLDG 9

Location: ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA

Issue Date: 03/24/2026

Checked: MK

Drawn: AJ

Project Number: 502-24-102

Building Number: 7

Drawing Number: AS101

VA FORM 08 - 6231

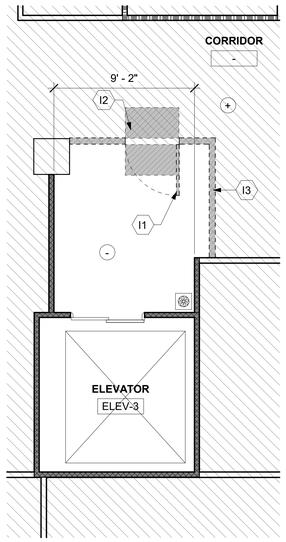

1 BLDG 7 - ELEV 3 - BASEMENT - ICRA PLAN
1/4" = 1'-0"

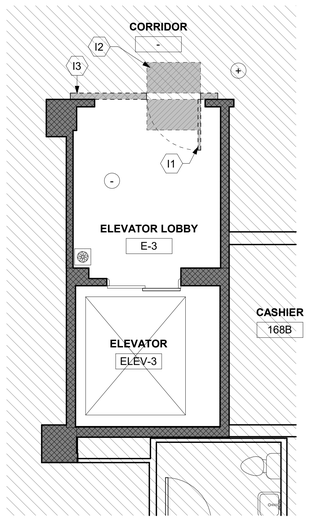

2 BUILDING 7 - ELEV 3 - LEVEL 01 - ICRA PLAN
1/4" = 1'-0"

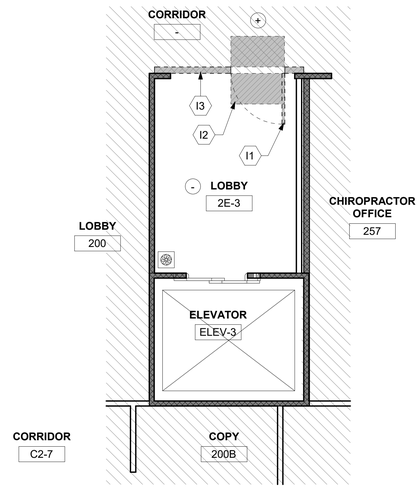

3 BUILDING 7 - ELEV 3 - LEVEL 02 - ICRA PLAN
1/4" = 1'-0"

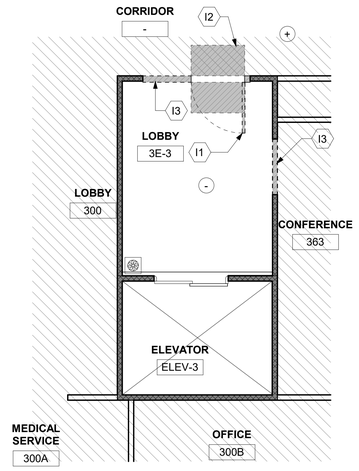

4 BUILDING 7 - ELEV 3 - LEVEL 03 - ICRA PLAN
1/4" = 1'-0"

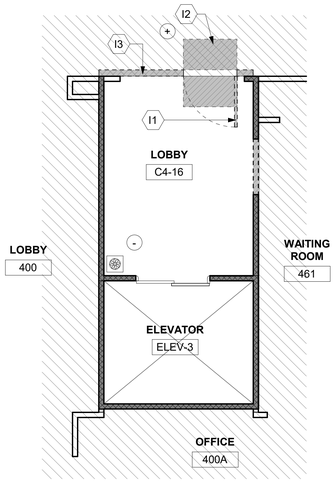

5 BUILDING 7 - ELEV 3 - LEVEL 04 - ICRA PLAN
1/4" = 1'-0"

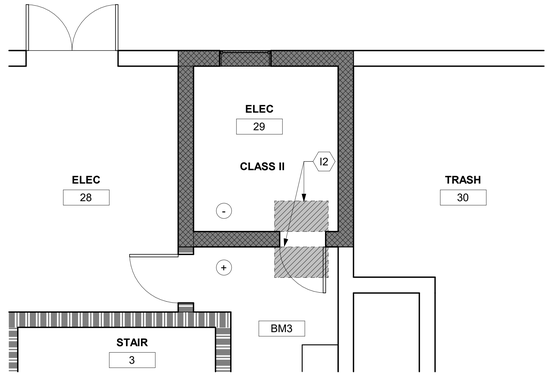

6 BUILDING 7 - BASEMENT - ROOM 29 - ICRA PLAN
1/4" = 1'-0"

LEGEND

- OUT OF SCOPE
- INACCESSIBLE DURING PHASE
- EXISTING WALL TEMPORARILY ACTING AS AN ICRA BOUNDRY. SEAL ALL OPENINGS, PENETRATIONS, & HVAC DUCTS AS REQUIRED PER SPECIFICATION SECTION 01 35 26 - SAFETY REQUIREMENTS.
- TEMPORARY ICRA BARRIER FRAMED TO STRUCTURE ABOVE. CONSTRUCT AS REQUIRED PER SPECIFICATION SECTION 01 35 26 - SAFETY REQUIREMENTS.
- TEMPORARY ICRA DOOR AND FRAME AS REQUIRED PER SPECIFICATION SECTION 01 35 26 - SAFETY REQUIREMENTS.
- TEMPORARY ICRA AIR PRESSURE
- HEPA EQUIPPED EXHAUST
- 2 HR FIRE RATED WALL (EXISTING)

KEY NOTES (THIS SHEET ONLY)

I1	TEMPORARY ICRA DOOR.
I2	TACKY MAT.
I3	TEMPORARY ICRA BARRIER.

GENERAL NOTES

1. ICRA **CLASS II & III** REQUIREMENTS MUST BE MET THROUGHOUT THE ENTIRE DURATION OF CONSTRUCTION.
2. COMPLY WITH ALL REQUIREMENTS IN SPECIFICATION SECTION 01 35 26 - SAFETY REQUIREMENTS.
3. CONSTRUCTION ZONE ENTRANCES AND EXITS SHALL BE LOCKED AT ALL TIMES UNLESS IN USE BY THE CONTRACTOR. WHEN IN USE, ACCESS WILL BE CONTROLLED AND MONITORED BY THE CONTRACTOR.
4. ADHESIVE WALK-OFF MATS TO BE USED AT ALL CONSTRUCTION ENTRANCES AND EXITS, INCLUDING ANTE ROOMS.
5. TEMPORARY BARRIERS AND DOORS MAY ONLY BE DEMOLISHED ONCE GIVEN FINAL APPROVAL BY THE VA COR.
6. TEMPORARY FIRE RESISTIVE SHEET PLASTIC WITH ZIPPER ACCESS MAY BE USED AS A MEANS OF DUST CONTROL WHILE CONSTRUCTING AND DEMOLISHING TEMPORARY ICRA BARRIERS.
7. CONSTRUCTION WORK TO BE DONE IN PHASES SO ONE ELEVATOR REMAINS OPERATIONAL.
8. WORK AT LEVELS 2 AND 3 FOR REPLACEMENT OF DOOR AND JAMB TO BE DONE OUTSIDE OF REGULAR BUSINESS HOURS.
9. DO NOT DISTURB FLOORING WHILE CONSTRUCTION OCCURS ON ANY FLOOR, UNLESS OTHERWISE NOTED.

KEY PLAN

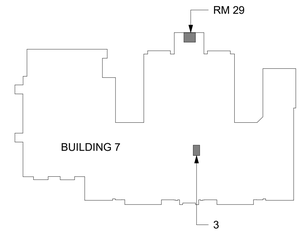

AREA SHOWN

Revisions:	Date:

CONSULTANT
ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD
A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246
SDB SPEESDESIGNBUILD

STAMP
10000 REGISTERED ARCHITECT JAMES W. KING STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management
VA U.S. Department of Veterans Affairs

Drawing Title: BUILDING 7 - ICRA PLANS - ELEVATOR 3 & ROOM 29
Approved:
Phase: 100% CONSTRUCTION DOCUMENTS
FULLY SPRINKLERED
Project Title: REPLACE ELEVATORS IN BLDG 7 & BLDG 9
Location: ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA
Issue Date: 03/24/2026
Checked: MK
Drawn: AJ
Project Number: 502-24-102
Building Number: 7
Drawing Number: AS102

VA FORM 08 - 6231

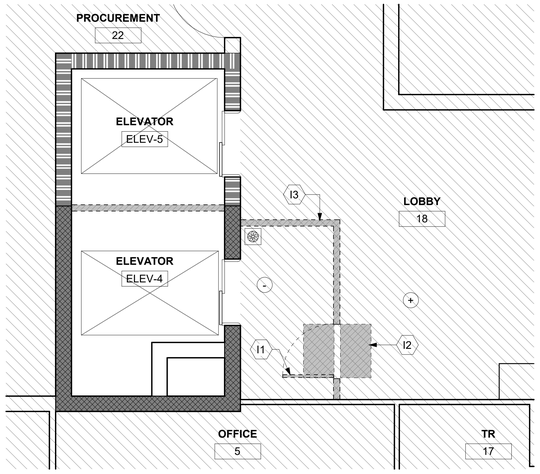

1 BLDG 7 - ELEV 4,5 - BASEMENT - ICRA PLAN - PHASE 1

1/4" = 1'-0"

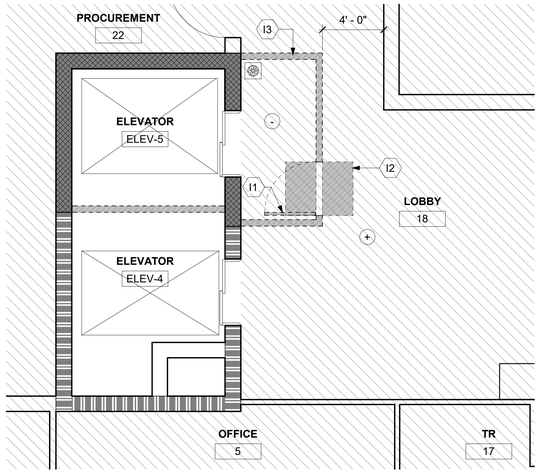

2 BLDG 7 - ELEV 4,5 - BASEMENT - ICRA PLAN - PHASE 2

1/4" = 1'-0"

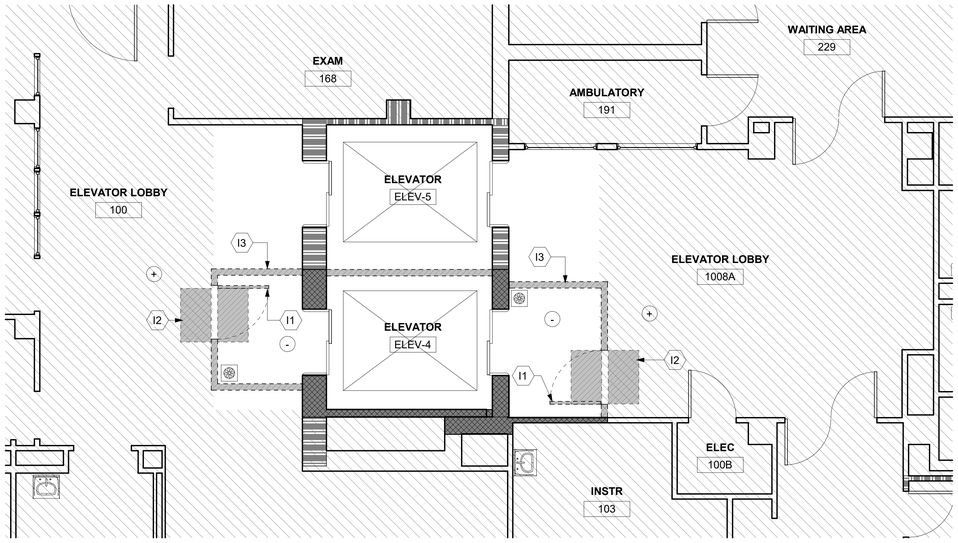

5 BUILDING 7 - ELEV 4,5 - LEVEL 01 - ICRA PLAN - PHASE 1

1/4" = 1'-0"

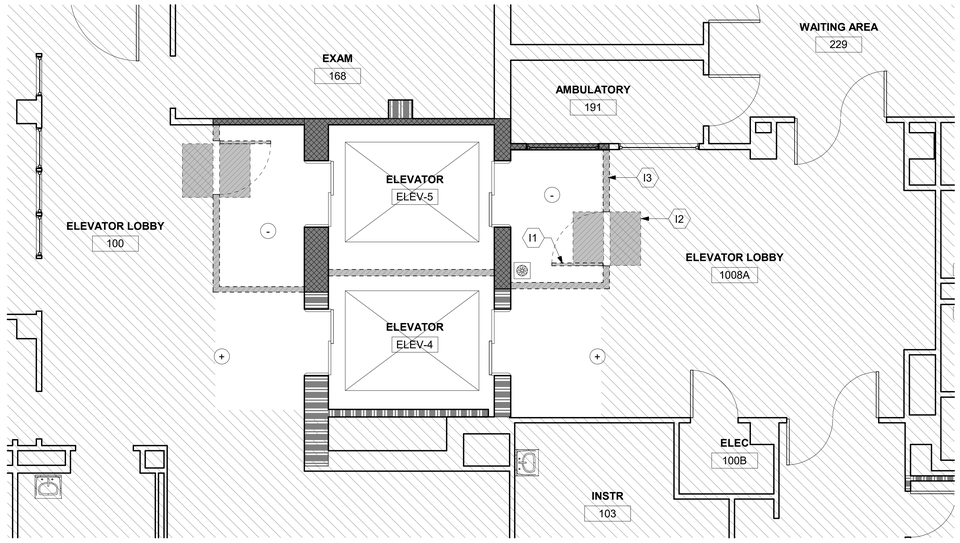

3 BUILDING 7 - ELEV 4,5 - LEVEL 01 - ICRA PLAN - PHASE 2

1/4" = 1'-0"

LEGEND

- OUT OF SCOPE
- INACCESSIBLE DURING PHASE
- EXISTING WALL TEMPORARILY ACTING AS AN ICRA BOUNDRY. SEAL ALL OPENINGS, PENETRATIONS, & HVAC DUCTS AS REQUIRED PER SPECIFICATION SECTION 01 35 26 - SAFETY REQUIREMENTS.
- TEMPORARY ICRA BARRIER FRAMED TO STRUCTURE ABOVE. CONSTRUCT AS REQUIRED PER SPECIFICATION SECTION 01 35 26 - SAFETY REQUIREMENTS.
- TEMPORARY ICRA DOOR AND FRAME AS REQUIRED PER SPECIFICATION SECTION 01 35 26 - SAFETY REQUIREMENTS.
- TEMPORARY ICRA AIR PRESSURE
- HEPA EQUIPPED EXHAUST
- 2 HR FIRE RATED WALL (EXISTING)

KEY NOTES (THIS SHEET ONLY)

I1	TEMPORARY ICRA DOOR.
I2	TACKY MAT.
I3	TEMPORARY ICRA BARRIER.

GENERAL NOTES

1. ICRA **CLASS III** REQUIREMENTS MUST BE MET THROUGHOUT THE ENTIRE DURATION OF CONSTRUCTION.
2. COMPLY WITH ALL REQUIREMENTS IN SPECIFICATION SECTION 01 35 26 - SAFETY REQUIREMENTS.
3. CONSTRUCTION ZONE ENTRANCES AND EXITS SHALL BE LOCKED AT ALL TIMES UNLESS IN USE BY THE CONTRACTOR. WHEN IN USE, ACCESS WILL BE CONTROLLED AND MONITORED BY THE CONTRACTOR.
4. ADHESIVE WALK-OFF MATS TO BE USED AT ALL CONSTRUCTION ENTRANCES AND EXITS, INCLUDING ANTE ROOMS.
5. TEMPORARY BARRIERS AND DOORS MAY ONLY BE DEMOLISHED ONCE GIVEN FINAL APPROVAL BY THE VA COR.
6. TEMPORARY FIRE RESISTIVE SHEET PLASTIC WITH ZIPPER ACCESS MAY BE USED AS A MEANS OF DUST CONTROL WHILE CONSTRUCTING AND DEMOLISHING TEMPORARY ICRA BARRIERS.
7. CONSTRUCTION WORK TO BE DONE IN PHASES SO ONE ELEVATOR REMAINS OPERATIONAL.
8. WORK AT LEVELS 2 AND 3 FOR REPLACEMENT OF DOOR AND JAMB TO BE DONE OUTSIDE OF REGULAR BUSINESS HOURS.
9. DO NOT DISTURB FLOORING WHILE CONSTRUCTION OCCURS ON ANY FLOOR, UNLESS OTHERWISE NOTED.

KEY PLAN

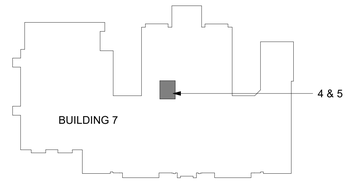

AREA SHOWN

Revisions:	Date:

CONSULTANT

ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246

SPEESDESIGNBUILD

STAMP

10000 REGISTERED ARCHITECT JAMES M. KING STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management

U.S. Department of Veterans Affairs

Drawing Title	BUILDING 7 - ICRA PLANS - ELEVATORS 4, 5
Phase	100% CONSTRUCTION DOCUMENTS
Approved:	
	FULLY SPRINKLERED
Project Title	REPLACE ELEVATORS IN BLDG 7 & BLDG 9
Project Number	502-24-102
Building Number	7
Location	ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA
Drawing Number	AS103
Issue Date	03/24/2026
Checked	MK
Drawn	AJ

VA FORM 08 - 6231

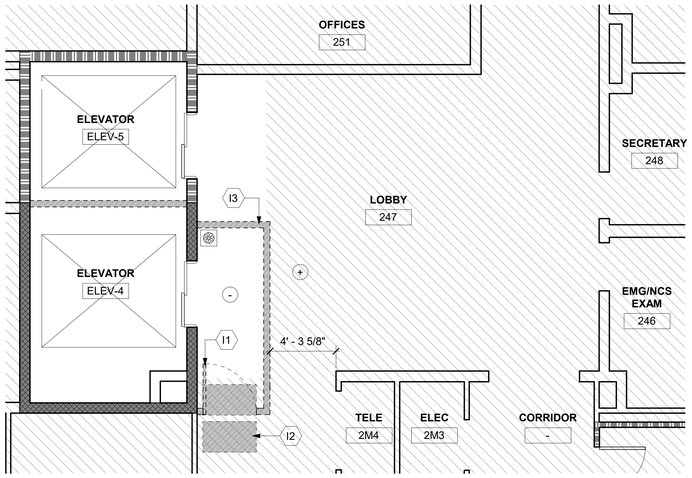

1 BUILDING 7 - ELEV 4 & 5 - LEVEL 02 - PHASE 1

1/4" = 1'-0"

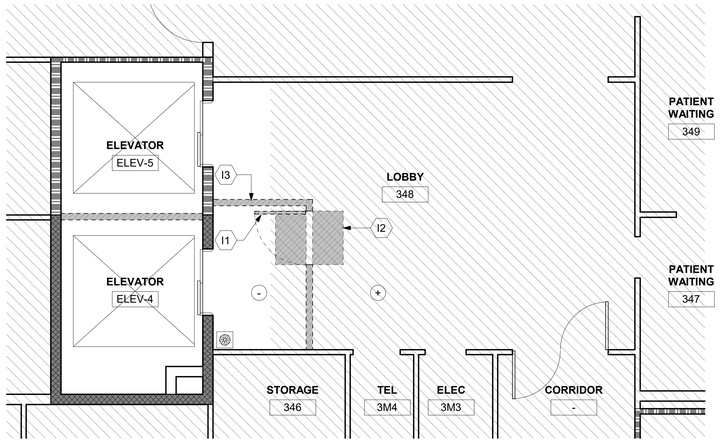

3 BUILDING 7 - ELEV 4 & 5 - LEVEL 03 - PHASE 1

1/4" = 1'-0"

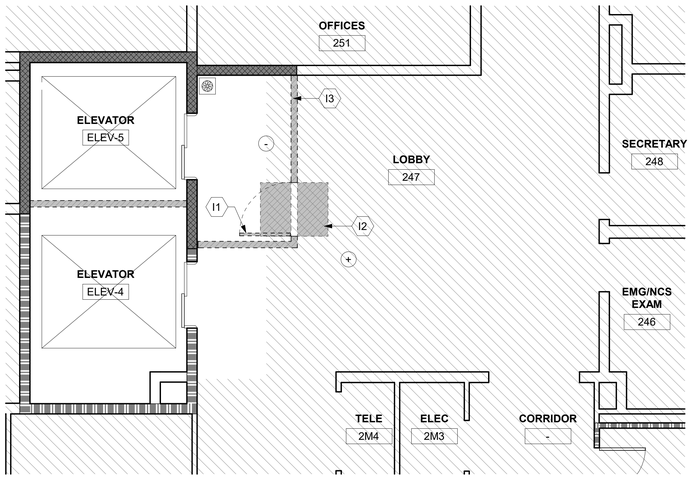

2 BUILDING 7 - ELEV 4 & 5 - LEVEL 02 - PHASE 2

1/4" = 1'-0"

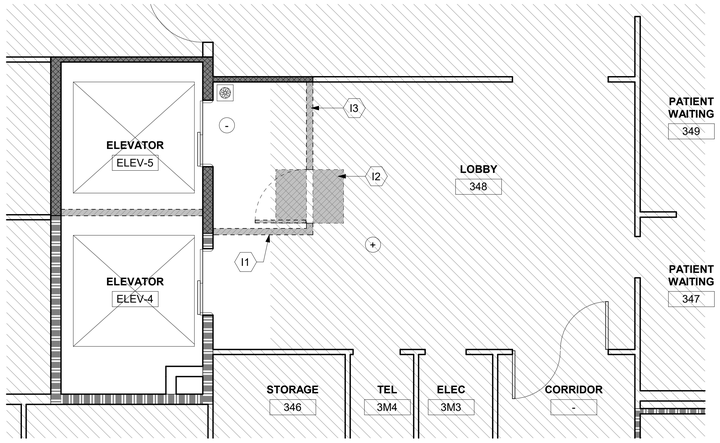

4 BUILDING 7 - ELEV 4 & 5 - LEVEL 03 - PHASE 2

1/4" = 1'-0"

LEGEND

- OUT OF SCOPE
- INACCESSIBLE DURING PHASE
- EXISTING WALL TEMPORARILY ACTING AS AN ICRA BOUNDRY. SEAL ALL OPENINGS, PENETRATIONS, & HVAC DUCTS AS REQUIRED PER SPECIFICATION SECTION 01 35 26 - SAFETY REQUIREMENTS.
- TEMPORARY ICRA BARRIER FRAMED TO STRUCTURE ABOVE. CONSTRUCT AS REQUIRED PER SPECIFICATION SECTION 01 35 26 - SAFETY REQUIREMENTS.
- TEMPORARY ICRA DOOR AND FRAME AS REQUIRED PER SPECIFICATION SECTION 01 35 26 - SAFETY REQUIREMENTS.
- TEMPORARY ICRA AIR PRESSURE
- HEPA EQUIPPED EXHAUST
- 2 HR FIRE RATED WALL (EXISTING)

KEY NOTES (THIS SHEET ONLY)

I1	TEMPORARY ICRA DOOR.
I2	TACKY MAT.
I3	TEMPORARY ICRA BARRIER.

GENERAL NOTES

1. ICRA **CLASS III** REQUIREMENTS MUST BE MET THROUGHOUT THE ENTIRE DURATION OF CONSTRUCTION.
2. COMPLY WITH ALL REQUIREMENTS IN SPECIFICATION SECTION 01 35 26 - SAFETY REQUIREMENTS.
3. CONSTRUCTION ZONE ENTRANCES AND EXITS SHALL BE LOCKED AT ALL TIMES UNLESS IN USE BY THE CONTRACTOR. WHEN IN USE, ACCESS WILL BE CONTROLLED AND MONITORED BY THE CONTRACTOR.
4. ADHESIVE WALK-OFF MATS TO BE USED AT ALL CONSTRUCTION ENTRANCES AND EXITS, INCLUDING ANTE ROOMS.
5. TEMPORARY BARRIERS AND DOORS MAY ONLY BE DEMOLISHED ONCE GIVEN FINAL APPROVAL BY THE VA COR.
6. TEMPORARY FIRE RESISTIVE SHEET PLASTIC WITH ZIPPER ACCESS MAY BE USED AS A MEANS OF DUST CONTROL WHILE CONSTRUCTING AND DEMOLISHING TEMPORARY ICRA BARRIERS.
7. CONSTRUCTION WORK TO BE DONE IN PHASES SO ONE ELEVATOR REMAINS OPERATIONAL.
8. WORK AT LEVELS 2 AND 3 FOR REPLACEMENT OF DOOR AND JAMB TO BE DONE OUTSIDE OF REGULAR BUSINESS HOURS.
9. DO NOT DISTURB FLOORING WHILE CONSTRUCTION OCCURS ON ANY FLOOR, UNLESS OTHERWISE NOTED.

KEY PLAN

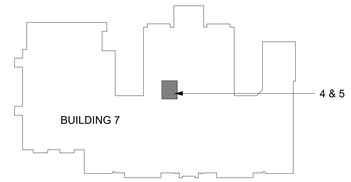

AREA SHOWN

Revisions:	Date:

CONSULTANT

ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246

SPEESDESIGNBUILD

STAMP

10000 REGISTERED ARCHITECT JAMES M. KING STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: BUILDING 7 - ICRA PLANS - ELEVATORS 4, 5

Approved:

Phase: 100% CONSTRUCTION DOCUMENTS

FULLY SPRINKLERED

Project Title: REPLACE ELEVATORS IN BLDG 7 & BLDG 9

Location: ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA

Issue Date: 03/24/2026 | Checked: MK | Drawn: AJ

Project Number: 502-24-102

Building Number: 7

Drawing Number: AS104

VA FORM 08 - 6231

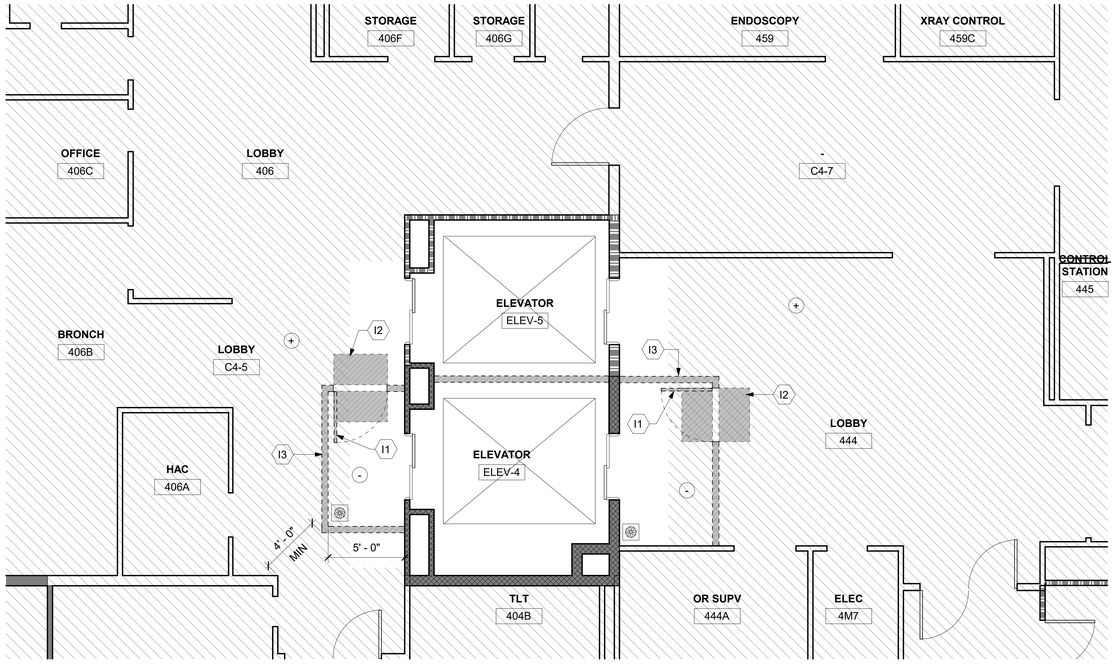

1 BUILDING 7 - ELEV 4 & 5 - LEVEL 04 - PHASE 1

1/4" = 1'-0"

PROJECT NORTH
TRUE NORTH (DASHED)

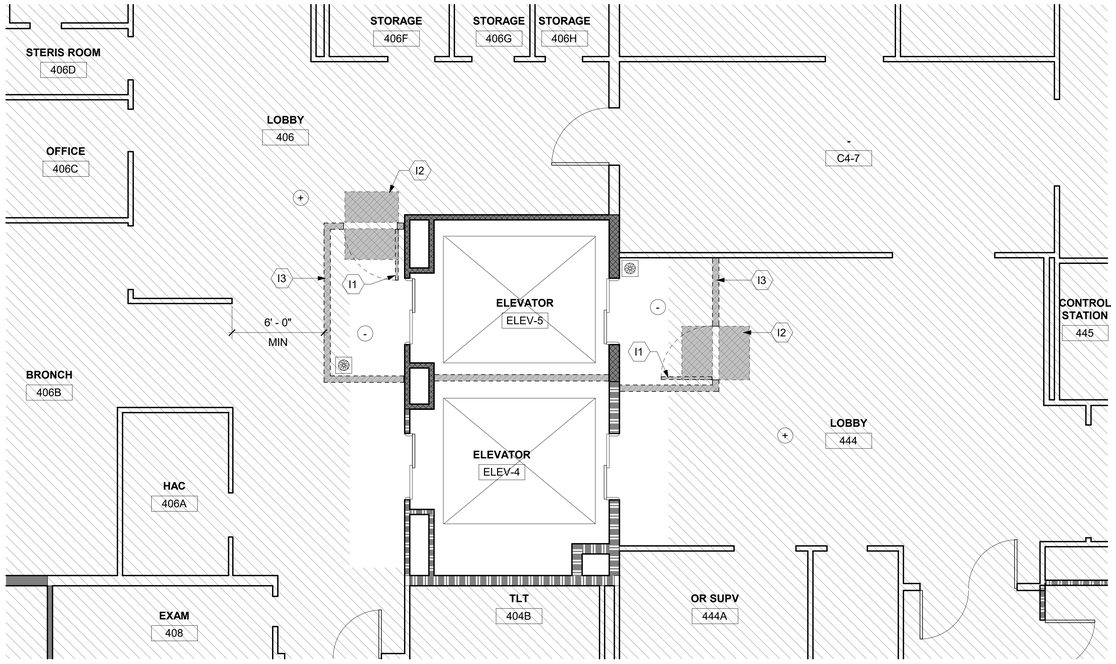

2 BUILDING 7 - ELEV 4 & 5 - LEVEL 04 - PHASE 2

1/4" = 1'-0"

PROJECT NORTH
TRUE NORTH (DASHED)

LEGEND

- OUT OF SCOPE
- INACCESSIBLE DURING PHASE
- EXISTING WALL TEMPORARILY ACTING AS AN ICRA BOUNDRY. SEAL ALL OPENINGS, PENETRATIONS, & HVAC DUCTS AS REQUIRED PER SPECIFICATION SECTION 01 35 26 - SAFETY REQUIREMENTS.
- TEMPORARY ICRA BARRIER FRAMED TO STRUCTURE ABOVE. CONSTRUCT AS REQUIRED PER SPECIFICATION SECTION 01 35 26 - SAFETY REQUIREMENTS.
- TEMPORARY ICRA DOOR AND FRAME AS REQUIRED PER SPECIFICATION SECTION 01 35 26 - SAFETY REQUIREMENTS.
- TEMPORARY ICRA AIR PRESSURE
- HEPA EQUIPPED EXHAUST
- 2 HR FIRE RATED WALL (EXISTING)

KEY NOTES (THIS SHEET ONLY)

I1	TEMPORARY ICRA DOOR.
I2	TACKY MAT.
I3	TEMPORARY ICRA BARRIER.

GENERAL NOTES

1. ICRA **CLASS III** REQUIREMENTS MUST BE MET THROUGHOUT THE ENTIRE DURATION OF CONSTRUCTION.
2. COMPLY WITH ALL REQUIREMENTS IN SPECIFICATION SECTION 01 35 26 - SAFETY REQUIREMENTS.
3. CONSTRUCTION ZONE ENTRANCES AND EXITS SHALL BE LOCKED AT ALL TIMES UNLESS IN USE BY THE CONTRACTOR. WHEN IN USE, ACCESS WILL BE CONTROLLED AND MONITORED BY THE CONTRACTOR.
4. ADHESIVE WALK-OFF MATS TO BE USED AT ALL CONSTRUCTION ENTRANCES AND EXITS, INCLUDING ANTE ROOMS.
5. TEMPORARY BARRIERS AND DOORS MAY ONLY BE DEMOLISHED ONCE GIVEN FINAL APPROVAL BY THE VA COR.
6. TEMPORARY FIRE RESISTIVE SHEET PLASTIC WITH ZIPPER ACCESS MAY BE USED AS A MEANS OF DUST CONTROL WHILE CONSTRUCTING AND DEMOLISHING TEMPORARY ICRA BARRIERS.
7. CONSTRUCTION WORK TO BE DONE IN PHASES SO ONE ELEVATOR REMAINS OPERATIONAL.
8. WORK AT LEVELS 2 AND 3 FOR REPLACEMENT OF DOOR AND JAMB TO BE DONE OUTSIDE OF REGULAR BUSINESS HOURS.
9. DO NOT DISTURB FLOORING WHILE CONSTRUCTION OCCURS ON ANY FLOOR, UNLESS OTHERWISE NOTED.

KEY PLAN

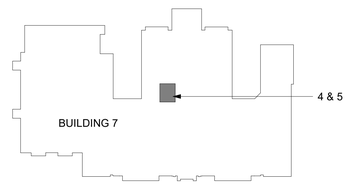

AREA SHOWN

PROJECT NORTH
TRUE NORTH (DASHED)

Revisions:	Date:

CONSULTANT

ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246

SDB SPEESDESIGNBUILD

STAMP

10000 REGISTERED ARCHITECT JAMES M. KING STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title	BUILDING 7 - ICRA PLANS - ELEVATORS 4, 5
Phase	100% CONSTRUCTION DOCUMENTS
Approved:	
	FULLY SPRINKLERED
Project Title	REPLACE ELEVATORS IN BLDG 7 & BLDG 9
Project Number	502-24-102
Building Number	7
Location	ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA
Drawing Number	AS105
Issue Date	03/24/2026
Checked	MK
Drawn	AJ

VA FORM 08 - 6231

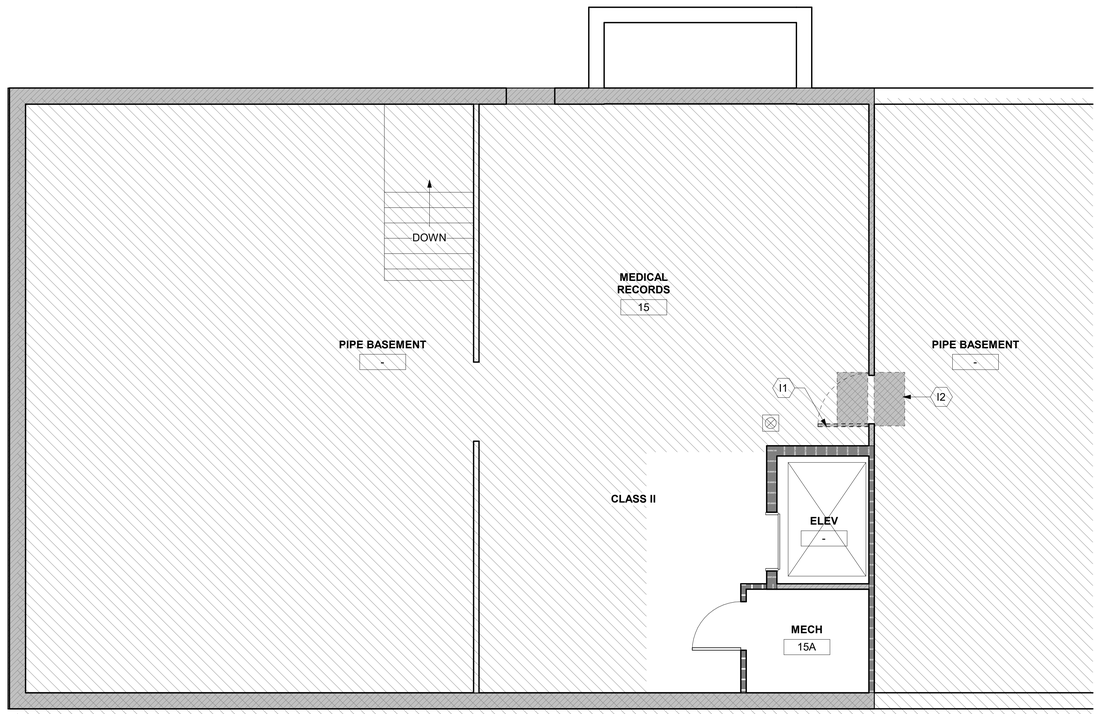

1 BUILDING 7 - MED RECORDS ELEV - BASEMENT - ICRA PLAN

1/4" = 1'-0"

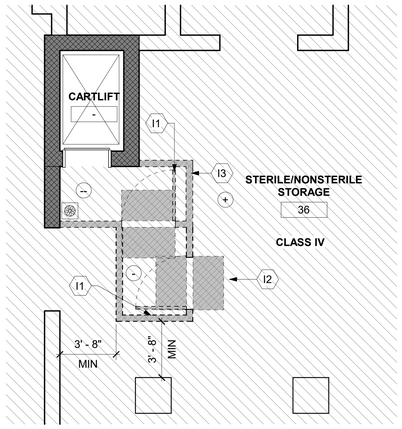

2 BLDG 7 - BASEMENT - SPS CARTLIFT - ICRA PLAN

1/4" = 1'-0"

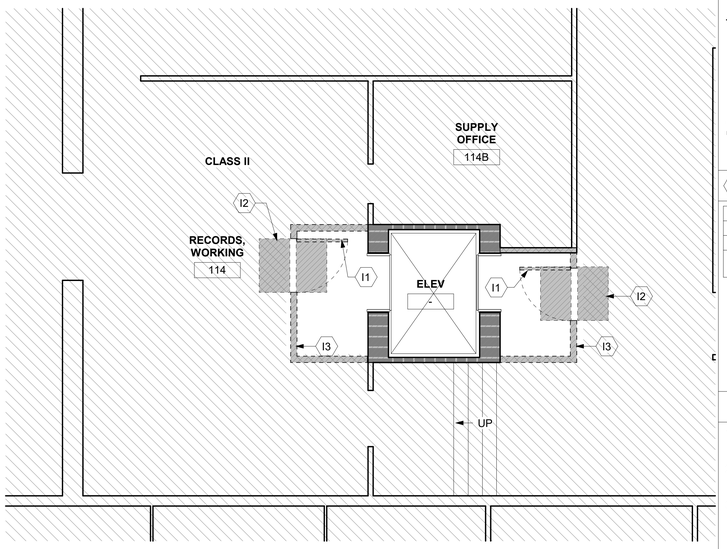

3 BUILDING 7 - MED RECORDS ELEV - LEVEL 01 - ICRA PLAN

1/4" = 1'-0"

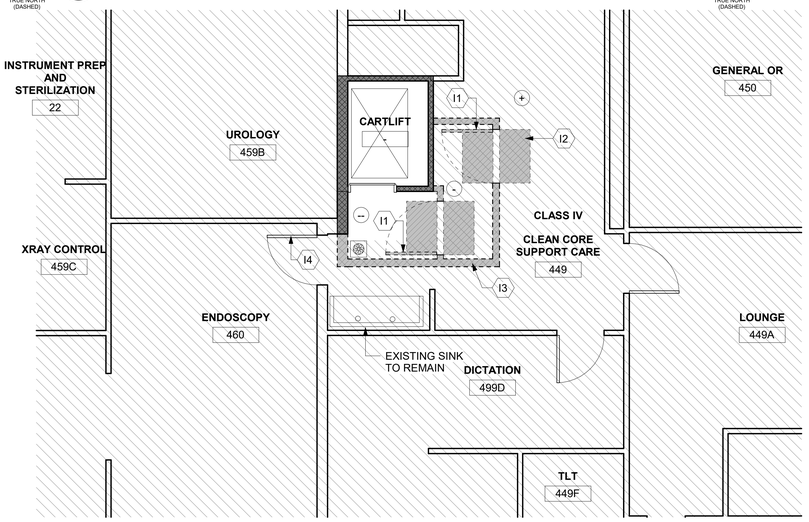

4 BUILDING 7 - LEVEL 04 - SPS CARTLIFT - ICRA PLAN

1/4" = 1'-0"

LEGEND

- OUT OF SCOPE
- INACCESSIBLE DURING PHASE
- EXISTING WALL TEMPORARILY ACTING AS AN ICRA BOUNDRY. SEAL ALL OPENINGS, PENETRATIONS, & HVAC DUCTS AS REQUIRED PER SPECIFICATION SECTION 01 35 26 - SAFETY REQUIREMENTS.
- TEMPORARY ICRA BARRIER FRAMED TO STRUCTURE ABOVE. CONSTRUCT AS REQUIRED PER SPECIFICATION SECTION 01 35 26 - SAFETY REQUIREMENTS.
- TEMPORARY ICRA DOOR AND FRAME AS REQUIRED PER SPECIFICATION SECTION 01 35 26 - SAFETY REQUIREMENTS.
- TEMPORARY ICRA AIR PRESSURE
- CONTRACTOR PATH OF TRAVEL
- HEPA EQUIPPED EXHAUST
- HEPA EQUIPED FILTER
- 2 HR FIRE RATED WALL (EXISTING & NEW)

KEY NOTES (THIS SHEET ONLY)

I1	TEMPORARY ICRA DOOR.
I2	TACKY MAT.
I3	TEMPORARY ICRA BARRIER.
I4	TEMPORARILY SEAL DOOR FOR DURATION OF CONSTRUCTION PHASE.

GENERAL NOTES

1. ICRA **CLASS II & IV** REQUIREMENTS MUST BE MET THROUGHOUT THE ENTIRE DURATION OF CONSTRUCTION.
2. COMPLY WITH ALL REQUIREMENTS IN SPECIFICATION SECTION 01 35 26 - SAFETY REQUIREMENTS.
3. CONSTRUCTION ZONE ENTRANCES AND EXITS SHALL BE LOCKED AT ALL TIMES UNLESS IN USE BY THE CONTRACTOR. WHEN IN USE, ACCESS WILL BE CONTROLLED AND MONITORED BY THE CONTRACTOR.
4. ADHESIVE WALK-OFF MATS TO BE USED AT ALL CONSTRUCTION ENTRANCES AND EXITS, INCLUDING ANTE ROOMS.
5. TEMPORARY BARRIERS AND DOORS MAY ONLY BE DEMOLISHED ONCE GIVEN FINAL APPROVAL BY THE VA COR.
6. TEMPORARY FIRE RESISTIVE SHEET PLASTIC WITH ZIPPER ACCESS MAY BE USED AS A MEANS OF DUST CONTROL WHILE CONSTRUCTING AND DEMOLISHING TEMPORARY ICRA BARRIERS.
7. CONSTRUCTION WORK TO BE DONE IN PHASES SO ONE ELEVATOR REMAINS OPERATIONAL.
8. WORK AT LEVELS 2 AND 3 FOR REPLACEMENT OF DOOR AND JAMB TO BE DONE OUTSIDE OF REGULAR BUSINESS HOURS.
9. DO NOT DISTURB FLOORING WHILE CONSTRUCTION OCCURS ON ANY FLOOR, UNLESS OTHERWISE NOTED.

KEY PLAN

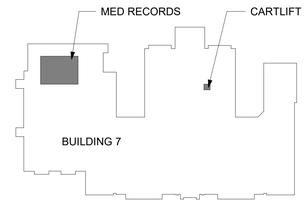

AREA SHOWN

Revisions:	Date:

CONSULTANT

ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246

SDB SPEESDESIGNBUILD

STAMP

10000 REGISTERED ARCHITECT JAMES M. KING STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title	BUILDING 7 - ICRA PLANS - MED RECORDS & SPS CARTLIFT
Phase	100% CONSTRUCTION DOCUMENTS
Approved:	
	FULLY SPRINKLERED
Project Title	REPLACE ELEVATORS IN BLDG 7 & BLDG 9
Project Number	502-24-102
Building Number	7
Location	ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA
Drawing Number	AS106
Issue Date	03/24/2026
Checked	MK
Drawn	AJ

VA FORM 08 - 6231

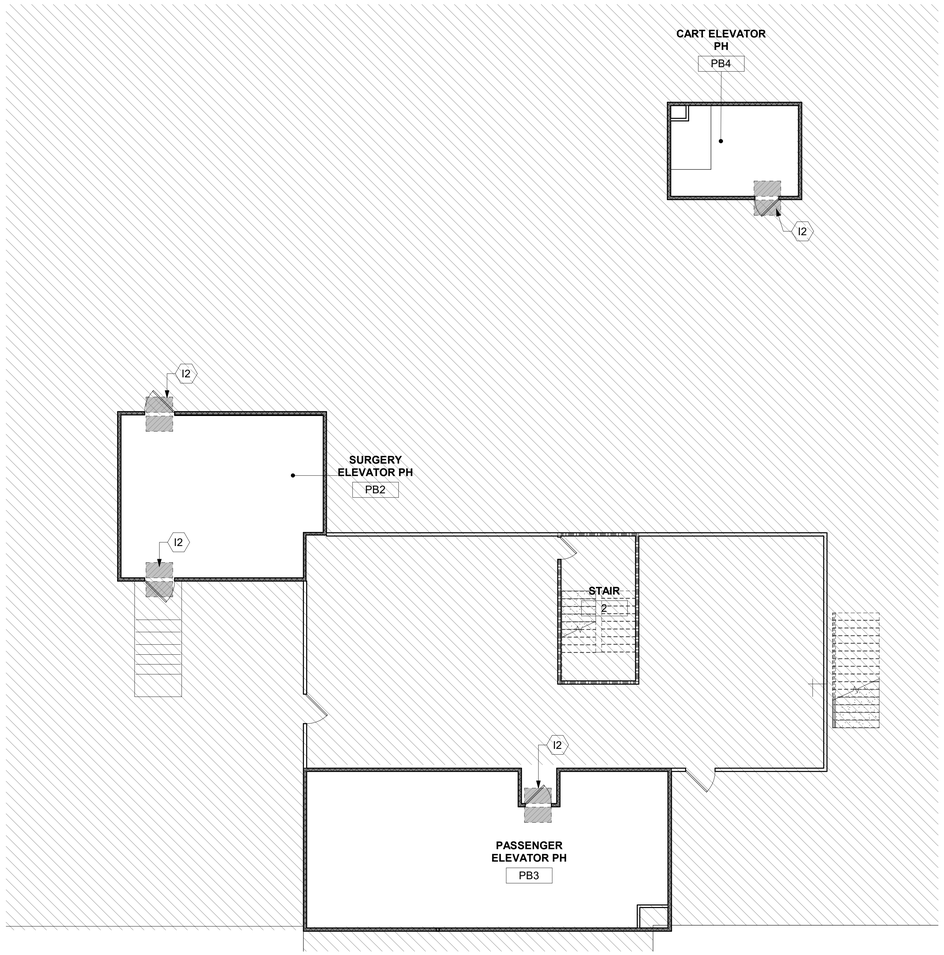

1 BUILDING 7 - PENTHOUSE - FLOOR PLAN - ICRA PLANS

1/8" = 1'-0"

PROJECT NORTH

TRUE NORTH (DASHED)

LEGEND

- OUT OF SCOPE
- INACCESSIBLE DURING PHASE
- EXISTING WALL TEMPORARILY ACTING AS AN ICRA BOUNDRY. SEAL ALL OPENINGS, PENETRATIONS, & HVAC DUCTS AS REQUIRED PER SPECIFICATION SECTION 01 35 26 - SAFETY REQUIREMENTS.
- TEMPORARY ICRA BARRIER FRAMED TO STRUCTURE ABOVE. CONSTRUCT AS REQUIRED PER SPECIFICATION SECTION 01 35 26 - SAFETY REQUIREMENTS.
- TEMPORARY ICRA DOOR AND FRAME AS REQUIRED PER SPECIFICATION SECTION 01 35 26 - SAFETY REQUIREMENTS.
- TEMPORARY ICRA AIR PRESSURE
- CONTRACTOR PATH OF TRAVEL
- HEPA EQUIPPED EXHAUST
- HEPA EQUIPED FILTER
- 2 HR FIRE RATED WALL (EXISTING & NEW)

KEY NOTES (THIS SHEET ONLY)

I2	TACKY MAT.

GENERAL NOTES

1. ICRA **CLASS II** REQUIREMENTS MUST BE MET THROUGHOUT THE ENTIRE DURATION OF CONSTRUCTION.
2. COMPLY WITH ALL REQUIREMENTS IN SPECIFICATION SECTION 01 35 26 - SAFETY REQUIREMENTS.
3. CONSTRUCTION ZONE ENTRANCES AND EXITS SHALL BE LOCKED AT ALL TIMES UNLESS IN USE BY THE CONTRACTOR. WHEN IN USE, ACCESS WILL BE CONTROLLED AND MONITORED BY THE CONTRACTOR.
4. ADHESIVE WALK-OFF MATS TO BE USED AT ALL CONSTRUCTION ENTRANCES AND EXITS, INCLUDING ANTE ROOMS.
5. TEMPORARY BARRIERS AND DOORS MAY ONLY BE DEMOLISHED ONCE GIVEN FINAL APPROVAL BY THE VA COR.
6. TEMPORARY FIRE RESISTIVE SHEET PLASTIC WITH ZIPPER ACCESS MAY BE USED AS A MEANS OF DUST CONTROL WHILE CONSTRUCTING AND DEMOLISHING TEMPORARY ICRA BARRIERS.
7. CONSTRUCTION WORK TO BE DONE IN PHASES SO ONE ELEVATOR REMAINS OPERATIONAL.
8. WORK AT LEVELS 2 AND 3 FOR REPLACEMENT OF DOOR AND JAMB TO BE DONE OUTSIDE OF REGULAR BUSINESS HOURS.
9. DO NOT DISTURB FLOORING WHILE CONSTRUCTION OCCURS ON ANY FLOOR, UNLESS OTHERWISE NOTED.

KEY PLAN

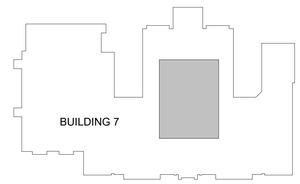

AREA SHOWN

PROJECT NORTH

TRUE NORTH (DASHED)

Revisions:	Date:

CONSULTANT

ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246

SDB SPEESDESIGNBUILD

STAMP

10000 REGISTERED ARCHITECT JAMES M. KING STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: BUILDING 7 - ICRA PLANS - PENTHOUSE

Approved:

Phase: 100% CONSTRUCTION DOCUMENTS

FULLY SPRINKLERED

Project Title: REPLACE ELEVATORS IN BLDG 7 & BLDG 9

Project Number: 502-24-102

Building Number: 7

Location: ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA

Drawing Number: AS107

Issue Date: 03/24/2026

Checked: MK

Drawn: AJ

VA FORM 08 - 6231

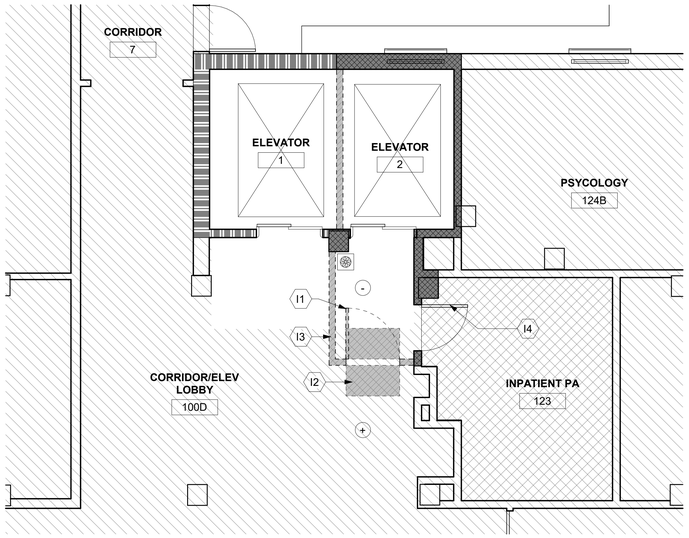

1 BUILDING 9 - ELEV 1 & 2 - LEVEL 01 - ICRA PLAN - PHASE 1
1/4" = 1'-0"

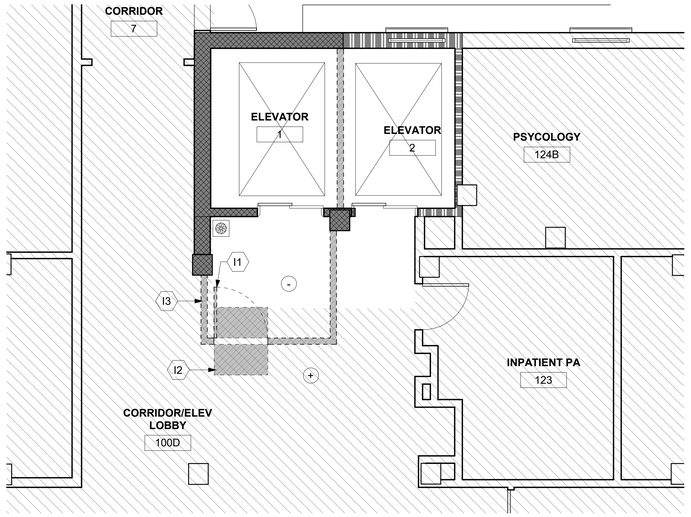

2 BUILDING 9 - ELEV 1 & 2 - LEVEL 01 - ICRA PLAN - PHASE 2
1/4" = 1'-0"

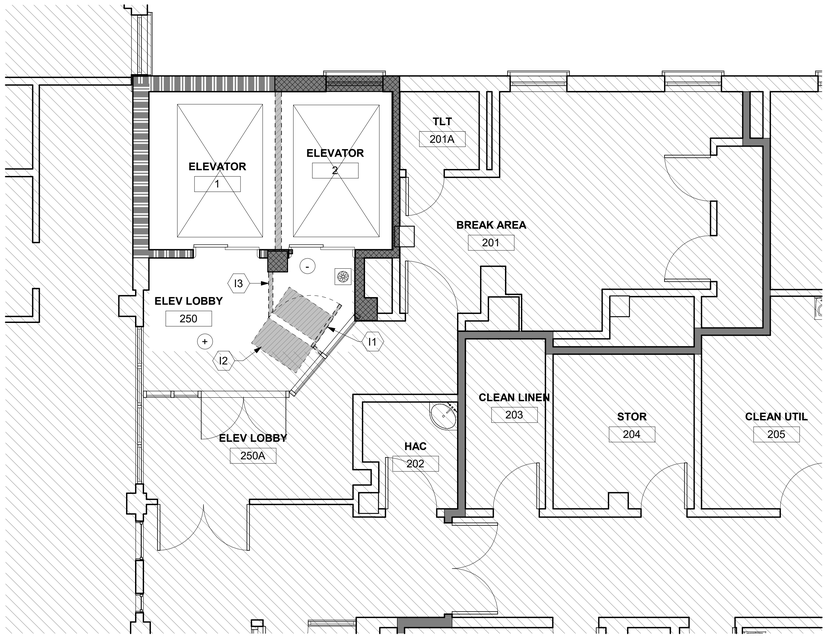

3 BUILDING 9 - ELEV 1 & 2 - LEVEL 02 - ICRA PLAN - PHASE 1
1/4" = 1'-0"

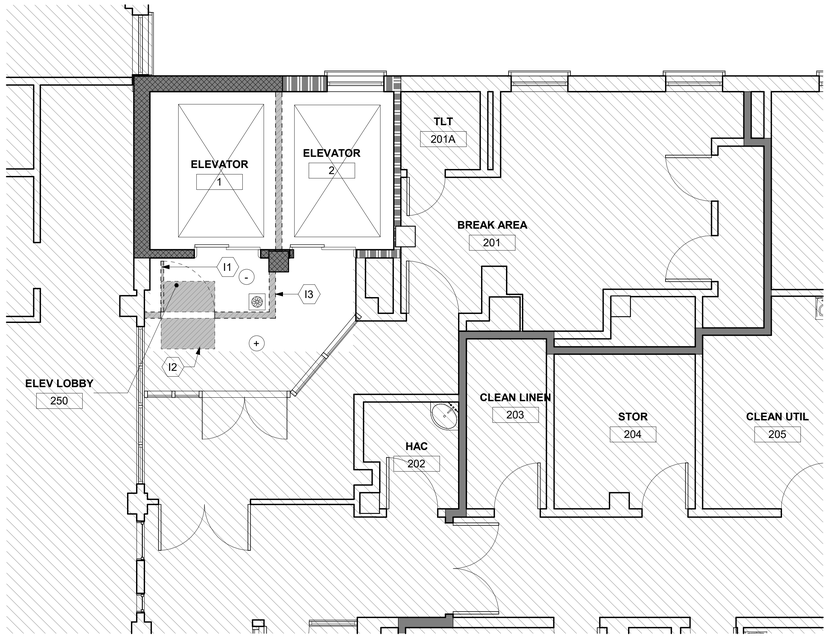

4 BUILDING 9 - ELEV 1 & 2 - LEVEL 02 - ICRA PLAN - PHASE 2
1/4" = 1'-0"

LEGEND

- OUT OF SCOPE
- INACCESSIBLE DURING PHASE
- EXISTING WALL TEMPORARILY ACTING AS AN ICRA BOUNDRY. SEAL ALL OPENINGS, PENETRATIONS, & HVAC DUCTS AS REQUIRED PER SPECIFICATION SECTION 01 35 26 - SAFETY REQUIREMENTS.
- TEMPORARY ICRA BARRIER FRAMED TO STRUCTURE ABOVE. CONSTRUCT AS REQUIRED PER SPECIFICATION SECTION 01 35 26 - SAFETY REQUIREMENTS.
- TEMPORARY ICRA DOOR AND FRAME AS REQUIRED PER SPECIFICATION SECTION 01 35 26 - SAFETY REQUIREMENTS.
- TEMPORARY ICRA AIR PRESSURE
- HEPA EQUIPPED EXHAUST
- 2 HR FIRE RATED WALL (EXISTING)

KEY NOTES (THIS SHEET ONLY)

I1	TEMPORARY ICRA DOOR.
I2	TACKY MAT.
I3	TEMPORARY ICRA BARRIER.
I4	TEMPORARILY SEAL DOOR FOR DURATION OF CONSTRUCTION PHASE.

GENERAL NOTES

1. ICRA **CLASS III** REQUIREMENTS MUST BE MET THROUGHOUT THE ENTIRE DURATION OF CONSTRUCTION.
2. COMPLY WITH ALL REQUIREMENTS IN SPECIFICATION SECTION 01 35 26 - SAFETY REQUIREMENTS.
3. CONSTRUCTION ZONE ENTRANCES AND EXITS SHALL BE LOCKED AT ALL TIMES UNLESS IN USE BY THE CONTRACTOR. WHEN IN USE, ACCESS WILL BE CONTROLLED AND MONITORED BY THE CONTRACTOR.
4. ADHESIVE WALK-OFF MATS TO BE USED AT ALL CONSTRUCTION ENTRANCES AND EXITS, INCLUDING ANTE ROOMS.
5. TEMPORARY BARRIERS AND DOORS MAY ONLY BE DEMOLISHED ONCE GIVEN FINAL APPROVAL BY THE VA COR.
6. TEMPORARY FIRE RESISTIVE SHEET PLASTIC WITH ZIPPER ACCESS MAY BE USED AS A MEANS OF DUST CONTROL WHILE CONSTRUCTING AND DEMOLISHING TEMPORARY ICRA BARRIERS.
7. CONSTRUCTION WORK TO BE DONE IN PHASES SO ONE ELEVATOR REMAINS OPERATIONAL.
8. WORK AT LEVELS 2 AND 3 FOR REPLACEMENT OF DOOR AND JAMB TO BE DONE OUTSIDE OF REGULAR BUSINESS HOURS.
9. DO NOT DISTURB FLOORING WHILE CONSTRUCTION OCCURS ON ANY FLOOR, UNLESS OTHERWISE NOTED.

KEY PLAN

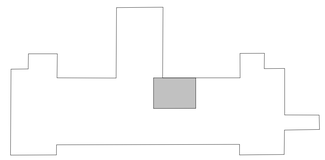

BUILDING 9

AREA SHOWN

Revisions:	Date:

CONSULTANT

ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246

SDB SPEESDESIGNBUILD

STAMP

10000 REGISTERED ARCHITECT JAMES M. KING STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title	BUILDING 9 - ICRA PLANS
Phase	100% CONSTRUCTION DOCUMENTS
Approved:	
	FULLY SPRINKLERED
Project Title	REPLACE ELEVATORS IN BLDG 7 & BLDG 9
Project Number	502-24-102
Building Number	9
Location	ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA
Drawing Number	AS108
Issue Date	03/24/2026
Checked	MK
Drawn	AJ

VA FORM 08 - 6231

1 BUILDING 9 - ELEV 1 & 2 - LEVEL 03 - ICRA PLAN - PHASE 1

1/4" = 1'-0"

2 BUILDING 9 - ELEV 1 & 2 - LEVEL 03 - ICRA PLAN - PHASE 2

1/4" = 1'-0"

LEGEND

- OUT OF SCOPE
- INACCESSIBLE DURING PHASE
- EXISTING WALL TEMPORARILY ACTING AS AN ICRA BOUNDRY. SEAL ALL OPENINGS, PENETRATIONS, & HVAC DUCTS AS REQUIRED PER SPECIFICATION SECTION 01 35 26 - SAFETY REQUIREMENTS.
- TEMPORARY ICRA BARRIER FRAMED TO STRUCTURE ABOVE. CONSTRUCT AS REQUIRED PER SPECIFICATION SECTION 01 35 26 - SAFETY REQUIREMENTS.
- TEMPORARY ICRA DOOR AND FRAME AS REQUIRED PER SPECIFICATION SECTION 01 35 26 - SAFETY REQUIREMENTS.
- TEMPORARY ICRA AIR PRESSURE
- HEPA EQUIPPED EXHAUST
- 2 HR FIRE RATED WALL (EXISTING)

KEY NOTES (THIS SHEET ONLY)

I1	TEMPORARY ICRA DOOR.
I2	TACKY MAT.
I3	TEMPORARY ICRA BARRIER.

GENERAL NOTES

1. ICRA **CLASS III** REQUIREMENTS MUST BE MET THROUGHOUT THE ENTIRE DURATION OF CONSTRUCTION.
2. COMPLY WITH ALL REQUIREMENTS IN SPECIFICATION SECTION 01 35 26 - SAFETY REQUIREMENTS.
3. CONSTRUCTION ZONE ENTRANCES AND EXITS SHALL BE LOCKED AT ALL TIMES UNLESS IN USE BY THE CONTRACTOR. WHEN IN USE, ACCESS WILL BE CONTROLLED AND MONITORED BY THE CONTRACTOR.
4. ADHESIVE WALK-OFF MATS TO BE USED AT ALL CONSTRUCTION ENTRANCES AND EXITS, INCLUDING ANTE ROOMS.
5. TEMPORARY BARRIERS AND DOORS MAY ONLY BE DEMOLISHED ONCE GIVEN FINAL APPROVAL BY THE VA COR.
6. TEMPORARY FIRE RESISTIVE SHEET PLASTIC WITH ZIPPER ACCESS MAY BE USED AS A MEANS OF DUST CONTROL WHILE CONSTRUCTING AND DEMOLISHING TEMPORARY ICRA BARRIERS.
7. CONSTRUCTION WORK TO BE DONE IN PHASES SO ONE ELEVATOR REMAINS OPERATIONAL.
8. WORK AT LEVELS 2 AND 3 FOR REPLACEMENT OF DOOR AND JAMB TO BE DONE OUTSIDE OF REGULAR BUSINESS HOURS.
9. DO NOT DISTURB FLOORING WHILE CONSTRUCTION OCCURS ON ANY FLOOR, UNLESS OTHERWISE NOTED.

KEY PLAN

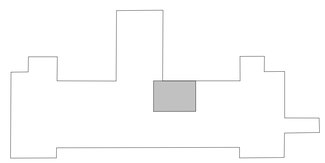

AREA SHOWN

PROJECT NORTH
TRUE NORTH (DASHED)

Revisions:	Date:

CONSULTANT

ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246

SPEESDESIGNBUILD

STAMP

10000 REGISTERED ARCHITECT JAMES M. KING STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title	BUILDING 9 - ICRA PLANS
Phase	100% CONSTRUCTION DOCUMENTS
Approved:	
	FULLY SPRINKLERED
Project Title	REPLACE ELEVATORS IN BLDG 7 & BLDG 9
Project Number	502-24-102
Building Number	9
Location	ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA
Drawing Number	AS109
Issue Date	03/24/2026
Checked	MK
Drawn	AJ

VA FORM 08 - 6231

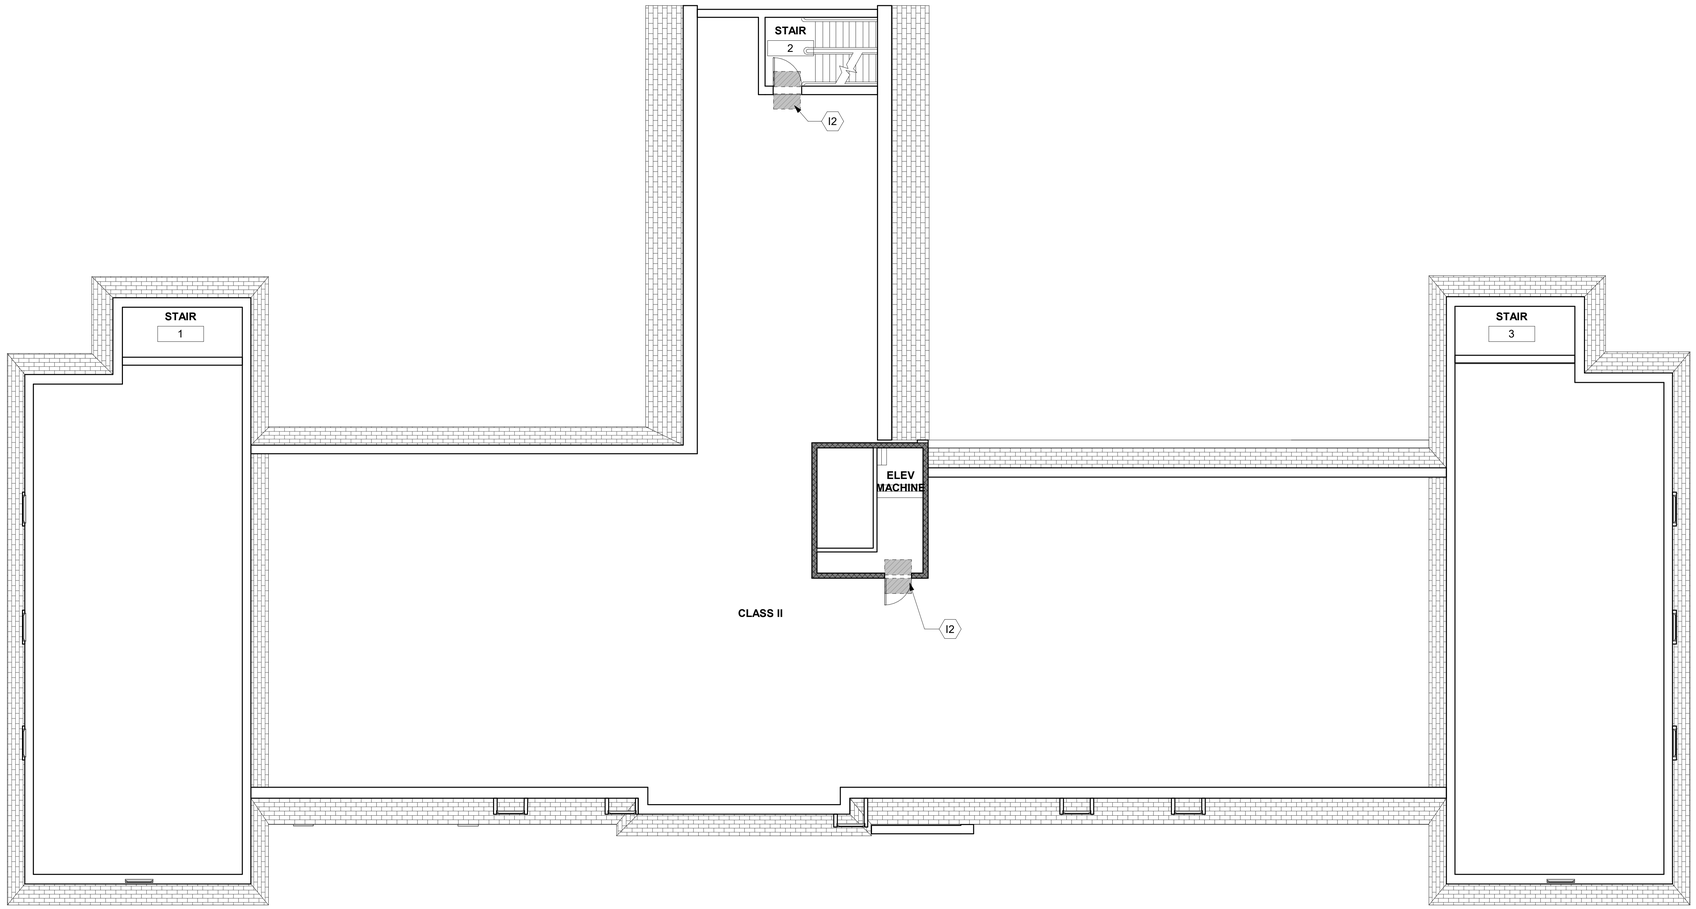

1 BUILDING 9 - PENTHOUSE - ICRA PLAN

1/8" = 1'-0"

PROJECT NORTH

TRUE NORTH (DASHED)

LEGEND

- OUT OF SCOPE
- INACCESSIBLE DURING PHASE
- EXISTING WALL TEMPORARILY ACTING AS AN ICRA BOUNDRY. SEAL ALL OPENINGS, PENETRATIONS, & HVAC DUCTS AS REQUIRED PER SPECIFICATION SECTION 01 35 26 - SAFETY REQUIREMENTS.
- TEMPORARY ICRA BARRIER FRAMED TO STRUCTURE ABOVE. CONSTRUCT AS REQUIRED PER SPECIFICATION SECTION 01 35 26 - SAFETY REQUIREMENTS.
- TEMPORARY ICRA DOOR AND FRAME AS REQUIRED PER SPECIFICATION SECTION 01 35 26 - SAFETY REQUIREMENTS.
- TEMPORARY ICRA AIR PRESSURE
- HEPA EQUIPPED EXHAUST
- 2 HR FIRE RATED WALL (EXISTING)

KEY NOTES (THIS SHEET ONLY)

I2	TACKY MAT.

GENERAL NOTES

1. ICRA **CLASS II** REQUIREMENTS MUST BE MET THROUGHOUT THE ENTIRE DURATION OF CONSTRUCTION.
2. COMPLY WITH ALL REQUIREMENTS IN SPECIFICATION SECTION 01 35 26 - SAFETY REQUIREMENTS.
3. CONSTRUCTION ZONE ENTRANCES AND EXITS SHALL BE LOCKED AT ALL TIMES UNLESS IN USE BY THE CONTRACTOR. WHEN IN USE, ACCESS WILL BE CONTROLLED AND MONITORED BY THE CONTRACTOR.
4. ADHESIVE WALK-OFF MATS TO BE USED AT ALL CONSTRUCTION ENTRANCES AND EXITS, INCLUDING ANTE ROOMS.
5. TEMPORARY BARRIERS AND DOORS MAY ONLY BE DEMOLISHED ONCE GIVEN FINAL APPROVAL BY THE VA COR.
6. TEMPORARY FIRE RESISTIVE SHEET PLASTIC WITH ZIPPER ACCESS MAY BE USED AS A MEANS OF DUST CONTROL WHILE CONSTRUCTING AND DEMOLISHING TEMPORARY ICRA BARRIERS.
7. CONSTRUCTION WORK TO BE DONE IN PHASES SO ONE ELEVATOR REMAINS OPERATIONAL.
8. WORK AT LEVELS 2 AND 3 FOR REPLACEMENT OF DOOR AND JAMB TO BE DONE OUTSIDE OF REGULAR BUSINESS HOURS.
9. DO NOT DISTURB FLOORING WHILE CONSTRUCTION OCCURS ON ANY FLOOR, UNLESS OTHERWISE NOTED.

KEY PLAN



BUILDING 9

AREA SHOWN

PROJECT NORTH

TRUE NORTH (DASHED)

Revisions:	Date:

CONSULTANT

ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246

SPEESDESIGNBUILD

STAMP

10000 REGISTERED ARCHITECT JAMES M. KING STATE OF WASHINGTON

03/23/2026

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: BUILDING 9 - ICRA PLANS

Approved:

Phase: 100% CONSTRUCTION DOCUMENTS

FULLY SPRINKLERED

Project Title: REPLACE ELEVATORS IN BLDG 7 & BLDG 9

Location: ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA

Issue Date: 03/24/2026

Checked: MK

Drawn: AJ

Project Number: 502-24-102

Building Number: 9

Drawing Number: AS110

VA FORM 08 - 6231

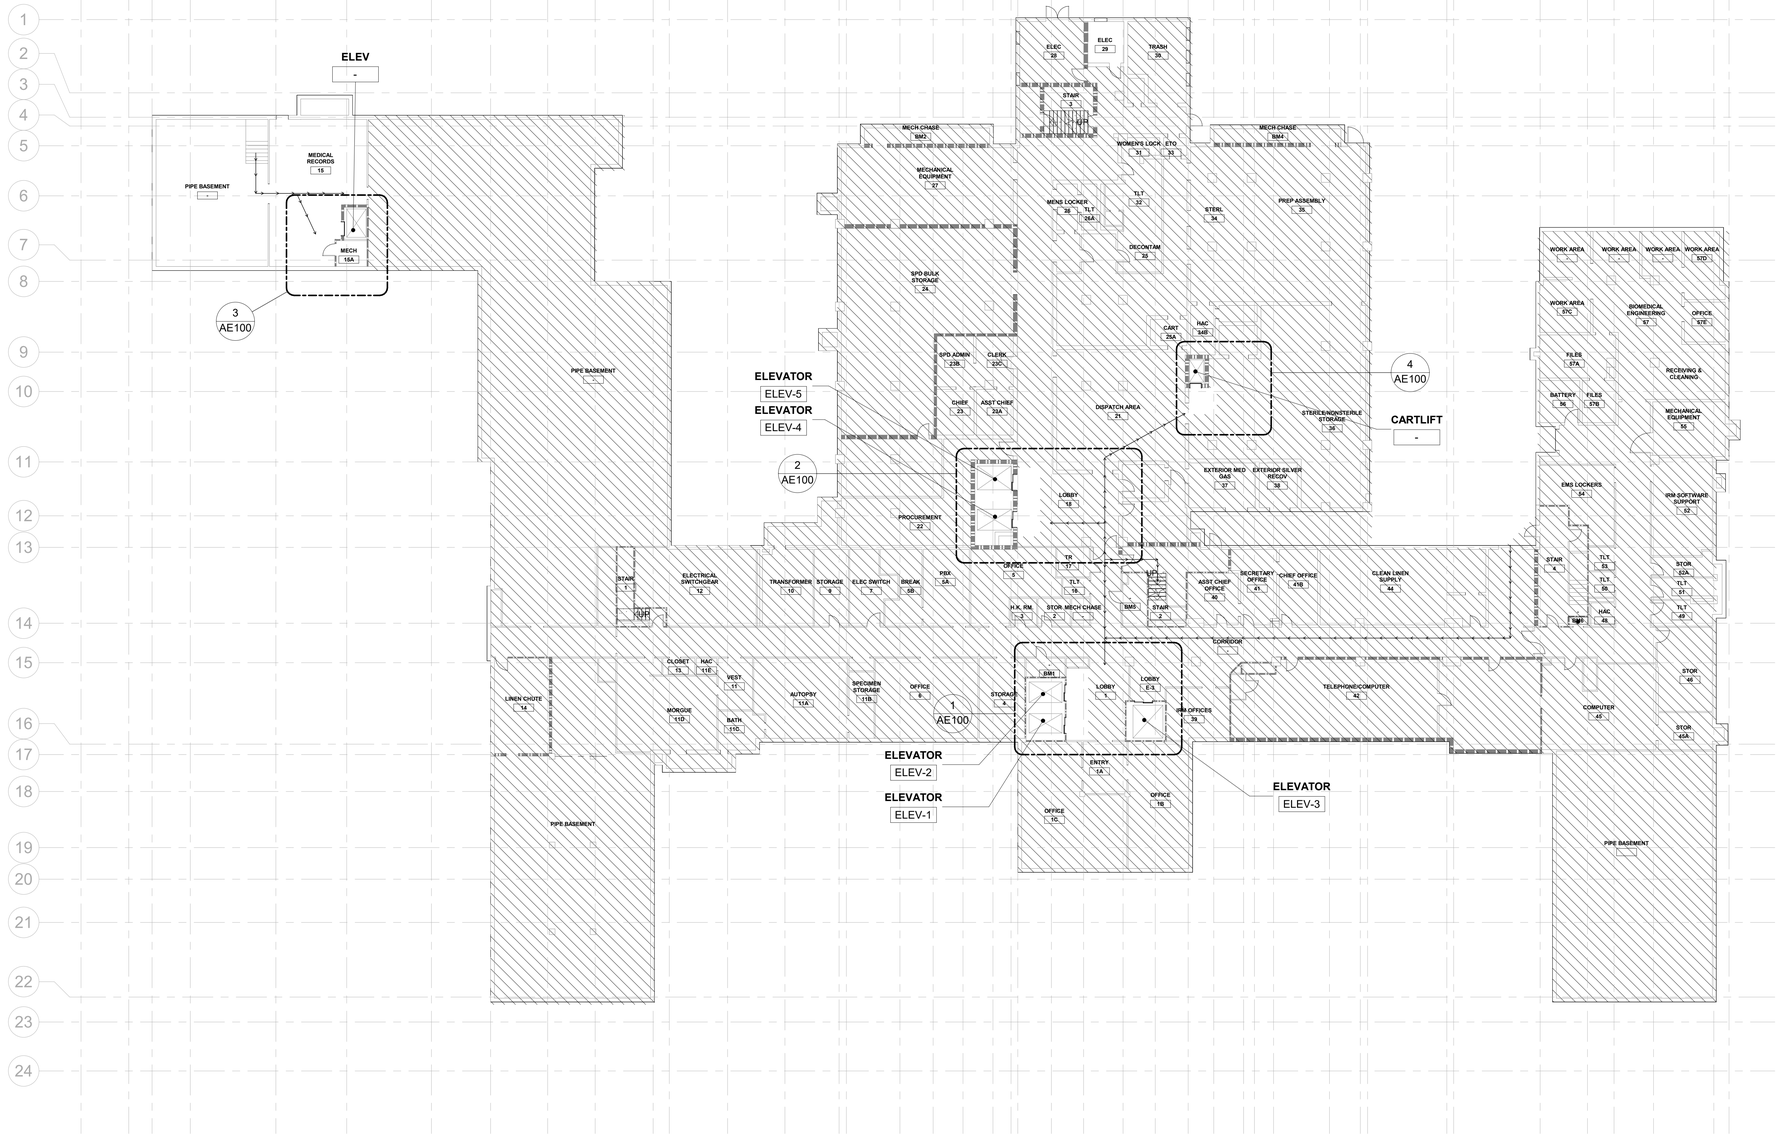

1 BUILDING 7 - BASEMENT - OVERALL FLOOR PLAN

1/16" = 1'-0"

PROJECT NORTH

TRUE NORTH (DASHED)

LEGEND

- OUT OF SCOPE
- CONTRACTOR PATH OF TRAVEL
- 2 HR FIRE RATED WALL (EXISTING)
- 1 HR FIRE RATED WALL (EXISTING)
- SMOKE RATED WALL (EXISTING)

Revisions:	Date:

CONSULTANT

ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246

SDB SPEESDESIGNBUILD

STAMP

10000 REGISTERED ARCHITECT JAMES M. KING STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: BUILDING 7 - BASEMENT - OVERALL FLOOR PLAN	Phase: 100% CONSTRUCTION DOCUMENTS
Approved:	FULLY SPRINKLERED

Project Title: REPLACE ELEVATORS IN BLDG 7 & BLDG 9	Project Number: 502-24-102
	Building Number: 7
Location: ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA	Drawing Number: A-100
Issue Date: 03/24/2026 / Checked: MK / Drawn: AJ	

VA FORM 08 - 6231

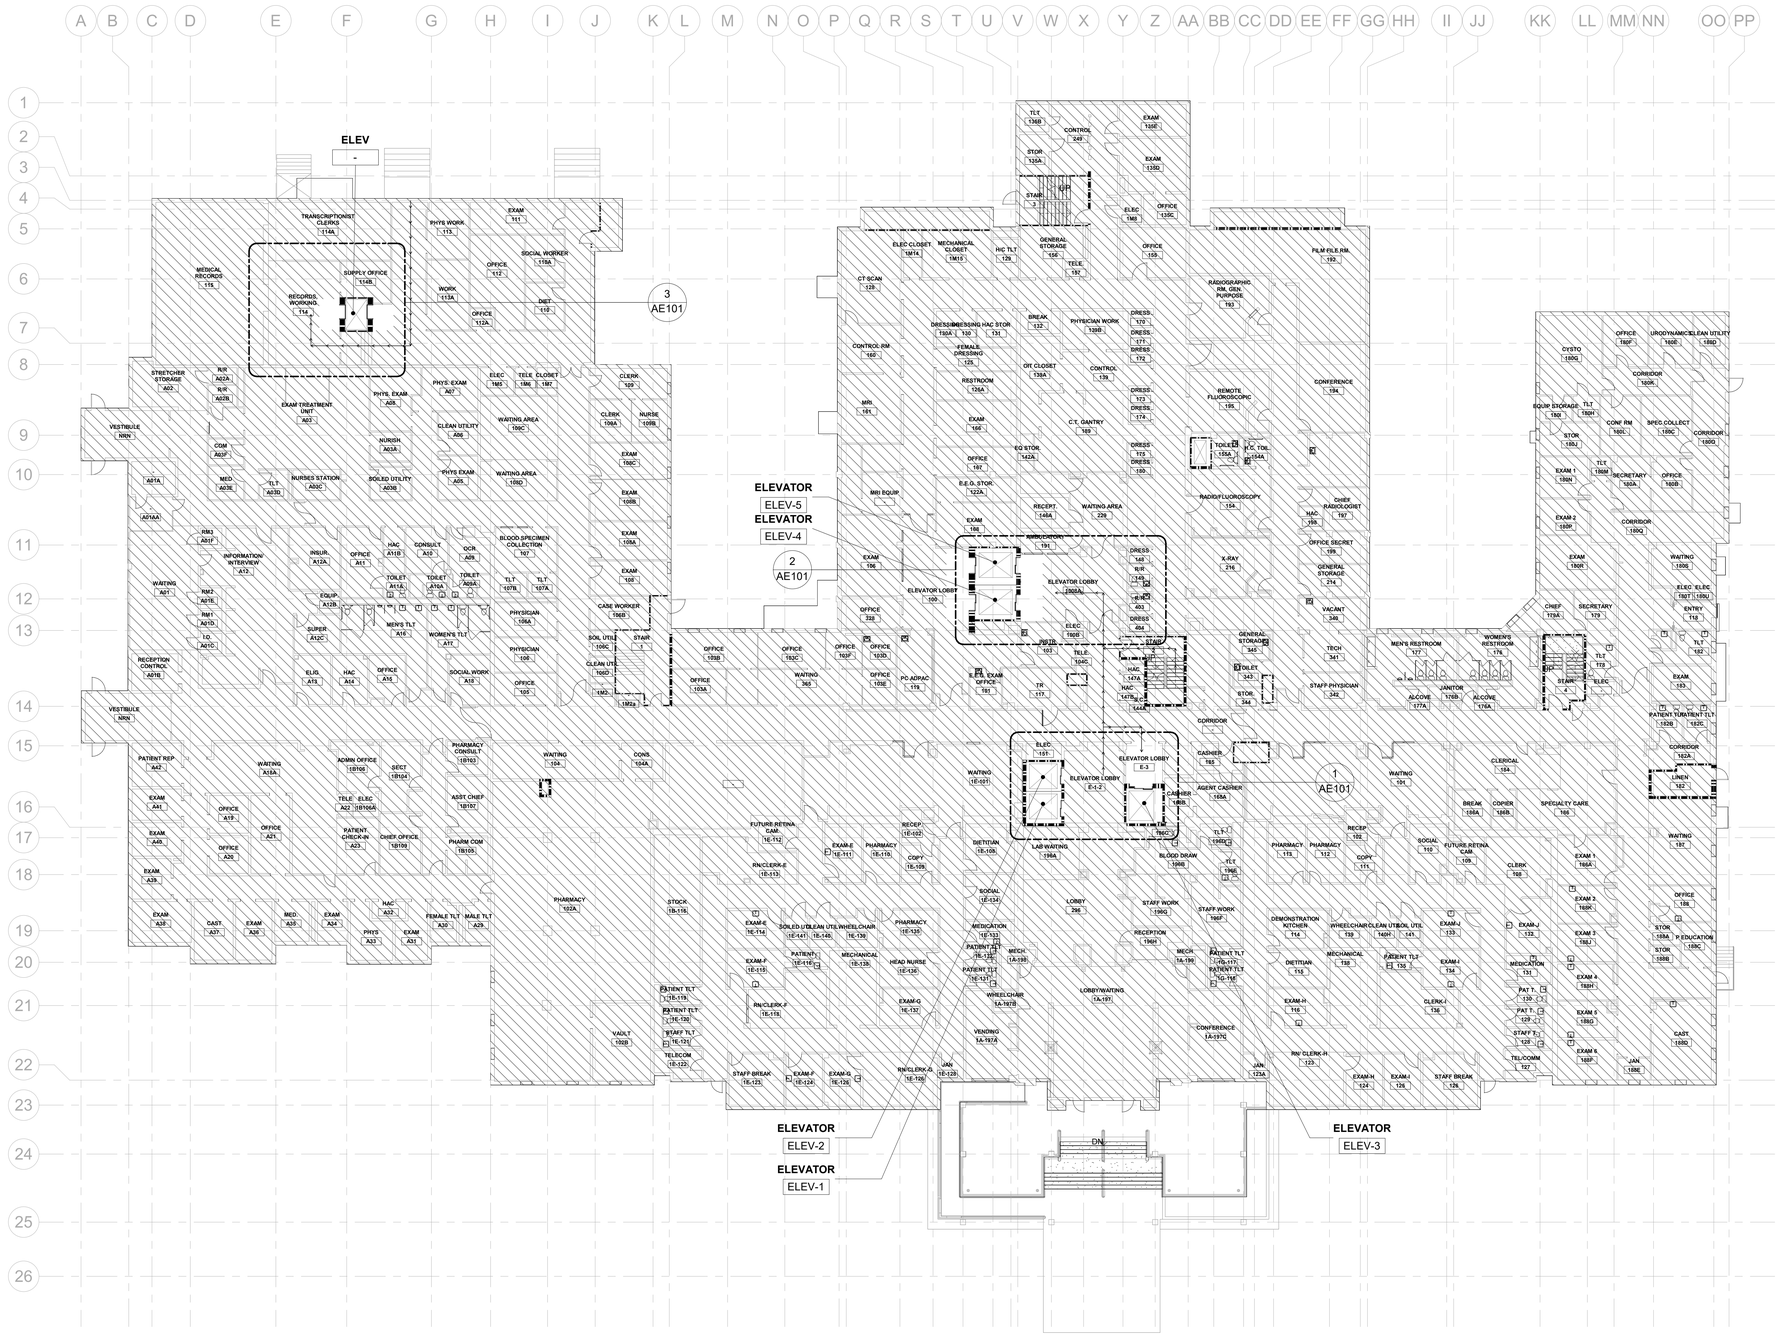

LEGEND

- OUT OF SCOPE
- CONTRACTOR PATH OF TRAVEL
- 2 HR FIRE RATED WALL (EXISTING)
- 1 HR FIRE RATED WALL (EXISTING)
- SMOKE RATED WALL (EXISTING)

1 BUILDING 7 - LEVEL 01 - OVERALL FLOOR PLAN

1/16" = 1'-0"

PROJECT NORTH
TRUE NORTH (DASHED)

Revisions:	Date:

CONSULTANT

ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246
SDB SPEESDESIGNBUILD

STAMP

10000 REGISTERED ARCHITECT JAMES M. KING STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title
BUILDING 7 - LEVEL 01 - OVERALL FLOOR PLAN

Approved:

Phase
100% CONSTRUCTION DOCUMENTS

FULLY SPRINKLERED

Project Title
REPLACE ELEVATORS IN BLDG 7 & BLDG 9

Project Number
502-24-102

Building Number
7

Location
ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA

Drawing Number
A-101

Issue Date
03/24/2026

Checked
MK

Drawn
AJ

VA FORM 08 - 6231

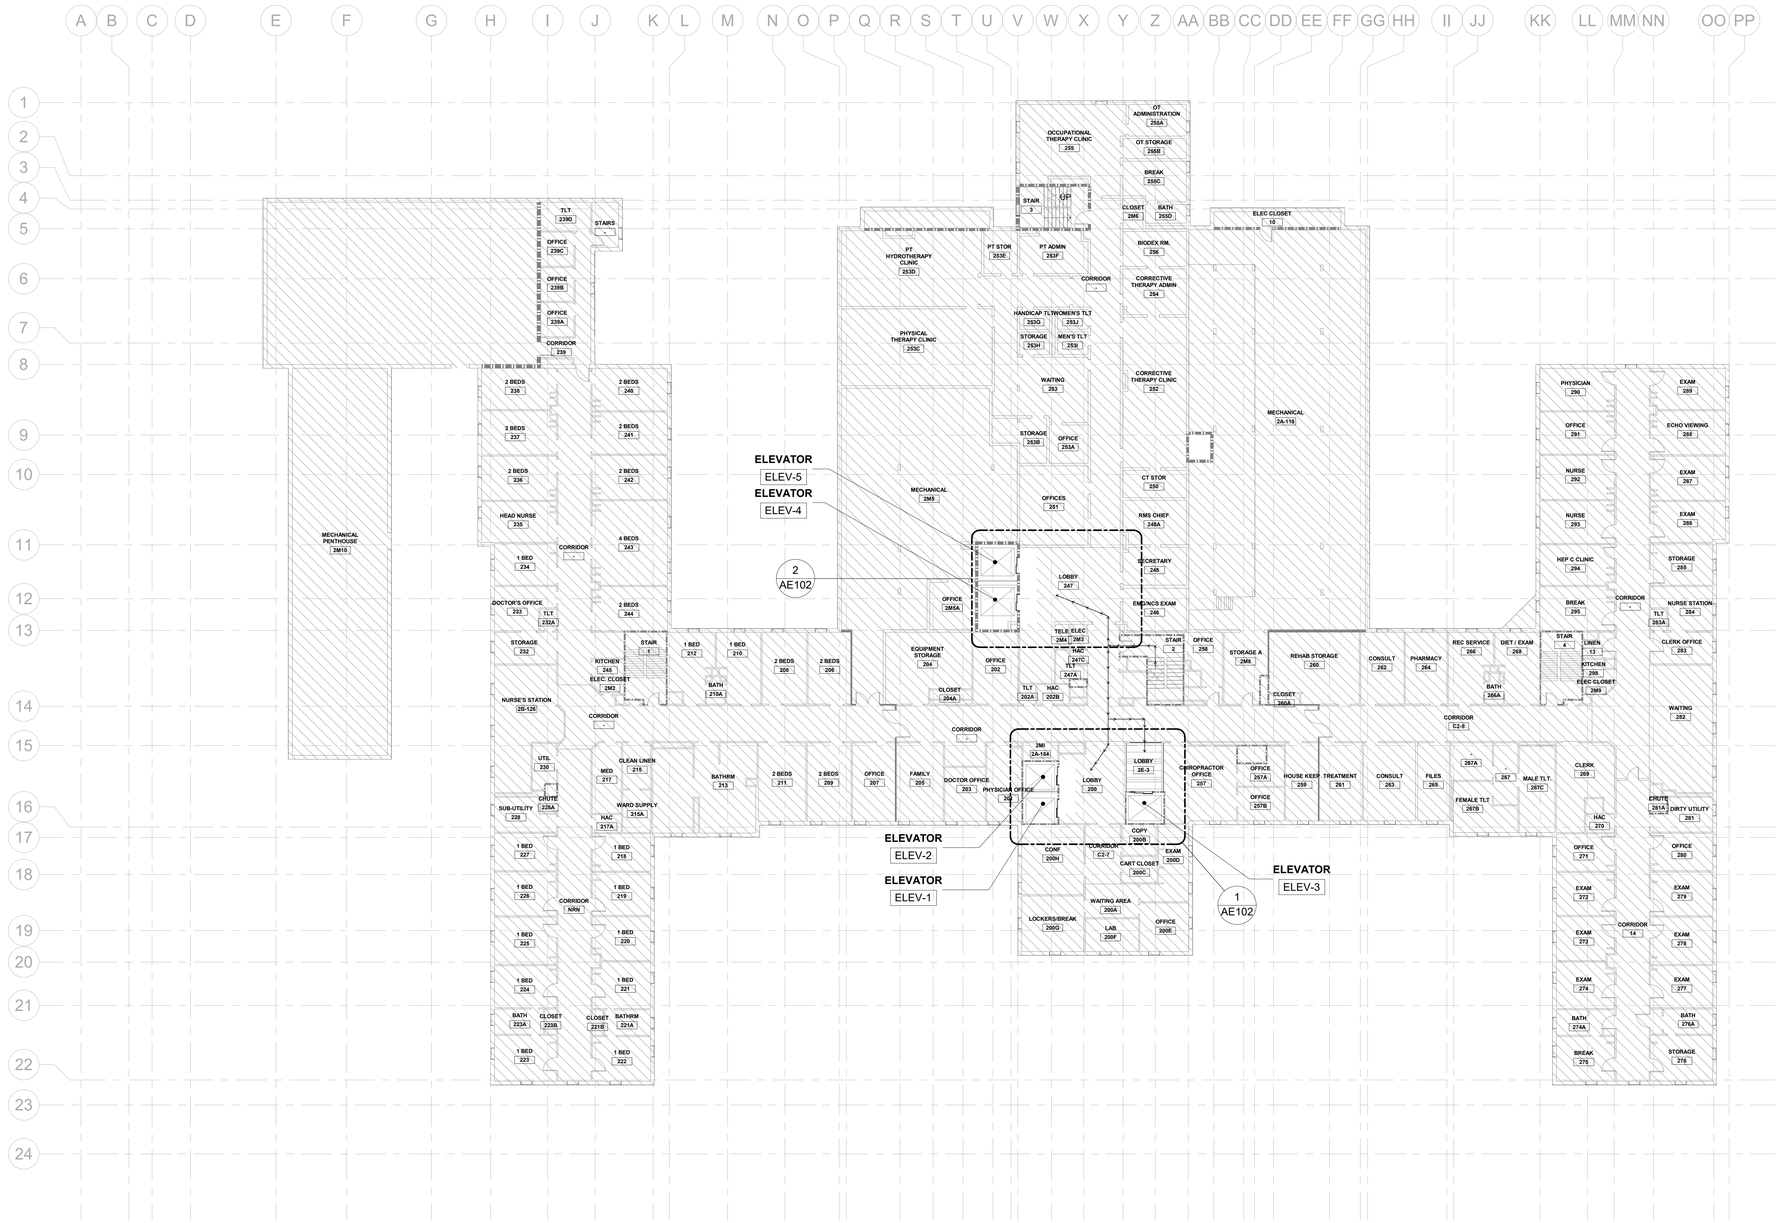

1 BUILDING 7 - LEVEL 02 - OVERALL FLOOR PLAN

1/16" = 1'-0"

PROJECT NORTH

TRUE NORTH (DASHED)

LEGEND

- OUT OF SCOPE
- CONTRACTOR PATH OF TRAVEL
- 2 HR FIRE RATED WALL (EXISTING)
- 1 HR FIRE RATED WALL (EXISTING)
- SMOKE RATED WALL (EXISTING)

Revisions:	Date:

CONSULTANT

ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246

SPEESDESIGNBUILD

STAMP

10000 REGISTERED ARCHITECT JAMES M. KING STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: BUILDING 7 - LEVEL 02 - OVERALL FLOOR PLAN

Approved:

Phase: 100% CONSTRUCTION DOCUMENTS

FULLY SPRINKLERED

Project Title: REPLACE ELEVATORS IN BLDG 7 & BLDG 9

Location: ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA

Issue Date: 03/24/2026

Checked: MK

Drawn: AJ

Project Number: 502-24-102

Building Number: 7

Drawing Number: A-102

VA FORM 08 - 6231

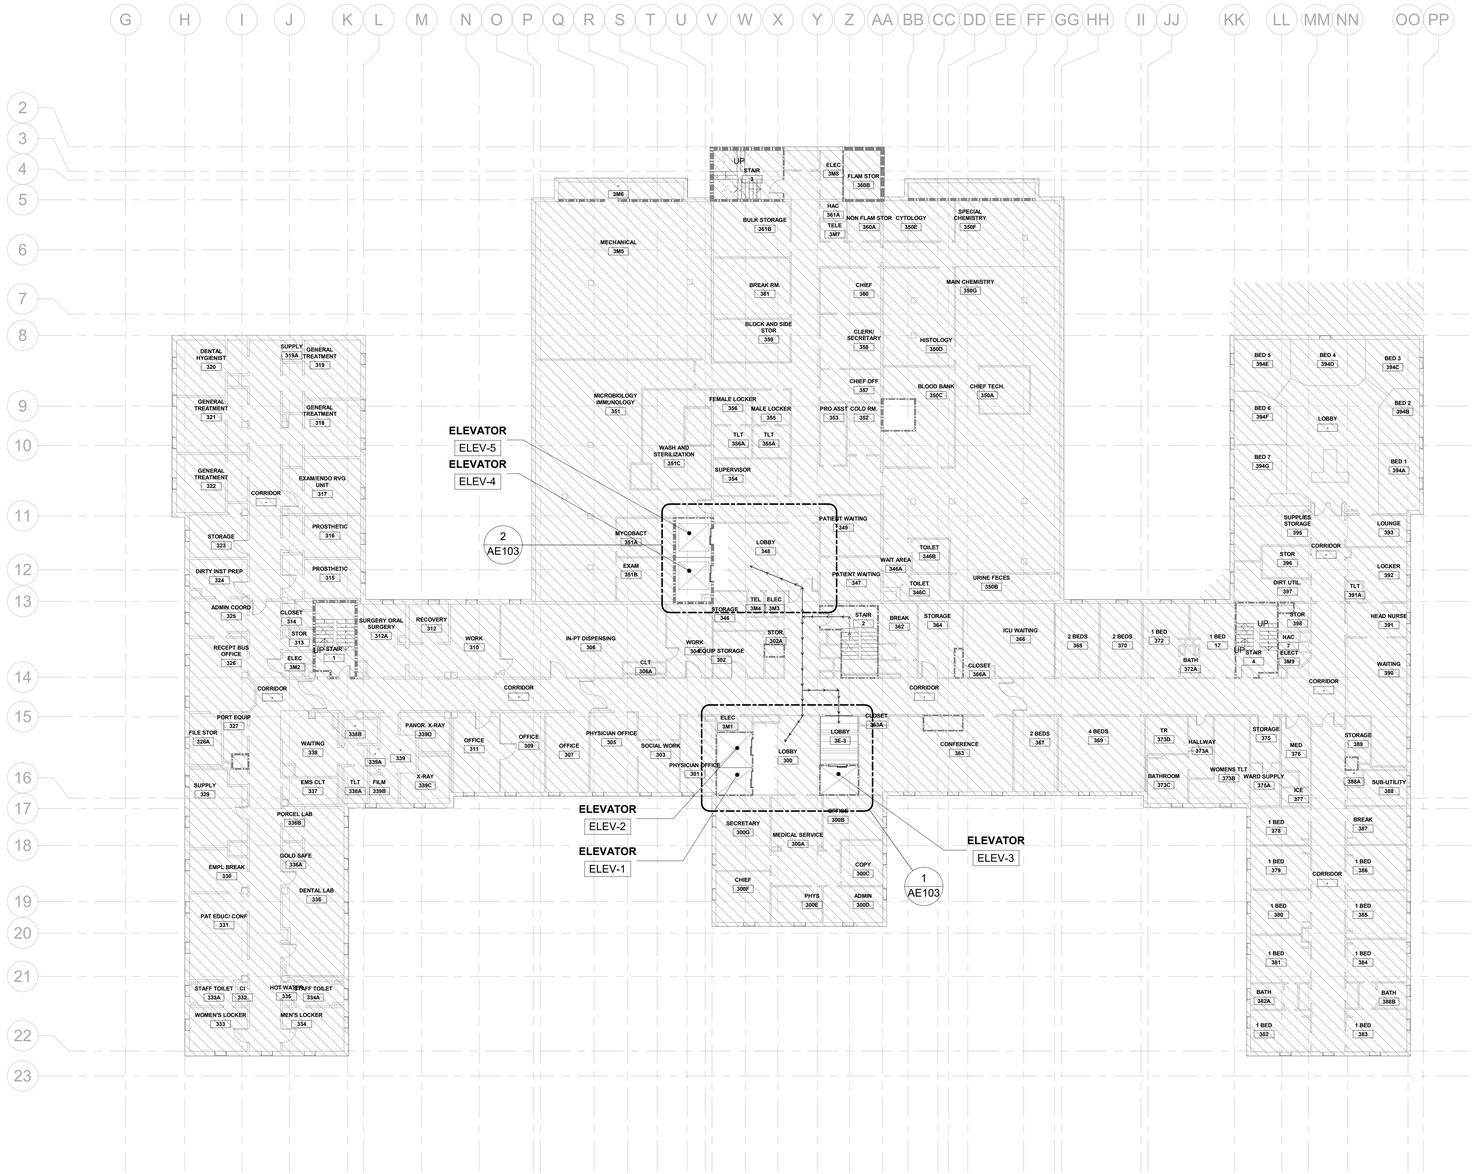

1 BUILDING 7 - LEVEL 03 - OVERALL FLOOR PLAN

1/16" = 1'-0"

PROJECT NORTH

TRUE NORTH (DASHED)

LEGEND

- OUT OF SCOPE
- CONTRACTOR PATH OF TRAVEL
- 2 HR FIRE RATED WALL (EXISTING)
- 1 HR FIRE RATED WALL (EXISTING)
- SMOKE RATED WALL (EXISTING)

Revisions:	Date:

CONSULTANT

ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD

A/E:

SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246

SDB SPEESDESIGNBUILD

STAMP

10000 REGISTERED ARCHITECT JAMES M. KING STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: BUILDING 7 - LEVEL 03 - OVERALL FLOOR PLAN	Phase: 100% CONSTRUCTION DOCUMENTS
Approved:	FULLY SPRINKLERED

Project Title: REPLACE ELEVATORS IN BLDG 7 & BLDG 9	Project Number: 502-24-102
	Building Number: 7
Location: ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA	Drawing Number: A-103
Issue Date: 03/24/2026	Checked: MK / Drawn: AJ

VA FORM 08 - 6231

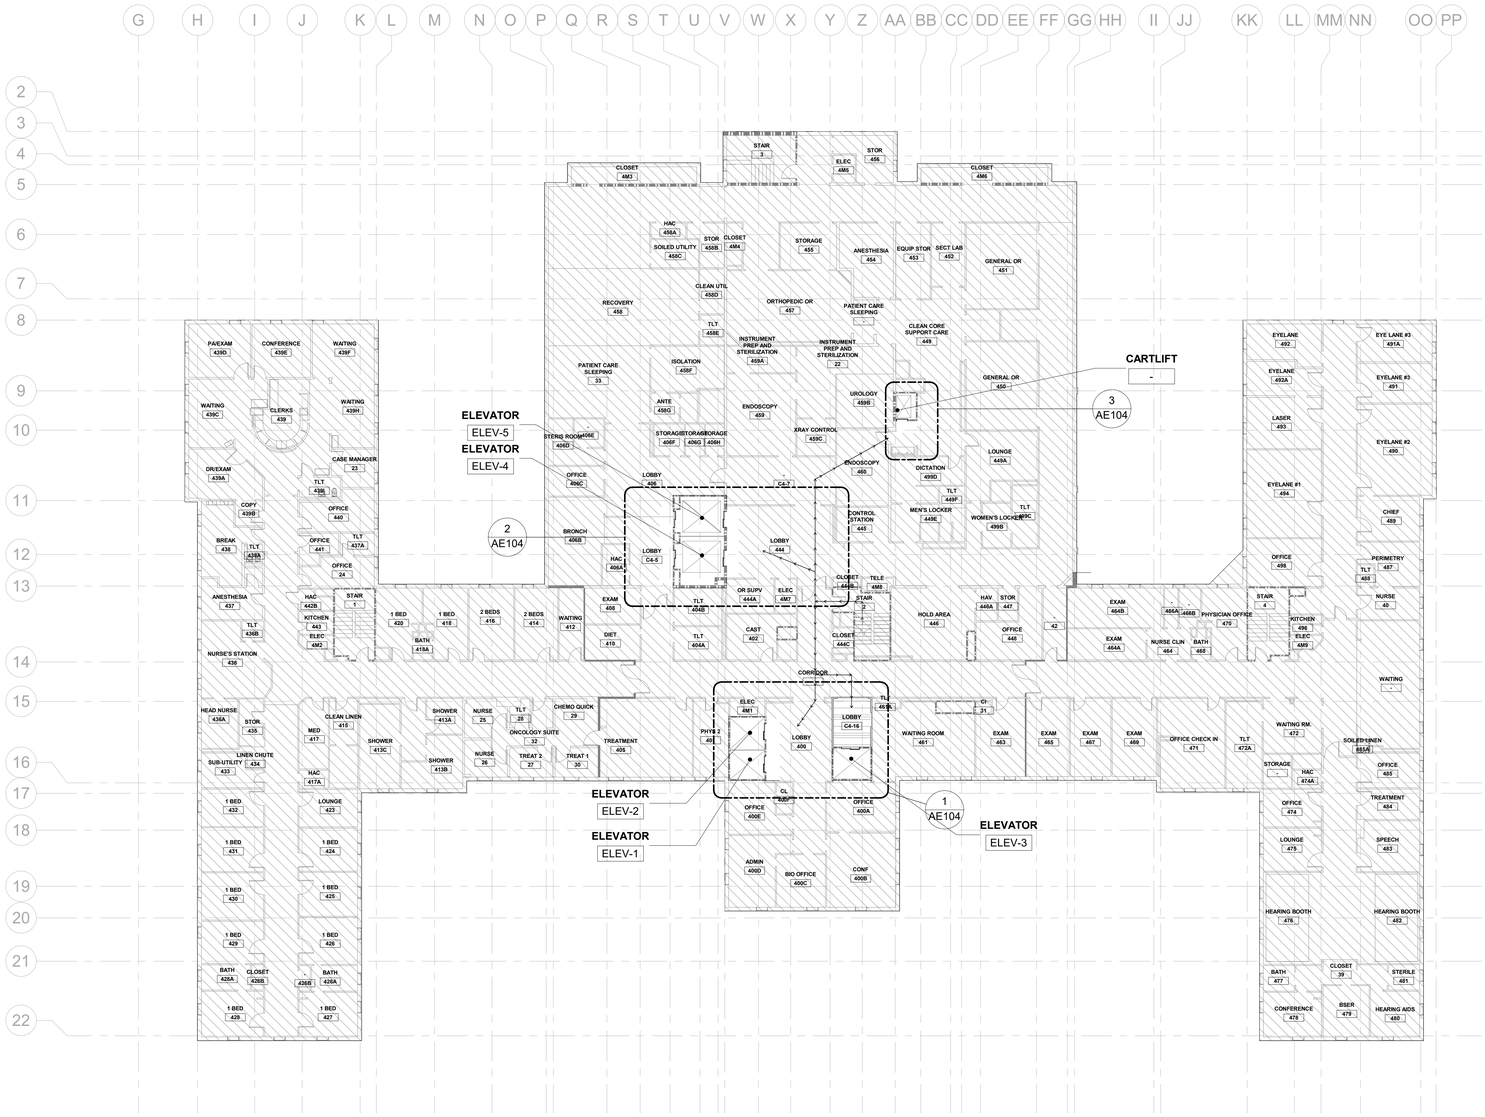

1 BUILDING 7 - LEVEL 04 - OVERALL FLOOR PLAN

1/16" = 1'-0"

PROJECT NORTH

TRUE NORTH (DASHED)

LEGEND

- OUT OF SCOPE
- CONTRACTOR PATH OF TRAVEL
- 2 HR FIRE RATED WALL (EXISTING)
- 1 HR FIRE RATED WALL (EXISTING)
- SMOKE RATED WALL (EXISTING)

Revisions:	Date:

CONSULTANT

ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246

SPEESDESIGNBUILD

STAMP

10000 REGISTERED ARCHITECT
JAMES M. KING
STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: BUILDING 7 - LEVEL 04 - OVERALL FLOOR PLAN

Approved:

Phase: 100% CONSTRUCTION DOCUMENTS

FULLY SPRINKLERED

Project Title: REPLACE ELEVATORS IN BLDG 7 & BLDG 9

Location: ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA

Project Number: 502-24-102

Building Number: 7

Drawing Number: A-104

Issue Date: 03/24/2026 | **Checked:** MK | **Drawn:** AJ

VA FORM 08 - 6231

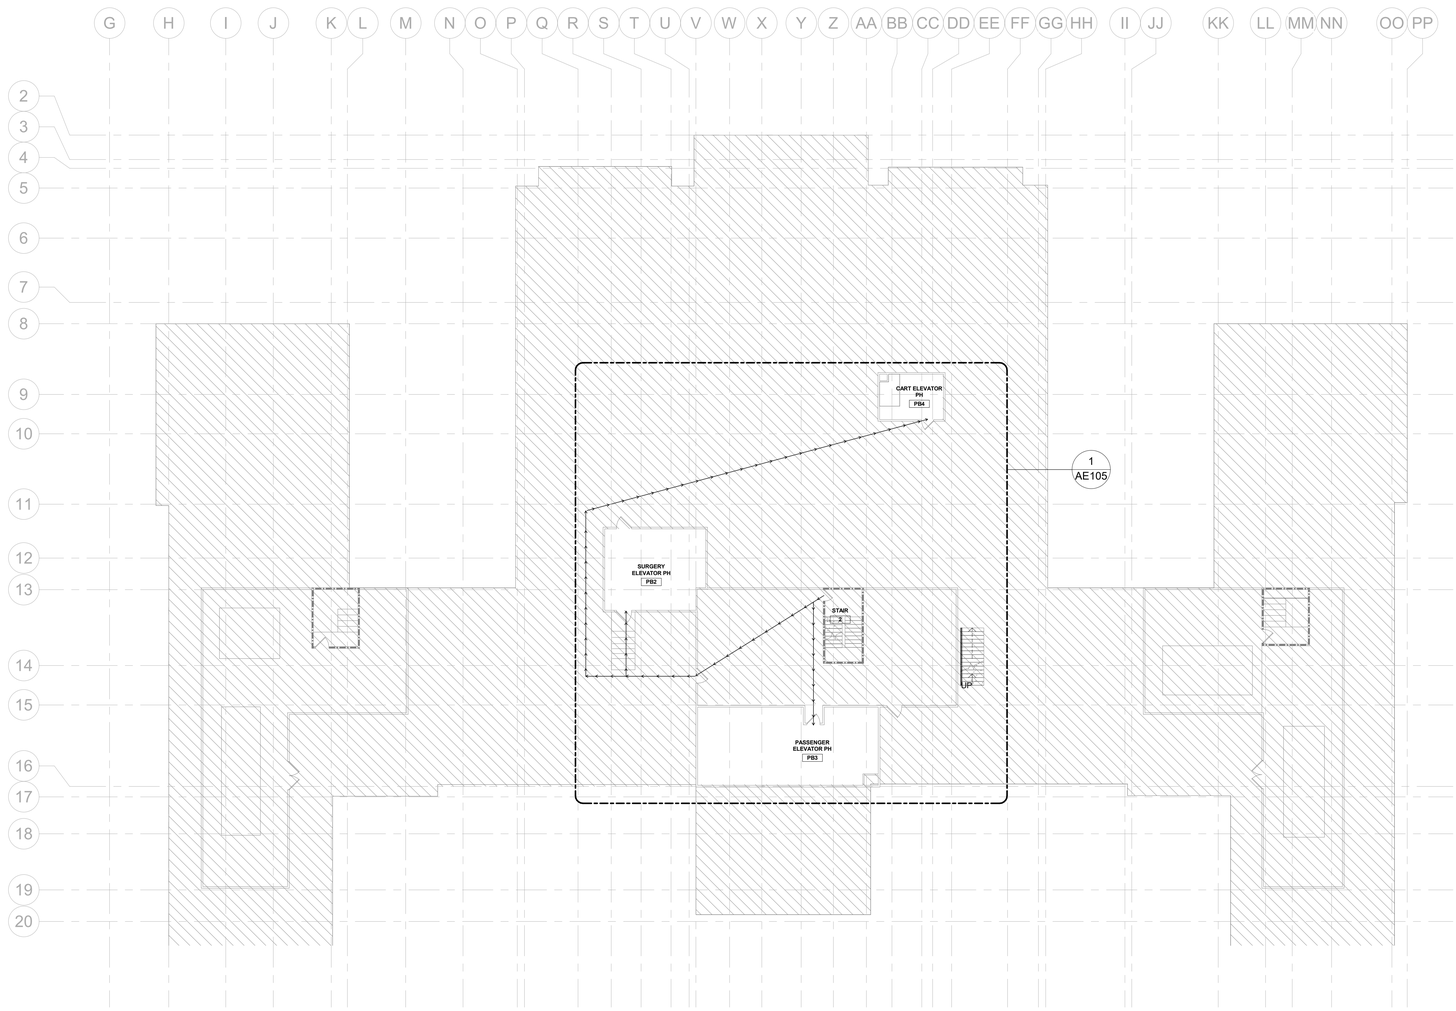

1 BUILDING 7 - PENTHOUSE - OVERALL FLOOR PLAN

1/16" = 1'-0"

PROJECT NORTH

TRUE NORTH (DASHED)

LEGEND

- OUT OF SCOPE
- CONTRACTOR PATH OF TRAVEL
- 2 HR FIRE RATED WALL (EXISTING)
- 1 HR FIRE RATED WALL (EXISTING)
- SMOKE RATED WALL (EXISTING)

Revisions:	Date:

CONSULTANT

ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246

SDB SPEESDESIGNBUILD

STAMP

10000 REGISTERED ARCHITECT JAMES M. KING STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: BUILDING 7 - PENTHOUSE - OVERALL FLOOR PLAN

Phase: 100% CONSTRUCTION DOCUMENTS

Approved:

FULLY SPRINKLERED

Project Title: REPLACE ELEVATORS IN BLDG 7 & BLDG 9

Project Number: 502-24-102

Building Number: 7

Location: ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA

Drawing Number: A-105

Issue Date: 03/24/2026

Checked: MK

Drawn: AJ

VA FORM 08 - 6231

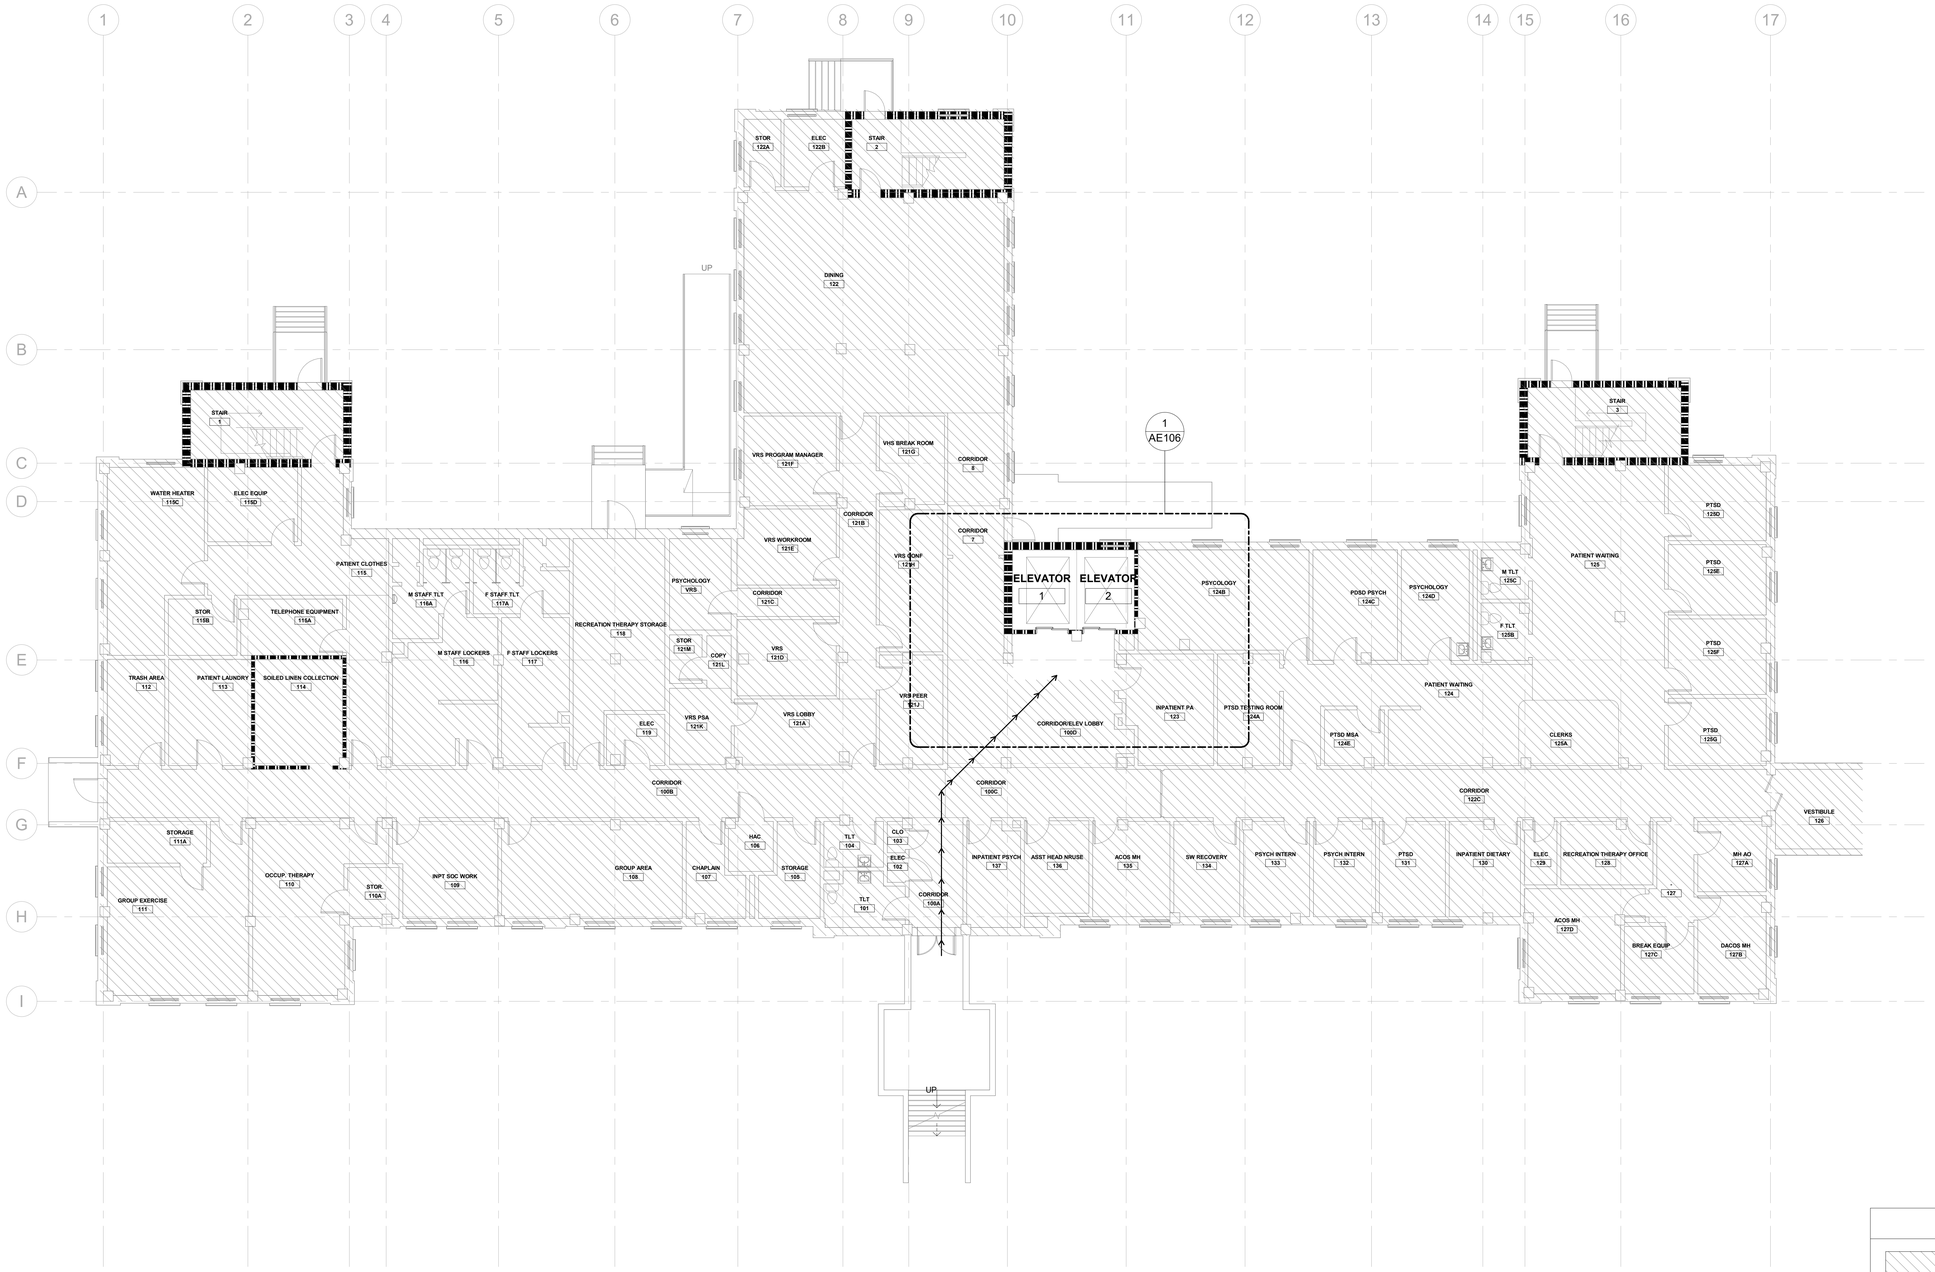

LEGEND

- OUT OF SCOPE
- CONTRACTOR PATH OF TRAVEL
- 2 HR FIRE RATED WALL (EXISTING)
- 1 HR FIRE RATED WALL (EXISTING)
- SMOKE RATED WALL (EXISTING)

PROJECT NORTH
TRUE NORTH (DASHED)

1 BUILDING 9 - LEVEL 01 - OVERALL FLOOR PLAN

1/8" = 1'-0"

Revisions:	Date:

CONSULTANT

ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246

SDB SPEESDESIGNBUILD

STAMP

10000 REGISTERED ARCHITECT JAMES M. KING STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: BUILDING 9 - LEVEL 01 - OVERALL FLOOR PLAN

Approved:

Phase: 100% CONSTRUCTION DOCUMENTS

FULLY SPRINKLERED

Project Title: REPLACE ELEVATORS IN BLDG 7 & BLDG 9

Project Number: 502-24-102

Building Number: 9

Location: ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA

Issue Date: 03/24/2026

Checked: MK

Drawn: AJ

Drawing Number: A-106

VA FORM 08 - 6231

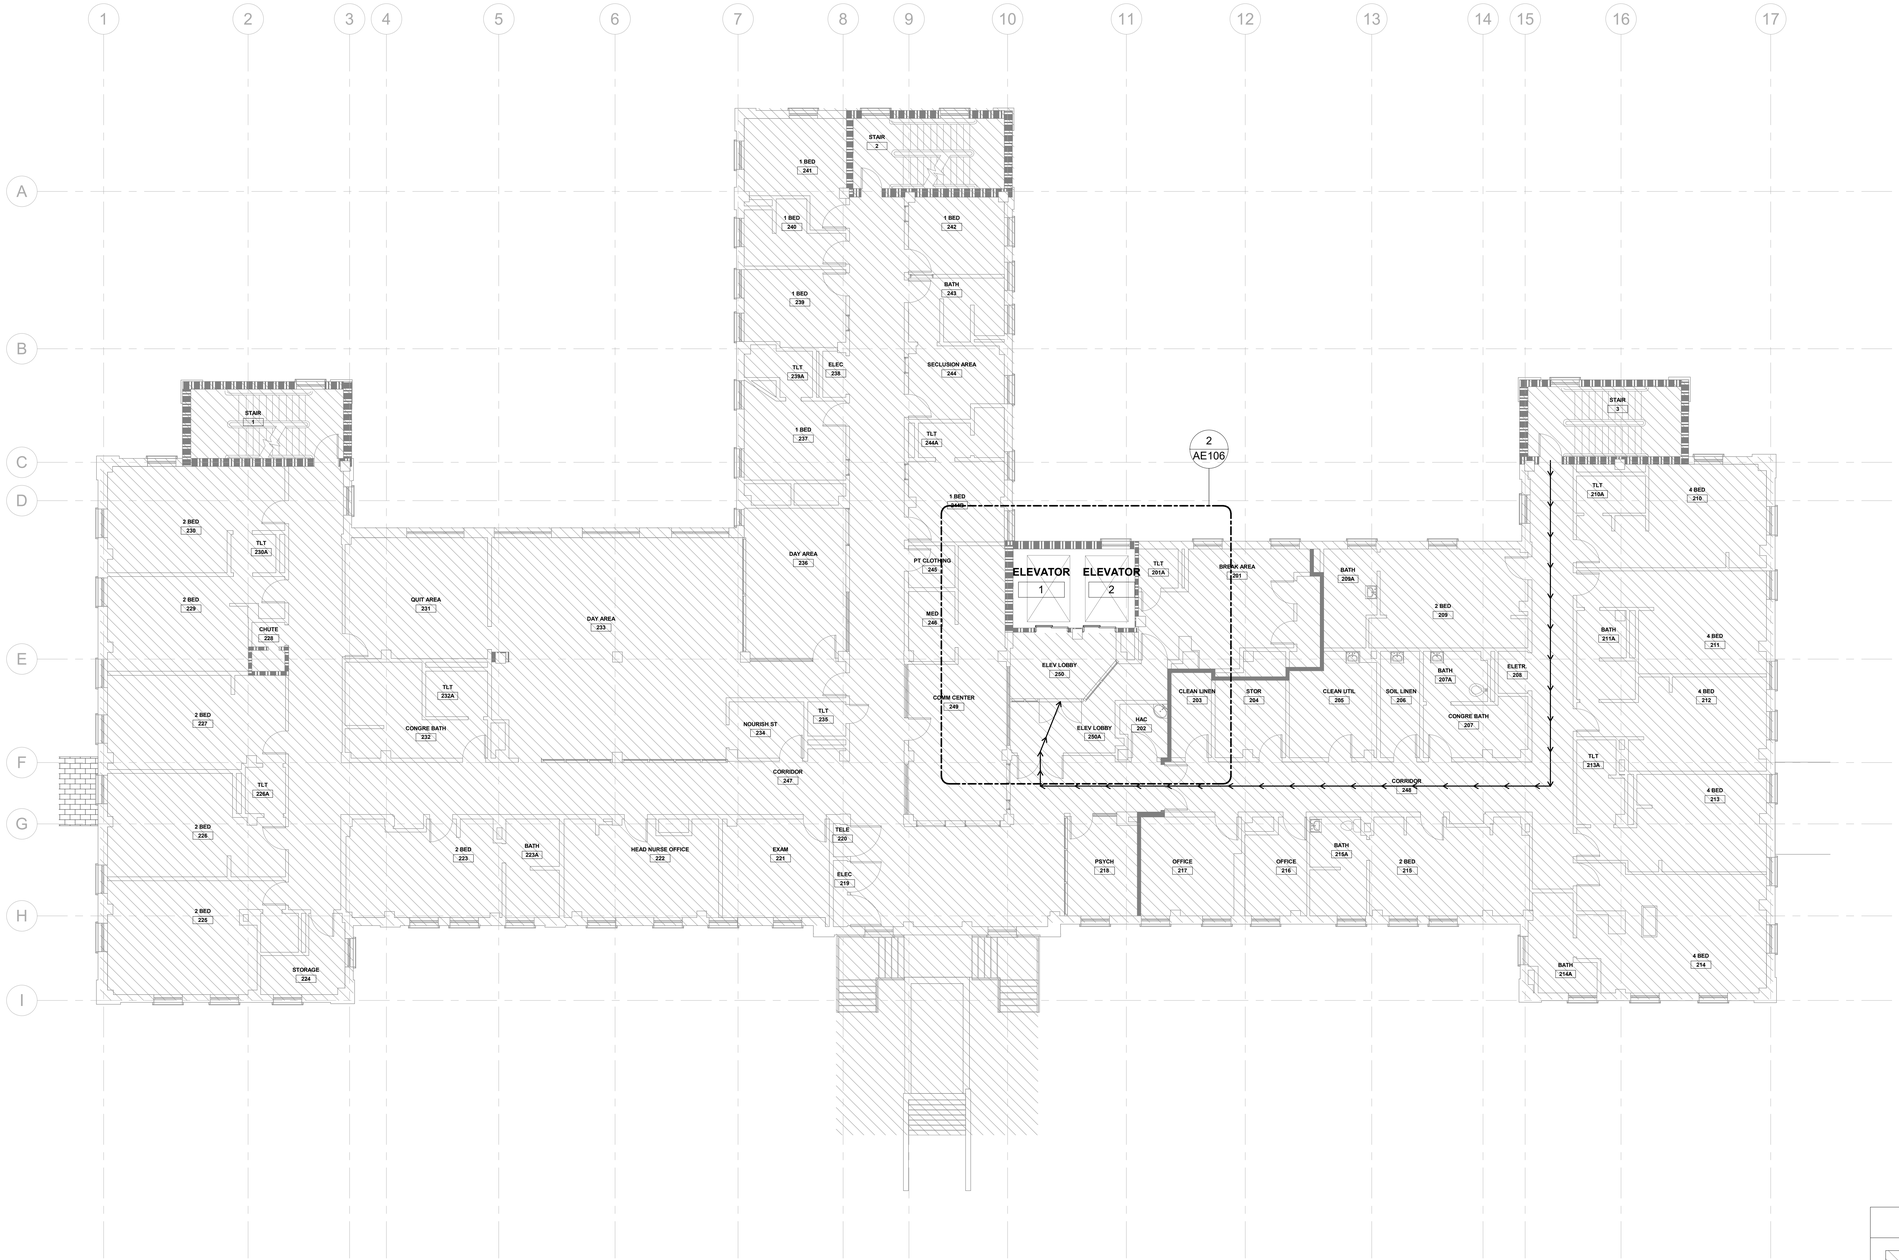

1 BUILDING 9 - LEVEL 02 - OVERALL FLOOR PLAN

1/8" = 1'-0"

PROJECT NORTH

TRUE NORTH (DASHED)

LEGEND

- OUT OF SCOPE
- CONTRACTOR PATH OF TRAVEL
- 2 HR FIRE RATED WALL (EXISTING)
- 1 HR FIRE RATED WALL (EXISTING)
- SMOKE RATED WALL (EXISTING)

Revisions:	Date:

CONSULTANT

ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246

SDB SPEESDESIGNBUILD

STAMP

10000 REGISTERED ARCHITECT JAMES M. KING STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: BUILDING 9 - LEVEL 02 - OVERALL FLOOR PLAN

Phase: 100% CONSTRUCTION DOCUMENTS

Project Title: REPLACE ELEVATORS IN BLDG 7 & BLDG 9

Project Number: 502-24-102

Building Number: 9

Approved:

FULLY SPRINKLERED

Location: ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA

Issue Date: 03/24/2026

Checked: MK

Drawn: AJ

Drawing Number: A-107

VA FORM 08 - 6231

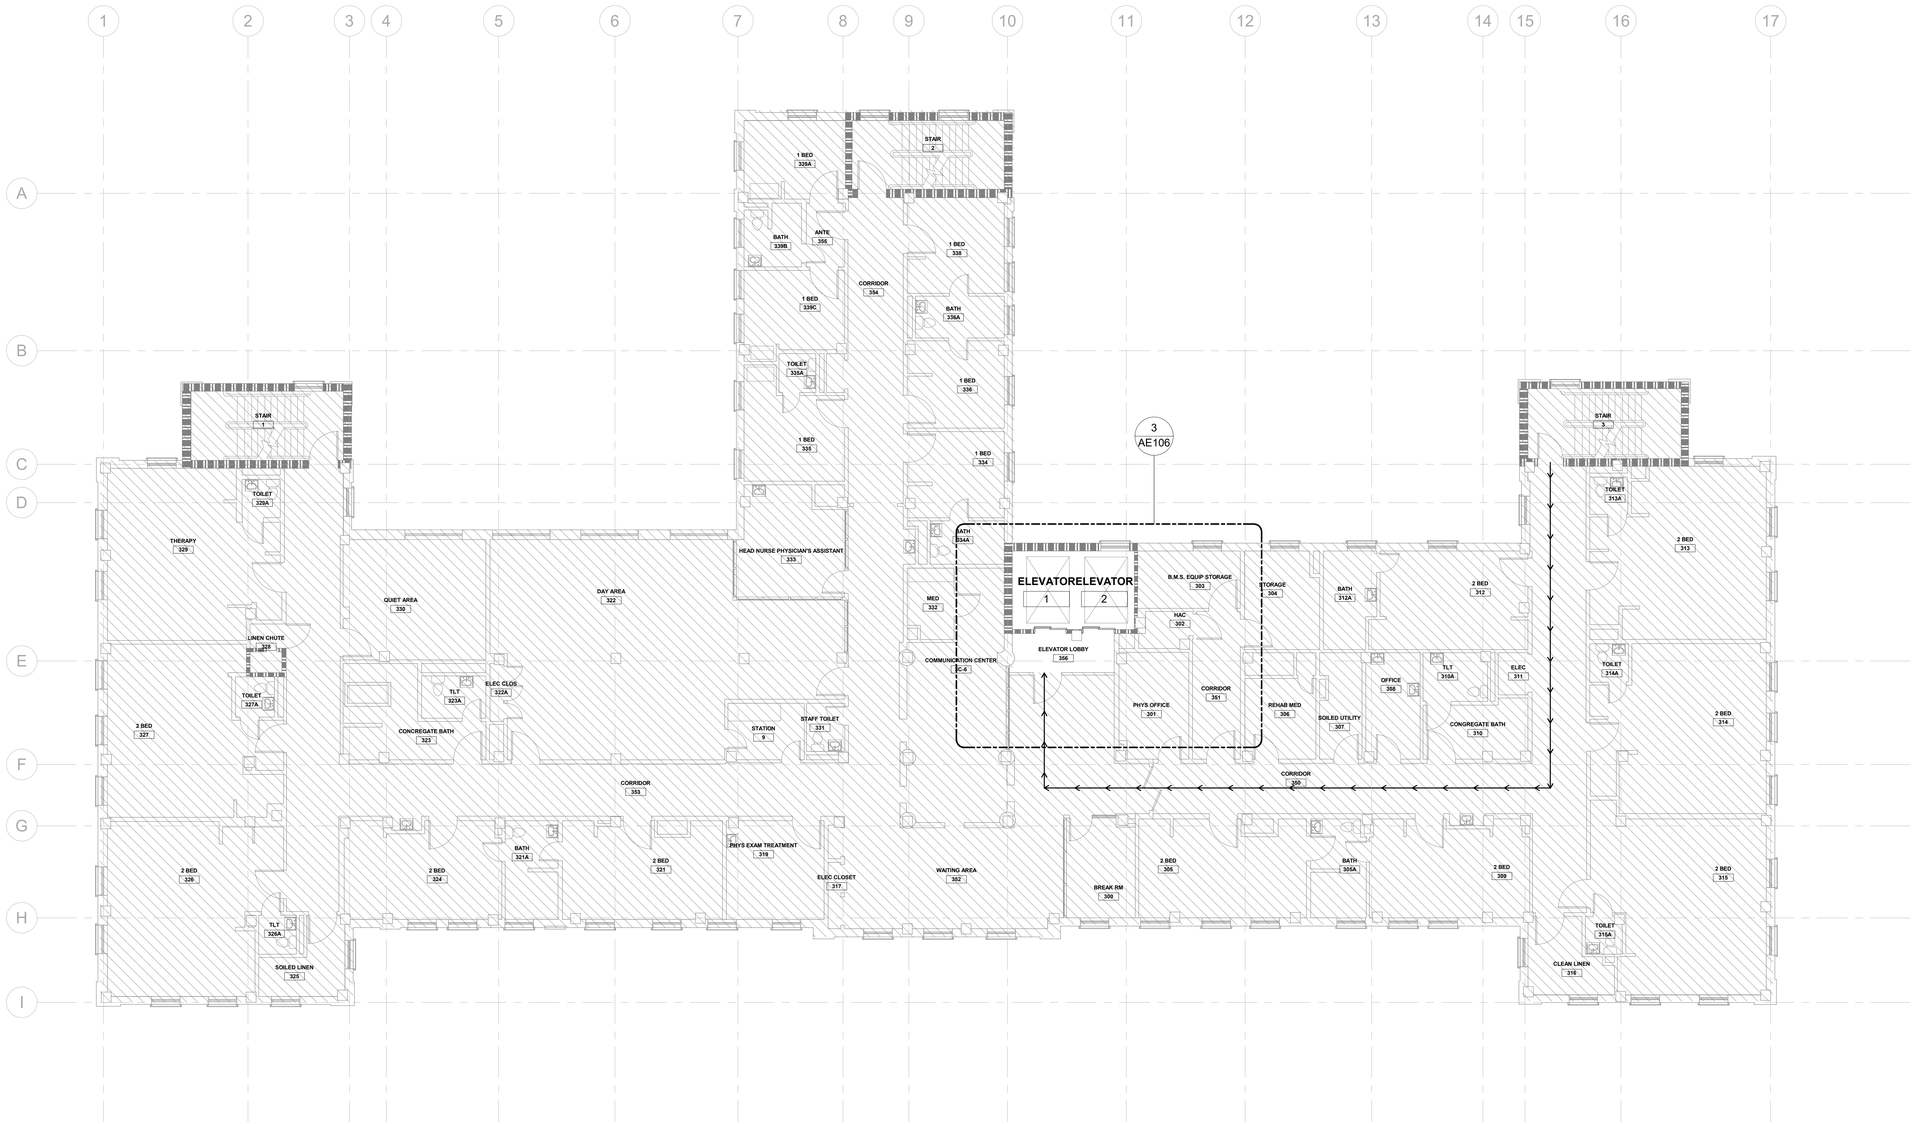

1 BUILDING 9 - LEVEL 03 - OVERALL FLOOR PLAN

1/8" = 1'-0"

PROJECT NORTH

TRUE NORTH (DASHED)

LEGEND

- OUT OF SCOPE
- CONTRACTOR PATH OF TRAVEL
- 2 HR FIRE RATED WALL (EXISTING)
- 1 HR FIRE RATED WALL (EXISTING)
- SMOKE RATED WALL (EXISTING)

Revisions:	Date:

CONSULTANT

ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246

SPEESDESIGNBUILD

STAMP

10000 REGISTERED ARCHITECT JAMES M. KING STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: BUILDING 9 - LEVEL 03 - OVERALL FLOOR PLAN

Approved:

Phase: 100% CONSTRUCTION DOCUMENTS

FULLY SPRINKLERED

Project Title: REPLACE ELEVATORS IN BLDG 7 & BLDG 9

Location: ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA

Project Number: 502-24-102

Building Number: 9

Drawing Number: A-108

Issue Date: 03/24/2026 | **Checked:** MK | **Drawn:** AJ

VA FORM 08 - 6231

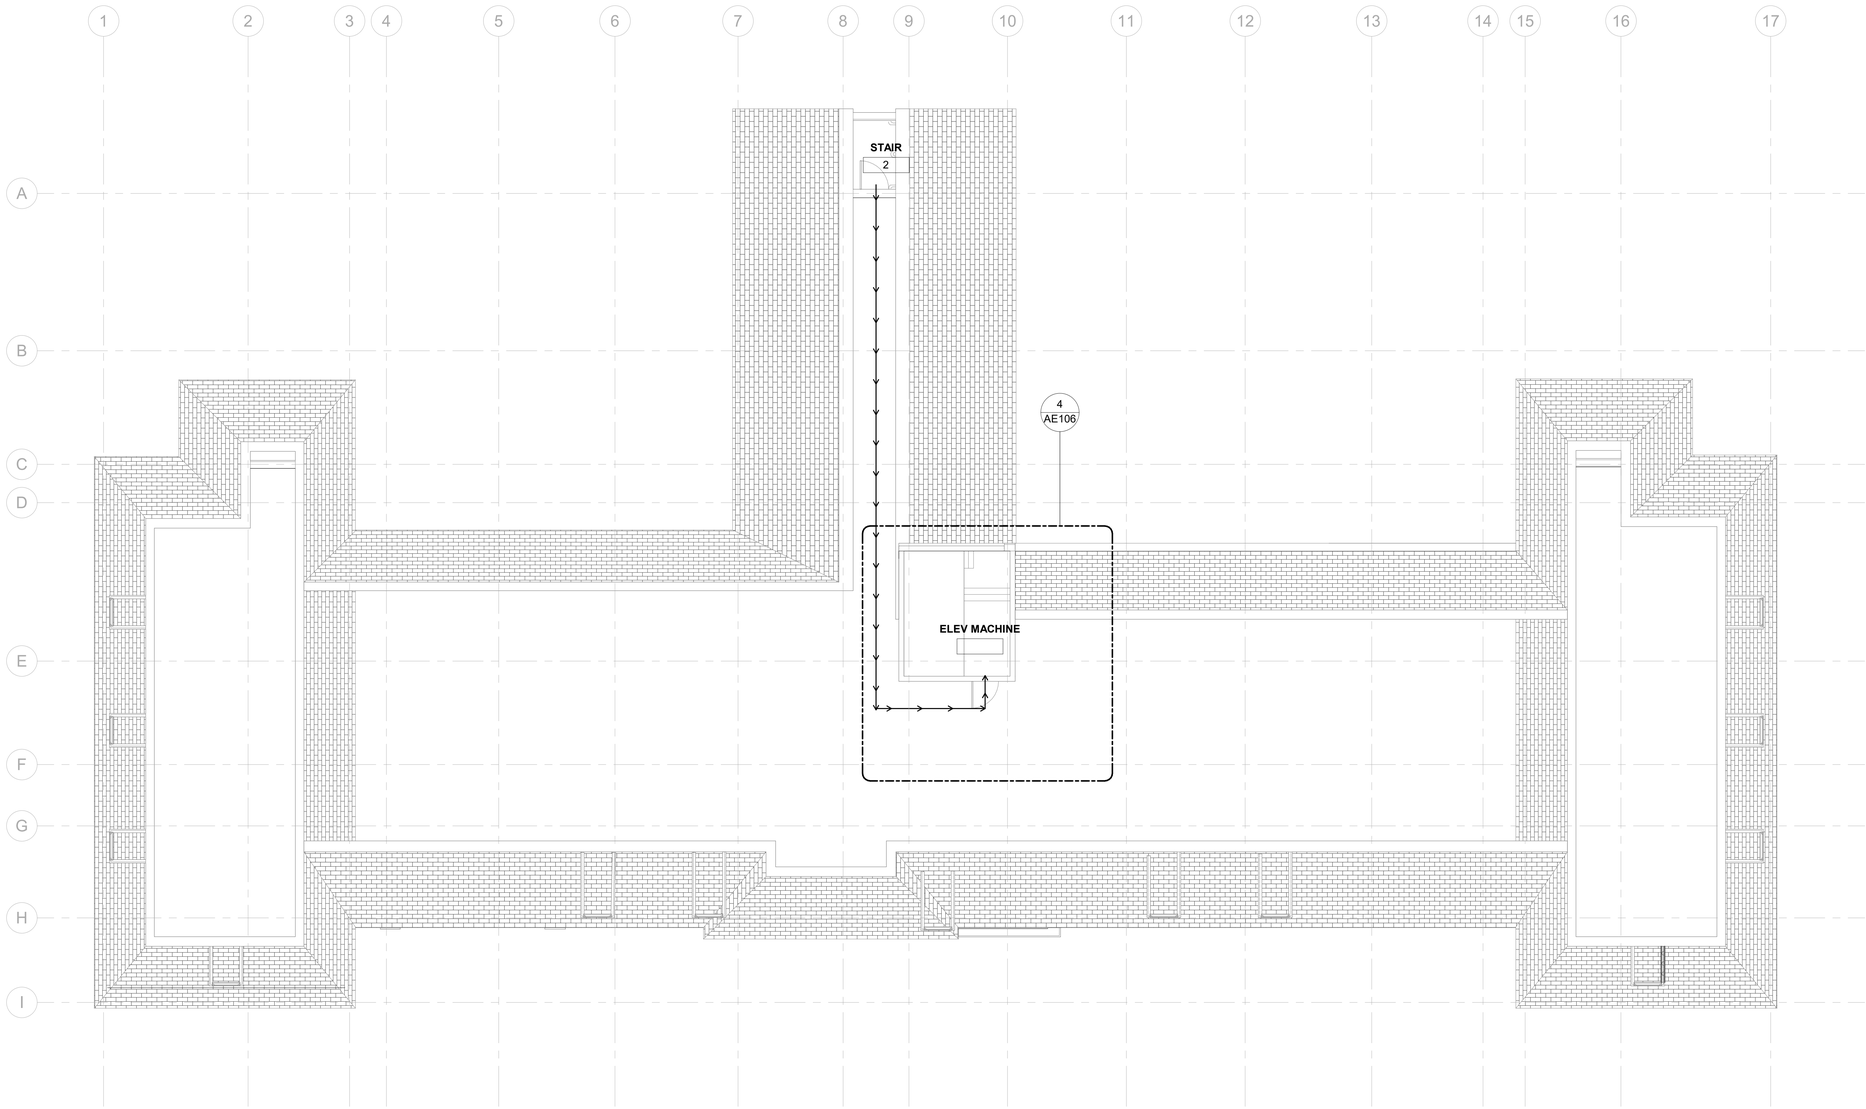

LEGEND

- OUT OF SCOPE
- CONTRACTOR PATH OF TRAVEL
- 2 HR FIRE RATED WALL (EXISTING)
- 1 HR FIRE RATED WALL (EXISTING)
- SMOKE RATED WALL (EXISTING)

1 BUILDING 9 - PENTHOUSE - OVERALL FLOOR PLAN

1/8" = 1'-0"

PROJECT NORTH

TRUE NORTH (DASHED)

Revisions:	Date:

CONSULTANT

ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD

A/E:

SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246

SDB SPEESDESIGNBUILD

STAMP

10000 REGISTERED ARCHITECT JAMES M. KING STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: BUILDING 9 - PENTHOUSE - OVERALL FLOOR PLAN

Approved:

Phase: 100% CONSTRUCTION DOCUMENTS

FULLY SPRINKLERED

Project Title: REPLACE ELEVATORS IN BLDG 7 & BLDG 9

Project Number: 502-24-102

Building Number: 9

Location: ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA

Drawing Number: A-109

Issue Date: 03/24/2026

Checked: MK

Drawn: AJ

VA FORM 08 - 6231

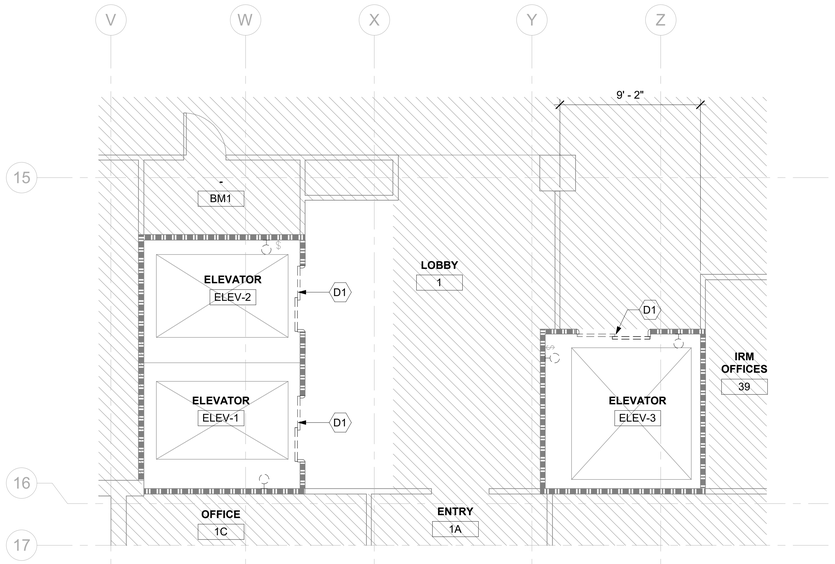

1 BUILDING 7 - BASEMENT - ELEV 1, 2 & 3 - DEMO ENLARGED PLAN

1/4" = 1'-0"

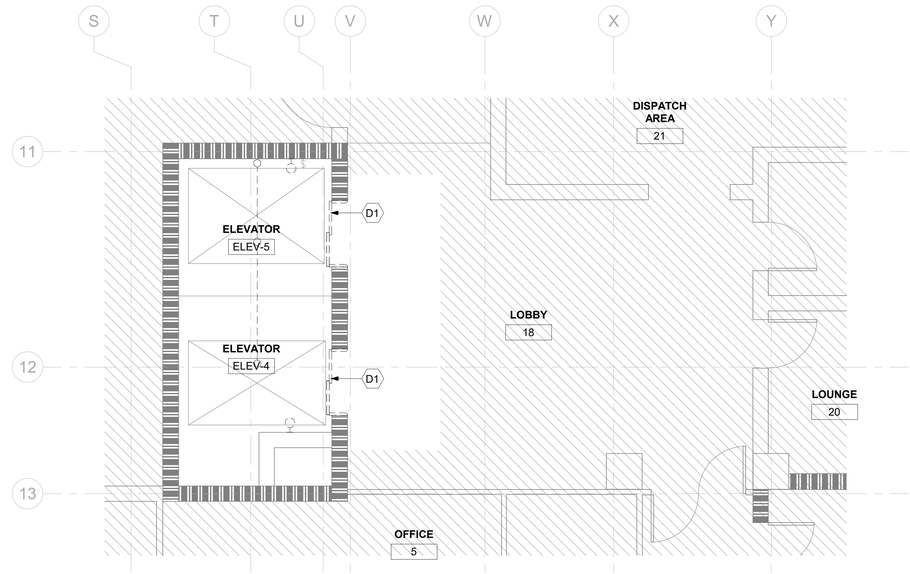

2 BUILDING 7 - BASEMENT - ELEV 4 & 5 - DEMO ENLARGED PLAN

1/4" = 1'-0"

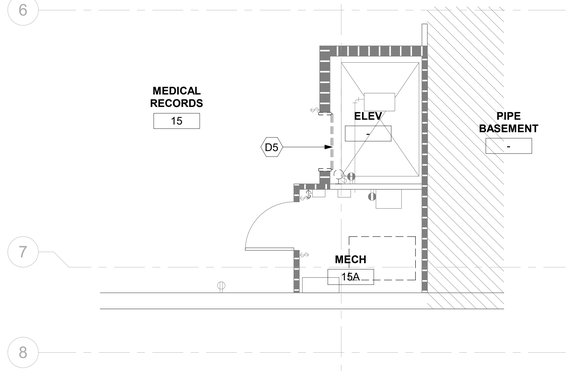

3 BUILDING 7 - BASEMENT - MED RECORDS ELEV - DEMO ENLARGED PLAN

1/4" = 1'-0"

4 BUILDING 7 - BASEMENT - SPS CART LIFT - DEMO ENLARGED FLOOR PLAN

1/4" = 1'-0"

LEGEND

- OUT OF SCOPE
- EXISTING DOOR TO REMAIN
- EXISTING DOOR TO DEMOLISH
- TO DEMOLISH
- EXISTING TO REMAIN
- 2 HR FIRE RATED WALL (EXISTING)
- SMOKE RATED WALL (EXISTING)
- DEMOLITION

KEY NOTES (THIS SHEET ONLY)

D1	DEMO EXISTING ELEVATOR DOOR, EXISTING FRAME AND SILL TO REMAIN, PREP FOR REFINISH.
D5	DEMOLISH EXISTING ELEVATOR DOORS, FRAME AND SILL. PREP FOR NEW.

GENERAL NOTES

1. ENSURE CONSTRUCTION ZONE IS FULLY ENCLOSED, PRIOR TO BEGINNING ANY WORK. NO WORK SHALL BE DONE WITHOUT PROPERLY MEETING ALL ICRA REQUIREMENTS, SEE ICRA PLAN(S) FOR SPECIFIC ICRA CLASS LOCATIONS & REQUIREMENTS.
2. REMOVE WALL MOUNTED ACCESSORIES REQUIRED TO COMPLETE A CONSTRUCTION TASK. VERIFY WITH COR BEFORE DISPOSAL.
3. COORDINATE WITH VA COR PRIOR TO THE DEMOLITION OF ANY EXISTING EQUIPMENT.
4. SEE ELEVATOR REPORTS FOR ALL NEW ELEVATOR EQUIPMENT.
5. ALL PERSONNEL WORKING IN SURGERY AND SPS MUST WEAR PROPER DONNING AS THESE AREAS ARE STERILE AREAS.
6. SEE MECHANICAL AND ELECTRICAL DRAWINGS FOR DEMOLITION OF EXISTING EQUIPMENT, LIGHTS. ETC. PATCH AND PAINT ANY PENETRATIONS WHERE PIPES, CONDUITS, ETC. WHERE DEMOLISHED.

KEY PLAN

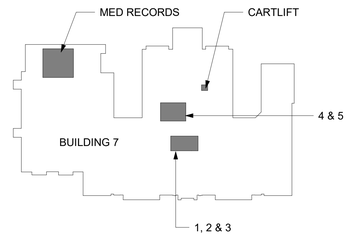

AREA SHOWN

Revisions:	Date:

CONSULTANT

ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246

SPEESDESIGNBUILD

STAMP

10000 REGISTERED ARCHITECT JAMES M. KING STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: BUILDING 7 - BASEMENT - DEMO ENLARGED PLANS

Phase: 100% CONSTRUCTION DOCUMENTS

Approved:

FULLY SPRINKLERED

Project Title: REPLACE ELEVATORS IN BLDG 7 & BLDG 9

Project Number: 502-24-102

Building Number: 7

Location: ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA

Drawing Number: AD100

Issue Date: 03/24/2026

Checked: MK

Drawn: AJ

VA FORM 08 - 6231

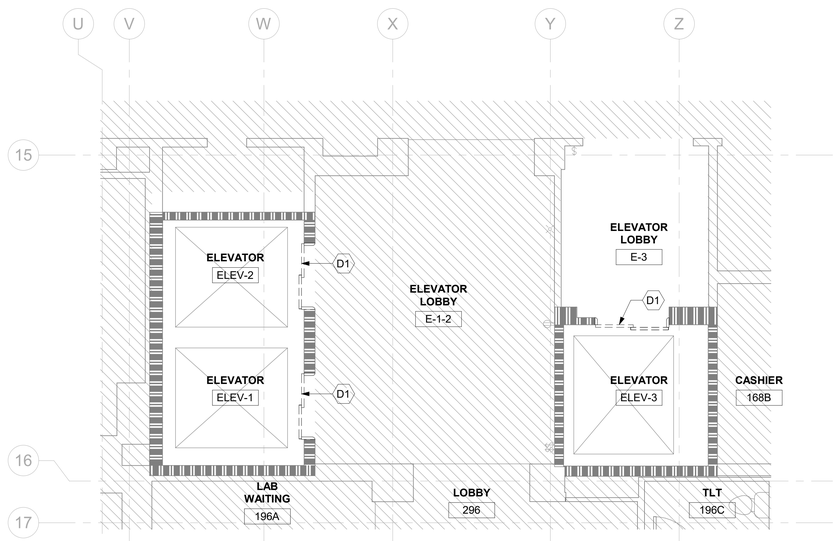

1 BUILDING 7 - LEVEL 01 - ELEV 1, 2 & 3 - DEMO ENLARGED PLAN

1/4" = 1'-0"

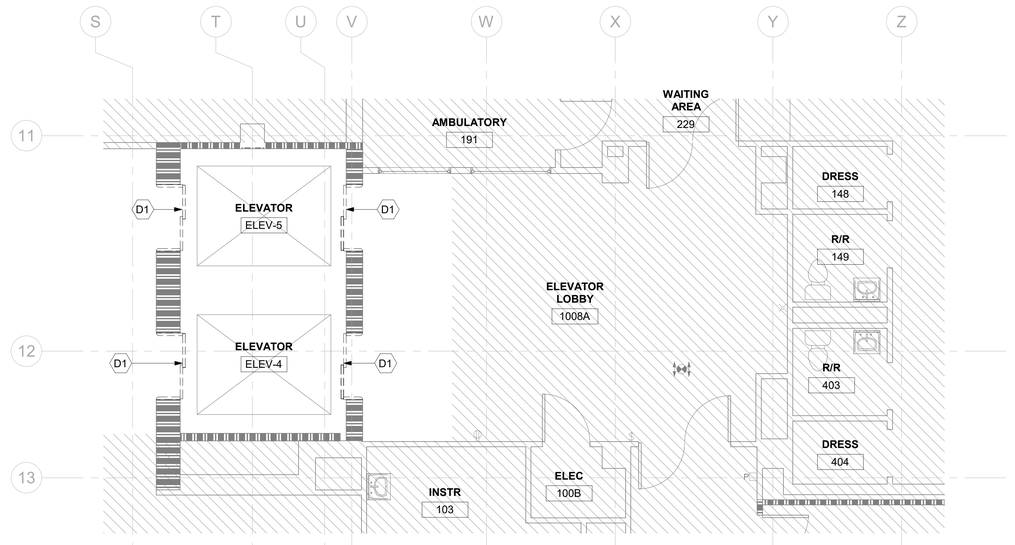

2 BUILDING 7 - LEVEL 01 - ELEV 4 & 5 - DEMO ENLARGED PLAN

1/4" = 1'-0"

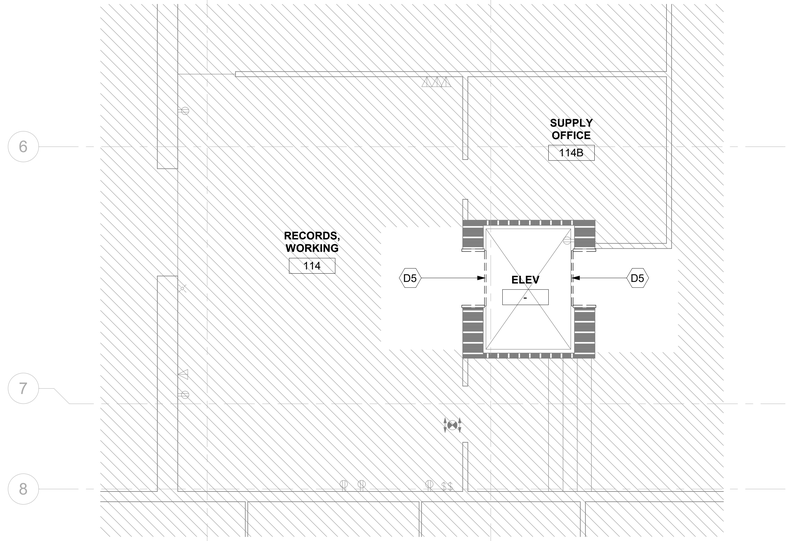

3 BUILDING 7 - LEVEL 01 - MED RECORDS ELEV - DEMO ENLARGED PLAN

1/4" = 1'-0"

LEGEND

- OUT OF SCOPE
- EXISTING DOOR TO REMAIN
- EXISTING DOOR TO DEMOLISH
- TO DEMOLISH
- EXISTING TO REMAIN
- 2 HR FIRE RATED WALL (EXISTING)
- SMOKE RATED WALL (EXISTING)
- DEMOLITION

KEY NOTES (THIS SHEET ONLY)

D1	DEMO EXISTING ELEVATOR DOOR, EXISTING FRAME AND SILL TO REMAIN, PREP FOR REFINISH.
D5	DEMOLISH EXISTING ELEVATOR DOORS, FRAME AND SILL. PREP FOR NEW.

GENERAL NOTES

1. ENSURE CONSTRUCTION ZONE IS FULLY ENCLOSED, PRIOR TO BEGINNING ANY WORK. NO WORK SHALL BE DONE WITHOUT PROPERLY MEETING ALL ICRA REQUIREMENTS, SEE ICRA PLAN(S) FOR SPECIFIC ICRA CLASS LOCATIONS & REQUIREMENTS.
2. REMOVE WALL MOUNTED ACCESSORIES REQUIRED TO COMPLETE A CONSTRUCTION TASK. VERIFY WITH COR BEFORE DISPOSAL.
3. COORDINATE WITH VA COR PRIOR TO THE DEMOLITION OF ANY EXISTING EQUIPMENT.
4. SEE ELEVATOR REPORTS FOR ALL NEW ELEVATOR EQUIPMENT.
5. ALL PERSONNEL WORKING IN SURGERY AND SPS MUST WEAR PROPER DONNING AS THESE AREAS ARE STERILE AREAS.
6. SEE MECHANICAL AND ELECTRICAL DRAWINGS FOR DEMOLITION OF EXISTING EQUIPMENT, LIGHTS. ETC. PATCH AND PAINT ANY PENETRATIONS WHERE PIPES, CONDUITS, ETC. WHERE DEMOLISHED.

KEY PLAN

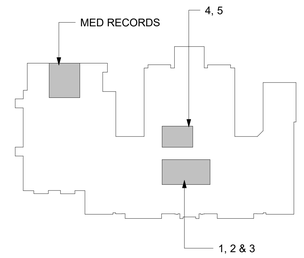

AREA SHOWN

Revisions:	Date:

CONSULTANT

ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246

SDB SPEESDESIGNBUILD

STAMP

REGISTERED ARCHITECT 10000 JAMES M. KING STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: BUILDING 7 - LEVEL 01 - DEMO ENLARGED PLANS

Approved:

Phase: 100% CONSTRUCTION DOCUMENTS

FULLY SPRINKLERED

Project Title: REPLACE ELEVATORS IN BLDG 7 & BLDG 9

Location: ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA

Issue Date: 03/24/2026 | Checked: MK | Drawn: AJ

Project Number: 502-24-102

Building Number: 7

Drawing Number: AD101

VA FORM 08 - 6231

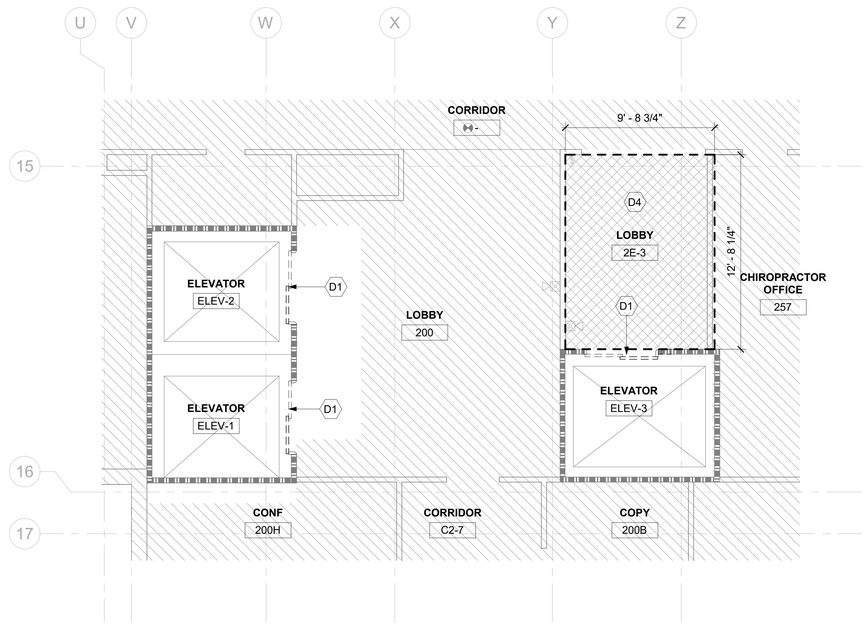

1 BUILDING 7 - LEVEL 02 - ELEV 1, 2 & 3 - DEMO ENLARGED PLAN

1/4" = 1'-0"

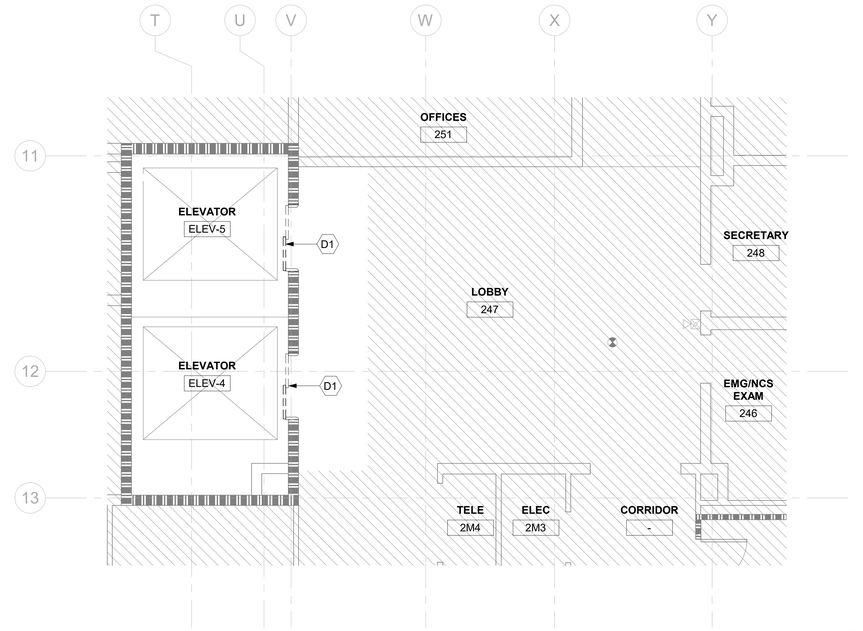

2 BUILDING 7 - LEVEL 02 - ELEV 4 & 5 - DEMO ENLARGED PLAN

1/4" = 1'-0"

LEGEND

- OUT OF SCOPE
- EXISTING DOOR TO REMAIN
- EXISTING DOOR TO DEMOLISH
- TO DEMOLISH
- EXISTING TO REMAIN
- 2 HR FIRE RATED WALL (EXISTING)
- SMOKE RATED WALL (EXISTING)
- DEMOLITION

KEY NOTES (THIS SHEET ONLY)

D1	DEMO EXISTING ELEVATOR DOOR, EXISTING FRAME AND SILL TO REMAIN, PREP FOR REFINISH.
D4	DEMO EXISTING ELEVATOR LOBBY FLOOR, INCLUDING ASSOCIATED ADHESIVE (BLACK MASTIC). ABATEMENT SHALL BE PERFORMED. PROTECT ADJACENT FINISHES, ELEVATOR EQUIPMENT, AND OCCUPIED AREAS. CONTRACTOR TO VERIFY EXTENTS WITH ENVIRONMENTAL SURVEY REPORT.

GENERAL NOTES

1. ENSURE CONSTRUCTION ZONE IS FULLY ENCLOSED, PRIOR TO BEGINNING ANY WORK. NO WORK SHALL BE DONE WITHOUT PROPERLY MEETING ALL ICRA REQUIREMENTS, SEE ICRA PLAN(S) FOR SPECIFIC ICRA CLASS LOCATIONS & REQUIREMENTS.
2. REMOVE WALL MOUNTED ACCESSORIES REQUIRED TO COMPLETE A CONSTRUCTION TASK. VERIFY WITH COR BEFORE DISPOSAL.
3. COORDINATE WITH VA COR PRIOR TO THE DEMOLITION OF ANY EXISTING EQUIPMENT.
4. SEE ELEVATOR REPORTS FOR ALL NEW ELEVATOR EQUIPMENT.
5. ALL PERSONNEL WORKING IN SURGERY AND SPS MUST WEAR PROPER DONNING AS THESE AREAS ARE STERILE AREAS.
6. SEE MECHANICAL AND ELECTRICAL DRAWINGS FOR DEMOLITION OF EXISTING EQUIPMENT, LIGHTS, ETC. PATCH AND PAINT ANY PENETRATIONS WHERE PIPES, CONDUITS, ETC. WHERE DEMOLISHED.

KEY PLAN

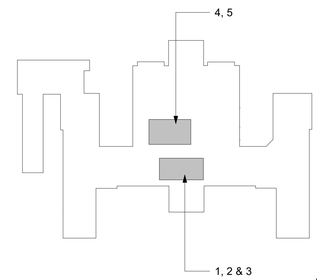

AREA SHOWN

Revisions:	Date:

CONSULTANT

ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246

SPEESDESIGNBUILD

STAMP

10000 REGISTERED ARCHITECT JAMES W. KING STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: BUILDING 7 - LEVEL 02 - DEMO ENLARGED PLANS

Approved:

Phase: 100% CONSTRUCTION DOCUMENTS

FULLY SPRINKLERED

Project Title: REPLACE ELEVATORS IN BLDG 7 & BLDG 9

Project Number: 502-24-102

Building Number: 7

Location: ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA

Issue Date: 03/24/2026

Checked: MK

Drawn: AJ

Drawing Number: AD102

VA FORM 08 - 6231

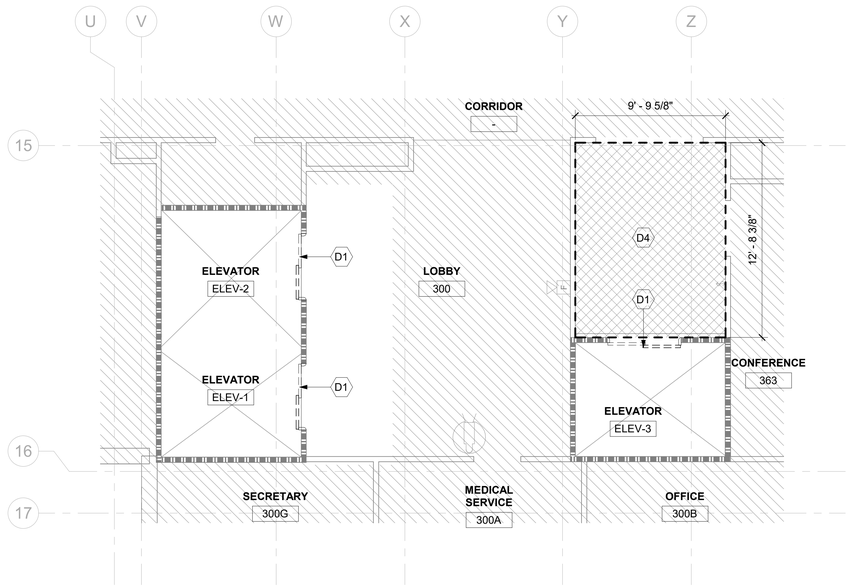

1 BUILDING 7 - LEVEL 03 - ELEV 1, 2 & 3 - DEMO ENLARGED PLAN

1/4" = 1'-0"

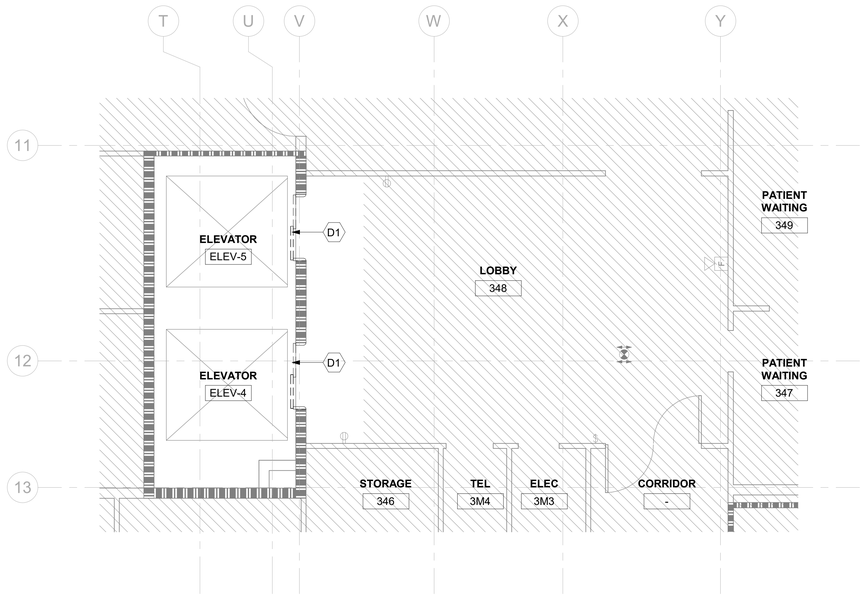

2 BUILDING 7 - LEVEL 03 - ELEV 4 & 5 - DEMO ENLARGED PLAN

1/4" = 1'-0"

LEGEND

- OUT OF SCOPE
- EXISTING DOOR TO REMAIN
- EXISTING DOOR TO DEMOLISH
- TO DEMOLISH
- EXISTING TO REMAIN
- 2 HR FIRE RATED WALL (EXISTING)
- SMOKE RATED WALL (EXISTING)
- DEMOLITION

KEY NOTES (THIS SHEET ONLY)

D1	DEMO EXISTING ELEVATOR DOOR, EXISTING FRAME AND SILL TO REMAIN, PREP FOR REFINISH.
D4	DEMO EXISTING ELEVATOR LOBBY FLOOR, INCLUDING ASSOCIATED ADHESIVE (BLACK MASTIC). ABATEMENT SHALL BE PERFORMED. PROTECT ADJACENT FINISHES, ELEVATOR EQUIPMENT, AND OCCUPIED AREAS. CONTRACTOR TO VERIFY EXTENTS WITH ENVIRONMENTAL SURVEY REPORT.

GENERAL NOTES

1. ENSURE CONSTRUCTION ZONE IS FULLY ENCLOSED, PRIOR TO BEGINNING ANY WORK. NO WORK SHALL BE DONE WITHOUT PROPERLY MEETING ALL ICRA REQUIREMENTS, SEE ICRA PLAN(S) FOR SPECIFIC ICRA CLASS LOCATIONS & REQUIREMENTS.
2. REMOVE WALL MOUNTED ACCESSORIES REQUIRED TO COMPLETE A CONSTRUCTION TASK. VERIFY WITH COR BEFORE DISPOSAL.
3. COORDINATE WITH VA COR PRIOR TO THE DEMOLITION OF ANY EXISTING EQUIPMENT.
4. SEE ELEVATOR REPORTS FOR ALL NEW ELEVATOR EQUIPMENT.
5. ALL PERSONNEL WORKING IN SURGERY AND SPS MUST WEAR PROPER DONNING AS THESE AREAS ARE STERILE AREAS.
6. SEE MECHANICAL AND ELECTRICAL DRAWINGS FOR DEMOLITION OF EXISTING EQUIPMENT, LIGHTS. ETC. PATCH AND PAINT ANY PENETRATIONS WHERE PIPES, CONDUITS, ETC. WHERE DEMOLISHED.

KEY PLAN



AREA SHOWN

Revisions:	Date:

CONSULTANT

ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246

SPEESDESIGNBUILD

STAMP

10000 REGISTERED ARCHITECT JAMES M. KING STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: BUILDING 7 - LEVEL 03 - DEMO ENLARGED PLANS

Phase: 100% CONSTRUCTION DOCUMENTS

Approved:

FULLY SPRINKLERED

Project Title: REPLACE ELEVATORS IN BLDG 7 & BLDG 9

Location: ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA

Issue Date: 03/24/2026 | Checked: MK | Drawn: AJ

Project Number: 502-24-102

Building Number: 7

Drawing Number: AD103

VA FORM 08 - 6231

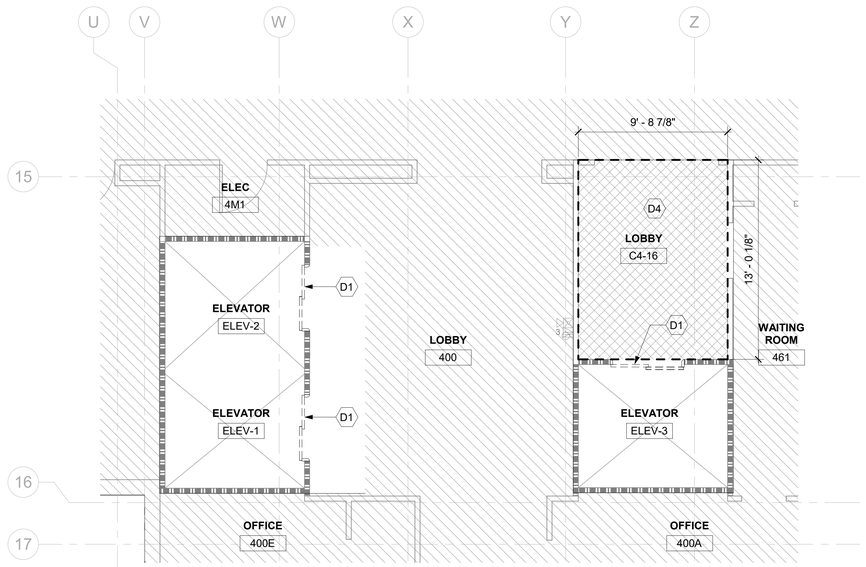

1 BUILDING 7 - LEVEL 04 - ELEV 1, 2 & 3 - DEMO ENLARGED PLAN

1/4" = 1'-0"

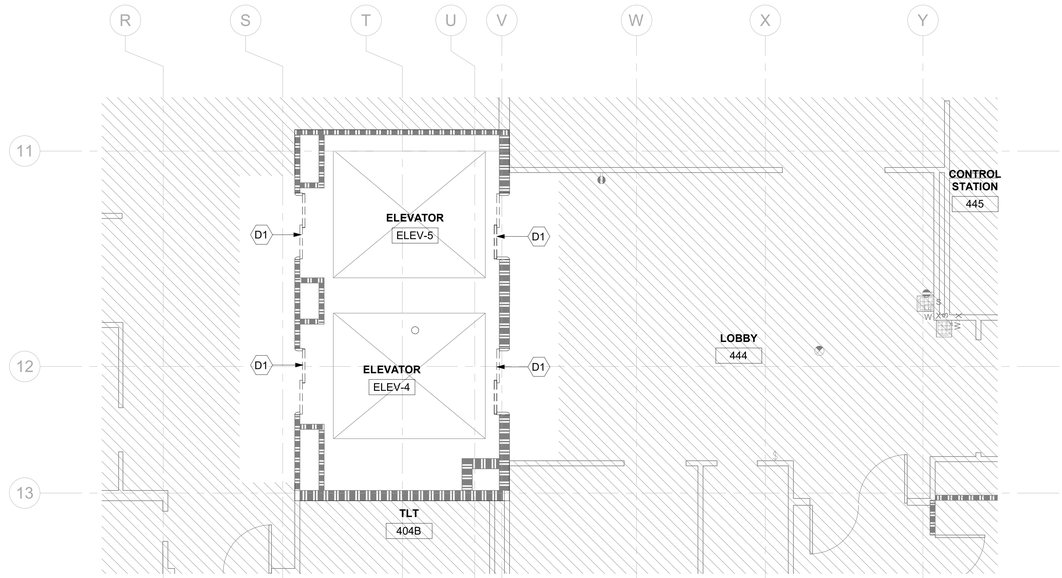

2 BUILDING 7 - LEVEL 04 - ELEV 4 & 5 - DEMO ENLARGED PLAN

1/4" = 1'-0"

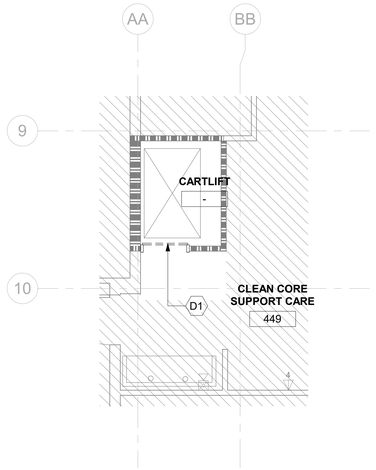

3 BUILDING 7 - LEVEL 04 - SPS CARTLIFT - DEMO ENLARGED PLAN

1/4" = 1'-0"

LEGEND

- OUT OF SCOPE
- EXISTING DOOR TO REMAIN
- EXISTING DOOR TO DEMOLISH
- TO DEMOLISH
- EXISTING TO REMAIN
- 2 HR FIRE RATED WALL (EXISTING)
- SMOKE RATED WALL (EXISTING)
- DEMOLITION

KEY NOTES (THIS SHEET ONLY)

D1	DEMO EXISTING ELEVATOR DOOR, EXISTING FRAME AND SILL TO REMAIN, PREP FOR REFINISH.
D4	DEMO EXISTING ELEVATOR LOBBY FLOOR, INCLUDING ASSOCIATED ADHESIVE (BLACK MASTIC). ABATEMENT SHALL BE PERFORMED. PROTECT ADJACENT FINISHES, ELEVATOR EQUIPMENT, AND OCCUPIED AREAS. CONTRACTOR TO VERIFY EXTENTS WITH ENVIRONMENTAL SURVEY REPORT.

GENERAL NOTES

1. ENSURE CONSTRUCTION ZONE IS FULLY ENCLOSED, PRIOR TO BEGINNING ANY WORK. NO WORK SHALL BE DONE WITHOUT PROPERLY MEETING ALL ICRA REQUIREMENTS, SEE ICRA PLAN(S) FOR SPECIFIC ICRA CLASS LOCATIONS & REQUIREMENTS.
2. REMOVE WALL MOUNTED ACCESSORIES REQUIRED TO COMPLETE A CONSTRUCTION TASK. VERIFY WITH COR BEFORE DISPOSAL.
3. COORDINATE WITH VA COR PRIOR TO THE DEMOLITION OF ANY EXISTING EQUIPMENT.
4. SEE ELEVATOR REPORTS FOR ALL NEW ELEVATOR EQUIPMENT.
5. ALL PERSONNEL WORKING IN SURGERY AND SPS MUST WEAR PROPER DONNING AS THESE AREAS ARE STERILE AREAS.
6. SEE MECHANICAL AND ELECTRICAL DRAWINGS FOR DEMOLITION OF EXISTING EQUIPMENT, LIGHTS. ETC. PATCH AND PAINT ANY PENETRATIONS WHERE PIPES, CONDUITS, ETC. WHERE DEMOLISHED.

KEY PLAN



Revisions:	Date:

CONSULTANT

ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246

SPEESDESIGNBUILD

STAMP

10000 REGISTERED ARCHITECT JAMES M. KING STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: BUILDING 7 - LEVEL 04 - DEMO ENLARGED PLANS	Phase: 100% CONSTRUCTION DOCUMENTS
Approved:	FULLY SPRINKLERED

Project Title: REPLACE ELEVATORS IN BLDG 7 & BLDG 9	Project Number: 502-24-102
	Building Number: 7
Location: ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA	Drawing Number: AD104
Issue Date: 03/24/2026 / Checked: MK / Drawn: AJ	

VA FORM 08 - 6231

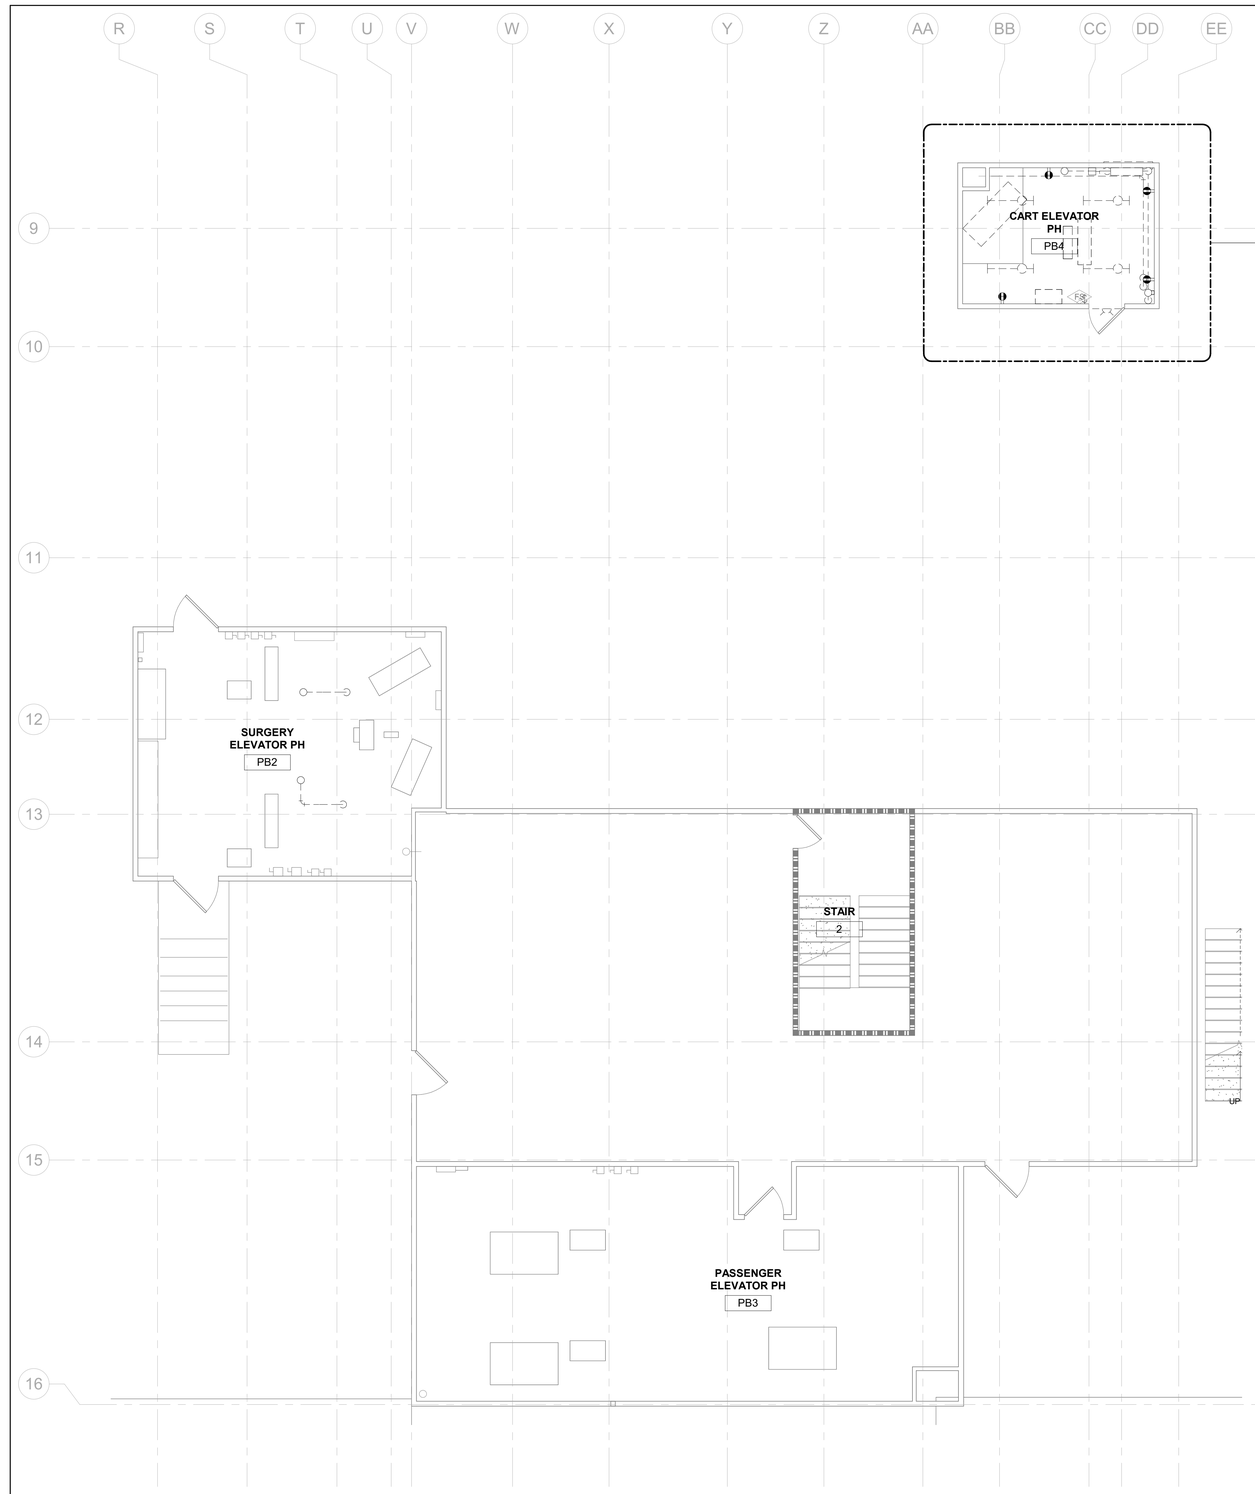

1 BUILDING 7 - PENTHOUSE - DEMO ENLARGED PLAN
3/16" = 1'-0"

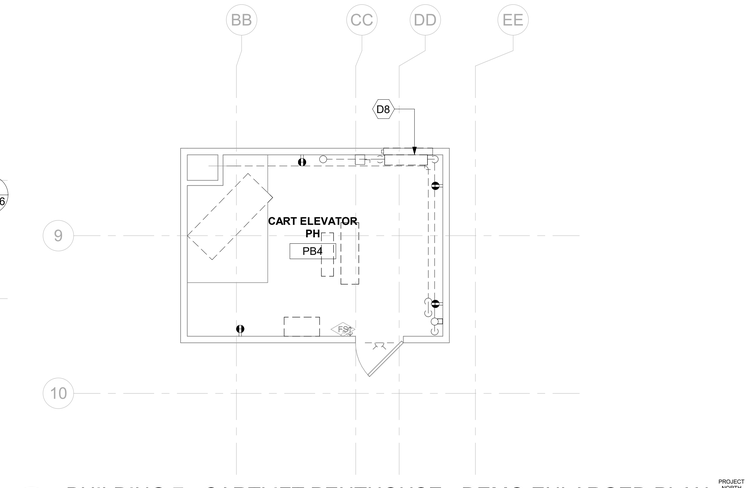

2 BUILDING 7 - CARTLIFT PENTHOUSE - DEMO ENLARGED PLAN
1/4" = 1'-0"



3 BLDG 7 - CARTLIFT PENTHOUSE - DEMO ROOF PLAN
1/4" = 1'-0"

LEGEND

- OUT OF SCOPE
- EXISTING DOOR TO REMAIN
- EXISTING DOOR TO DEMOLISH
- TO DEMOLISH
- EXISTING TO REMAIN
- 2 HR FIRE RATED WALL (EXISTING)
- SMOKE RATED WALL (EXISTING)
- DEMOLITION

KEY NOTES (THIS SHEET ONLY)

D8	DEMO EXISTING LOUVER, PREP TO INFILL
D10	DEMO EXHAUST FAN ON ROOF, SEE MECH. PREP TO INFILL CONCRETE CURB.

GENERAL NOTES

1. ENSURE CONSTRUCTION ZONE IS FULLY ENCLOSED, PRIOR TO BEGINNING ANY WORK. NO WORK SHALL BE DONE WITHOUT PROPERLY MEETING ALL ICRA REQUIREMENTS, SEE ICRA PLAN(S) FOR SPECIFIC ICRA CLASS LOCATIONS & REQUIREMENTS.
2. REMOVE WALL MOUNTED ACCESSORIES REQUIRED TO COMPLETE A CONSTRUCTION TASK. VERIFY WITH COR BEFORE DISPOSAL.
3. COORDINATE WITH VA COR PRIOR TO THE DEMOLITION OF ANY EXISTING EQUIPMENT.
4. SEE ELEVATOR REPORTS FOR ALL NEW ELEVATOR EQUIPMENT.
5. ALL PERSONNEL WORKING IN SURGERY AND SPS MUST WEAR PROPER DONNING AS THESE AREAS ARE STERILE AREAS.
6. SEE MECHANICAL AND ELECTRICAL DRAWINGS FOR DEMOLITION OF EXISTING EQUIPMENT, LIGHTS, ETC. PATCH AND PAINT ANY PENETRATIONS WHERE PIPES, CONDUITS, ETC. WHERE DEMOLISHED.

KEY PLAN

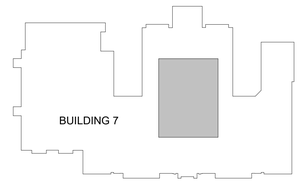

AREA SHOWN

Revisions:	Date:

CONSULTANT
ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD
A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246
SPEESDESIGNBUILD

STAMP
10000 REGISTERED ARCHITECT JAMES M. KING STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management
VA U.S. Department of Veterans Affairs

Drawing Title: BUILDING 7 - PENTHOUSE - DEMO ENLARGED PLANS	Phase: 100% CONSTRUCTION DOCUMENTS	Project Title: REPLACE ELEVATORS IN BLDG 7 & BLDG 9	Project Number: 502-24-102
			Building Number: 7
Approved:	FULLY SPRINKLERED	Location: ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA	Drawing Number: AD106
		Issue Date: 03/24/2026 / Checked: MK / Drawn: AJ	

VA FORM 08 - 6231

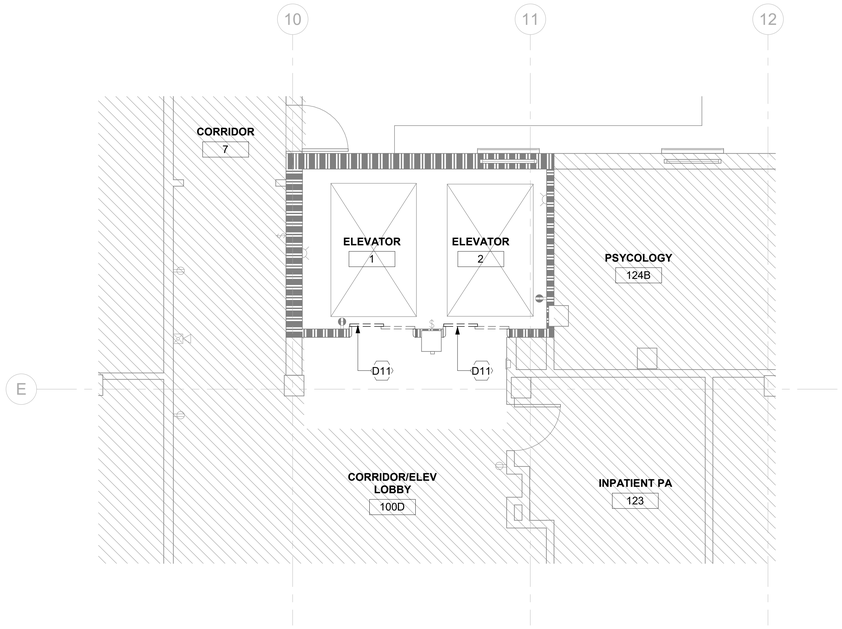

1 BUILDING 9 - LEVEL 01 - ELEV 1 & 2 - DEMO ENLARGED PLAN
1/4" = 1'-0"

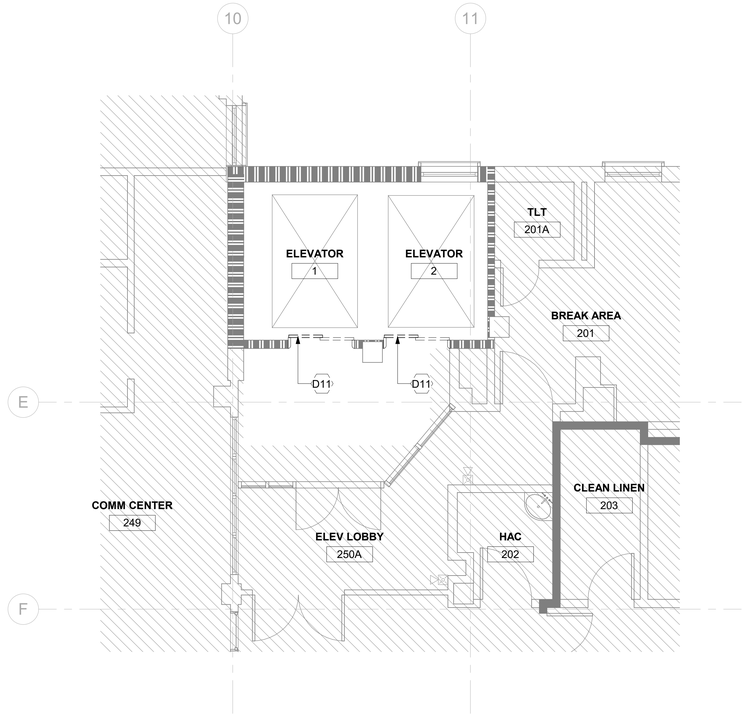

2 BUILDING 9 - LEVEL 02 - ELEV 1 & 2 - DEMO ENLARGED PLAN
1/4" = 1'-0"

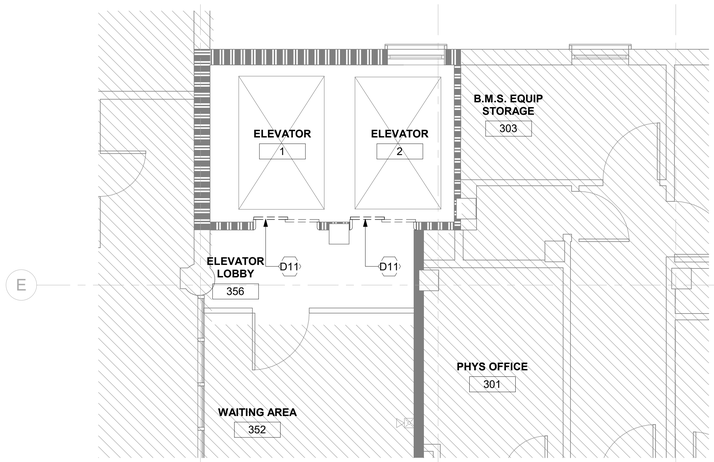

3 BUILDING 9 - LEVEL 03 - ELEV 1 & 2 - DEMO ENLARGED PLAN
1/4" = 1'-0"

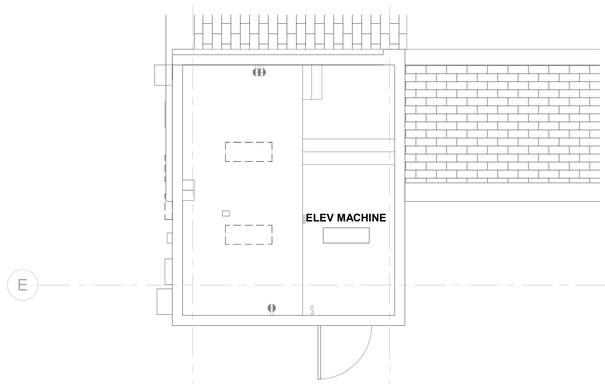

4 BUILDING 9 - PENTHOUSE - DEMO ENLARGED PLAN
1/4" = 1'-0"

LEGEND

- OUT OF SCOPE
- EXISTING DOOR TO REMAIN
- EXISTING DOOR TO DEMOLISH
- TO DEMOLISH
- EXISTING TO REMAIN
- 2 HR FIRE RATED WALL (EXISTING)
- SMOKE RATED WALL (EXISTING)
- DEMOLITION

KEY NOTES (THIS SHEET ONLY)

D11	DEMO EXISTING ELEVATOR DOOR AND SILL. EXISTING FRAME TO REMAIN, PREP FOR REFINISH.

GENERAL NOTES

1. ENSURE CONSTRUCTION ZONE IS FULLY ENCLOSED, PRIOR TO BEGINNING ANY WORK. NO WORK SHALL BE DONE WITHOUT PROPERLY MEETING ALL ICRA REQUIREMENTS, SEE ICRA PLAN(S) FOR SPECIFIC ICRA CLASS LOCATIONS & REQUIREMENTS.
2. REMOVE WALL MOUNTED ACCESSORIES REQUIRED TO COMPLETE A CONSTRUCTION TASK. VERIFY WITH COR BEFORE DISPOSAL.
3. COORDINATE WITH VA COR PRIOR TO THE DEMOLITION OF ANY EXISTING EQUIPMENT.
4. SEE ELEVATOR REPORTS FOR ALL NEW ELEVATOR EQUIPMENT.
5. ALL PERSONNEL WORKING IN SURGERY AND SPS MUST WEAR PROPER DONNING AS THESE AREAS ARE STERILE AREAS.
6. SEE MECHANICAL AND ELECTRICAL DRAWINGS FOR DEMOLITION OF EXISTING EQUIPMENT, LIGHTS. ETC. PATCH AND PAINT ANY PENETRATIONS WHERE PIPES, CONDUITS, ETC. WHERE DEMOLISHED.

KEY PLAN

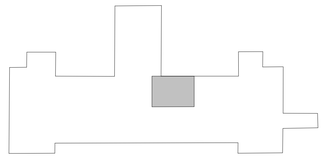

AREA SHOWN

Revisions:	Date:

CONSULTANT

ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246

SPEESDESIGNBUILD

STAMP

10000 REGISTERED ARCHITECT JAMES M. KING STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title	BUILDING 9 - LEVELS 01, 02, 03, PH. - DEMO ENLARGED PLANS
Phase	100% CONSTRUCTION DOCUMENTS
Approved:	
	FULLY SPRINKLERED
Project Title	REPLACE ELEVATORS IN BLDG 7 & BLDG 9
Project Number	502-24-102
Building Number	9
Location	ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA
Drawing Number	AD107
Issue Date	03/24/2026
Checked	MK
Drawn	AJ

VA FORM 08 - 6231

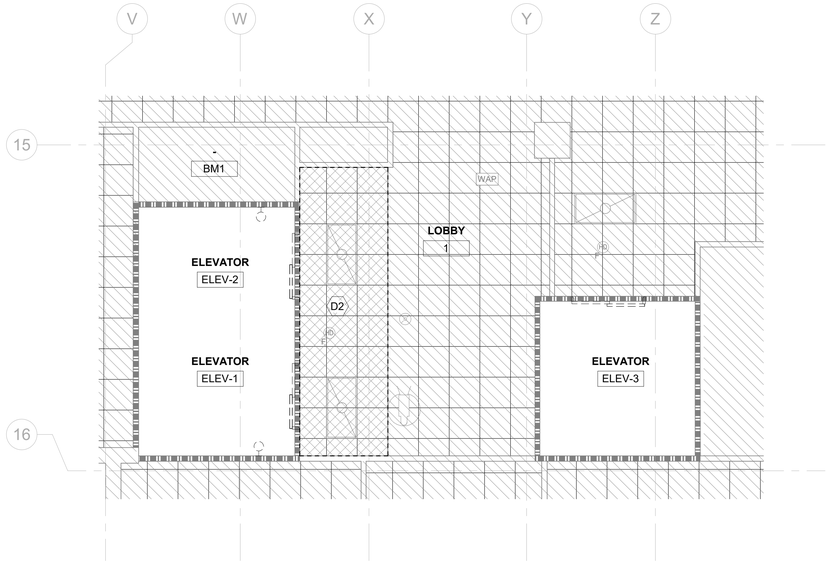

1 BUILDING 7 - BASEMENT - ELEV 1, 2, & 3 - DEMO ENLARGED RCP

1/4" = 1'-0"

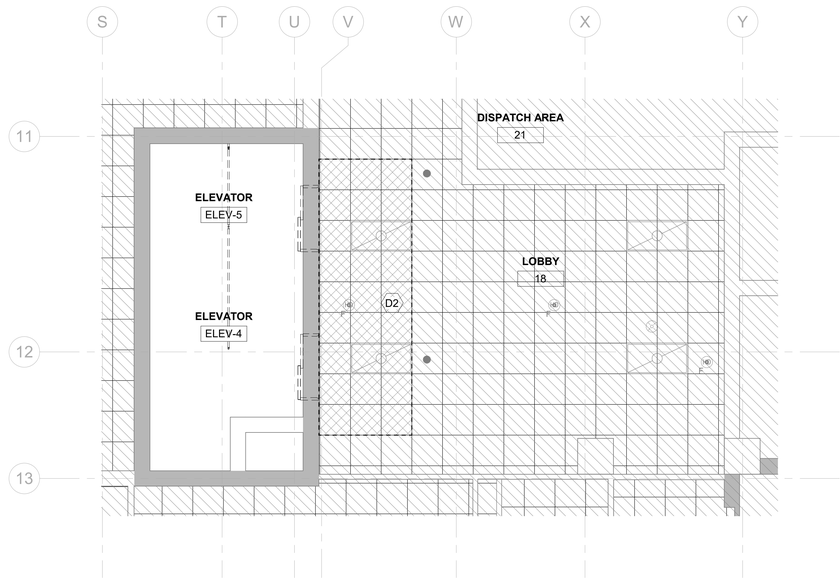

2 BUILDING 7 - BASEMENT - ELEV 4 & 5 - DEMO ENLARGED RCP

1/4" = 1'-0"

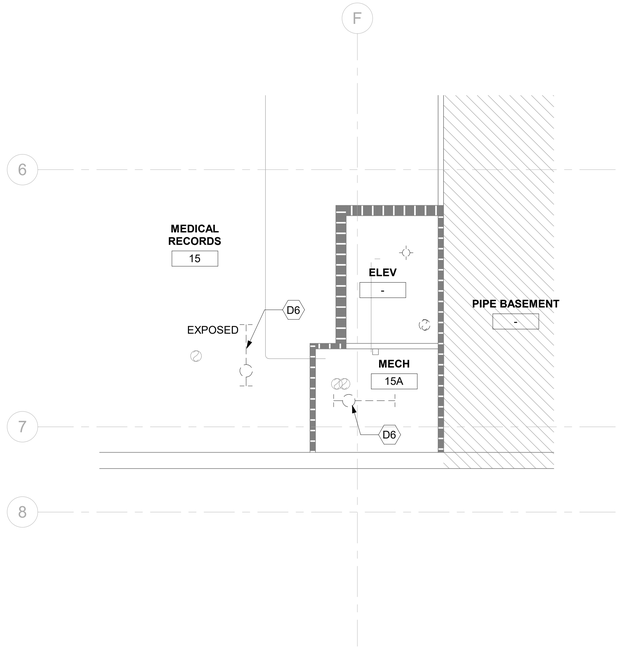

3 BUILDING 7 - BASEMENT - MED RECORDS ELEV - DEMO ENLARGED RCP

1/4" = 1'-0"

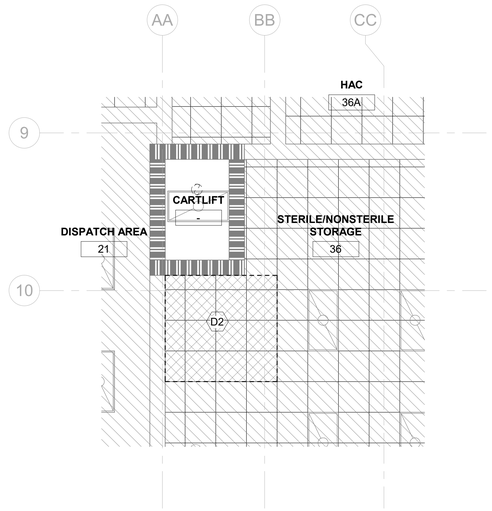

4 BUILDING 7 - BASEMENT - SPS CARTLIFT - DEMO ENLARGED RCP

1/4" = 1'-0"

LEGEND

- OUT OF SCOPE
- TO DEMOLISH
- 2x2 ACOUSTICAL CEILING TILE
- 2x4 ACOUSTICAL CEILING TILE
- GYPSUM BOARD ON METAL STUDS
- 2 HR FIRE RATED WALL (EXISTING)
- DEMOLITION
- EXISTING SPRINKLER TO REMAIN

KEY NOTES (THIS SHEET ONLY)

D2	DEMO EXISTING CEILING TILES AS NEEDED FOR COMPLETION OF WORK.
D6	DEMO EXISTING LIGHT PER ELECTRICAL.

GENERAL NOTES

1. SEE MECHANICAL AND ELECTRICAL DRAWINGS FOR DEMOLITION OF EXISTING EQUIPMENT, LIGHTS, ETC.
2. MAINTAIN FIRE-RATING OF ALL EXISTING WALLS, FLOORS, AND CEILING ASSEMBLIES WHERE NEW PENETRATIONS OR DEMOLITION OCCURS.
3. SEE MECHANICAL AND ELECTRICAL DRAWINGS FOR DEMOLITION OF EXISTING EQUIPMENT, LIGHTS. ETC. PATCH AND PAINT ANY PENETRATIONS WHERE PIPES, CONDUITS, ETC. WHERE DEMOLISHED.
4. ALL LIGHT FIXTURES AT ELEVATOR LOBBIES ARE TO REMAIN.

KEY PLAN

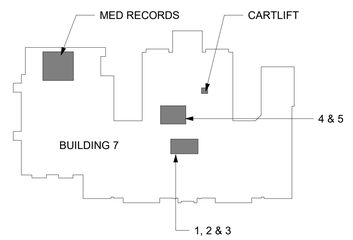

AREA SHOWN

Revisions:	Date:

CONSULTANT

ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246

SPEESDESIGNBUILD

STAMP

10000 REGISTERED ARCHITECT JAMES M. KING STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: BUILDING 7 - BASEMENT - DEMO ENLARGED RCP

Approved:

Phase: 100% CONSTRUCTION DOCUMENTS

FULLY SPRINKLERED

Project Title: REPLACE ELEVATORS IN BLDG 7 & BLDG 9

Project Number: 502-24-102

Building Number: 7

Location: ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA

Drawing Number: AD110

Issue Date: 03/24/2026

Checked: MK

Drawn: AJ

VA FORM 08 - 6231

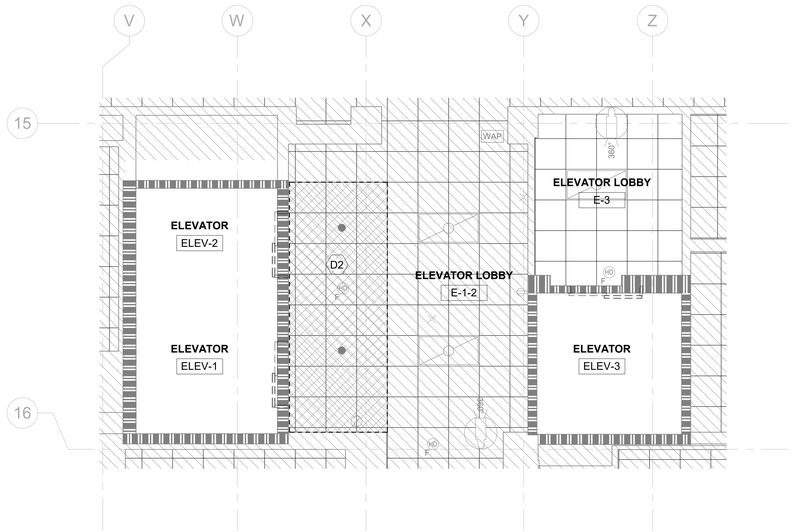

1 BUILDING 7 - LEVEL 01 - ELEV 1,2, &3 - DEMO ENLARGED RCP

1/4" = 1'-0"

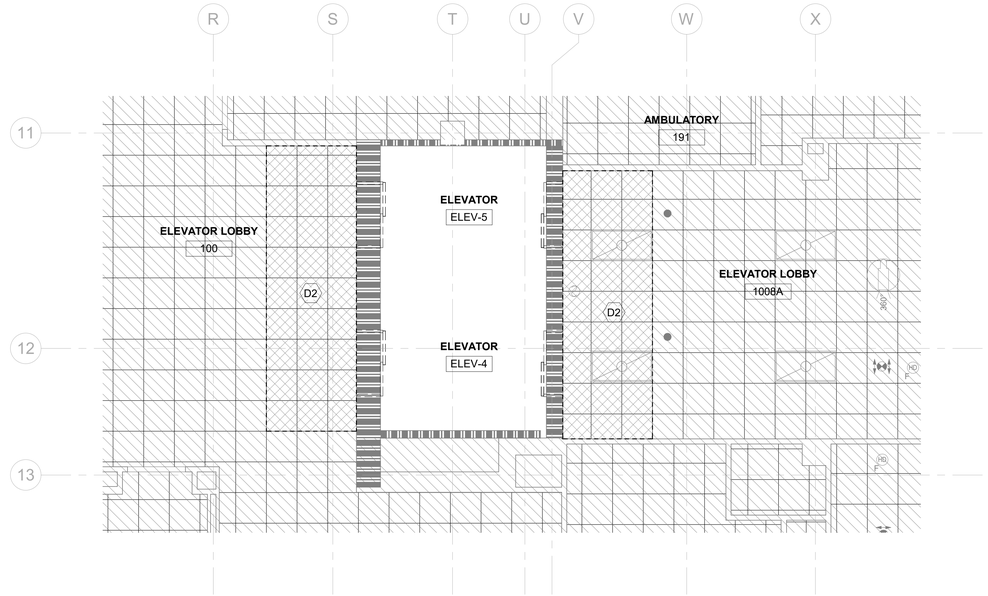

2 BUILDING 7 - LEVEL 01 - ELEV 4 & 5 - DEMO ENLARGED RCP

1/4" = 1'-0"

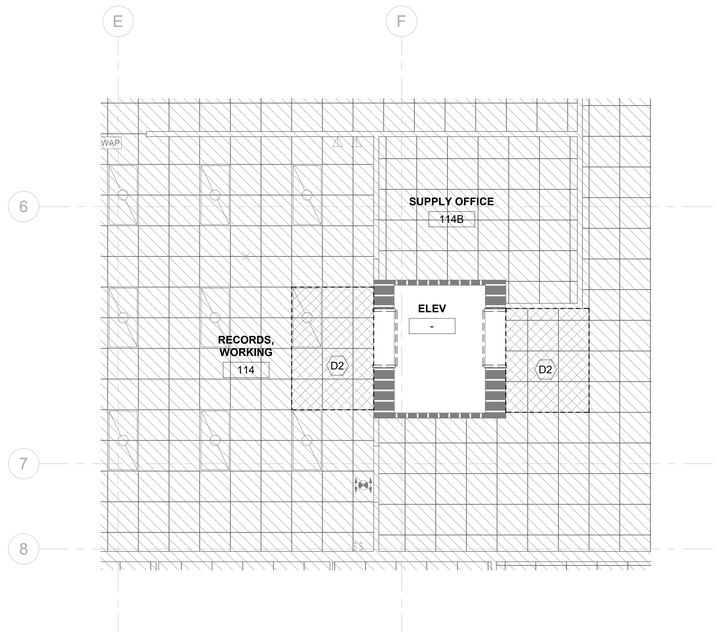

3 BUILDING 7 - LEVEL 01 - MED RECORDS ELEV - DEMO ENLARGED RCP

1/4" = 1'-0"

LEGEND

- OUT OF SCOPE
- TO DEMOLISH
- 2x2 ACOUSTICAL CEILING TILE
- 2x4 ACOUSTICAL CEILING TILE
- GYPSUM BOARD ON METAL STUDS
- 2 HR FIRE RATED WALL (EXISTING)
- DEMOLITION
- EXISTING SPRINKLER TO REMAIN

KEY NOTES (THIS SHEET ONLY)

D2	DEMO EXISTING CEILING TILES AS NEEDED FOR COMPLETION OF WORK.

GENERAL NOTES

1. SEE MECHANICAL AND ELECTRICAL DRAWINGS FOR DEMOLITION OF EXISTING EQUIPMENT, LIGHTS, ETC.
2. MAINTAIN FIRE-RATING OF ALL EXISTING WALLS, FLOORS, AND CEILING ASSEMBLIES WHERE NEW PENETRATIONS OR DEMOLITION OCCURS.
3. SEE MECHANICAL AND ELECTRICAL DRAWINGS FOR DEMOLITION OF EXISTING EQUIPMENT, LIGHTS. ETC. PATCH AND PAINT ANY PENETRATIONS WHERE PIPES, CONDUITS, ETC. WHERE DEMOLISHED.
4. ALL LIGHT FIXTURES AT ELEVATOR LOBBIES ARE TO REMAIN.

KEY PLAN

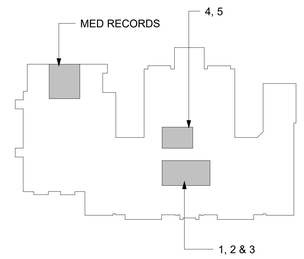

AREA SHOWN

PROJECT NORTH
TRUE NORTH (DASHED)

Revisions:	Date:

CONSULTANT

ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246

SDB SPEESDESIGNBUILD

STAMP

10000 REGISTERED ARCHITECT JAMES M. KING STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: BUILDING 7 - LEVEL 01 - DEMO ENLARGED RCP

Approved:

Phase: 100% CONSTRUCTION DOCUMENTS

FULLY SPRINKLERED

Project Title: REPLACE ELEVATORS IN BLDG 7 & BLDG 9

Location: ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA

Issue Date: 03/24/2026 | Checked: MK | Drawn: AJ

Project Number: 502-24-102

Building Number: 7

Drawing Number: AD111

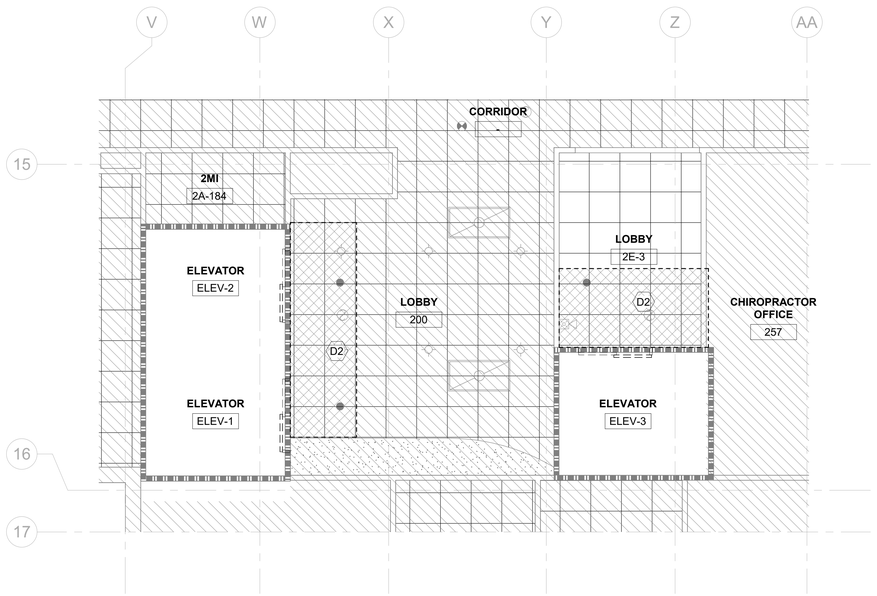

1 BUILDING 7 - LEVEL 02 - ELEV 1, 2, & 3 - DEMO ENLARGED RCP

1/4" = 1'-0"

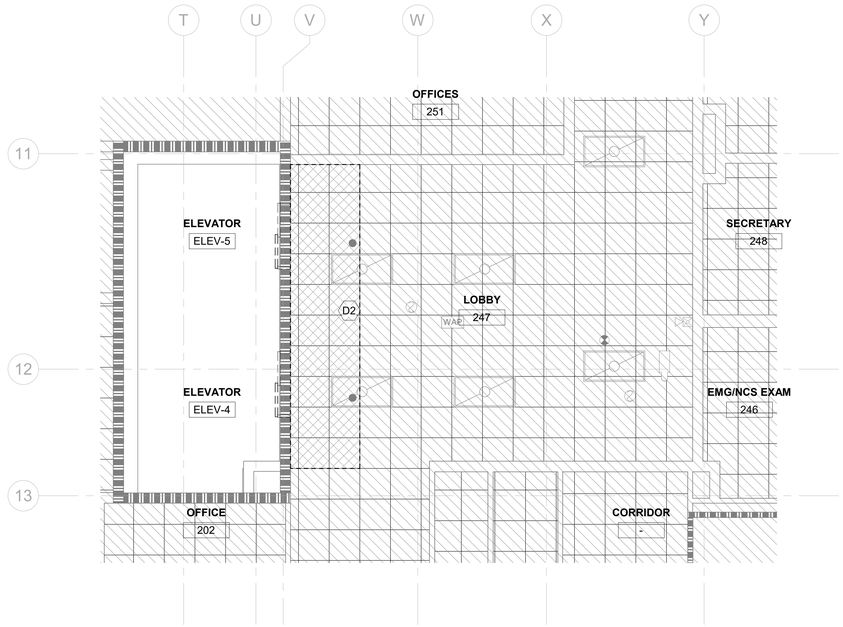

2 BUILDING 7 - LEVEL 02 - ELEV 4 & 5 - DEMO ENLARGED RCP

1/4" = 1'-0"

LEGEND

- OUT OF SCOPE
- TO DEMOLISH
- 2x2 ACOUSTICAL CEILING TILE
- 2x4 ACOUSTICAL CEILING TILE
- GYPSUM BOARD ON METAL STUDS
- 2 HR FIRE RATED WALL (EXISTING)
- DEMOLITION
- EXISTING SPRINKLER TO REMAIN

KEY NOTES (THIS SHEET ONLY)

D2	DEMO EXISTING CEILING TILES AS NEEDED FOR COMPLETION OF WORK.

GENERAL NOTES

1. SEE MECHANICAL AND ELECTRICAL DRAWINGS FOR DEMOLITION OF EXISTING EQUIPMENT, LIGHTS, ETC.
2. MAINTAIN FIRE-RATING OF ALL EXISTING WALLS, FLOORS, AND CEILING ASSEMBLIES WHERE NEW PENETRATIONS OR DEMOLITION OCCURS.
3. SEE MECHANICAL AND ELECTRICAL DRAWINGS FOR DEMOLITION OF EXISTING EQUIPMENT, LIGHTS. ETC. PATCH AND PAINT ANY PENETRATIONS WHERE PIPES, CONDUITS, ETC. WHERE DEMOLISHED.
4. ALL LIGHT FIXTURES AT ELEVATOR LOBBIES ARE TO REMAIN.

KEY PLAN

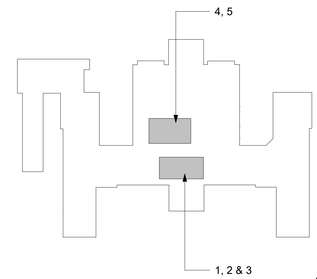

Revisions:	Date:

CONSULTANT

ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246

SDB SPEESDESIGNBUILD

STAMP

10000 REGISTERED ARCHITECT JAMES M. KING STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title	BUILDING 7 - LEVEL 02 - DEMO ENLARGED RCP
Phase	100% CONSTRUCTION DOCUMENTS
Approved:	
	FULLY SPRINKLERED
Project Title	REPLACE ELEVATORS IN BLDG 7 & BLDG 9
Project Number	502-24-102
Building Number	7
Location	ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA
Drawing Number	AD112
Issue Date	03/24/2026
Checked	MK
Drawn	AJ

VA FORM 08 - 6231

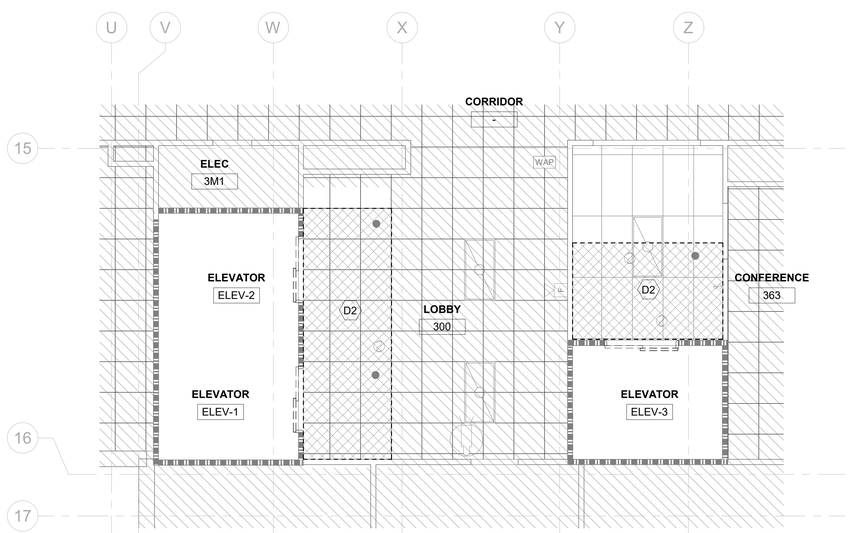

1 BUILDING 7 - LEVEL 03 - ELEV 1, 2, & 3 - DEMO ENLARGED RCP

1/4" = 1'-0"

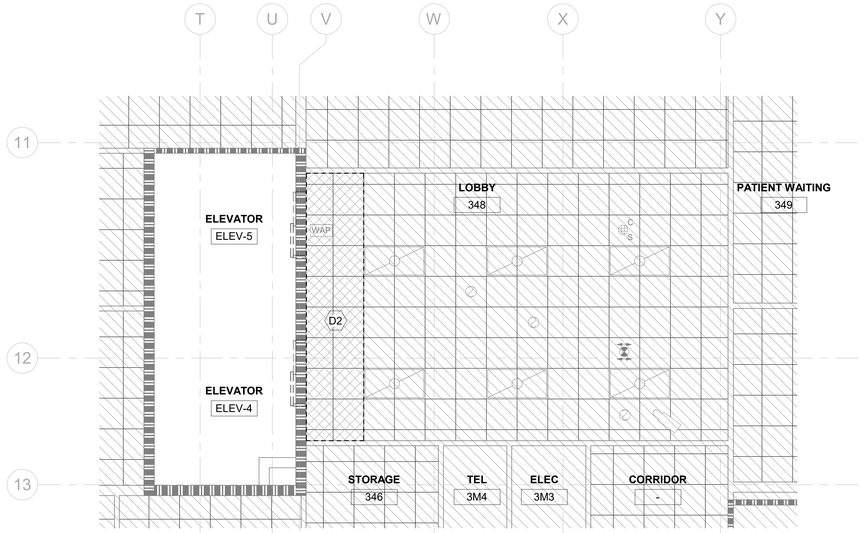

2 BUILDING 7 - LEVEL 03 - ELEV 4 & 5 - DEMO ENLARGED RCP

1/4" = 1'-0"

LEGEND

- OUT OF SCOPE
- TO DEMOLISH
- 2x2 ACOUSTICAL CEILING TILE
- 2x4 ACOUSTICAL CEILING TILE
- GYPSUM BOARD ON METAL STUDS
- 2 HR FIRE RATED WALL (EXISTING)
- DEMOLITION
- EXISTING SPRINKLER TO REMAIN

KEY NOTES (THIS SHEET ONLY)

D2	DEMO EXISTING CEILING TILES AS NEEDED FOR COMPLETION OF WORK.

GENERAL NOTES

1. SEE MECHANICAL AND ELECTRICAL DRAWINGS FOR DEMOLITION OF EXISTING EQUIPMENT, LIGHTS, ETC.
2. MAINTAIN FIRE-RATING OF ALL EXISTING WALLS, FLOORS, AND CEILING ASSEMBLIES WHERE NEW PENETRATIONS OR DEMOLITION OCCURS.
3. SEE MECHANICAL AND ELECTRICAL DRAWINGS FOR DEMOLITION OF EXISTING EQUIPMENT, LIGHTS. ETC. PATCH AND PAINT ANY PENETRATIONS WHERE PIPES, CONDUITS, ETC. WHERE DEMOLISHED.
4. ALL LIGHT FIXTURES AT ELEVATOR LOBBIES ARE TO REMAIN.

KEY PLAN



Revisions:	Date:

CONSULTANT

ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246

STAMP

REGISTERED ARCHITECT
10000
JAMES M. KING
STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management

U.S. Department of Veterans Affairs

Drawing Title: BUILDING 7 - LEVEL 03 - DEMO ENLARGED RCP

Approved:

Phase: 100% CONSTRUCTION DOCUMENTS

FULLY SPRINKLERED

Project Title: REPLACE ELEVATORS IN BLDG 7 & BLDG 9

Location: ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA

Issue Date: 03/24/2026

Checked: MK

Drawn: AJ

Project Number: 502-24-102

Building Number: 7

Drawing Number: AD113

VA FORM 08 - 6231

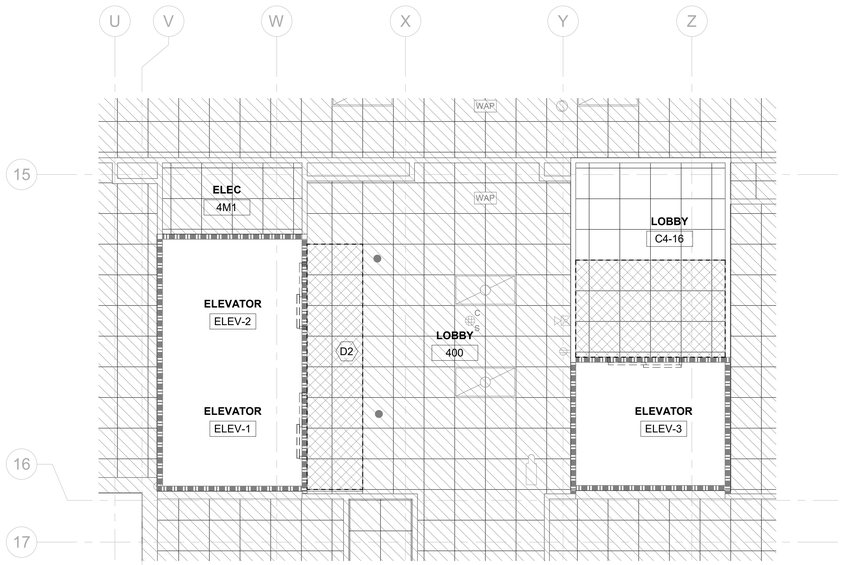

1 BUILDING 7 - LEVEL 04 - ELEV 1, 2, & 3 - DEMO ENLARGED RCP

1/4" = 1'-0"

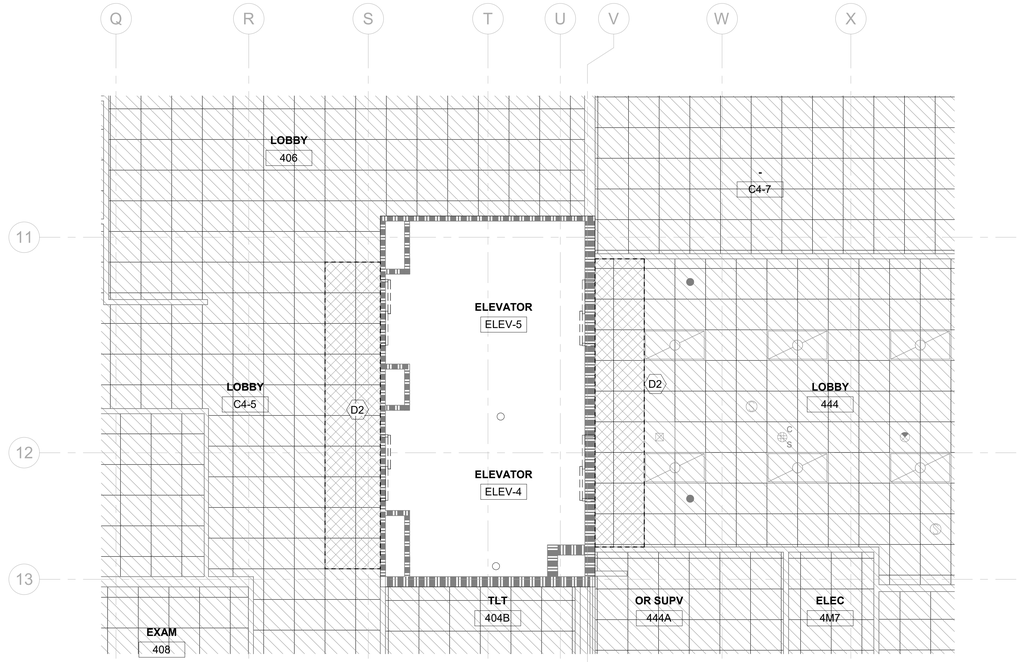

2 BUILDING 7 - LEVEL 04 - ELEV 4 & 5 - DEMO ENLARGED RCP

1/4" = 1'-0"

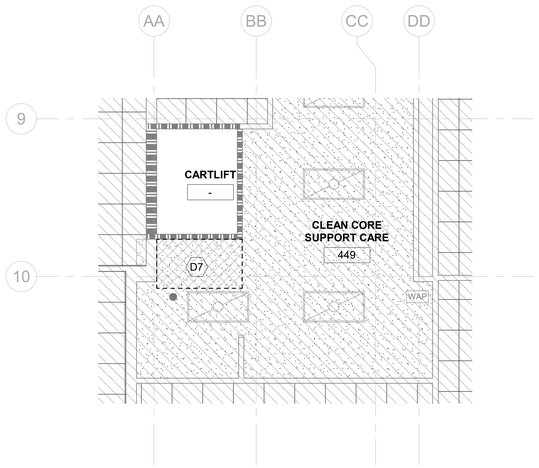

3 BUILDING 7 - LEVEL 04 - SPS CARTLIFT - DEMO ENLARGED RCP

1/4" = 1'-0"

LEGEND

- OUT OF SCOPE
- TO DEMOLISH
- 2x2 ACOUSTICAL CEILING TILE
- 2x4 ACOUSTICAL CEILING TILE
- GYPSUM BOARD ON METAL STUDS
- 2 HR FIRE RATED WALL (EXISTING)
- DEMOLITION
- EXISTING SPRINKLER TO REMAIN

KEY NOTES (THIS SHEET ONLY)

D2	DEMO EXISTING CEILING TILES AS NEEDED FOR COMPLETION OF WORK.
D7	CUT AND REMOVE PORTIONS OF EXISTING GYP CEILING ONLY AS REQUIRED FOR COMPLETION OF WORK. PATCH AND PAINT TO MATCH EXISTING.

GENERAL NOTES

1. SEE MECHANICAL AND ELECTRICAL DRAWINGS FOR DEMOLITION OF EXISTING EQUIPMENT, LIGHTS, ETC.
2. MAINTAIN FIRE-RATING OF ALL EXISTING WALLS, FLOORS, AND CEILING ASSEMBLIES WHERE NEW PENETRATIONS OR DEMOLITION OCCURS.
3. SEE MECHANICAL AND ELECTRICAL DRAWINGS FOR DEMOLITION OF EXISTING EQUIPMENT, LIGHTS. ETC. PATCH AND PAINT ANY PENETRATIONS WHERE PIPES, CONDUITS, ETC. WHERE DEMOLISHED.
4. ALL LIGHT FIXTURES AT ELEVATOR LOBBIES ARE TO REMAIN.

KEY PLAN



Revisions:	Date:

CONSULTANT

ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246

SPEESDESIGNBUILD

STAMP

10000 REGISTERED ARCHITECT JAMES M. KING STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: BUILDING 7 - LEVEL 04 - DEMO ENLARGED RCP	Phase: 100% CONSTRUCTION DOCUMENTS	Project Title: REPLACE ELEVATORS IN BLDG 7 & BLDG 9	Project Number: 502-24-102
			Building Number: 7
Approved:	FULLY SPRINKLERED	Location: ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA	Drawing Number: AD114
		Issue Date: 03/24/2026 / Checked: MK / Drawn: AJ	

VA FORM 08 - 6231

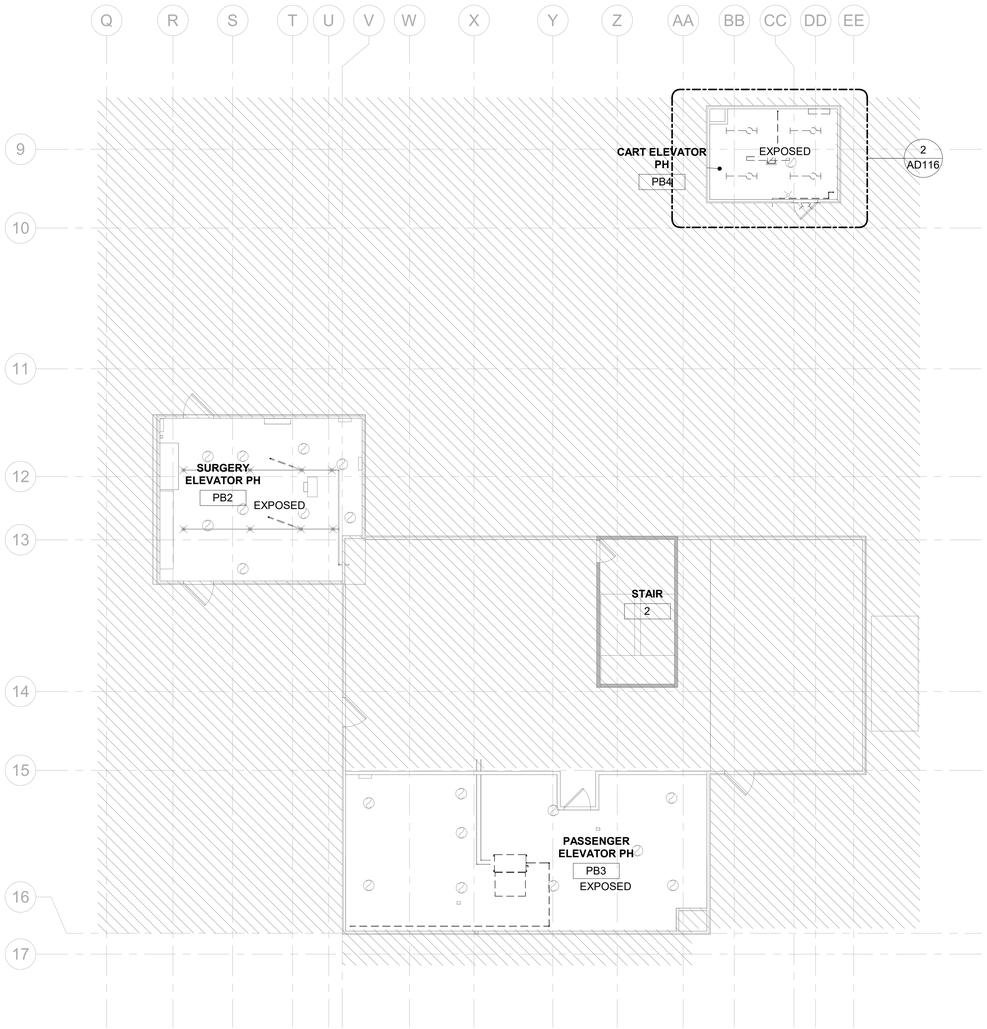

1 BLDG 7 - PENTHOUSE - DEMO RCP

1/8" = 1'-0"

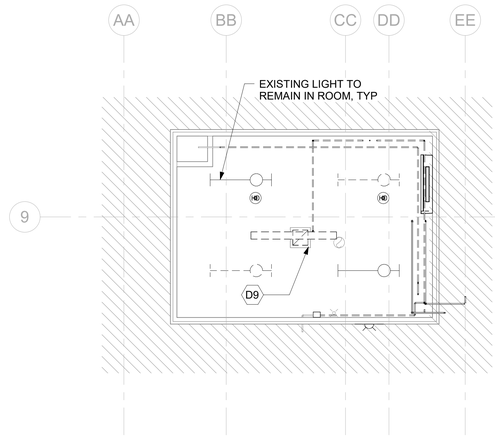

2 BLDG 7 - CARTLIFT PENTHOUSE - DEMO ENLARGED RCP

1/4" = 1'-0"

LEGEND

- OUT OF SCOPE
- TO DEMOLISH
- 2x2 ACOUSTICAL CEILING TILE
- 2x4 ACOUSTICAL CEILING TILE
- GYPSUM BOARD ON METAL STUDS
- 2 HR FIRE RATED WALL (EXISTING)
- DEMOLITION
- EXISTING SPRINKLER TO REMAIN

KEY NOTES (THIS SHEET ONLY)

D9	EXISTING FAN ABOVE ROOF TO BE REMOVED, SEE MECHANICAL. DUCT AND LOUVER TO REMAIN, PREP TO CAP.

GENERAL NOTES

1. SEE MECHANICAL AND ELECTRICAL DRAWINGS FOR DEMOLITION OF EXISTING EQUIPMENT, LIGHTS, ETC.
2. MAINTAIN FIRE-RATING OF ALL EXISTING WALLS, FLOORS, AND CEILING ASSEMBLIES WHERE NEW PENETRATIONS OR DEMOLITION OCCURS.
3. SEE MECHANICAL AND ELECTRICAL DRAWINGS FOR DEMOLITION OF EXISTING EQUIPMENT, LIGHTS. ETC. PATCH AND PAINT ANY PENETRATIONS WHERE PIPES, CONDUITS, ETC. WHERE DEMOLISHED.
4. ALL LIGHT FIXTURES AT ELEVATOR LOBBIES ARE TO REMAIN.

KEY PLAN



AREA SHOWN

Revisions:	Date:

CONSULTANT

ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246

SPEESDESIGNBUILD

STAMP

10000 REGISTERED ARCHITECT JAMES M. KING STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management

U.S. Department of Veterans Affairs

Drawing Title	BUILDING 7 - PENTHOUSE - DEMO ENLARGED RCP
Phase	100% CONSTRUCTION DOCUMENTS
Approved:	
	FULLY SPRINKLERED
Project Title	REPLACE ELEVATORS IN BLDG 7 & BLDG 9
Project Number	502-24-102
Building Number	7
Location	ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA
Drawing Number	AD116
Issue Date	03/24/2026
Checked	MK
Drawn	AJ

VA FORM 08 - 6231

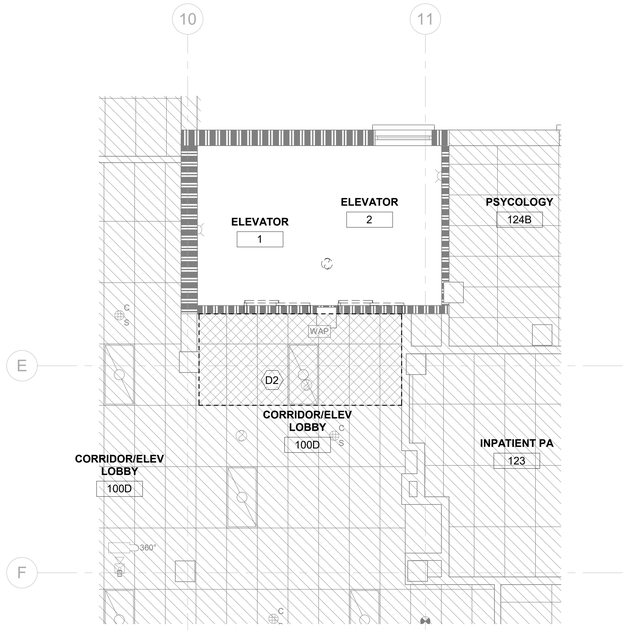

1 BUILDING 9 - LEVEL 01 - ELEV 1 & 2 - DEMO ENLARGED RCP

1/4" = 1'-0"

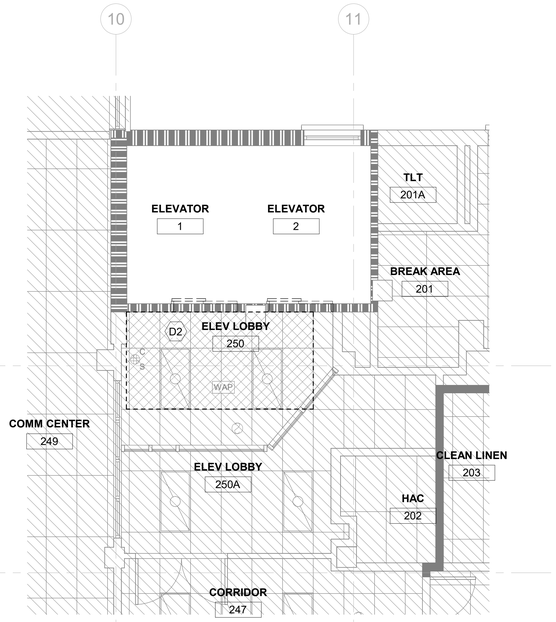

2 BUILDING 9 - LEVEL 02 - ELEV 1 & 2 - DEMO ENLARGED RCP

1/4" = 1'-0"

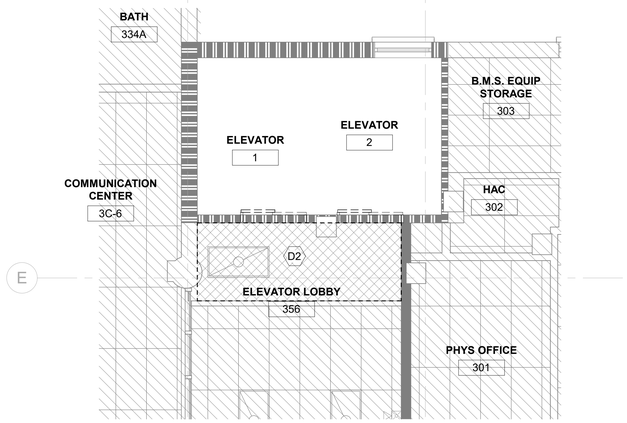

3 BUILDING 9 - LEVEL 03 - ELEV 1 & 2 - DEMO ENLARGED RCP

1/4" = 1'-0"



4 BLDG 9 - PENTHOUSE - DEMO ENLARGED RCP

1/4" = 1'-0"

LEGEND

- OUT OF SCOPE
- TO DEMOLISH
- 2x2 ACOUSTICAL CEILING TILE
- 2x4 ACOUSTICAL CEILING TILE
- GYPSUM BOARD ON METAL STUDS
- 2 HR FIRE RATED WALL (EXISTING)
- DEMOLITION
- EXISTING SPRINKLER TO REMAIN

KEY NOTES (THIS SHEET ONLY)

D2	DEMO EXISTING CEILING TILES AS NEEDED FOR COMPLETION OF WORK.

GENERAL NOTES

1. SEE MECHANICAL AND ELECTRICAL DRAWINGS FOR DEMOLITION OF EXISTING EQUIPMENT, LIGHTS, ETC.
2. MAINTAIN FIRE-RATING OF ALL EXISTING WALLS, FLOORS, AND CEILING ASSEMBLIES WHERE NEW PENETRATIONS OR DEMOLITION OCCURS.
3. SEE MECHANICAL AND ELECTRICAL DRAWINGS FOR DEMOLITION OF EXISTING EQUIPMENT, LIGHTS. ETC. PATCH AND PAINT ANY PENETRATIONS WHERE PIPES, CONDUITS, ETC. WHERE DEMOLISHED.
4. ALL LIGHT FIXTURES AT ELEVATOR LOBBIES ARE TO REMAIN.

KEY PLAN

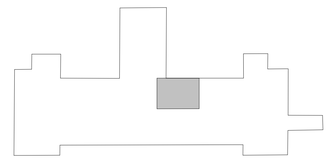

AREA SHOWN

Revisions:	Date:

CONSULTANT

ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246

SDB SPEESDESIGNBUILD

STAMP

10000 REGISTERED ARCHITECT JAMES M. KING STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title	BUILDING 9 - LEVELS 01, 02, 03, PH. - DEMO ENLARGED RCP
Phase	100% CONSTRUCTION DOCUMENTS
Approved:	FULLY SPRINKLERED
Project Title	REPLACE ELEVATORS IN BLDG 7 & BLDG 9
Project Number	502-24-102
Building Number	9
Location	ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA
Drawing Number	AD117
Issue Date	03/24/2026
Checked	MK
Drawn	AJ

VA FORM 08 - 6231

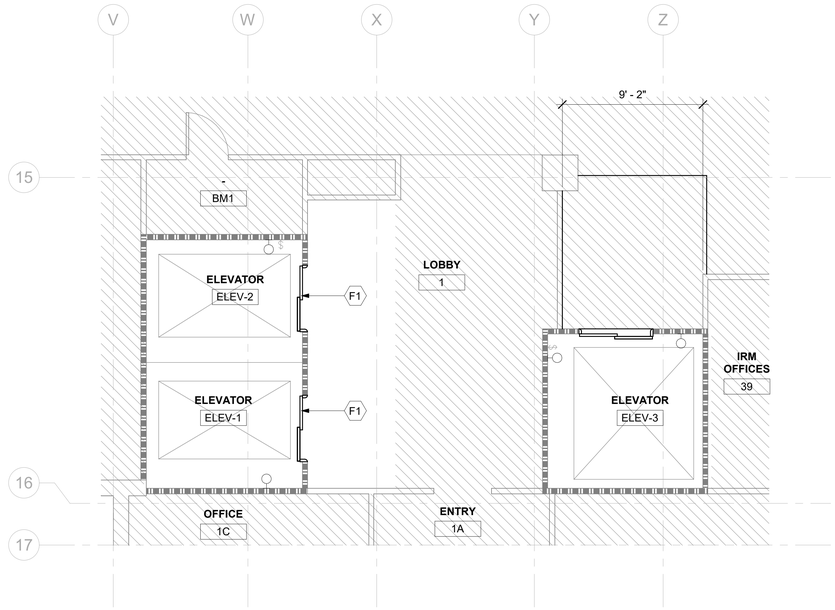

1 BUILDING 7 - BASEMENT - ELEV 1, 2 & 3 - ENLARGED PLAN

1/4" = 1'-0"

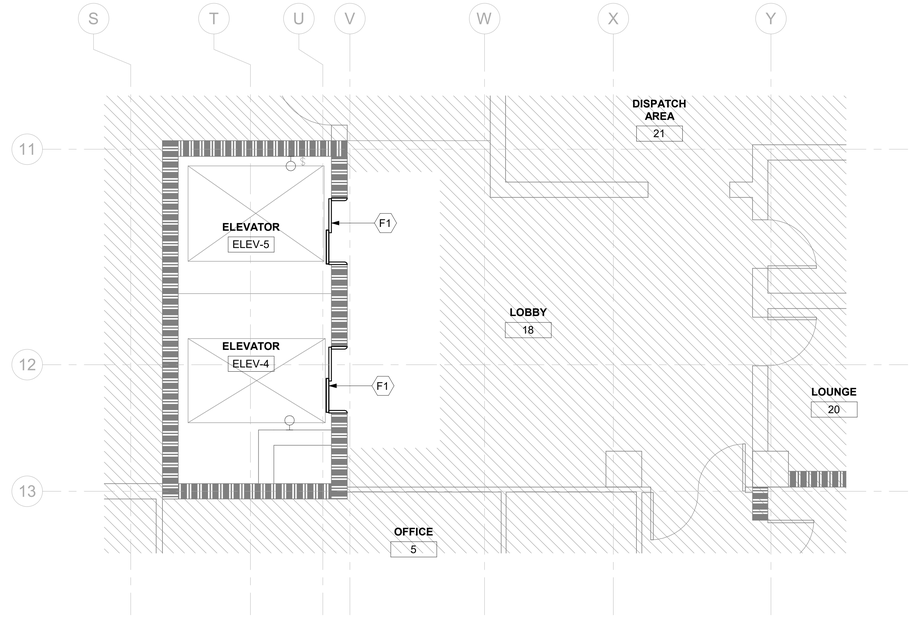

2 BUILDING 7 - BASEMENT - ELEV 4 & 5 - ENLARGED PLAN

1/4" = 1'-0"

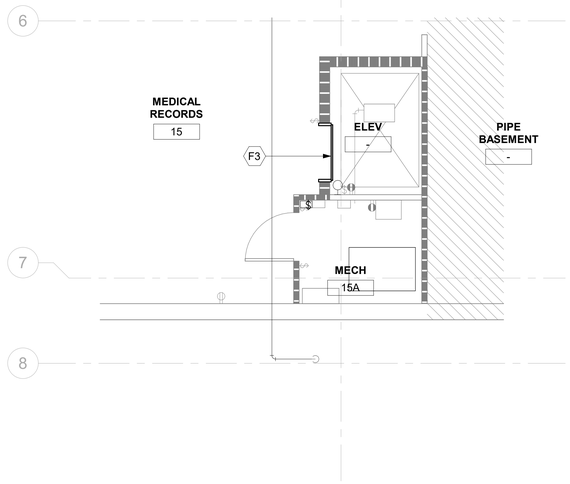

3 BUILDING 7 - BASEMENT - MED RECORDS ELEV - ENLARGED PLAN

1/4" = 1'-0"

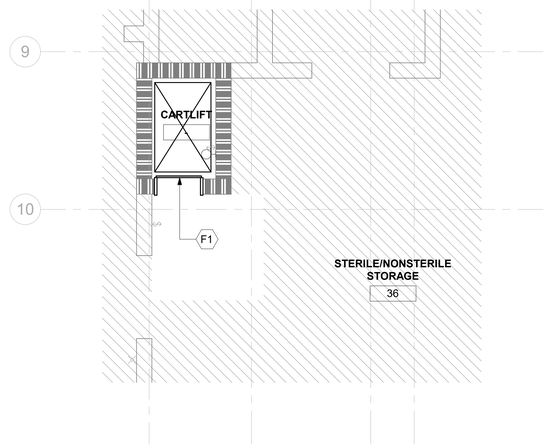

4 BUILDING 7 - BASEMENT - SPS CART LIFT - ENLARGED PLAN

1/4" = 1'-0"

LEGEND

- OUT OF SCOPE
- EXISTING DOOR TO REMAIN
- NEW DOOR
- EXISTING TO REMAIN
- NEW
- 2 HR FIRE RATED WALL (EXISTING)
- NEW LVT FLOORING

KEY NOTES (THIS SHEET ONLY)

F1	INSTALL NEW ELEVATOR DOORS. EXISTING FRAME AND SILL TO BE CLEANED AND REFURBISHED.
F3	INSTALL NEW ELEVATOR DOORS, FRAME AND SILL.

GENERAL NOTES

1. ALL DIMENSIONS NOTED AS CLEAR SHALL MAINTAIN THE FULL SPACE INDICATED WITHOUT ENCROACHMENTS.
2. ENSURE THAT ALL REQUIRED BACKING IS INSTALLED IN WALLS PRIOR TO INSTALLING GYPSUM BOARD.
3. INFILL, PATCH, AND REPAIR WALLS TO MATCH EXISTING CONDITIONS WHERE MECHANICAL, PLUMBING, AND ELECTRICAL ITEMS WERE DEMOLISHED. THESE INCLUDE BUT ARE NOT LIMITED TO; LOUVERS, EXHAUST FANS, PIPES, ETC.
4. PATCH AND REPAIR FLOOR TO MATCH EXISTING CONDITIONS WHERE DAMAGED.
5. SEE SHEETS A-602, A-603, A-604 FOR FULL ELEVATORS SCOPE OF WORK.
6. ALL PERSONNEL WORKING IN SURGERY AND SPS MUST WEAR PROPER DONNING AS THESE AREAS ARE STERILE AREAS.
7. MAINTAIN FIRE-RESISTANCE RATING OF ALL EXISTING WALLS, FLOORS, AND CEILING ASSEMBLIES WHERE NEW PENETRATIONS OR DEMOLITION OCCURS.

KEY PLAN

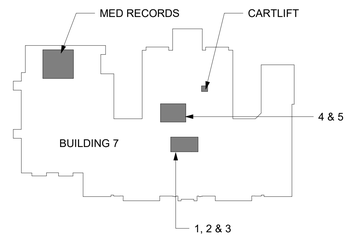

AREA SHOWN

Revisions:	Date:

CONSULTANT

ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246

SPEESDESIGNBUILD

STAMP

10000 REGISTERED ARCHITECT JAMES M. KING STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title	BUILDING 7 - BASEMENT - ENLARGED PLANS
Phase	100% CONSTRUCTION DOCUMENTS
Approved:	
	FULLY SPRINKLERED
Project Title	REPLACE ELEVATORS IN BLDG 7 & BLDG 9
Project Number	502-24-102
Building Number	7
Location	ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA
Drawing Number	AE100
Issue Date	03/24/2026
Checked	MK
Drawn	AJ

VA FORM 08 - 6231

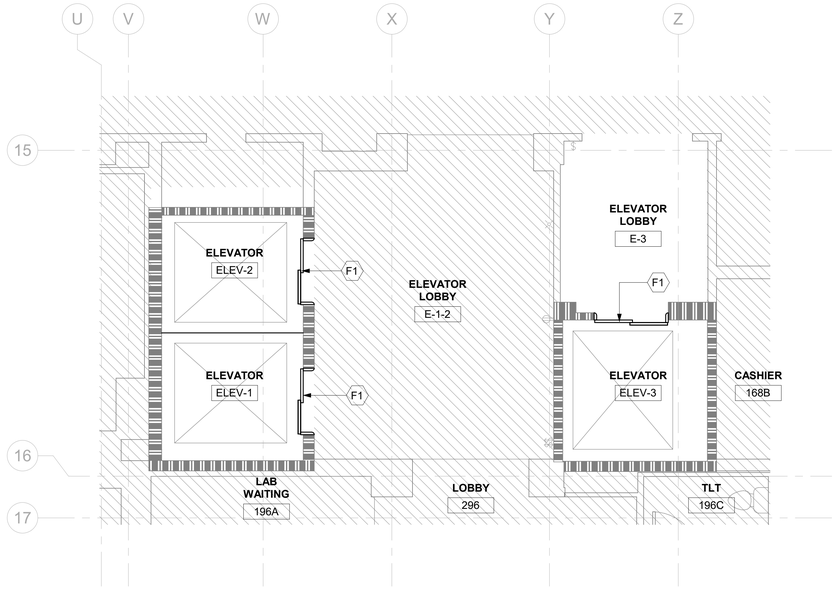

1 BUILDING 7 - LEVEL 01 - ELEV 1, 2 & 3 - ENLARGED PLAN

1/4" = 1'-0"

PROJECT NORTH
TRUE NORTH (DASHED)

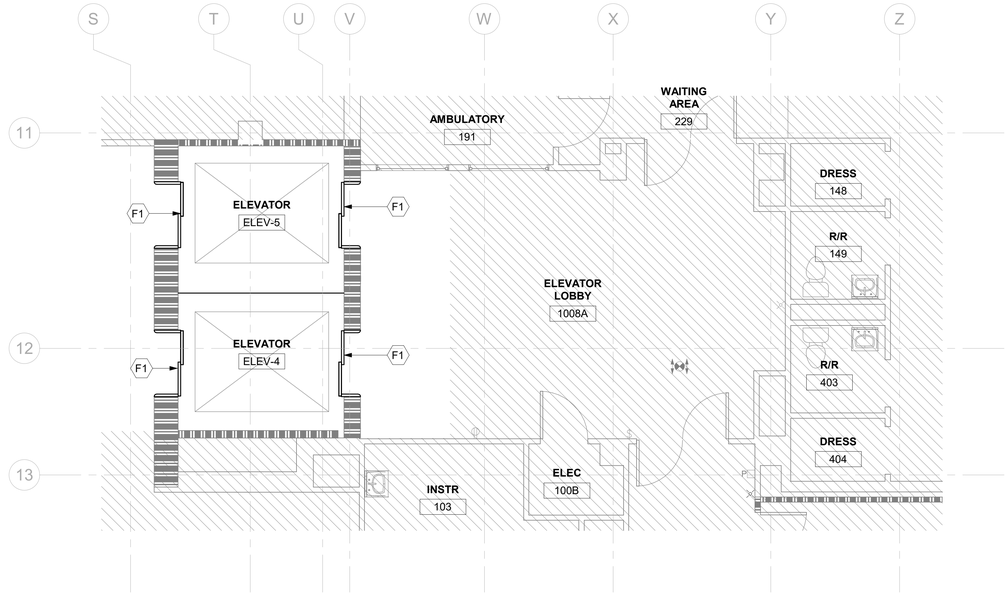

2 BUILDING 7 - LEVEL 01 - ELEV 4 & 5 - ENLARGED PLAN

1/4" = 1'-0"

PROJECT NORTH
TRUE NORTH (DASHED)

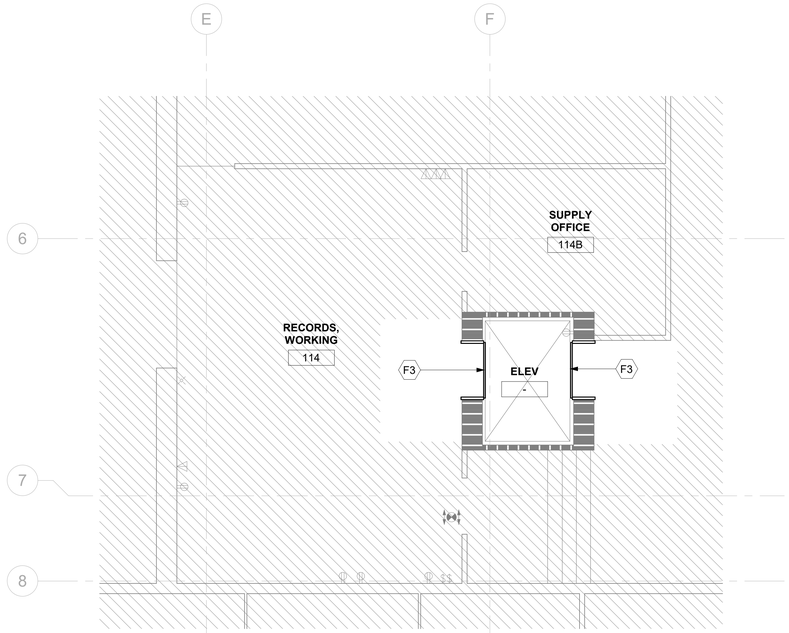

3 BUILDING 7 - LEVEL 01 - MED RECORDS ELEV - ENLARGED PLAN

1/4" = 1'-0"

PROJECT NORTH
TRUE NORTH (DASHED)

LEGEND

- OUT OF SCOPE
- EXISTING DOOR TO REMAIN
- NEW DOOR
- EXISTING TO REMAIN
- NEW
- 2 HR FIRE RATED WALL (EXISTING)
- NEW LVT FLOORING

KEY NOTES (THIS SHEET ONLY)

F1	INSTALL NEW ELEVATOR DOORS. EXISTING FRAME AND SILL TO BE CLEANED AND REFURBISHED.
F3	INSTALL NEW ELEVATOR DOORS, FRAME AND SILL.

GENERAL NOTES

1. ALL DIMENSIONS NOTED AS CLEAR SHALL MAINTAIN THE FULL SPACE INDICATED WITHOUT ENCROACHMENTS.
2. ENSURE THAT ALL REQUIRED BACKING IS INSTALLED IN WALLS PRIOR TO INSTALLING GYPSUM BOARD.
3. INFILL, PATCH, AND REPAIR WALLS TO MATCH EXISTING CONDITIONS WHERE MECHANICAL, PLUMBING, AND ELECTRICAL ITEMS WERE DEMOLISHED. THESE INCLUDE BUT ARE NOT LIMITED TO; LOUVERS, EXHAUST FANS, PIPES, ETC.
4. PATCH AND REPAIR FLOOR TO MATCH EXISTING CONDITIONS WHERE DAMAGED.
5. SEE SHEETS A-602, A-603, A-604 FOR FULL ELEVATORS SCOPE OF WORK.
6. ALL PERSONNEL WORKING IN SURGERY AND SPS MUST WEAR PROPER DONNING AS THESE AREAS ARE STERILE AREAS.
7. MAINTAIN FIRE-RESISTANCE RATING OF ALL EXISTING WALLS, FLOORS, AND CEILING ASSEMBLIES WHERE NEW PENETRATIONS OR DEMOLITION OCCURS.

KEY PLAN

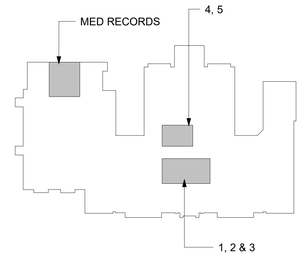

AREA SHOWN

Revisions:	Date:

CONSULTANT

ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246

SPEESDESIGNBUILD

STAMP

10000 REGISTERED ARCHITECT JAMES M. KING STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: BUILDING 7 - LEVEL 01 - ENLARGED PLANS

Approved:

Phase: 100% CONSTRUCTION DOCUMENTS

FULLY SPRINKLERED

Project Title: REPLACE ELEVATORS IN BLDG 7 & BLDG 9

Location: ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA

Issue Date: 03/24/2026 | Checked: MK | Drawn: AJ

Project Number: 502-24-102

Building Number: 7

Drawing Number: AE101

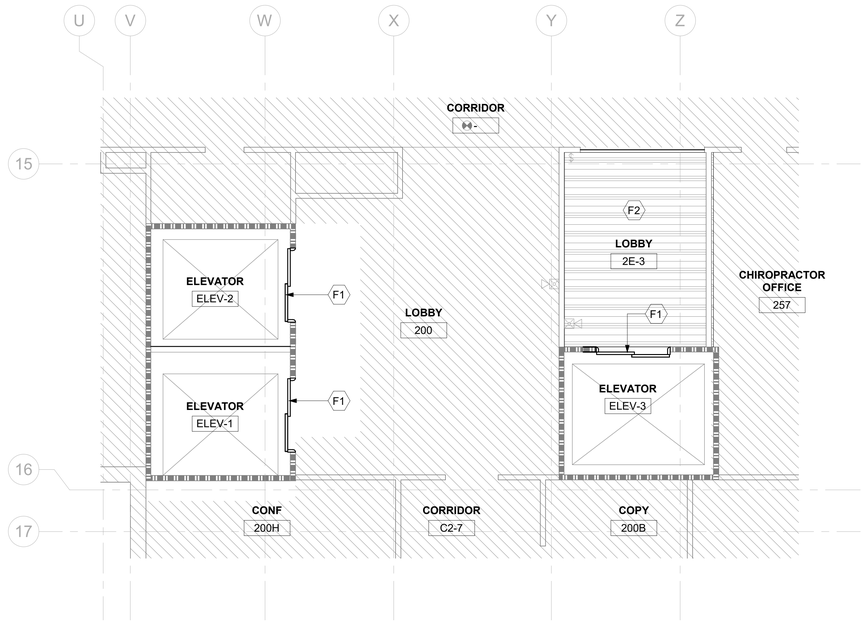

1 BUILDING 7 - LEVEL 02 - ELEV 1, 2 & 3 - ENLARGED PLAN

1/4" = 1'-0"

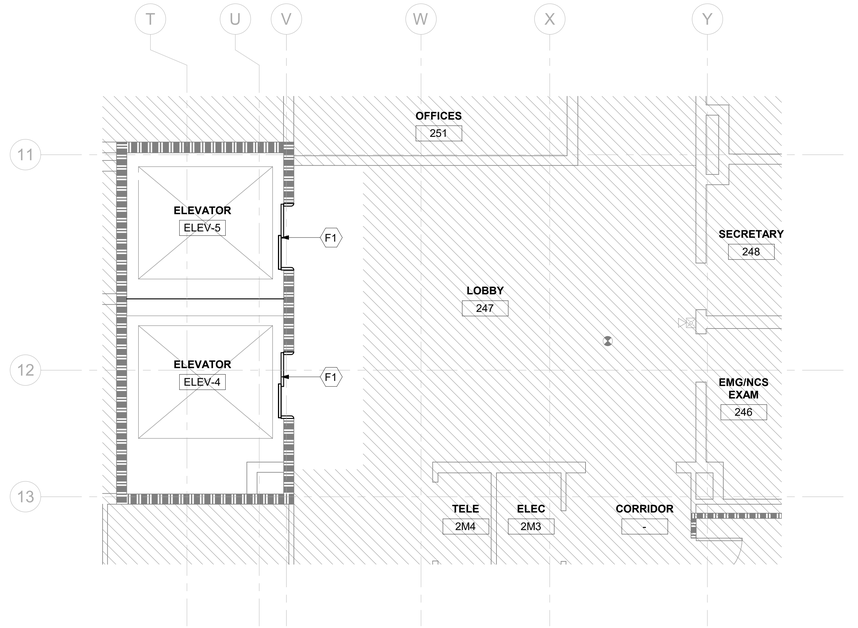

2 BUILDING 7 - LEVEL 02 - ELEV 4 & 5 - ENLARGED PLAN

1/4" = 1'-0"

LEGEND

- OUT OF SCOPE
- EXISTING DOOR TO REMAIN
- NEW DOOR
- EXISTING TO REMAIN
- NEW
- 2 HR FIRE RATED WALL (EXISTING)
- NEW LVT FLOORING

KEY NOTES (THIS SHEET ONLY)

F1	INSTALL NEW ELEVATOR DOORS. EXISTING FRAME AND SILL TO BE CLEANED AND REFURBISHED.
F2	INSTALL NEW LVT FLOORING AT ELEVATOR LOBBY.

GENERAL NOTES

1. ALL DIMENSIONS NOTED AS CLEAR SHALL MAINTAIN THE FULL SPACE INDICATED WITHOUT ENCROACHMENTS.
2. ENSURE THAT ALL REQUIRED BACKING IS INSTALLED IN WALLS PRIOR TO INSTALLING GYPSUM BOARD.
3. INFILL, PATCH, AND REPAIR WALLS TO MATCH EXISTING CONDITIONS WHERE MECHANICAL, PLUMBING, AND ELECTRICAL ITEMS WERE DEMOLISHED. THESE INCLUDE BUT ARE NOT LIMITED TO; LOUVERS, EXHAUST FANS, PIPES, ETC.
4. PATCH AND REPAIR FLOOR TO MATCH EXISTING CONDITIONS WHERE DAMAGED.
5. SEE SHEETS A-602, A-603, A-604 FOR FULL ELEVATORS SCOPE OF WORK.
6. ALL PERSONNEL WORKING IN SURGERY AND SPS MUST WEAR PROPER DONNING AS THESE AREAS ARE STERILE AREAS.
7. MAINTAIN FIRE-RESISTANCE RATING OF ALL EXISTING WALLS, FLOORS, AND CEILING ASSEMBLIES WHERE NEW PENETRATIONS OR DEMOLITION OCCURS.

KEY PLAN

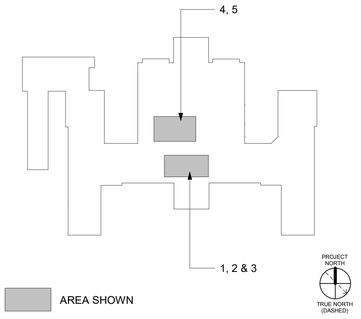

Revisions:	Date:

CONSULTANT

ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246

SPEESDESIGNBUILD

STAMP

10000 REGISTERED ARCHITECT JAMES M. KING STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: BUILDING 7 - LEVEL 02 - ENLARGED PLANS

Phase: 100% CONSTRUCTION DOCUMENTS

Approved:

FULLY SPRINKLERED

Project Title: REPLACE ELEVATORS IN BLDG 7 & BLDG 9

Project Number: 502-24-102

Building Number: 7

Location: ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA

Drawing Number: AE102

Issue Date: 03/24/2026 | Checked: MK | Drawn: AJ

VA FORM 08 - 6231

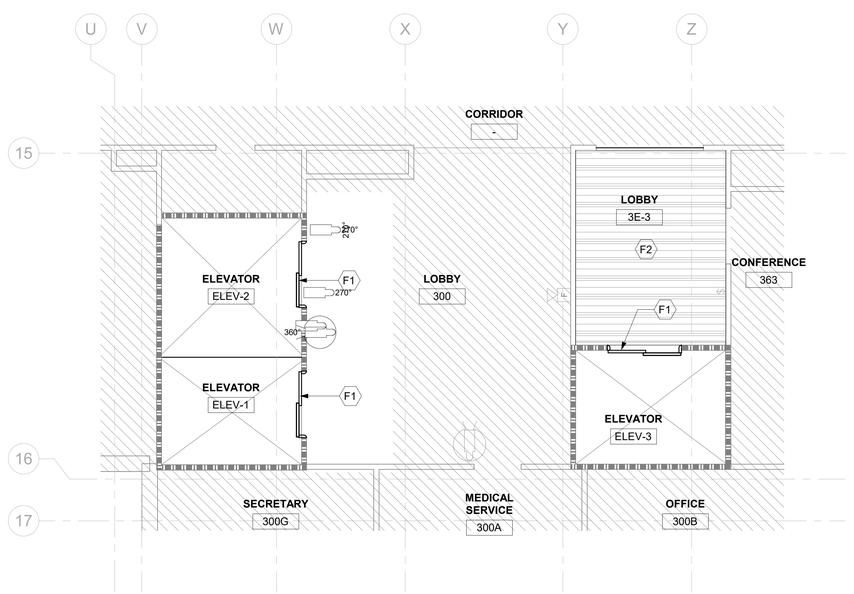

1 BUILDING 7 - LEVEL 03 - ELEV 1, 2 & 3 - ENLARGED PLAN

1/4" = 1'-0"

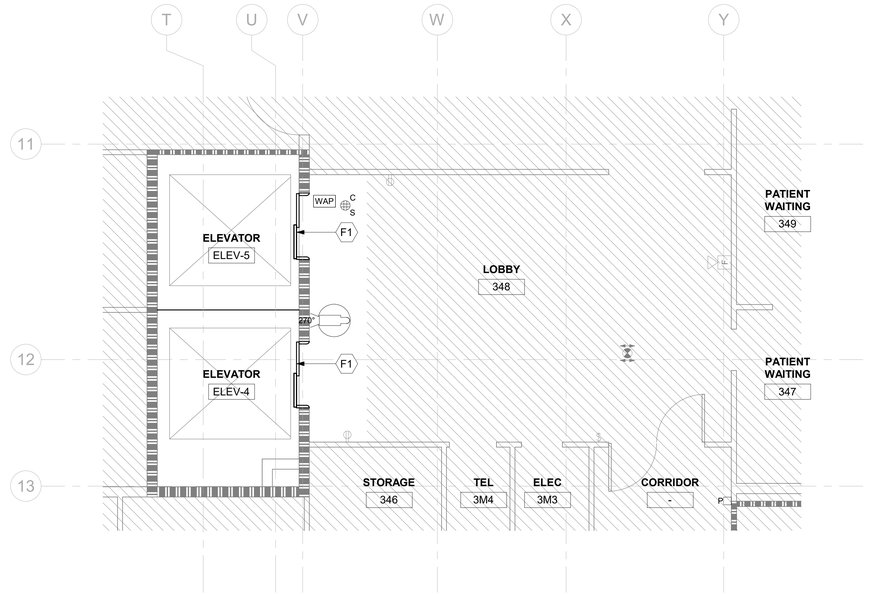

2 BUILDING 7 - LEVEL 03 - ELEV 4 & 5 - ENLARGED PLAN

1/4" = 1'-0"

LEGEND

- OUT OF SCOPE
- EXISTING DOOR TO REMAIN
- NEW DOOR
- EXISTING TO REMAIN
- NEW
- 2 HR FIRE RATED WALL (EXISTING)
- NEW LVT FLOORING

KEY NOTES (THIS SHEET ONLY)

F1	INSTALL NEW ELEVATOR DOORS. EXISTING FRAME AND SILL TO BE CLEANED AND REFURBISHED.
F2	INSTALL NEW LVT FLOORING AT ELEVATOR LOBBY.

GENERAL NOTES

1. ALL DIMENSIONS NOTED AS CLEAR SHALL MAINTAIN THE FULL SPACE INDICATED WITHOUT ENCROACHMENTS.
2. ENSURE THAT ALL REQUIRED BACKING IS INSTALLED IN WALLS PRIOR TO INSTALLING GYPSUM BOARD.
3. INFILL, PATCH, AND REPAIR WALLS TO MATCH EXISTING CONDITIONS WHERE MECHANICAL, PLUMBING, AND ELECTRICAL ITEMS WERE DEMOLISHED. THESE INCLUDE BUT ARE NOT LIMITED TO; LOUVERS, EXHAUST FANS, PIPES, ETC.
4. PATCH AND REPAIR FLOOR TO MATCH EXISTING CONDITIONS WHERE DAMAGED.
5. SEE SHEETS A-602, A-603, A-604 FOR FULL ELEVATORS SCOPE OF WORK.
6. ALL PERSONNEL WORKING IN SURGERY AND SPS MUST WEAR PROPER DONNING AS THESE AREAS ARE STERILE AREAS.
7. MAINTAIN FIRE-RESISTANCE RATING OF ALL EXISTING WALLS, FLOORS, AND CEILING ASSEMBLIES WHERE NEW PENETRATIONS OR DEMOLITION OCCURS.

KEY PLAN



Revisions:	Date:

CONSULTANT

ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246

SPEESDESIGNBUILD

STAMP

REGISTERED ARCHITECT
10000
JAMES M. KING
STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: BUILDING 7 - LEVEL 03 - ENLARGED PLANS	Phase: 100% CONSTRUCTION DOCUMENTS
Approved:	FULLY SPRINKLERED

Project Title: REPLACE ELEVATORS IN BLDG 7 & BLDG 9	Project Number: 502-24-102
	Building Number: 7
Location: ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA	Drawing Number: AE103
Issue Date: 03/24/2026 / Checked: MK / Drawn: AJ	

VA FORM 08 - 6231

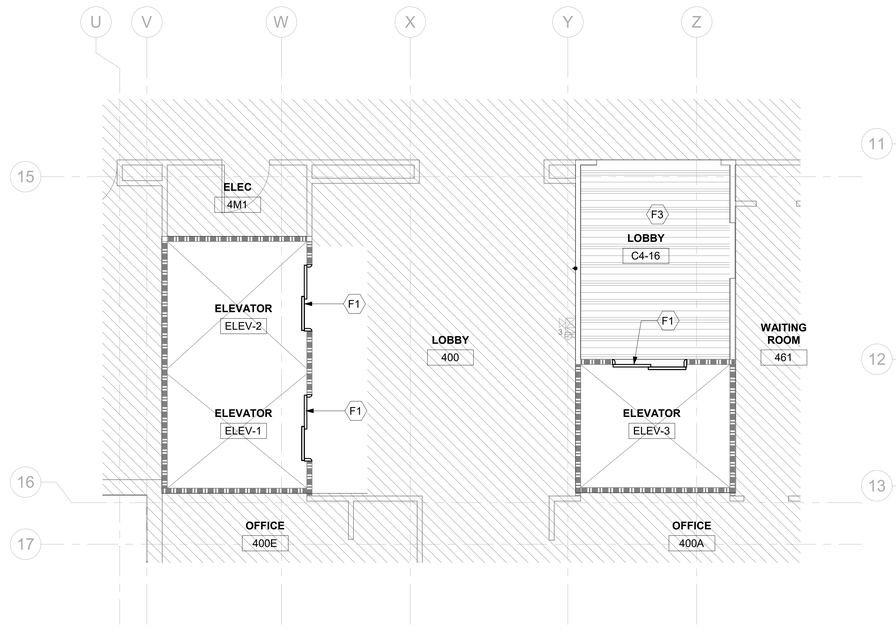

1 BUILDING 7 - LEVEL 04 - ELEV 1, 2 & 3 - ENLARGED PLAN

1/4" = 1'-0"

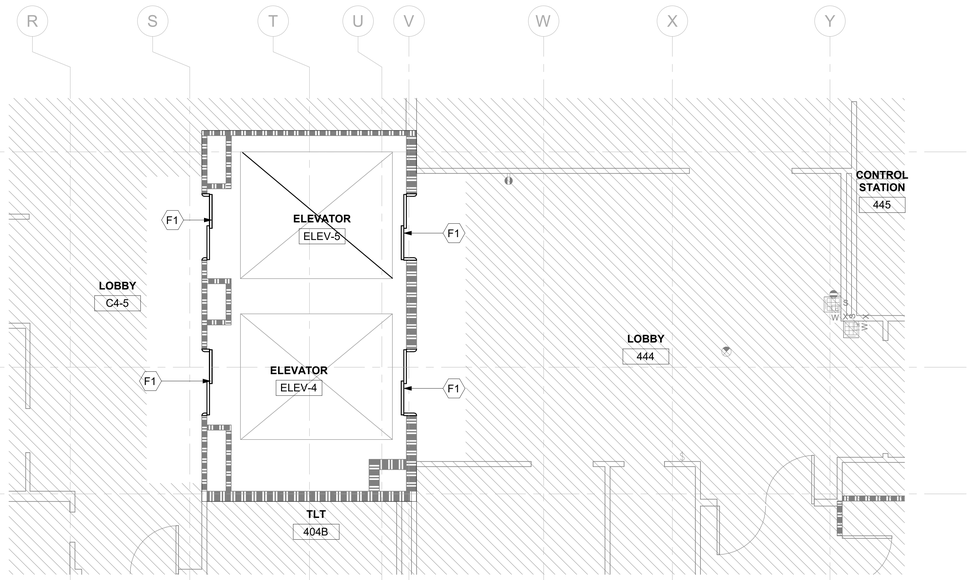

2 BUILDING 7 - LEVEL 04 - ELEV 4 & 5 - ENLARGED PLAN

1/4" = 1'-0"

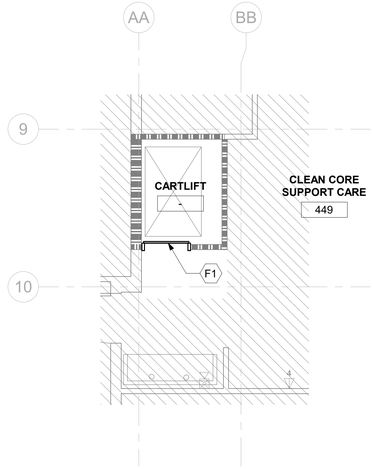

3 BUILDING 7 - LEVEL 04 - SPS CARTLIFT - ENLARGED PLAN

1/4" = 1'-0"

LEGEND

- OUT OF SCOPE
- EXISTING DOOR TO REMAIN
- NEW DOOR
- EXISTING TO REMAIN
- NEW
- 2 HR FIRE RATED WALL (EXISTING)
- NEW LVT FLOORING

KEY NOTES (THIS SHEET ONLY)

F1	INSTALL NEW ELEVATOR DOORS. EXISTING FRAME AND SILL TO BE CLEANED AND REFURBISHED.
F3	INSTALL NEW LVT FLOORING AT ELEVATOR LOBBY.

GENERAL NOTES

1. ALL DIMENSIONS NOTED AS CLEAR SHALL MAINTAIN THE FULL SPACE INDICATED WITHOUT ENCROACHMENTS.
2. ENSURE THAT ALL REQUIRED BACKING IS INSTALLED IN WALLS PRIOR TO INSTALLING GYPSUM BOARD.
3. INFILL, PATCH, AND REPAIR WALLS TO MATCH EXISTING CONDITIONS WHERE MECHANICAL, PLUMBING, AND ELECTRICAL ITEMS WERE DEMOLISHED. THESE INCLUDE BUT ARE NOT LIMITED TO; LOUVERS, EXHAUST FANS, PIPES, ETC.
4. PATCH AND REPAIR FLOOR TO MATCH EXISTING CONDITIONS WHERE DAMAGED.
5. SEE SHEETS A-602, A-603, A-604 FOR FULL ELEVATORS SCOPE OF WORK.
6. ALL PERSONNEL WORKING IN SURGERY AND SPS MUST WEAR PROPER DONNING AS THESE AREAS ARE STERILE AREAS.
7. MAINTAIN FIRE-RESISTANCE RATING OF ALL EXISTING WALLS, FLOORS, AND CEILING ASSEMBLIES WHERE NEW PENETRATIONS OR DEMOLITION OCCURS.

KEY PLAN



Revisions:	Date:

CONSULTANT

ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246

SPEESDESIGNBUILD

STAMP

10000 REGISTERED ARCHITECT JAMES M. KING STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title	BUILDING 7 - LEVEL 04 - ENLARGED PLANS
Phase	100% CONSTRUCTION DOCUMENTS
Approved:	
	FULLY SPRINKLERED
Project Title	REPLACE ELEVATORS IN BLDG 7 & BLDG 9
Project Number	502-24-102
Building Number	7
Location	ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA
Drawing Number	AE104
Issue Date	03/24/2026
Checked	MK
Drawn	AJ

VA FORM 08 - 6231

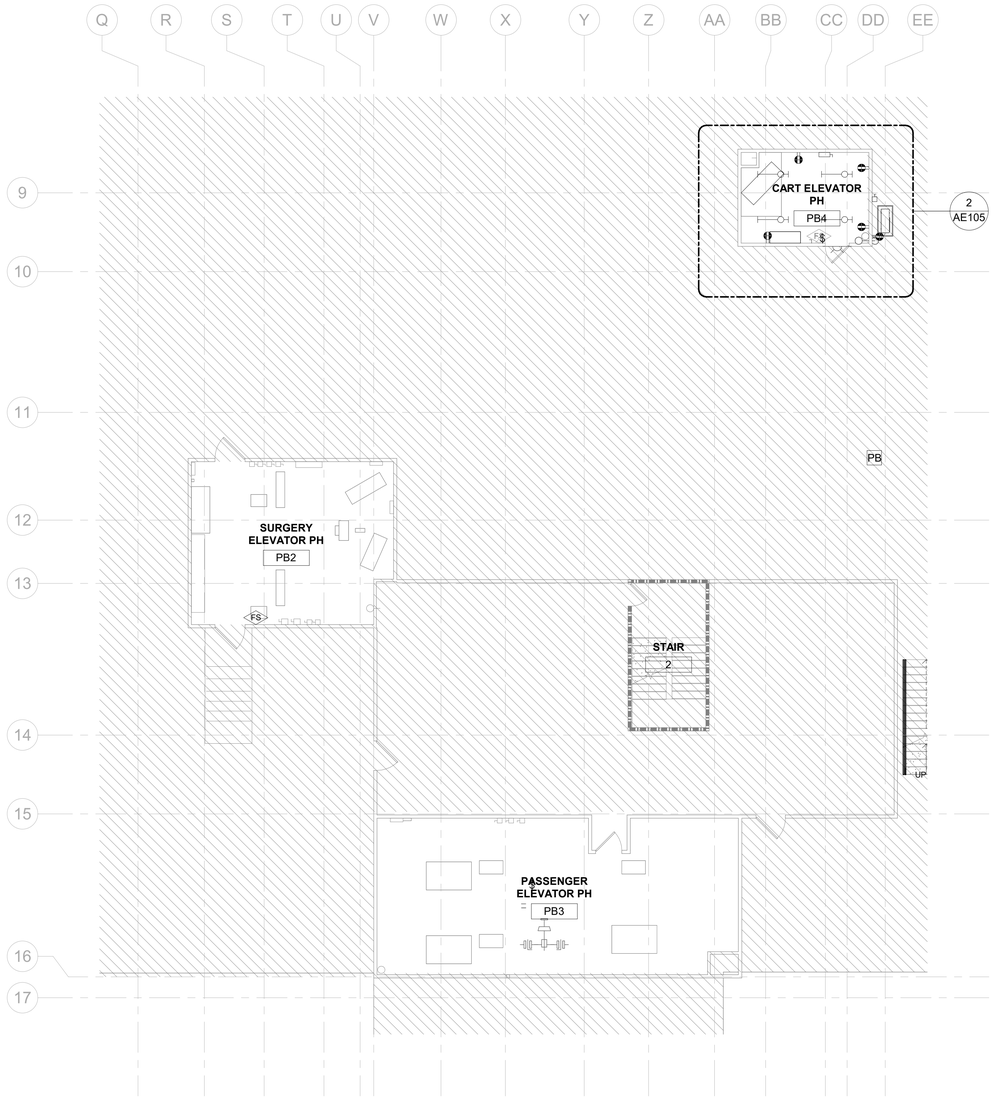

1 BUILDING 7 - PENTHOUSE - FLOOR PLAN - ENLARGED PLAN

1/8" = 1'-0"

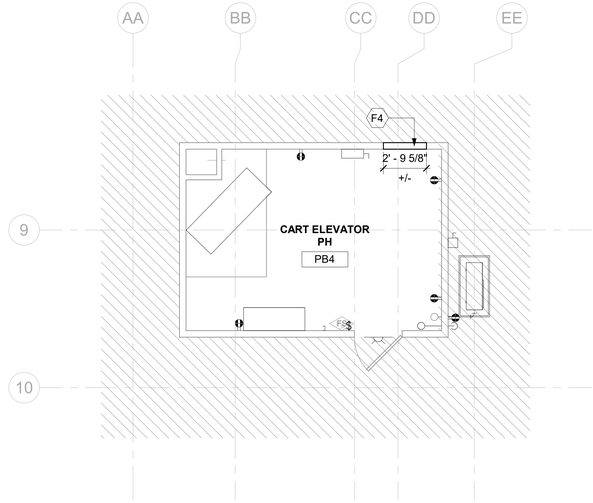

2 BLDG 7 - CARTLIFT PENTHOUSE- FLOOR PLAN - ENLARGED PLAN

1/4" = 1'-0"

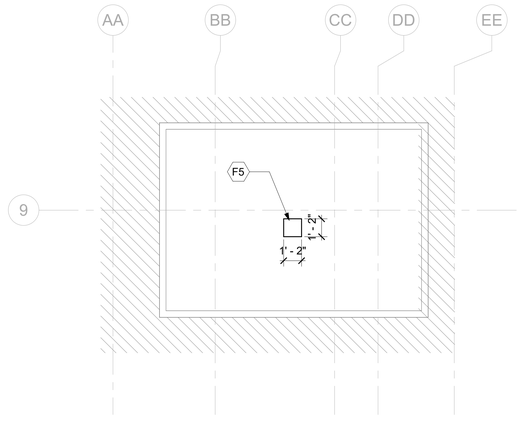

3 BLDG 7 - CARTLIFT PENTHOUSE - ROOF PLAN

1/4" = 1'-0"

LEGEND

- OUT OF SCOPE
- EXISTING DOOR TO REMAIN
- NEW DOOR
- EXISTING TO REMAIN
- NEW
- 2 HR FIRE RATED WALL (EXISTING)
- NEW LVT FLOORING

KEY NOTES (THIS SHEET ONLY)

F4	INFILL AND PAINT OPENING WHERE LOUVER WAS DEMOLISHED TO MATCH EXISTING CONDITIONS.
F5	INFILL CONCRETE CURB WHERE EXAUST FAN WAS DEMOLISHED. VERIFY DIMENSIONS ON FIELD. PAINT TO MATCH EXISTING ADJACENT CONDITIONS.

GENERAL NOTES

1. ALL DIMENSIONS NOTED AS CLEAR SHALL MAINTAIN THE FULL SPACE INDICATED WITHOUT ENCROACHMENTS.
2. ENSURE THAT ALL REQUIRED BACKING IS INSTALLED IN WALLS PRIOR TO INSTALLING GYPSUM BOARD.
3. INFILL, PATCH, AND REPAIR WALLS TO MATCH EXISTING CONDITIONS WHERE MECHANICAL, PLUMBING, AND ELECTRICAL ITEMS WERE DEMOLISHED. THESE INCLUDE BUT ARE NOT LIMITED TO; LOUVERS, EXHAUST FANS, PIPES, ETC.
4. PATCH AND REPAIR FLOOR TO MATCH EXISTING CONDITIONS WHERE DAMAGED.
5. SEE SHEETS A-602, A-603, A-604 FOR FULL ELEVATORS SCOPE OF WORK.
6. ALL PERSONNEL WORKING IN SURGERY AND SPS MUST WEAR PROPER DONNING AS THESE AREAS ARE STERILE AREAS.
7. MAINTAIN FIRE-RESISTANCE RATING OF ALL EXISTING WALLS, FLOORS, AND CEILING ASSEMBLIES WHERE NEW PENETRATIONS OR DEMOLITION OCCURS.

KEY PLAN



AREA SHOWN

Revisions:	Date:

CONSULTANT

ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246

SPEESDESIGNBUILD

STAMP

10000 REGISTERED ARCHITECT JAMES M. KING STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title	BUILDING 7 - PENTHOUSE - ENLARGED PLANS
Phase	100% CONSTRUCTION DOCUMENTS
Approved:	
	FULLY SPRINKLERED
Project Title	REPLACE ELEVATORS IN BLDG 7 & BLDG 9
Project Number	502-24-102
Building Number	7
Location	ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA
Drawing Number	AE105
Issue Date	03/24/2026
Checked	MK
Drawn	AJ

VA FORM 08 - 6231

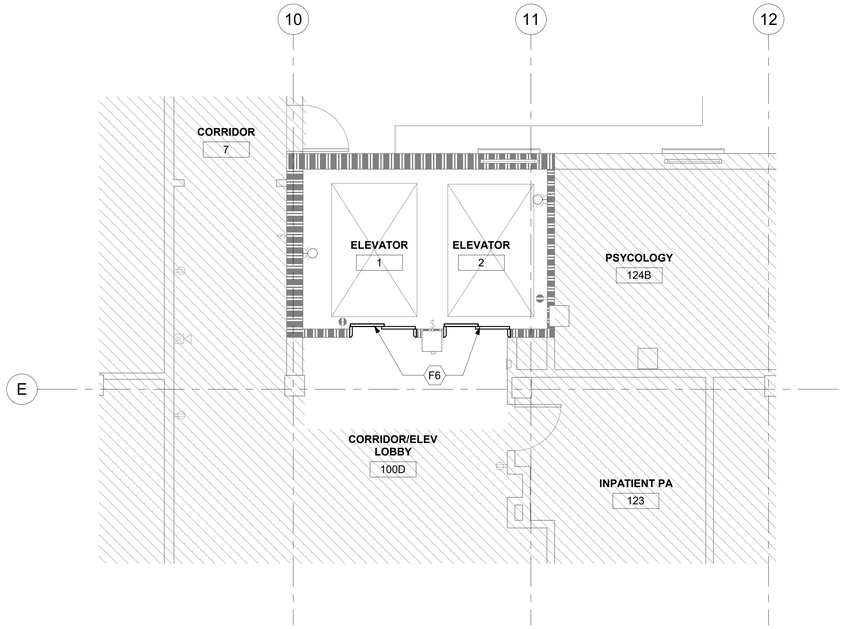

1 BUILDING 9 - LEVEL 01 - ELEV 1 & 2 - ENLARGED PLAN
1/4" = 1'-0"

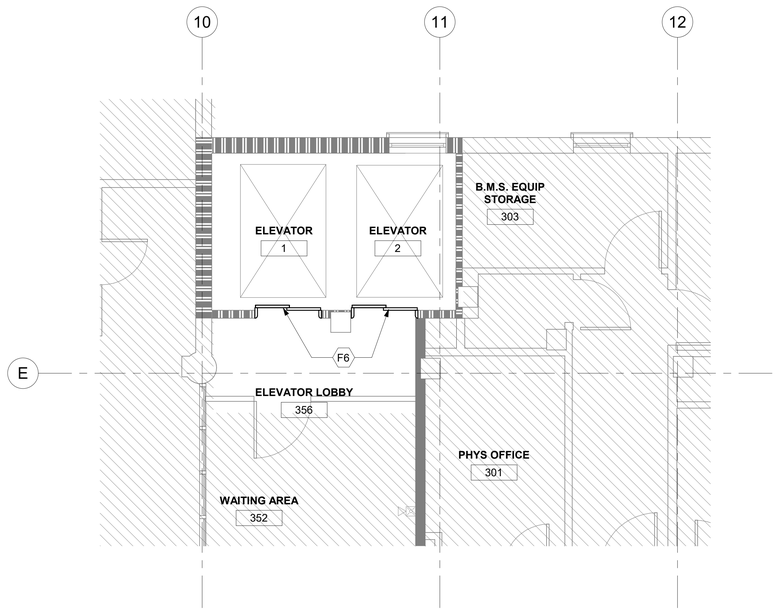

3 BUILDING 9 - LEVEL 03 - ELEV 1 & 2 - ENLARGED PLAN
1/4" = 1'-0"

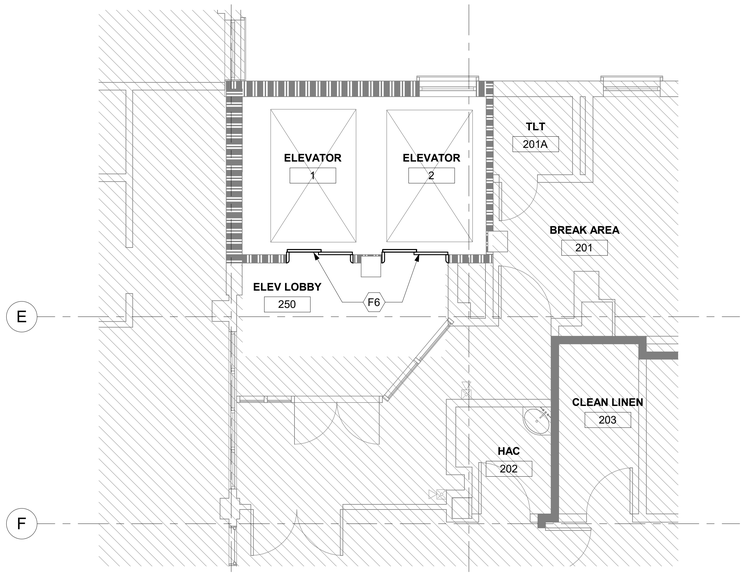

2 BUILDING 9 - LEVEL 02 - ELEV 1 & 2 - ENLARGED PLAN
1/4" = 1'-0"

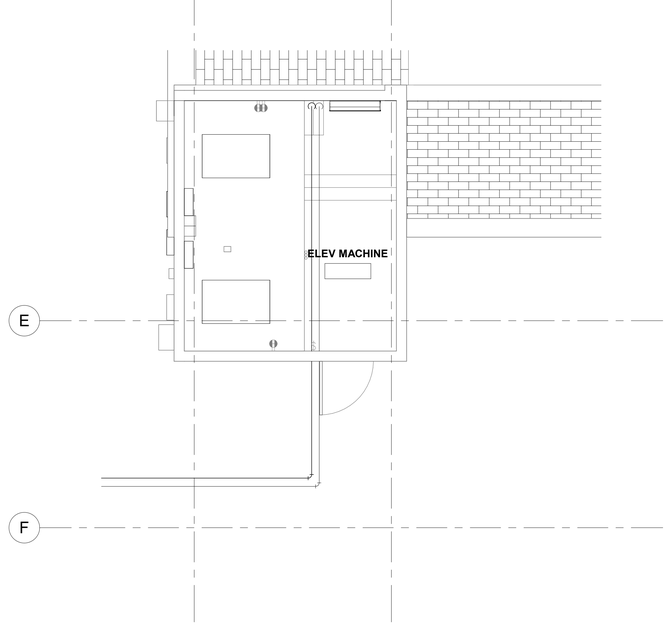

4 BUILDING 9 - PENTHOUSE - ENLARGED PLAN
1/4" = 1'-0"

LEGEND

- OUT OF SCOPE
- EXISTING DOOR TO REMAIN
- NEW DOOR
- EXISTING TO REMAIN
- NEW
- 2 HR FIRE RATED WALL (EXISTING)

KEY NOTES (THIS SHEET ONLY)

F6	INSTALL NEW MAIN FLOOR DOORS AND SILL. REFINISH EXISTING FRAME.

GENERAL NOTES

1. ALL DIMENSIONS NOTED AS CLEAR SHALL MAINTAIN THE FULL SPACE INDICATED WITHOUT ENCROACHMENTS.
2. ENSURE THAT ALL REQUIRED BACKING IS INSTALLED IN WALLS PRIOR TO INSTALLING GYPSUM BOARD.
3. INFILL, PATCH, AND REPAIR WALLS TO MATCH EXISTING CONDITIONS WHERE MECHANICAL, PLUMBING, AND ELECTRICAL ITEMS WERE DEMOLISHED. THESE INCLUDE BUT ARE NOT LIMITED TO; LOUVERS, EXHAUST FANS, PIPES, ETC.
4. PATCH AND REPAIR FLOOR TO MATCH EXISTING CONDITIONS WHERE DAMAGED.
5. SEE SHEETS A-602, A-603, A-604 FOR FULL ELEVATORS SCOPE OF WORK.
6. ALL PERSONNEL WORKING IN SURGERY AND SPS MUST WEAR PROPER DONNING AS THESE AREAS ARE STERILE AREAS.
7. MAINTAIN FIRE-RESISTANCE RATING OF ALL EXISTING WALLS, FLOORS, AND CEILING ASSEMBLIES WHERE NEW PENETRATIONS OR DEMOLITION OCCURS.

KEY PLAN

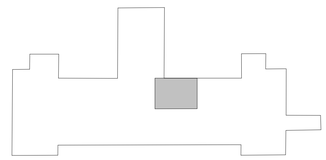

AREA SHOWN

Revisions:	Date:

CONSULTANT
ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD
A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246
SDB SPEESDESIGNBUILD

STAMP
10000 REGISTERED ARCHITECT JAMES M. KING STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management
VA U.S. Department of Veterans Affairs

Drawing Title	BUILDING 9 - LEVELS 01, 02, 03, PH. - ENLARGED PLANS
Phase	100% CONSTRUCTION DOCUMENTS
Approved:	FULLY SPRINKLERED
Project Title	REPLACE ELEVATORS IN BLDG 7 & BLDG 9
Project Number	502-24-102
Building Number	9
Location	ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA
Drawing Number	AE106
Issue Date	03/24/2026
Checked	MK
Drawn	AJ

VA FORM 08 - 6231

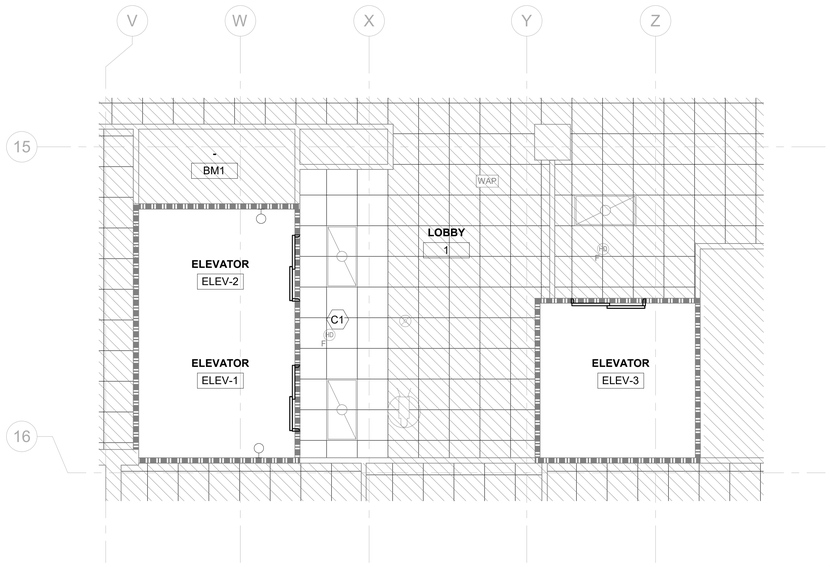

1 BUILDING 7 - BASEMENT - ELEV 1, 2, & 3 - ENLARGED RCP

1/4" = 1'-0"

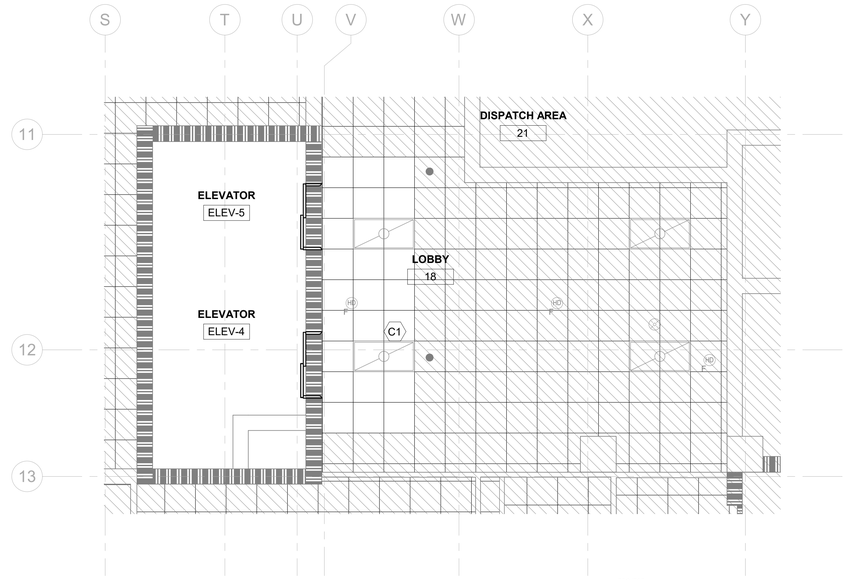

2 BUILDING 7 - BASEMENT - ELEV 4 & 5 - ENLARGED RCP

1/4" = 1'-0"

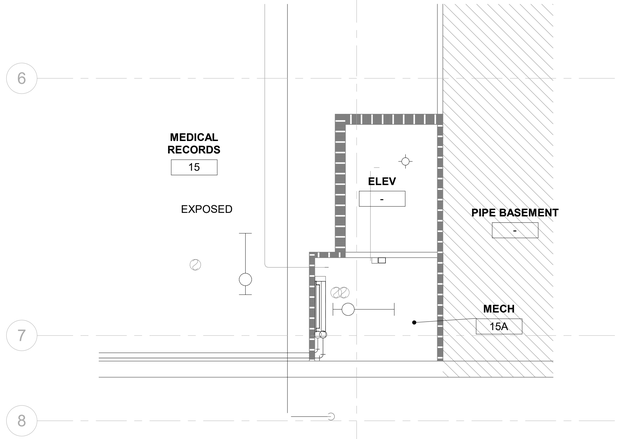

3 BUILDING 7 - BASEMENT - MED RECORDS ELEV - ENLARGED RCP

1/4" = 1'-0"

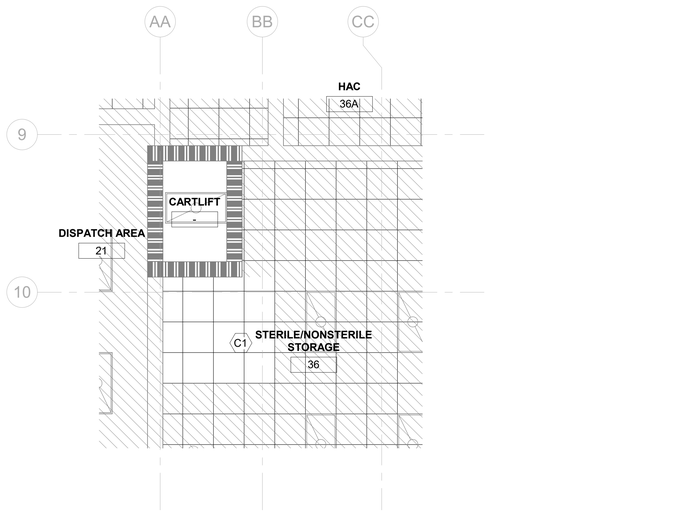

4 BUILDING 7 - BASEMENT - SPS CARTLIFT - ENLARGED RCP

1/4" = 1'-0"

LEGEND

- OUT OF SCOPE
- 2x2 ACOUSTICAL CEILING TILE
- 2x4 ACOUSTICAL CEILING TILE
- GYPSUM BOARD ON METAL STUDS
- SPRINKLER PER FIRE PROTECTION
- DIFFUSER PER MECHANICAL (SIZE & PROPORTION MAY VARY)
- LIGHT FIXTURE PER ELECTRICAL (SIZE & PROPORTION MAY VARY)

KEY NOTES (THIS SHEET ONLY)

C1	INSTALL NEW ACOUSTICAL TILES WHERE DEMOLISHED FOR COMPLETION OF WORK. TILES TO MATCH EXISTING ADJACENT.

GENERAL NOTES

1. ACT CEILING SHALL BE CENTERED WITHIN THE ROOM OR SPACE, UNLESS OTHERWISE NOTED.
2. ALL DIMENSIONS NOTED AS CLEAR SHALL MAINTAIN THE FULL SPACE INDICATED WITHOUT ENCROACHMENTS.
3. ENSURE THAT ALL REQUIRED BACKING IS INSTALLED IN WALLS PRIOR TO INSTALLING GYPSUM BOARD.
4. INFILL, PATCH, AND REPAIR WALLS TO MATCH EXISTING CONDITIONS WHERE MECHANICAL, PLUMBING, AND ELECTRICAL ITEMS WERE DEMOLISHED. THESE INCLUDE BUT ARE NOT LIMITED TO; LOUVERS, EXHAUST FANS, ETC.
5. PATCH AND REPAIR FLOOR TO MATCH EXISTING CONDITIONS WHERE DAMAGED.
6. SEE SHEETS A-602, A-603, A-604 FOR FULL ELEVATORS SCOPE OF WORK.
7. ALL PERSONNEL WORKING IN SURGERY AND SPS MUST WEAR PROPER DONNING AS THESE AREAS ARE STERILE AREAS.

KEY PLAN

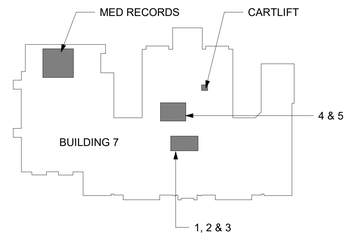

Revisions:	Date:

CONSULTANT

ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246

STAMP

10000 REGISTERED ARCHITECT JAMES M. KING STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: BUILDING 7 - BASEMENT - ENLARGED RCPS

Approved:

Phase: 100% CONSTRUCTION DOCUMENTS

FULLY SPRINKLERED

Project Title: REPLACE ELEVATORS IN BLDG 7 & BLDG 9

Location: ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA

Issue Date: 03/24/2026

Checked: MK

Drawn: AJ

Project Number: 502-24-102

Building Number: 7

Drawing Number: AC100

VA FORM 08 - 6231

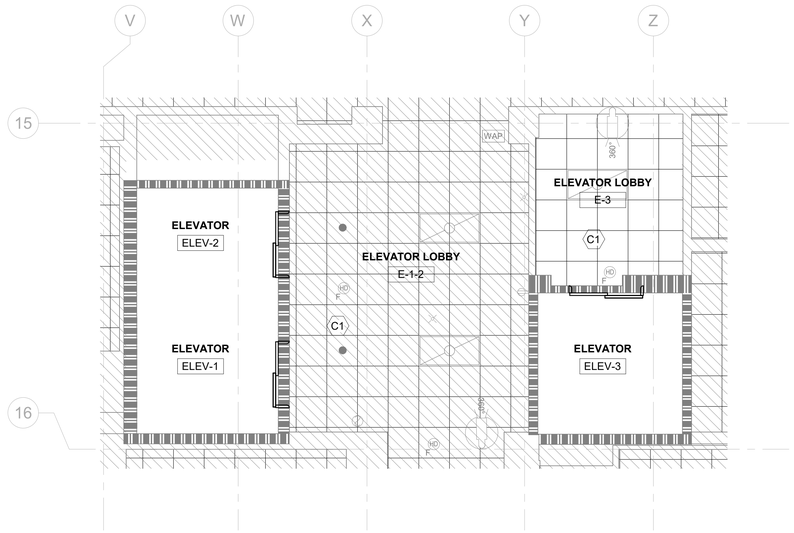

1 BUILDING 7 - LEVEL 01 - ELEV 1,2, &3 - ENLARGED RCP

1/4" = 1'-0"

PROJECT NORTH

TRUE NORTH (DASHED)

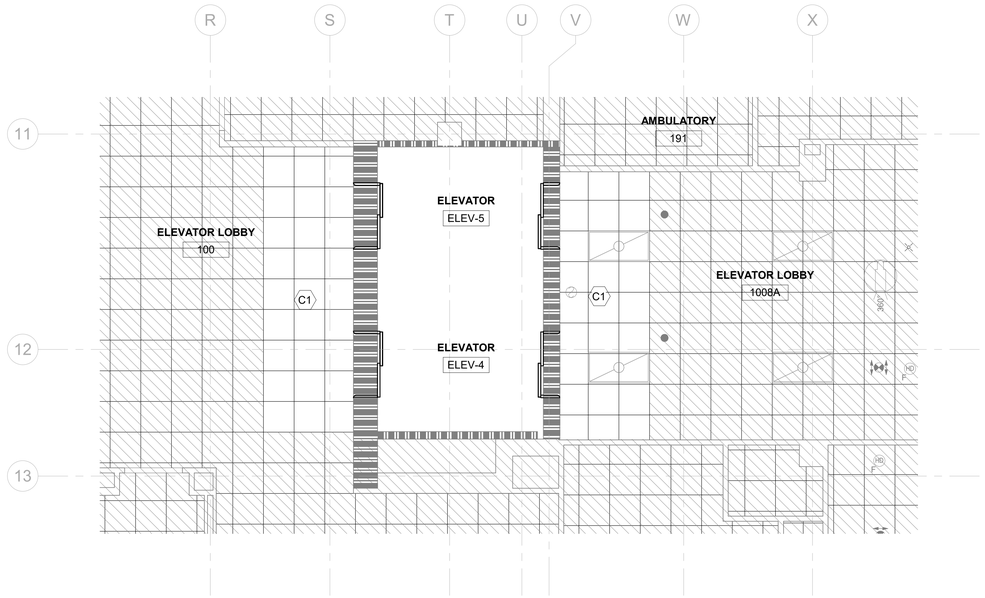

2 BUILDING 7 - LEVEL 01 - ELEV 4 & 5 - ENLARGED RCP

1/4" = 1'-0"

PROJECT NORTH

TRUE NORTH (DASHED)

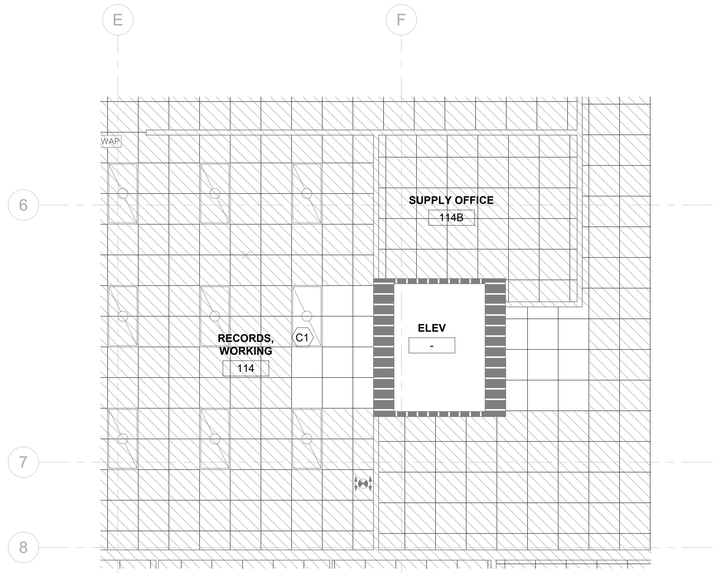

3 BUILDING 7 - LEVEL 01 - MED RECORDS ELEV - ENLARGED RCP

1/4" = 1'-0"

PROJECT NORTH

TRUE NORTH (DASHED)

LEGEND

- OUT OF SCOPE
- 2x2 ACOUSTICAL CEILING TILE
- 2x4 ACOUSTICAL CEILING TILE
- GYPSUM BOARD ON METAL STUDS
- SPRINKLER PER FIRE PROTECTION
- DIFFUSER PER MECHANICAL (SIZE & PROPORTION MAY VARY)
- LIGHT FIXTURE PER ELECTRICAL (SIZE & PROPORTION MAY VARY)

KEY NOTES (THIS SHEET ONLY)

C1	INSTALL NEW ACOUSTICAL TILES WHERE DEMOLISHED FOR COMPLETION OF WORK. TILES TO MATCH EXISTING ADJACENT.

GENERAL NOTES

1. ACT CEILING SHALL BE CENTERED WITHIN THE ROOM OR SPACE, UNLESS OTHERWISE NOTED.
2. ALL DIMENSIONS NOTED AS CLEAR SHALL MAINTAIN THE FULL SPACE INDICATED WITHOUT ENCROACHMENTS.
3. ENSURE THAT ALL REQUIRED BACKING IS INSTALLED IN WALLS PRIOR TO INSTALLING GYPSUM BOARD.
4. INFILL, PATCH, AND REPAIR WALLS TO MATCH EXISTING CONDITIONS WHERE MECHANICAL, PLUMBING, AND ELECTRICAL ITEMS WERE DEMOLISHED. THESE INCLUDE BUT ARE NOT LIMITED TO; LOUVERS, EXHAUST FANS, ETC.
5. PATCH AND REPAIR FLOOR TO MATCH EXISTING CONDITIONS WHERE DAMAGED.
6. SEE SHEETS A-602, A-603, A-604 FOR FULL ELEVATORS SCOPE OF WORK.
7. ALL PERSONNEL WORKING IN SURGERY AND SPS MUST WEAR PROPER DONNING AS THESE AREAS ARE STERILE AREAS.

KEY PLAN

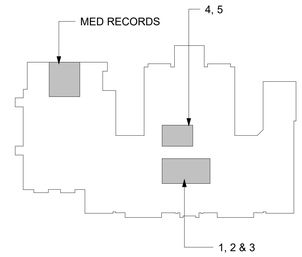

AREA SHOWN

Revisions:	Date:

CONSULTANT

ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246

SDB SPEESDESIGNBUILD

STAMP

10000 REGISTERED ARCHITECT JAMES M. KING STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: BUILDING 7 - LEVEL 01 - ENLARGED RCPS

Approved:

Phase: 100% CONSTRUCTION DOCUMENTS

FULLY SPRINKLERED

Project Title: REPLACE ELEVATORS IN BLDG 7 & BLDG 9

Location: ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA

Issue Date: 03/24/2026 | Checked: MK | Drawn: AJ

Project Number: 502-24-102

Building Number: 7

Drawing Number: AC101

VA FORM 08 - 6231

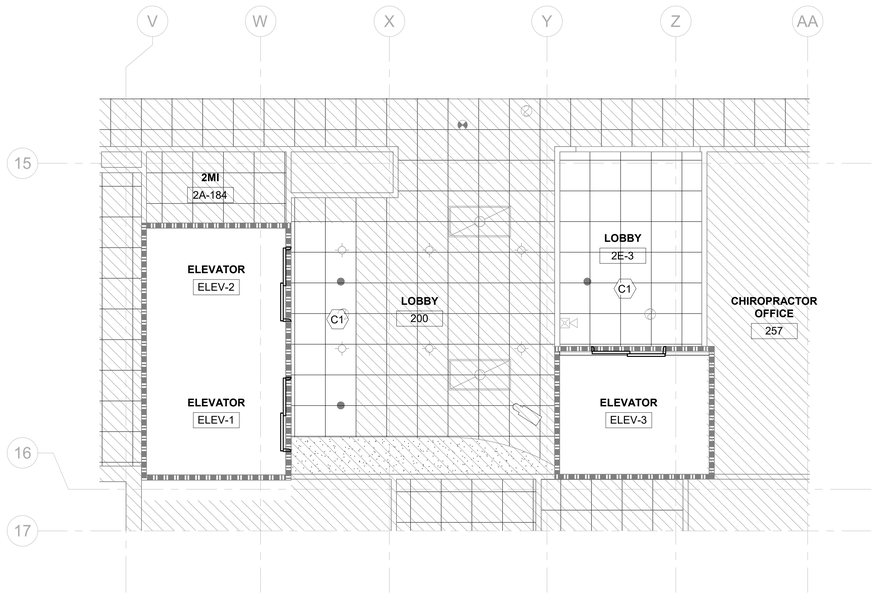

1 BUILDING 7 - LEVEL 02 - ELEV 1, 2, & 3 - ENLARGED RCP

1/4" = 1'-0"

PROJECT NORTH
TRUE NORTH (DASHED)

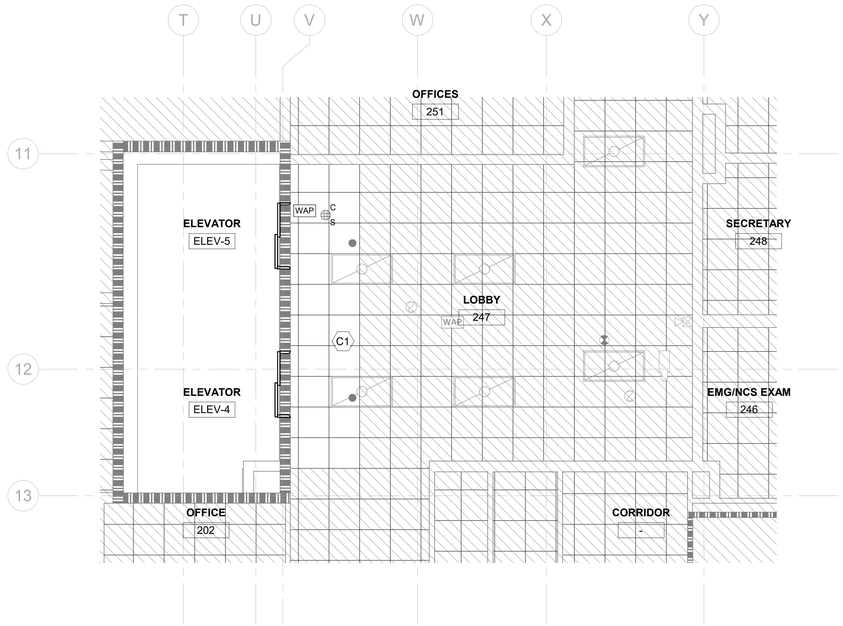

2 BUILDING 7 - LEVEL 02 - ELEV 4 & 5 - ENLARGED RCP

1/4" = 1'-0"

PROJECT NORTH
TRUE NORTH (DASHED)

LEGEND

- OUT OF SCOPE
- 2x2 ACOUSTICAL CEILING TILE
- 2x4 ACOUSTICAL CEILING TILE
- GYPSUM BOARD ON METAL STUDS
- SPRINKLER PER FIRE PROTECTION
- DIFFUSER PER MECHANICAL (SIZE & PROPORTION MAY VARY)
- LIGHT FIXTURE PER ELECTRICAL (SIZE & PROPORTION MAY VARY)

KEY NOTES (THIS SHEET ONLY)

C1	INSTALL NEW ACOUSTICAL TILES WHERE DEMOLISHED FOR COMPLETION OF WORK. TILES TO MATCH EXISTING ADJACENT.

GENERAL NOTES

1. ACT CEILING SHALL BE CENTERED WITHIN THE ROOM OR SPACE, UNLESS OTHERWISE NOTED.
2. ALL DIMENSIONS NOTED AS CLEAR SHALL MAINTAIN THE FULL SPACE INDICATED WITHOUT ENCROACHMENTS.
3. ENSURE THAT ALL REQUIRED BACKING IS INSTALLED IN WALLS PRIOR TO INSTALLING GYPSUM BOARD.
4. INFILL, PATCH, AND REPAIR WALLS TO MATCH EXISTING CONDITIONS WHERE MECHANICAL, PLUMBING, AND ELECTRICAL ITEMS WERE DEMOLISHED. THESE INCLUDE BUT ARE NOT LIMITED TO; LOUVERS, EXHAUST FANS, ETC.
5. PATCH AND REPAIR FLOOR TO MATCH EXISTING CONDITIONS WHERE DAMAGED.
6. SEE SHEETS A-602, A-603, A-604 FOR FULL ELEVATORS SCOPE OF WORK.
7. ALL PERSONNEL WORKING IN SURGERY AND SPS MUST WEAR PROPER DONNING AS THESE AREAS ARE STERILE AREAS.

KEY PLAN

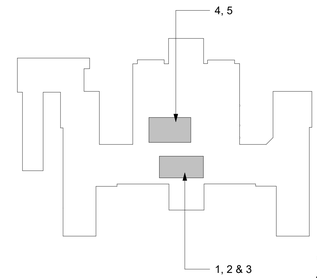

AREA SHOWN

Revisions:	Date:

CONSULTANT

ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246

SDB SPEESDESIGNBUILD

STAMP

10000 REGISTERED ARCHITECT JAMES M. KING STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: BUILDING 7 - LEVEL 02 - ENLARGED RCPS

Approved:

Phase: 100% CONSTRUCTION DOCUMENTS

FULLY SPRINKLERED

Project Title: REPLACE ELEVATORS IN BLDG 7 & BLDG 9

Location: ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA

Issue Date: 03/24/2026 | Checked: MK | Drawn: AJ

Project Number: 502-24-102

Building Number: 7

Drawing Number: AC102

VA FORM 08 - 6231

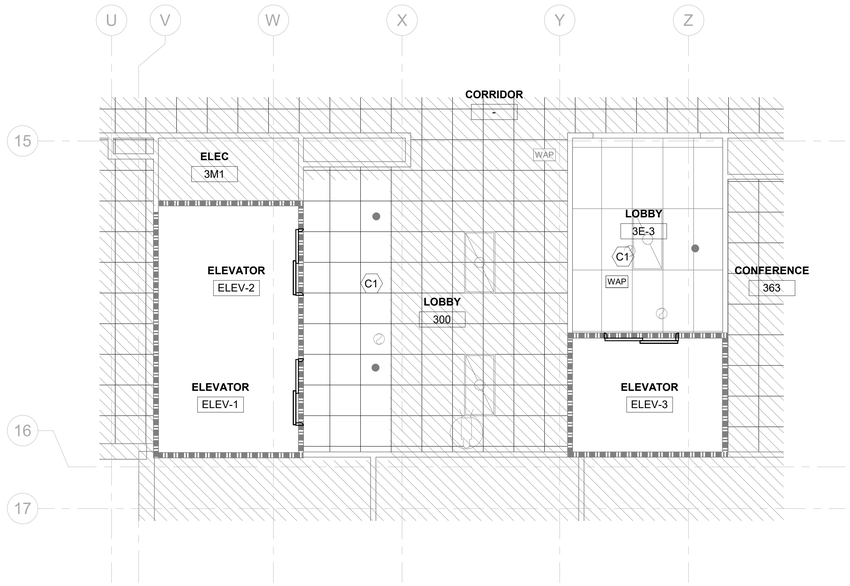

1 BUILDING 7 - LEVEL 03 - ELEV 1, 2, & 3 - ENLARGED RCP

1/4" = 1'-0"

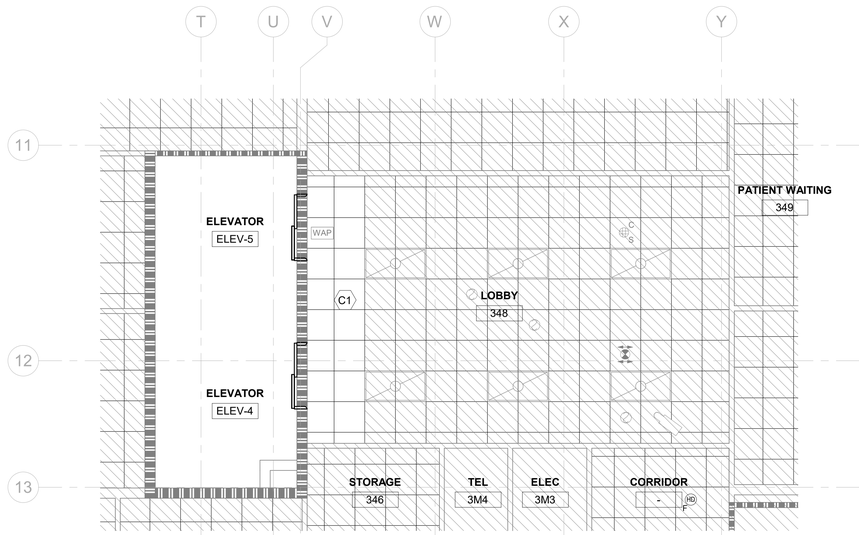

2 BUILDING 7 - LEVEL 03 - ELEV 4 & 5 - ENLARGED RCP

1/4" = 1'-0"

LEGEND

- OUT OF SCOPE
- 2x2 ACOUSTICAL CEILING TILE
- 2x4 ACOUSTICAL CEILING TILE
- GYPSUM BOARD ON METAL STUDS
- SPRINKLER PER FIRE PROTECTION
- DIFFUSER PER MECHANICAL (SIZE & PROPORTION MAY VARY)
- LIGHT FIXTURE PER ELECTRICAL (SIZE & PROPORTION MAY VARY)

KEY NOTES (THIS SHEET ONLY)

C1	INSTALL NEW ACOUSTICAL TILES WHERE DEMOLISHED FOR COMPLETION OF WORK. TILES TO MATCH EXISTING ADJACENT.

GENERAL NOTES

1. ACT CEILING SHALL BE CENTERED WITHIN THE ROOM OR SPACE, UNLESS OTHERWISE NOTED.
2. ALL DIMENSIONS NOTED AS CLEAR SHALL MAINTAIN THE FULL SPACE INDICATED WITHOUT ENCROACHMENTS.
3. ENSURE THAT ALL REQUIRED BACKING IS INSTALLED IN WALLS PRIOR TO INSTALLING GYPSUM BOARD.
4. INFILL, PATCH, AND REPAIR WALLS TO MATCH EXISTING CONDITIONS WHERE MECHANICAL, PLUMBING, AND ELECTRICAL ITEMS WERE DEMOLISHED. THESE INCLUDE BUT ARE NOT LIMITED TO; LOUVERS, EXHAUST FANS, ETC.
5. PATCH AND REPAIR FLOOR TO MATCH EXISTING CONDITIONS WHERE DAMAGED.
6. SEE SHEETS A-602, A-603, A-604 FOR FULL ELEVATORS SCOPE OF WORK.
7. ALL PERSONNEL WORKING IN SURGERY AND SPS MUST WEAR PROPER DONNING AS THESE AREAS ARE STERILE AREAS.

KEY PLAN



Revisions:	Date:

CONSULTANT

ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246

SDB SPEESDESIGNBUILD

STAMP

10000 REGISTERED ARCHITECT JAMES M. KING STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title	BUILDING 7 - LEVEL 03 - ENLARGED RCPS
Phase	100% CONSTRUCTION DOCUMENTS
Approved:	
	FULLY SPRINKLERED
Project Title	REPLACE ELEVATORS IN BLDG 7 & BLDG 9
Project Number	502-24-102
Building Number	7
Location	ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA
Drawing Number	AC103
Issue Date	03/24/2026
Checked	MK
Drawn	AJ

VA FORM 08 - 6231

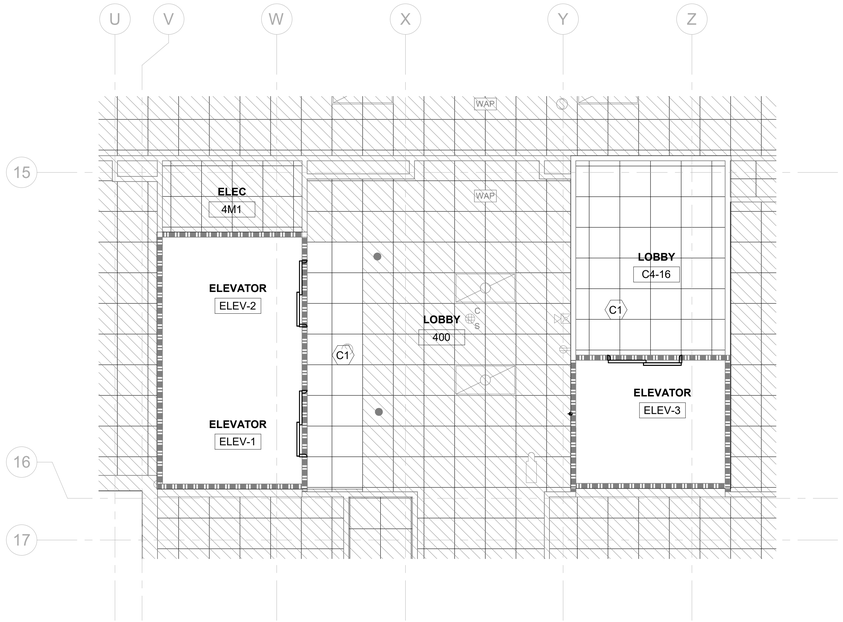

1 BUILDING 7 - LEVEL 04 - ELEV 1, 2, & 3 - ENLARGED RCP

1/4" = 1'-0"

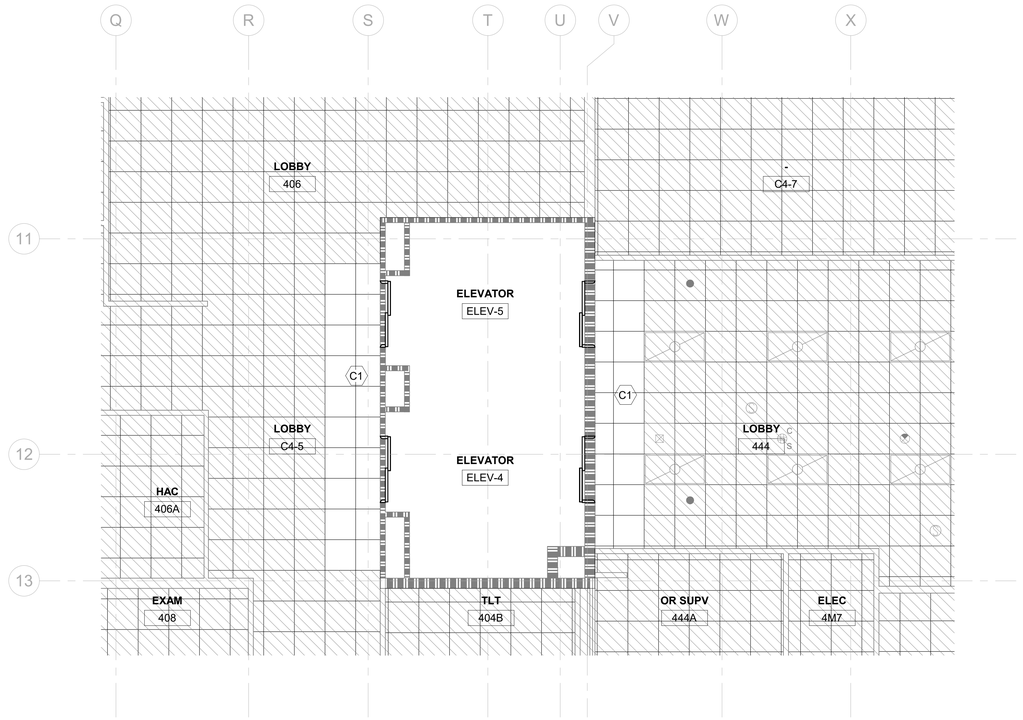

2 BUILDING 7 - LEVEL 04 - ELEV 4 & 5 - ENLARGED RCP

1/4" = 1'-0"

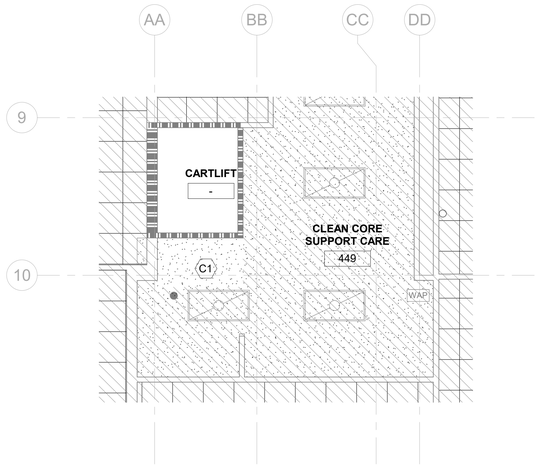

3 BUILDING 7 - LEVEL 04 - SPS CARTLIFT - ENLARGED RCP

1/4" = 1'-0"

LEGEND

- OUT OF SCOPE
- 2x2 ACOUSTICAL CEILING TILE
- 2x4 ACOUSTICAL CEILING TILE
- GYPSUM BOARD ON METAL STUDS
- SPRINKLER PER FIRE PROTECTION
- DIFFUSER PER MECHANICAL (SIZE & PROPORTION MAY VARY)
- LIGHT FIXTURE PER ELECTRICAL (SIZE & PROPORTION MAY VARY)

KEY NOTES (THIS SHEET ONLY)

C1	INSTALL NEW ACOUSTICAL TILES WHERE DEMOLISHED FOR COMPLETION OF WORK. TILES TO MATCH EXISTING ADJACENT.

GENERAL NOTES

1. ACT CEILING SHALL BE CENTERED WITHIN THE ROOM OR SPACE, UNLESS OTHERWISE NOTED.
2. ALL DIMENSIONS NOTED AS CLEAR SHALL MAINTAIN THE FULL SPACE INDICATED WITHOUT ENCROACHMENTS.
3. ENSURE THAT ALL REQUIRED BACKING IS INSTALLED IN WALLS PRIOR TO INSTALLING GYPSUM BOARD.
4. INFILL, PATCH, AND REPAIR WALLS TO MATCH EXISTING CONDITIONS WHERE MECHANICAL, PLUMBING, AND ELECTRICAL ITEMS WERE DEMOLISHED. THESE INCLUDE BUT ARE NOT LIMITED TO; LOUVERS, EXHAUST FANS, ETC.
5. PATCH AND REPAIR FLOOR TO MATCH EXISTING CONDITIONS WHERE DAMAGED.
6. SEE SHEETS A-602, A-603, A-604 FOR FULL ELEVATORS SCOPE OF WORK.
7. ALL PERSONNEL WORKING IN SURGERY AND SPS MUST WEAR PROPER DONNING AS THESE AREAS ARE STERILE AREAS.

KEY PLAN



Revisions:	Date:

CONSULTANT

ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246

STAMP

REGISTERED ARCHITECT
10000
JAMES M. KING
STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: BUILDING 7 - LEVEL 04 - ENLARGED RCPS

Phase: 100% CONSTRUCTION DOCUMENTS

Approved:

FULLY SPRINKLERED

Project Title: REPLACE ELEVATORS IN BLDG 7 & BLDG 9

Project Number: 502-24-102

Building Number: 7

Location: ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA

Drawing Number: AC104

Issue Date	Checked	Drawn
03/24/2026	MK	AJ

VA FORM 08 - 6231

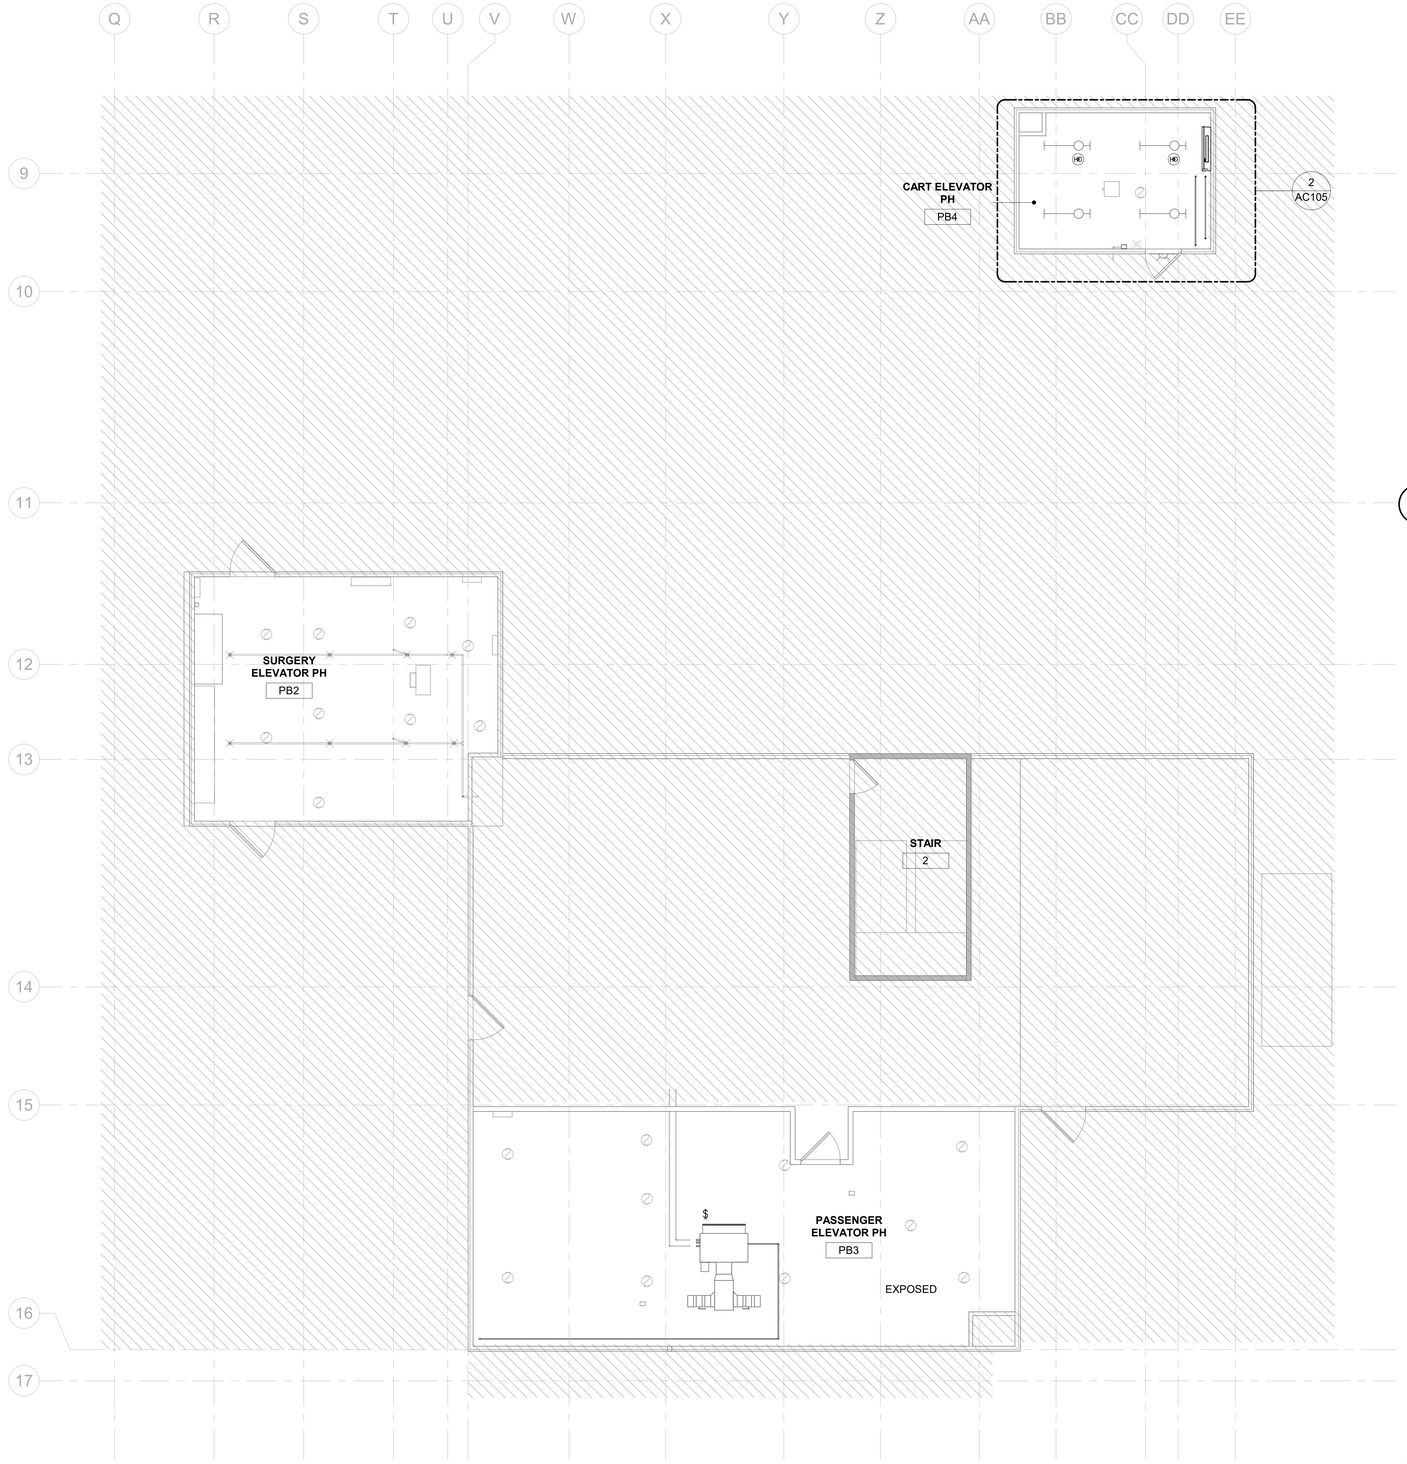

1 BLDG 7 - PENTHOUSE - RCP

3/16" = 1'-0"

PROJECT NORTH

TRUE NORTH (DASHED)

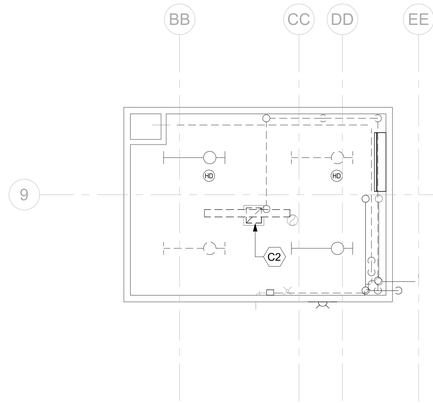

2 BLDG 7 - CARTLIFT PENTHOUSE - ENLARGED RCP

1/4" = 1'-0"

PROJECT NORTH

TRUE NORTH (DASHED)

LEGEND

- OUT OF SCOPE
- 2x2 ACOUSTICAL CEILING TILE
- 2x4 ACOUSTICAL CEILING TILE
- GYPSUM BOARD ON METAL STUDS
- SPRINKLER PER FIRE PROTECTION
- DIFFUSER PER MECHANICAL (SIZE & PROPORTION MAY VARY)
- LIGHT FIXTURE PER ELECTRICAL (SIZE & PROPORTION MAY VARY)

KEY NOTES (THIS SHEET ONLY)

C2	PROVIDE WEATHER-TIGHT SHEET METAL CAP AT TOP OF EXISTING ROOF FUCT AND SEAL AIRTIGHT. EXISTING DUCT AND INTERIOR LOUVER TO REMAIN.

GENERAL NOTES

1. ACT CEILING SHALL BE CENTERED WITHIN THE ROOM OR SPACE, UNLESS OTHERWISE NOTED.
2. ALL DIMENSIONS NOTED AS CLEAR SHALL MAINTAIN THE FULL SPACE INDICATED WITHOUT ENCROACHMENTS.
3. ENSURE THAT ALL REQUIRED BACKING IS INSTALLED IN WALLS PRIOR TO INSTALLING GYPSUM BOARD.
4. INFILL, PATCH, AND REPAIR WALLS TO MATCH EXISTING CONDITIONS WHERE MECHANICAL, PLUMBING, AND ELECTRICAL ITEMS WERE DEMOLISHED. THESE INCLUDE BUT ARE NOT LIMITED TO; LOUVERS, EXHAUST FANS, ETC.
5. PATCH AND REPAIR FLOOR TO MATCH EXISTING CONDITIONS WHERE DAMAGED.
6. SEE SHEETS A-602, A-603, A-604 FOR FULL ELEVATORS SCOPE OF WORK.
7. ALL PERSONNEL WORKING IN SURGERY AND SPS MUST WEAR PROPER DONNING AS THESE AREAS ARE STERILE AREAS.

KEY PLAN



AREA SHOWN

PROJECT NORTH

TRUE NORTH (DASHED)

Revisions:	Date:

CONSULTANT

ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246

SDB SPEESDESIGNBUILD

STAMP

10000 REGISTERED ARCHITECT JAMES M. KING STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title	BUILDING 7 - PENTHOUSE - ENLARGED RCPS
Approved:	
Phase	100% CONSTRUCTION DOCUMENTS
	FULLY SPRINKLERED
Project Title	REPLACE ELEVATORS IN BLDG 7 & BLDG 9
Location	ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA
Issue Date	03/24/2026
Checked	MK
Drawn	AJ
Project Number	502-24-102
Building Number	7
Drawing Number	AC105

VA FORM 08 - 6231

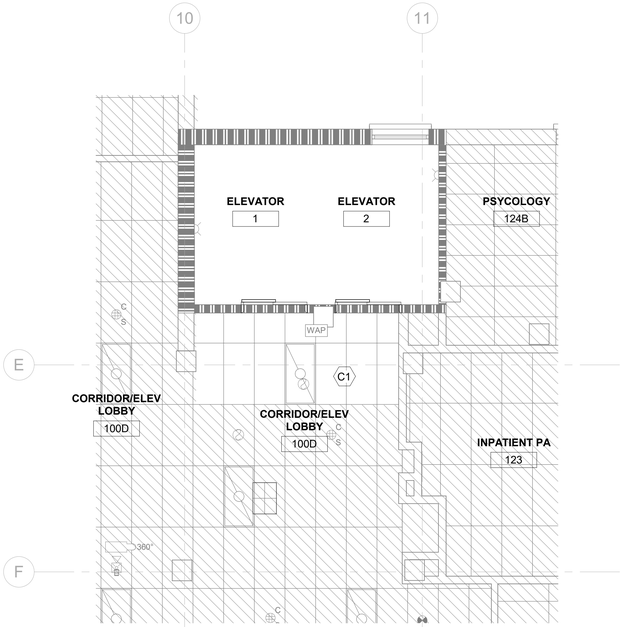

1 BUILDING 9 - LEVEL 01 - ELEV 1 & 2 - ENLARGED RCP

1/4" = 1'-0"

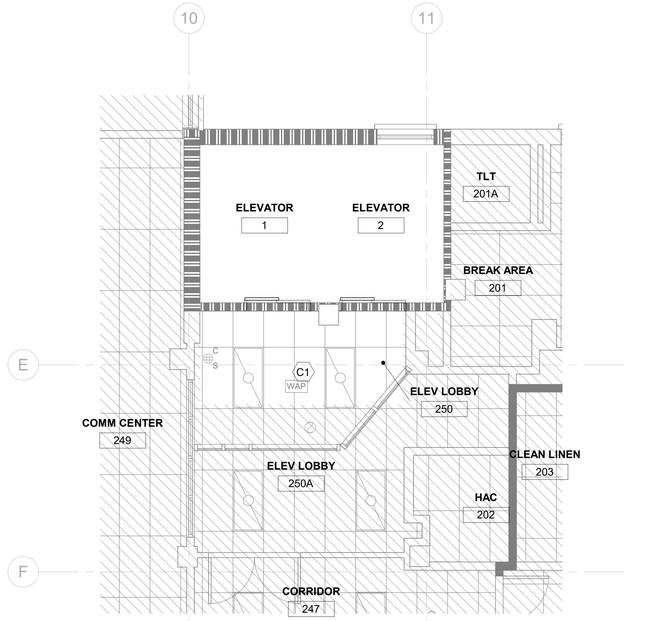

2 BUILDING 9 - LEVEL 02 - ELEV 1 & 2 - ENLARGED RCP

1/4" = 1'-0"

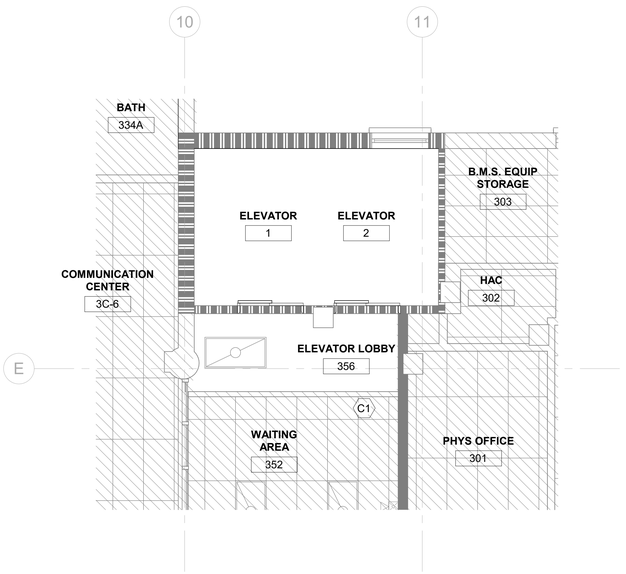

3 BUILDING 9 - LEVEL 03 - ELEV 1 & 2 - ENLARGED RCP

1/4" = 1'-0"

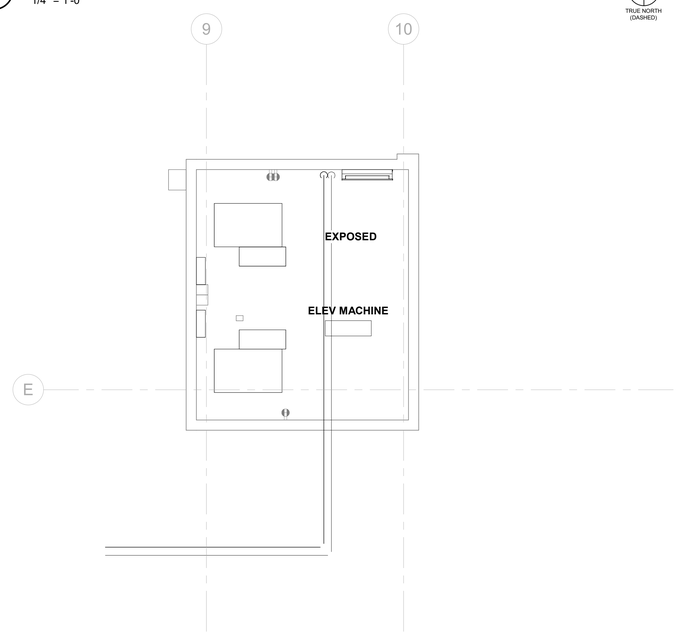

4 BLDG 9 - PENTHOUSE - ENLARGED RCP

1/4" = 1'-0"

LEGEND

- OUT OF SCOPE
- 2x2 ACOUSTICAL CEILING TILE
- 2x4 ACOUSTICAL CEILING TILE
- GYPSUM BOARD ON METAL STUDS
- SPRINKLER PER FIRE PROTECTION
- DIFFUSER PER MECHANICAL (SIZE & PROPORTION MAY VARY)
- LIGHT FIXTURE PER ELECTRICAL (SIZE & PROPORTION MAY VARY)

KEY NOTES (THIS SHEET ONLY)

C1	INSTALL NEW ACOUSTICAL TILES WHERE DEMOLISHED FOR COMPLETION OF WORK. TILES TO MATCH EXISTING ADJACENT.

GENERAL NOTES

1. ACT CEILING SHALL BE CENTERED WITHIN THE ROOM OR SPACE, UNLESS OTHERWISE NOTED.
2. ALL DIMENSIONS NOTED AS CLEAR SHALL MAINTAIN THE FULL SPACE INDICATED WITHOUT ENCROACHMENTS.
3. ENSURE THAT ALL REQUIRED BACKING IS INSTALLED IN WALLS PRIOR TO INSTALLING GYPSUM BOARD.
4. INFILL, PATCH, AND REPAIR WALLS TO MATCH EXISTING CONDITIONS WHERE MECHANICAL, PLUMBING, AND ELECTRICAL ITEMS WERE DEMOLISHED. THESE INCLUDE BUT ARE NOT LIMITED TO; LOUVERS, EXHAUST FANS, ETC.
5. PATCH AND REPAIR FLOOR TO MATCH EXISTING CONDITIONS WHERE DAMAGED.
6. SEE SHEETS A-602, A-603, A-604 FOR FULL ELEVATORS SCOPE OF WORK.
7. ALL PERSONNEL WORKING IN SURGERY AND SPS MUST WEAR PROPER DONNING AS THESE AREAS ARE STERILE AREAS.

KEY PLAN

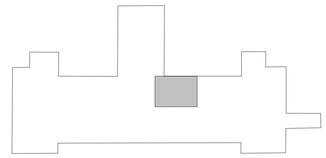

AREA SHOWN

Revisions:	Date:

CONSULTANT

ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246

SDB SPEESDESIGNBUILD

STAMP

10000 REGISTERED ARCHITECT JAMES M. KING STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: BUILDING 9 - LEVELS 01, 02, 03, PH. - ENLARGED RCPS	Phase: 100% CONSTRUCTION DOCUMENTS
Approved:	FULLY SPRINKLERED

Project Title: REPLACE ELEVATORS IN BLDG 7 & BLDG 9			Project Number: 502-24-102
			Building Number: 9
Location: ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA			Drawing Number: AC106
Issue Date: 03/24/2026	Checked: MK	Drawn: AJ	

VA FORM 08 - 6231

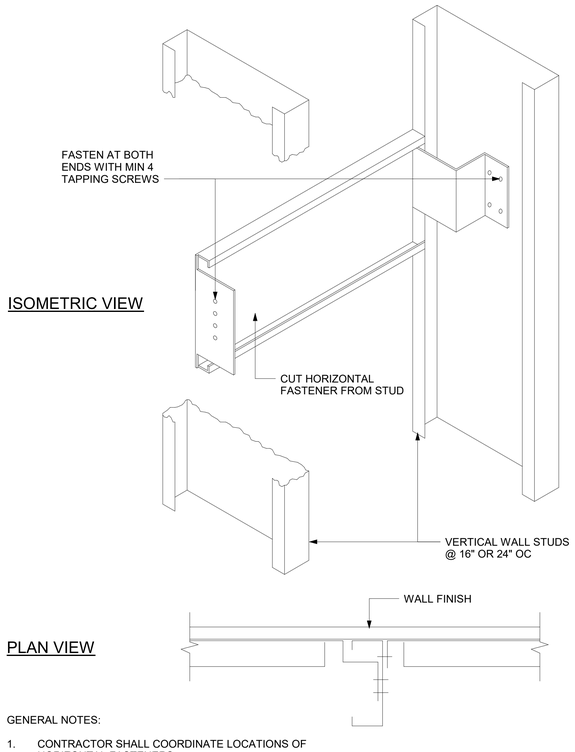

GENERAL NOTES:

1. CONTRACTOR SHALL COORDINATE LOCATIONS OF HORIZONTAL FASTENERS
2. ALL WALL MOUNTED EQUIPMENT SHALL HAVE METAL BLOCKING IN WALL BEHIND. ENSURE ALL REQUIRED BACKING IS INSTALLED PRIOR TO INSTALLING GYP.

1 TYPICAL BLOCKING DETAIL

NOT TO SCALE

BUILDING 7 - ROOM FINISH SCHEDULE

ROOM #	ROOM NAME	CEILING FINISH	FLOOR FINISH	BASE		WAINSCOT		WALL FINISH	COMMENTS
				MAT	HT	MAT	HT		
LEVEL 00									
1	LOBBY	P-01	LVT-2	RB-1	MATCH EXIST	-	-	P-01	
15	MEDICAL RECORDS	-	EXPOSED	-	-	-	-	P-03	
18	LOBBY	P-01	LVT-2	RB-1	MATCH EXIST	-	-	P-01	
36	STERILE/NONSTERILE STORAGE	P-01	LVT-2	RB-1	MATCH EXIST	-	-	P-03	
E-3	LOBBY	P-01	LVT-1	RB-1	MATCH EXIST	-	-	P-01	
LEVEL 01									
100	ELEVATOR LOBBY	P-01	LVT-2	RB-1	MATCH EXIST	-	-	P-01	
114	RECORDS, WORKING	P-01	EXIST	RB-1	MATCH EXIST	-	-	P-03	
1008A	ELEVATOR LOBBY	P-01	LVT-2	RB-1	MATCH EXIST	-	-	P-01	
E-1-2	ELEVATOR LOBBY	P-01	LVT-2	RB-1	MATCH EXIST	-	-	P-01	
E-3	ELEVATOR LOBBY	P-01	LVT-2	RB-1	MATCH EXIST	-	-	P-01	
LEVEL 02									
2E-3	LOBBY	P-01	LVT-1	RB-1	MATCH EXIST	-	-	P-01	
200	LOBBY	P-01	LVT-2	RB-1	MATCH EXIST	-	-	P-01	
247	LOBBY	P-01	LVT-2	RB-1	MATCH EXIST	-	-	P-01	
LEVEL 03									
3E-3	LOBBY	P-01	LVT-1	RB-1	MATCH EXIST	-	-	P-01	
300	LOBBY	P-01	LVT-2	RB-1	MATCH EXIST	-	-	P-01	
348	LOBBY	P-01	LVT-2	RB-1	MATCH EXIST	-	-	P-01	
LEVEL 04									
400	LOBBY	P-01	LVT-2	RB-1	MATCH EXIST	-	-	P-01	
444	LOBBY	P-01	LVT-2	RB-1	MATCH EXIST	-	-	P-01	
449	CLEAN CORE SUPPORT CARE	P-01	LVT-2	RB-1	MATCH EXIST	-	-	P-03	
C4-5	LOBBY	P-01	LVT-2	RB-1	MATCH EXIST	-	-	P-01	
C4-16	LOBBY	P-01	LVT-1	RB-1	MATCH EXIST	-	-	P-01	

BUILDING 9 - ROOM FINISH SCHEDULE

ROOM #	ROOM NAME	CEILING FINISH	FLOOR FINISH	BASE		WAINSCOT		WALL FINISH	COMMENTS
				MAT	HT	MAT	HT		
LEVEL 01									
100D	CORRIDOR/ELEV LOBBY	P-01	LVT-2	RB-1	MATCH EXIST	-	-	P-01	
LEVEL 02									
250A	ELEV LOBBY	P-01	LVT-2	RB-1	MATCH EXIST	-	-	P-01	
LEVEL 03									
356	ELEVATOR LOBBY	P-01	LVT-2	RB-1	MATCH EXIST	-	-	P-01	

FINISH ABBREVIATIONS

ACT	ACOUSTICAL CEILING TILE
LVT	LUXURY VINYL TILE
P	PAINT
RB	RESILIENT BASE
EXIST	EXISTING
EX	EXPOSED

GENERAL NOTES

1. SEE SPECIFICATION SECTION 09 06 00 - SCHEDULE FOR FINISHES FOR MANUFACTURERS, COLORS, AND FINISHES USED AS A BASIS OF DESIGN.
2. SEE CEILING PLANS FOR CEILING MATERIALS.

Revisions:	Date:

CONSULTANT

ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246

SDB SPEESDESIGNBUILD

STAMP

10000 REGISTERED ARCHITECT JAMES M. KING STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: ROOM FINISH SCHEDULE, DETAILS

Approved:

Phase: 100% CONSTRUCTION DOCUMENTS

FULLY SPRINKLERED

Project Title: REPLACE ELEVATORS IN BLDG 7 & BLDG 9

Location: ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA

Issue Date: 03/24/2026 | Checked: MK | Drawn: AJ

Project Number: 502-24-102

Building Number: -

Drawing Number: A-601

VA FORM 08 - 6231

BUILDING 7 - ELEVATORS 1 & 2 SCOPE OF WORK

MACHINE ROOM	DESCRIPTION	DISPOSITION	COMMENTS
LOCATION	OVERHEAD	NO CHANGE	
MACHINE TYPE/MFR	GEARED TRACTION/OTIS	NO CHANGE	
CONTROLLER TYPE/MFR	SOLID STATE/ OTIS GCS	NO CHANGE	
SEISMIC CONTROL	YES	NO CHANGE	
POWER DRIVE	OTIS REGEN	NO CHANGE	
GOVERNORS		NO CHANGE	
LIGHTING	LED	NO CHANGE	
EXTERIOR LIGHTING	NA	NA	
SPRINKLER	YES	NO CHANGE	
DETECTORS	YES	NO CHANGE	
VENTILATION	YES	NEW	
DISCONNECT TYPE/GRND	YES	NO CHANGE	VERIFY SHUNT TRIP BREAKER
110 V LIGHT CIRCUIT	YES	NO CHANGE	
110V OUTLET/GFCI	YES	NO CHANGE	
MR DOOR AUTO CLOSE	YES	NO CHANGE	
MR DOOR AURO LOCK	YES	NO CHANGE	
FOREIGN EQUIPMENT	NO		
MR ENCLOSURE	CONCRETE	NO CHANGE	
HOISTWAY	**DESCRIPTION**	**DISPOSITION**	**COMMENTS**
DO MFR/MODEL	OTIS GLIDE P	NO CHANGE	
RESTRICTOR	OTIS	NO CHANGE	CONFIRM ALL RESTRICTORS
CAR DOOR HANGERS	OTIS		
DOOR PROTECTION	OTIS		
HALL DOOR HANGERS	OTIS		
CLOSER TYPE	SPIRATOR	NEW	
CAR GUIDES	SPRING LOADED ROLLERS	NEW	
COUNTER WEIGHT GUIDES	SPRING LOADED ROLLERS	NEW	
CAR GUIDE RAILS	15 #	NOCHANGE	UBC - SEISMIC ZONE 0, IBC - SEISMIC DESIGN CATEROGY A (B IF SOIL IS VERY POOR)
COUNTER WEIGHT RAILS	8 #	NO CHANGE	UBC - SEISMIC ZONE 0 , IBC - SEISMIC DESIGN CATEROGY A (B IF SOIL IS VERY POOR)
DETECTORS	YES	REMOVE DETECTOR	DETECTOR SHOULD BE ACCESSIBLE FROM OUTSIDE THE HOISTWAY
SPRINKLER	NO	NO CHANGE	
VENTILATION	NO	NO CHANGE	
H'WAY CONSTRUCTION	CONCRETE	NO CHANGE	
PIT	**DESCRIPTION**	**DISPOSITION**	**COMMENTS**
BUFFERS	OTIS	NO CHANGE	
COMPENSATION	NA	AS NEEDED	PENDING CAB ALTERATIONS
PUT LADDER	YES	CONFIRM CODE COMPLIANT	
SUMP	NA	NA	
SUMP PUMP	NA	NA	
PIT LIGHT	LED	ENSURE MEETS LIGHTING REQ	
SPRINKLER	NO	NO CHANGE	
PIT CONSTRUCTION	CONCRETE	NO CHANGE	
CAB ENCLOSURE	**DESCRIPTION**	**DISPOSITION**	**COMMENTS**
ENTRANCE FINISH	STAINLESS-STEEL	NEW	
FRONT RETURN FINISH	STAINLESS-STEEL	NEW	
DOORS	STAINLESS-STEEL	NEW	
TRANSOM	STAINLESS-STEEL	NEW	
WALL FINISH	WOOD	NEW	PANEL, TOP 2 ROWS: INPRO-WOODGRAIN: WABASH 5E081 PANEL, BOTTOM ROW: INPRO STAINLESS STEEL BRUSHED SILVER 5E025
SHELL	STEEL	RETAIN	RETAIN EXISTING
HANDRAIL SIZE/TYPE	FLAT WOOD	NEW	INPRO-STAINLESS STEEL:BRUSHED SILVER 5E025
HANDRAIL LOCATION	SIDE CAR AND REAR WALLS	NEW	
CEILING	GRID W/ DIFFUSERS	NEW	MATCH EXISTING
LIGHTING	FLUORESCENT	NEW LED	
FLOORING	VCT	NEW	LVT, TO BE SELECTED FROM MANUFACTURER'S STANDARD OPTIONS
SILL	STAINLESS STEEL	NEW	
ENTRANCES	**DESCRIPTION**	**DISPOSITION**	**COMMENTS**
MAIN FLOOR DOORS	STAINLESS-STEEL	NEW	
MAIN FLOOR FRAMES	RADIUSED STAINLESS-STEEL	REFINISH/CLAD	
MAIN FLOOR SILL	STAINLESS STEEL	REFINISH/CLAD	
MAIN FLOOR DETECTORS	YES	NO CHANGE	
TYP FLOOR DOORS	STAINLESS-STEEL	NEW	
TYP FLOOR FRAMES	ROUNDED STAINLESS-STEEL	REFINISH/CLAD	
TYP FLOOR SILL	STAINLESS-STEEL	REFINISH/CLAD	
TYP FLOOR DETECTORS	YES	NO CHANGE	
SIGNAL FIXTURES-CAR	**DESCRIPTION**	**DISPOSITION**	**COMMENTS**
CAR OPERATING PANEL	OTIS FLAT APPLIED	NEW	
COP FINISH	STAINLESS-STEEL	NO CHANGE	
CAR POSITION IND.	YES	NEW	
CAR P.I LOCATION	COP	NO CHANGE	
DIRECTION LANTERNS	NO	NEW	
LANTERN LOCATION	NA	NEW	
COMMUNICATIONS	TWO WAY	NEW CODE COMPLIANT	
HANDS FREE	YES	NEW	
EMERGENCY LIGHT	YES	NEW INTEGRAL TO MAIN CAB LIGHTING	
RESTRICTED ACCESS	NO	NA	
SIGNAL FIXTURES-HALL	**DESCRIPTION**	**DISPOSITION**	**COMMENTS**
HALL STATIONS/FINISH	SURFACE MOUNTED/STAINLESS-STEEL	NO CHANGE	
PU/COMBO LANTERNS	YES/ SURFACE MOUNT	RETAIN/REPLACE AS NEEDED	
HALL P.I. LOCATION	CENTERED OVER DOORS	NO CHANGE	
HOISTWAY ACESS	YES	NO CHANGE	

BUILDING 7 - ELEVATORS 3 SCOPE OF WORK

MACHINE ROOM	DESCRIPTION	DISPOSITION	COMMENTS
LOCATION	OVERHEAD	NO CHANGE	
MACHINE TYPE/MFR	GEARED TRACTION/OTIS	NO CHANGE	
CONTROLLER TYPE/MFR	SOLID STATE/ OTIS GCS	NO CHANGE	
SEISMIC CONTROL	YES	NO CHANGE	
POWER DRIVE	OTIS REGEN	NO CHANGE	
GOVERNORS	OTIS	NO CHANGE	
LIGHTING	LED	NO CHANGE	
EXTERIOR LIGHTING	NA	NA	
SPRINKLER	YES	NO CHANGE	
DETECTORS	YES	NO CHANGE	
VENTILATION	YES	NEW	
DISCONNECT TYPE/GRND	YES	NO CHANGE	VERIFY SHUNT TRIP BREAKER
110 V LIGHT CIRCUIT	YES	NO CHANGE	
110V OUTLET/GFCI	YES	NO CHANGE	
MR DOOR AUTO CLOSE	YES	NO CHANGE	
MR DOOR AURO LOCK	YES	NO CHANGE	
FOREIGN EQUIPMENT	NO	NA	
MR ENCLOSURE	CONCRETE	NO CHANGE	
HOISTWAY	**DESCRIPTION**	**DISPOSITION**	**COMMENTS**
DO MFR/MODEL	OTIS GLIDE P	NO CHANGE	
RESTRICTOR	OTIS	NO CHANGE	CONFIRM ALL RESTRICTORS
CAR DOOR HANGERS	OTIS	NEW	
DOOR PROTECTION	OTIS	NEW 3D INFRARED	
HALL DOOR HANGERS	OTIS	NEW	
CLOSER TYPE	SPIRATOR	NEW	
CAR GUIDES	SPRING LOADED ROLLERS	NEW	
COUNTER WEIGHT GUIDES	SPRING LOADED ROLLERS	NEW	
CAR GUIDE RAILS	15 #	NO CHANGE	UBC - SEISMIC ZONE 0, IBC - SEISMIC DESIGN CATEROGY A (B IF SOIL IS VERY POOR)
COUNTER WEIGHT RAILS	8 #	NO CHANGE	UBC - SEISMIC ZONE 0, IBC - SEISMIC DESIGN CATEROGY A (B IF SOIL IS VERY POOR)
DETECTORS	YES	REMOVE DETECTOR	
SPRINKLER	NO	NO CHANGE	
VENTILATION	NO	NO CHANGE	
H'WAY CONSTRUCTION	CONCRETE	NO CHANGE	
PIT	**DESCRIPTION**	**DISPOSITION**	**COMMENTS**
BUFFERS	OTIS	NO CHANGE	
COMPENSATION	NA	AS NEEDED	PENDING CAB ALTERATIONS
PUT LADDER	YES	CONFIRM CODE COMPLIANT	
SUMP	NA		
SUMP PUMP	NA		
PIT LIGHT	LED	ENSURE MEETS LIGHTING REQ	
SPRINKLER	NO	NO CHANGE	
PIT CONSTRUCTION	CONCRETE	NO CHANGE	
CAB ENCLOSURE	**DESCRIPTION**	**DISPOSITION**	**COMMENTS**
ENTRANCE FINISH	STAINLESS-STEEL	NEW	
FRONT RETURN FINISH	STAINLESS-STEEL	NEW	
DOORS	STAINLESS-STEEL	NEW	
TRANSOM	STAINLESS-STEEL	NEW	
WALL FINISH	WOOD	NEW	PANEL, TOP 2 ROWS: INPRO STAINLESS STEEL BRUSHED SILVER 5E025 PANEL, BOTTOM ROW: INPRO STAINLESS STEEL BRUSHED SILVER 5E025
SHELL	STEEL	NEW	
HANDRAIL SIZE/TYPE	FLAT STAINLESS-STEEL	NEW	INPRO-STAINLESS STEEL:BRUSHED SILVER 5E025
HANDRAIL LOCATION	SIDE CAR AND REAR WALLS	NEW	
CEILING	GRID W/ DIFFUSERS	NEW	MATCH EXISTING
LIGHTING	FLUORESCENT	NEW LED	
FLOORING	ALUMINUM DIAMOND PLATE	NEW	MATCH EXISTING
SILL	STAINLESS STEEL	NEW	
ENTRANCES	**DESCRIPTION**	**DISPOSITION**	**COMMENTS**
MAIN FLOOR DOORS	STAINLESS-STEEL	NEW	
MAIN FLOOR FRAMES	RADIUSED STAINLESS-STEEL	REFINISH/CLAD	
MAIN FLOOR SILL	STAINLESS STEEL	REFINISH/CLAD	
MAIN FLOOR DETECTORS	YES	NO CHANGE	
TYP FLOOR DOORS	STAINLESS-STEEL	NEW	
TYP FLOOR FRAMES	ROUNDED STAINLESS-STEEL	REFINISH/CLAD	
TYP FLOOR SILL	STAINLESS-STEEL	REFINISH	
TYP FLOOR DETECTORS	YES	NO CHANGE	
SIGNAL FIXTURES-CAR	**DESCRIPTION**	**DISPOSITION**	**COMMENTS**
CAR OPERATING PANEL	OTIS FLAT APPLIED	NEW	
COP FINISH	STAINLESS-STEEL	NO CHANGE	
CAR POSITION IND.	YES	NEW	
CAR P.I LOCATION	COP	NO CHANGE	
DIRECTION LANTERNS	NO	NEW	
LANTERN LOCATION	NA	NEW	
COMMUNICATIONS	TWO WAY	NEW CODE COMPLIANT	
HANDS FREE	YES	NEW	
EMERGENCY LIGHT	YES	NEW INTEGRAL TO MAIN CAB LIGHTING	
RESTRICTED ACCESS	NO	NA	
SIGNAL FIXTURES-HALL	**DESCRIPTION**	**DISPOSITION**	**COMMENTS**
HALL STATIONS/FINISH	SURFACE MOUNTED/STAINLESS-STEEL	NO CHANGE	
PU/COMBO LANTERNS	YES/ SURFACE MOUNT	RETAIN/REPLACE AS NEEDED	
HALL P.I. LOCATION	CENTERED OVER DOORS	NO CHANGE	
HOISTWAY ACESS	YES	NO CHANGE	

Revisions:	Date:

CONSULTANT

ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246

SPEESDESIGNBUILD

STAMP

10000 REGISTERED ARCHITECT JAMES M. KING STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title	BLDG 7 - ELEVATOR SCOPE
Phase	100% CONSTRUCTION DOCUMENTS
Project Title	REPLACE ELEVATORS IN BLDG 7 & BLDG 9
Project Number	502-24-102
Building Number	-
Approved:	
	FULLY SPRINKLERED
Location	ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA
Issue Date	03/24/2026
Checked	MK
Drawn	AJ
Drawing Number	A-602

VA FORM 08 - 6231

BUILDING 7 - ELEVATORS 4 & 5 SCOPE OF WORK

MACHINE ROOM	DESCRIPTION	DISPOSITION	COMMENTS
LOCATION	OVERHEAD	NO CHANGE	
MACHINE TYPE/MFR	GEARED TRACTION/OTIS	NO CHANGE	
CONTROLLER TYPE/MFR	SOLID STATE/ OTIS GCS	NO CHANGE	
SEISMIC CONTROL	YES	NO CHANGE	
POWER DRIVE	OTIS REGEN	NO CHANGE	
GOVERNORS	OTIS	NO CHANGE	
LIGHTING	LED	NO CHANGE	
EXTERIOR LIGHTING	NA	NA	
SPRINKLER	YES	NO CHANGE	
DETECTORS	YES	NO CHANGE	
VENTILATION	YES	NO CHANGE	EXISTING COOLING SYSTEM
DISCONNECT TYPE/GRND	YES	NO CHANGE	VERIFY SHUNT TRIP BREAKER
110 V LIGHT CIRCUIT	YES	NO CHANGE	
110V OUTLET/GFCI	YES	NO CHANGE	
MR DOOR AUTO CLOSE	YES	NO CHANGE	
MR DOOR AURO LOCK	YES	NO CHANGE	
FOREIGN EQUIPMENT	NO	NA	
MR ENCLOSURE	CONCRETE	NO CHANGE	
HOISTWAY	**DESCRIPTION**	**DISPOSITION**	**COMMENTS**
DO MFR/MODEL	OTIS GLIDE P	NO CHANGE	
RESTRICTOR	OTIS	NO CHANGE	CONFIRM ALL RESTRICTORS
CAR DOOR HANGERS	OTIS	NEW	
DOOR PROTECTION	OTIS	NEW 3D INFRARED	
HALL DOOR HANGERS	OTIS	NEW	
CLOSER TYPE	SPIRATOR	NEW	
CAR GUIDES	SPRING LOADED ROLLERS	NEW	
COUNTER WEIGHT GUIDES	SPRING LOADED ROLLERS	NEW	
CAR GUIDE RAILS	15 #	NO CHANGE	UBC - SEISMIC ZONE 0, IBC - SEISMIC DESIGN CATEROGY A (B IF SOIL IS VERY POOR)
COUNTER WEIGHT RAILS	8 #	NO CHANGE	UBC - SEISMIC ZONE 0, IBC - SEISMIC DESIGN CATEROGY A (B IF SOIL IS VERY POOR)
DETECTORS	YES	REMOVE DETECTOR	DETECTOR SHOULD BE ACCESSIBLE FROM OUTSIDE THE HOISTWAY
SPRINKLER	YES	SPRINKLER REMOVAL	
VENTILATION	NO	NO CHANGE	
H'WAY CONSTRUCTION	CONCRETE	NO CHANGE	
PIT	**DESCRIPTION**	**DISPOSITION**	**COMMENTS**
BUFFERS	OTIS	NO CHANGE	
COMPENSATION	NA	AS NEEDED	PENDING CAB ALTERATIONS
PUT LADDER	YES	CONFIRM CODE COMPLIANT	
SUMP	NA	NA	
SUMP PUMP	NA	NA	
PIT LIGHT	LED	ENSURE MEETS LIGHTING REQ	
SPRINKLER	NO	NO CHANGE	
PIT CONSTRUCTION	CONCRETE	NO CHANGE	
CAB ENCLOSURE	**DESCRIPTION**	**DISPOSITION**	**COMMENTS**
ENTRANCE FINISH	STAINLESS-STEEL	NEW	
FRONT RETURN FINISH	STAINLESS-STEEL	NEW	
DOORS	STAINLESS-STEEL	NEW	
TRANSOM	STAINLESS-STEEL	NEW	
WALL FINISH	LOWER STAINLESS/UPPER	NEW	PANEL, TOP 2 ROWS: INPRO-WOODGRAIN: WABASH 5E081 PANEL, BOTTOM ROW: INPRO STAINLESS STEEL BRUSHED SILVER 5E025
SHELL	STAINLESS-STEEL	NEW	
HANDRAIL SIZE/TYPE	FLAT STAINLESS-STEEL	NEW	INPRO-STAINLESS STEEL:BRUSHED SILVER 5E025
HANDRAIL LOCATION	SIDE WALLS	NEW	
CEILING	STEEL SHELL	NEW	
LIGHTING	COVE LIGHTING/FLUORESCENT	NEW LED	
FLOORING	VCT	NEW	LVT, TO BE SELECTED FROM MANUFACTURER'S STANDARD OPTIONS
SILL	BRONZE	NEW	
ENTRANCES	**DESCRIPTION**	**DISPOSITION**	**COMMENTS**
MAIN FLOOR DOORS	PAINTED	NEW	
MAIN FLOOR FRAMES	RADIUSED STAINLESS-STEEL	REFINISH/CLAD	
MAIN FLOOR SILL	STAINLESS STEEL	REFINISH	
MAIN FLOOR DETECTORS	YES	NO CHANGE	
TYP FLOOR DOORS	PAINTED	NEW	
TYP FLOOR FRAMES	RADIUSED STAINLESS-STEEL	REFINISH/CLAD	
TYP FLOOR SILL	STAINLESS-STEEL	REFINISH	
TYP FLOOR DETECTORS	YES	NO CHANGE	
SIGNAL FIXTURES-CAR	**DESCRIPTION**	**DISPOSITION**	**COMMENTS**
CAR OPERATING PANEL	OTIS FLAT APPLIED	NEW	
COP FINISH	STAINLESS-STEEL	NO CHANGE	
CAR POSITION IND.	YES	NEW	
CAR P.I LOCATION	COP	NO CHANGE	
DIRECTION LANTERNS	NO	NEW	
LANTERN LOCATION	NA	NEW	
COMMUNICATIONS	TWO WAY	NEW CODE COMPLIANT	
HANDS FREE	YES	NEW	
EMERGENCY LIGHT	YES	NEW INTEGRAL TO MAIN CAB LIGHTING	
RESTRICTED ACCESS	NO	NA	
SIGNAL FIXTURES-HALL	**DESCRIPTION**	**DISPOSITION**	**COMMENTS**
HALL STATIONS/FINISH	SURFACE MOUNTED/STAINLESS-STEEL	NO CHANGE	
PU/COMBO LANTERNS	YES/ SURFACE MOUNT	RETAIN/REPLACE AS NEEDED	
HALL P.I. LOCATION	CENTERED OVER DOORS	NO CHANGE	
HOISTWAY ACESS	YES	NO CHANGE	

BUILDING 7 - CARTLIFT SCOPE OF WORK

MACHINE ROOM	DESCRIPTION	DISPOSITION	COMMENTS
LOCATION	ROOFTOP OVER HOISTWAY	NO CHANGE	
MACHINE TYPE/MFR	GEARED TRACTION/ MONTGOMERY	NEW	
CONTROLLER TYPE/MFR	MONTGOMERY VVL	NEW SOLID STATE CONTROL	
SEISMIC CONTROL	NO	NEW	
POWER DRIVE	NO	NEW	
GOVERNORS	MONTGOMERY VERT. PLANE	NEW	
LIGHTING	FLUORESCENT	NEW LED	
EXTERIOR LIGHTING	NONE	NEW LED	
SPRINKLER	YES	NO CHANGE	FINAL DETERMINATION SHOULD BE VERIFIED WITH THE AUTHORITY HAVING JURISDICTION
DETECTORS	SMOKE	HEAT DETECTOR	
VENTILATION	WALL DUCT	NEW SPLIT SYSTEM	
DISCONNECT TYPE/GRND	TYPICAL DISCONNECT	NEW DISCONNECT	
110 V LIGHT CIRCUIT	LIGHT SWITCH	NEW DISCONNECT	
110V OUTLET/GFCI	GFCI	NEW	
MR DOOR AUTO CLOSE	YES	NO CHANGE	
MR DOOR AURO LOCK	YES	NO CHANGE	
FOREIGN EQUIPMENT	YES	REMOVE/RE-ROUTE/COVER	FOREIGN ITEMS DRAIN PIPES
MR ENCLOSURE	GENERAL CONSTRUCTION	NO CHANGE	
HOISTWAY	**DESCRIPTION**	**DISPOSITION**	**COMMENTS**
DO MFR/MODEL	PEELLE	NEW	
RESTRICTOR	NA	NA	
CAR DOOR HANGERS	PEELLE	NEW	
DOOR PROTECTION	NA	NA	
HALL DOOR HANGERS	PEELLE	NEW	
CLOSER TYPE	PEELLE	NEW	
CAR GUIDES	MONTGOMERY ROLLER GUIDES	NEW SPRING TYPE ROLLERS	
COUNTER WEIGHT GUIDES	MONTGOMERY ROLLER GUIDES	NEW SPRING TYPE ROLLERS	
CAR GUIDE RAILS	15 LB	NO CHANGE	
COUNTER WEIGHT RAILS	8 LB	NO CHANGE	
DETECTORS	YES	REMOVE DETECTOR	
SPRINKLER	VERIFY	REMOVE SPRINKLER IF EXISTING	
VENTILATION	TBD	NO CHANGE	
H'WAY CONSTRUCTION	CONCRETE	NO CHANGE	
PIT	**DESCRIPTION**	**DISPOSITION**	**COMMENTS**
BUFFERS	OTIS	REFINISH	PIT WAS NOT ACCESSIBLE
COMPENSATION	NA	NA	TIME OF SURVEY
PUT LADDER	YES	NEW CODE COMPLIANT	
SUMP	NA	NO CHANGE	
SUMP PUMP	NA	NOCHANGE	
PIT LIGHT	FLUORESCENT	NEW LED	
SPRINKLER	NO	NO CHANGE	
PIT CONSTRUCTION	CONCRETE	NO CHANGE	
CAB ENCLOSURE	**DESCRIPTION**	**DISPOSITION**	**COMMENTS**
ENTRANCE FINISH	NA	NA	
FRONT RETURN FINISH	NA	NA	
DOORS	STAINLESS-STEEL	NEW	
TRANSOM	NA	NA	
WALL FINISH	NA	NA	
SHELL	STAINLESS-STEEL	NO CHANGE	
HANDRAIL SIZE/TYPE	NA	NA	
HANDRAIL LOCATION	NA	NA	
CEILING	STAINLESS-STEEL	NO CHANGE	
LIGHTING	FLUORESCENT	NEW LED	
FLOORING	STAINLESS-STEEL W/ CART TRACK	NEW	
SILL	NA	NA	
ENTRANCES	**DESCRIPTION**	**DISPOSITION**	**COMMENTS**
MAIN FLOOR DOORS	STAINLESS-STEEL	NEW	
MAIN FLOOR FRAMES	STAINLESS-STEEL	REFINISH	
MAIN FLOOR SILL	NA	NA	
MAIN FLOOR DETECTORS	NO	NEW	
TYP FLOOR DOORS	STAINLESS-STEEL	NEW	
TYP FLOOR FRAMES	STAINLESS-STEEL	REFINISH	
TYP FLOOR SILL	NA	NA	
TYP FLOOR DETECTORS	NA	NA	
SIGNAL FIXTURES-CAR	**DESCRIPTION**	**DISPOSITION**	**COMMENTS**
CAR OPERATING PANEL	FLAT APPLIED	NEW	
COP FINISH	STAINLESS-STEEL	NO CHANGE	
CAR POSITION IND.	NA	NA	
CAR P.I LOCATION	NA	NA	
DIRECTION LANTERNS	NA	NA	
LANTERN LOCATION	NA	NA	
COMMUNICATIONS	NA	NA	
HANDS FREE	NA	NA	
EMERGENCY LIGHT	NO	NEW	
RESTRICTED ACCESS	NA	NA	
SIGNAL FIXTURES-HALL	**DESCRIPTION**	**DISPOSITION**	**COMMENTS**
HALL STATIONS/FINISH	STAINLESS-STEEL	NEW	
PU/COMBO LANTERNS	YES	NEW COMBO PI/LANTERN	
HALL P.I. LOCATION	CENTERED ABOVE ENTRANCE	NEW	
HOISTWAY ACESS	YES	NEW	

Revisions:	Date:

CONSULTANT

ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246

SDB SPEESDESIGNBUILD

STAMP

10000 REGISTERED ARCHITECT JAMES M. KINGI STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: BLDG 7 - ELEVATOR SCOPE

Phase: 100% CONSTRUCTION DOCUMENTS

Project Title: REPLACE ELEVATORS IN BLDG 7 & BLDG 9

Project Number: 502-24-102

Building Number: -

Approved:

FULLY SPRINKLERED

Location: ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA

Issue Date: 03/24/2026

Checked: MK

Drawn: AJ

Drawing Number: A-603

VA FORM 08 - 6231

BUILDING 7 - MED RECORDS SCOPE OF WORK

MACHINE ROOM	DESCRIPTION	DISPOSITION	COMMENTS
LOCATION	BASEMENT ADJACENT	NO CHANGE	
MACHINE TYPE/MFR	DRY 40 HP HYDRAULIC/MONTROMGERY	NEW SUBMESIBLE	
CONTROLLER TYPE/MFR	MONTGOMERY MIPROM	NEW SOLID STATE CONTROL	
SEISMIC CONTROL	MAXTON PIPE RUPTURE	NEW	
POWER DRIVE	NA		
GOVERNORS	NA		
LIGHTING	FLUORESCENT	NEW LED	
EXTERIOR LIGHTING	FLUORESCENT	NEW LED	
SPRINKLER	YES	NO CHANGE	
DETECTORS	SMOKE/HEAT	NO CHANGE	
VENTILATION	DUCT TYPE	NEW	
DISCONNECT TYPE/GRND	SHUNT TRIP BREAKER	NO CHANGE	
110 V LIGHT CIRCUIT	LIGHT SWITCH	NEW	
110V OUTLET/GFCI	GFCI	NO CHANGE	
MR DOOR AUTO CLOSE	YES	NO CHANGE	
MR DOOR AURO LOCK	YES	NO CHANGE	
FOREIGN EQUIPMENT	YES	REMOVE/RE-ROUTE/COVER	
MR ENCLOSURE	CMU/CONCRETE	NO CHANGE	
HOISTWAY	**DESCRIPTION**	**DISPOSITION**	**COMMENTS**
DO MFR/MODEL	MAC	NEW	
RESTRICTOR	MAC	NEW	
CAR DOOR HANGERS	MAC	NEW	
DOOR PROTECTION	INFRARED	NEW 3D	
HALL DOOR HANGERS	MAC	NEW	
CLOSER TYPE	SPIRATOR	NEW SMART TORQ SPIRATOR	
CAR GUIDES	MONTGOMERY SLIDE GUIDES	NEW SPRING TYPE ROLLERS	
COUNTER WEIGHT GUIDES	NA		
CAR GUIDE RAILS	15LB	NO CHANGE	
COUNTER WEIGHT RAILS	NA		
DETECTORS	YES	REMOVE DETECTOR	
SPRINKLER	NO	SPRINKLER REMOVAL	
VENTILATION	YES	NO CHANGE	
H'WAY CONSTRUCTION	CONCRETE	NO CHANGE	
PIT	**DESCRIPTION**	**DISPOSITION**	**COMMENTS**
BUFFERS	SPRING	NEW	
COMPENSATION	TYPICAL MONTGOMERY	NEW DOUBLE BOTTOM WITH SECONDARY CONTAINMENT	
PUT LADDER	YES	NEW CODE COMPLIANT	
SUMP	NO	NO CHANGE	
SUMP PUMP	NO	NO CHANGE	
PIT LIGHT	INCANDESCENT	NEW LED	
SPRINKLER	NO	NO CHANGE	
PIT CONSTRUCTION	CONCRETE	NO CHANGE	
CAB ENCLOSURE	**DESCRIPTION**	**DISPOSITION**	**COMMENTS**
ENTRANCE FINISH	STAINLESS-STEEL	NEW	
FRONT RETURN FINISH	STAINLESS-STEEL	NEW	
DOORS	STAINLESS-STEEL	NEW	
TRANSOM	STAINLESS-STEEL	NEW	
WALL FINISH	STAINLESS-STEEL/LAMINET	NEW	
SHELL	STEEL	NEW	
HANDRAIL SIZE/TYPE	FLAT STAINLESS-STEEL	NEW	
HANDRAIL LOCATION	SIDE WALLS	NO CHANGE	
CEILING	STEEL SHELL	NEW	
LIGHTING	FLUORESCENT	NEW LED	
FLOORING	VCT	NEW	
SILL	BRONZE	NEW	
ENTRANCES	**DESCRIPTION**	**DISPOSITION**	**COMMENTS**
MAIN FLOOR DOORS	PAINTED	STAINLESS-STEEL	
MAIN FLOOR FRAMES	RADIUSED STAINLESS-STEEL	REFINISH/CLAD/REPLACE	
MAIN FLOOR SILL	ALUMINUM	NEW	
MAIN FLOOR DETECTORS	NONE	NEW	
TYP FLOOR DOORS	PAINTED	NEW STAINLESS STEEL	
TYP FLOOR FRAMES	RADIUSED STAINLESS-STEEL	NEW STAINLESS-STEEL	
TYP FLOOR SILL	ALUMINUM	NEW	
TYP FLOOR DETECTORS	NONE	NEW	
SIGNAL FIXTURES-CAR	**DESCRIPTION**	**DISPOSITION**	**COMMENTS**
CAR OPERATING PANEL	FLAT APPLIED	NEW	
COP FINISH	STAINLESS-STEEL	NEW	
AUX CAR PANEL	FLAT APPLIED	NEW	
CAR POSITION IND.	LAMP	NEW 3 CE ELEC OR EQUAL	
CAR P.I LOCATION	TRANSOM	NEW C.O.P	
DIRECTION LANTERNS	HALL	NEW IN RETURN JAMB	
LANTERN LOCATION	NEW	MOUNT IN RETURN HAMB	
COMMUNICATIONS	TWO WAY	NEW CODE COMPLIANT	
HANDS FREE	YES	NEW	
EMERGENCY LIGHT	YES	NEW	
RESTRICTED ACCESS	YES	NO CHANGE	
SIGNAL FIXTURES-HALL	**DESCRIPTION**	**DISPOSITION**	**COMMENTS**
HALL STATIONS/FINISH	STAINLESS-STEEL	NEW	
PU/COMBO LANTERNS	YES	NEW COMBO PI/LANTERN	
HALL P.I. LOCATION	CENTERED ABOVE ENTRANCE	NEW	
HOISTWAY ACESS	YES	NEW	

BUILDING 9 - ELEV 1 & 2 SCOPE OF WORK

MACHINE ROOM	DESCRIPTION	DISPOSITION	COMMENTS
LOCATION	ABOVE HOISTWAY / ATTIC	NO CHANGE	RETAIN
MACHINE TYPE/MFR	DRY / MONTGOMERY	NEW	
CONTROLLER TYPE/MFR	HMC 2000 / MCE	NEW	
SEISMIC CONTROL	MAXTON PIPE RUPTURE	NEW	
POWER DRIVE	NA		
GOVERNORS	NA	NO CHANGE	
LIGHTING	LED	NO CHANGE	
EXTERIOR LIGHTING	LED	NO CHANGE	
SPRINKLER	YES	NO CHANGE	
DETECTORS	YES	NO CHANGE	
VENTILATION	WINDOW MOUNT	NO CHANGE	
DISCONNECT TYPE/GRND	SHUNT BREAKER	NO CHANGE	
110 V LIGHT CIRCUIT	FUSEABLE LOCKABLE	NO CHANGE	
110V OUTLET/GFCI	GFCI	NO CHANGE	
MR DOOR AUTO CLOSE	YES	NO CHANGE	
MR DOOR AURO LOCK	YES	NO CHANGE	
FOREIGN EQUIPMENT	NA		
MR ENCLOSURE		NO CHANGE	RETAIN
HOISTWAY	**DESCRIPTION**	**DISPOSITION**	**COMMENTS**
DO MFR/MODEL	GAL MOVFR	REPLACE AS NEEDED	
RESTRICTOR	GAL	REPLACE AS NEEDED	
CAR DOOR HANGERS	GAL	REPLACE AS NEEDED	
DOOR PROTECTION	INFRARED	REPLACE AS NEEDED	
HALL DOOR HANGERS	GAL	REPLACE AS NEEDED	
CLOSER TYPE	SPIRATOR	NEW	SMART TORQ
CAR GUIDES	ELSCO MODEL B	REPLACE AS NEEDED	
COUNTER WEIGHT GUIDES	NA		
CAR GUIDE RAILS	15#	REPLACE AS NEEDED	
COUNTER WEIGHT RAILS	NA		
DETECTORS	YES	REMOVE DETECTOR	DETECTOR IS NOT ACCESSIBLE
SPRINKLER	NO	NO CHANGE	
VENTILATION	YES	NO CHANGE	
H'WAY CONSTRUCTION	CMU/CONCRETE	NO CHANGE	
PIT	**DESCRIPTION**	**DISPOSITION**	**COMMENTS**
BUFFERS	SPRING	NEW	
COMPENSATION	MONTGOMERY	NEW	
PUT LADDER	YES	NEW	
SUMP	NO	NO CHANGE	
SUMP PUMP	NO	NO CHANGE	
PIT LIGHT	FLUORESCENT	NEW LED	SWITCHES ARE FAULTY
SPRINKLER	NO	NO CHANGE	
PIT CONSTRUCTION	CONCRETE	NO CHANGE	
CAB ENCLOSURE	**DESCRIPTION**	**DISPOSITION**	**COMMENTS**
ENTRANCE FINISH	STAINLESS-STEEL	NEW STAINLESS-STEEL	
FRONT RETURN FINISH	STAINLESS-STEEL	NEW STAINLESS-STEEL	
DOORS	STAINLESS-STEEL	NEW STAINLESS-STEEL	
TRANSOM	STAINLESS-STEEL	NEW STAINLESS-STEEL	
WALL FINISH	STAINLESS/LAMINET	NEW	PANEL, TOP 2 ROWS: INPRO-WOODGRAIN: WABASH 5E081 PANEL, BOTTOM ROW: INPRO STAINLESS STEEL BRUSHED SILVER 5E025
SHELL	STEEL	NEW	
HANDRAIL SIZE/TYPE	2" FLAT	NEW	INPRO-STAINLESS STEEL:BRUSHED SILVER 5E025
HANDRAIL LOCATION	BACK AND SIDE WALLS	NEW	
CEILING	NA	NEW	GRID RADAR ACOUSTICAL PANELS WHITE
LIGHTING	TUBE LIGHTING	NEW LED	
FLOORING	VCT	NEW	LVT, TO BE SELECTED FROM MANUFACTURER'S STANDARD OPTIONS
SILL	BRONZE	NEW	
ENTRANCES	**DESCRIPTION**	**DISPOSITION**	**COMMENTS**
MAIN FLOOR DOORS	STAINLESS-STEEL	NEW STAINLESS-STEEL	
MAIN FLOOR FRAMES	STAINLESS-STEEL	REFURBISH/CLAD	
MAIN FLOOR SILL	ALUMINUM	NEW	REPLACE
MAIN FLOOR DETECTORS	YES	NO CHANGE	
TYP FLOOR DOORS	STAINLESS-STEEL	NEW STAINLESS-STEEL	
TYP FLOOR FRAMES	STAINLESS-STEEL	REFURBISH/CLAD	
TYP FLOOR SILL	ALUMINUM	NEW	REPLACE
TYP FLOOR DETECTORS	YES	NO CHANGE	
SIGNAL FIXTURES-CAR	**DESCRIPTION**	**DISPOSITION**	**COMMENTS**
CAR OPERATING PANEL	FLAT APPLIED	NEW	
COP FINISH	STAINLESS-STEEL	NEW	
CAR POSITION IND.	YES	NEW	
CAR P.I LOCATION	C.O.P	NO CHANGE	
DIRECTION LANTERNS	NO	NEW	
LANTERN LOCATION	NA	NEW JAMB	
COMMUNICATIONS	TWO-WAY	NEW CODE COMPLIANT	
HANDS FREE	YES	NO CHANGE	
EMERGENCY LIGHT	YES	NEW	
RESTRICTED ACCESS	NO	TBD	
SIGNAL FIXTURES-HALL	**DESCRIPTION**	**DISPOSITION**	**COMMENTS**
HALL STATIONS/FINISH	SURFACE MOUNT/STAINLESS	NEW	
PU/COMBO LANTERNS	CENTERED ABOVE DOOR	NEW	
HALL P.I. LOCATION	CENTERED ABOVE DOOR	NEW	
HOISTWAY ACESS	JAMB MOUNTED	NEW	

Revisions:	Date:

CONSULTANT

ENGINEERING DISCIPLINE:

ARCHITECT/ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HWY S
KENT, WA 98032
(206)-209-2246

SPEESDESIGNBUILD

STAMP

10000 REGISTERED ARCHITECT JAMES W. KING STATE OF WASHINGTON
03/23/2026

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: BLDG 7 & 9 - ELEVATOR SCOPE

Phase: 100% CONSTRUCTION DOCUMENTS

Project Title: REPLACE ELEVATORS IN BLDG 7 & BLDG 9

Project Number: 502-24-102

Building Number: -

Approved:

FULLY SPRINKLERED

Location: ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA

Issue Date: 03/24/2026

Checked: MK

Drawn: AJ

Drawing Number: A-604

VA FORM 08 - 6231

FIRE PROTECTION DEMOLITION GENERAL NOTES

1. REFER TO ALL DRAWINGS FOR COORDINATION BETWEEN DEMOLITION AND NEW WORK. COORDINATE DEMOLITION WORK WITH THAT OF OTHER TRADES.
2. COORDINATE SALVAGE AND REUSE OF EXISTING EQUIPMENT WITH OWNER. ITEMS OF VALUE WHICH ARE NOT DIRECTED TO BE RETURNED TO THE OWNER SHALL BECOME THE PROPERTY OF THE CONTRACTOR. STORAGE OR SALE OF ITEMS ON THE PROJECT SITE IS PROHIBITED.
3. CONTRACTOR SHALL BE RESPONSIBLE FOR THE FOLLOWING:
   A) PROTECTING, COVERING, AND SEALING EXISTING EQUIPMENT AND SURROUNDINGS DURING DEMOLITION FROM DIRT, DUST, AND DEBRIS.
   B) ENSURING THE SAFE PASSAGE OF PERSONS IN AND AROUND THE BUILDING DURING DEMOLITION.
   C) PREVENTING INJURY TO PERSONS AND DAMAGE TO PROPERTY.
   D) PROVIDING ADEQUATE SHORING AND BRACING TO PREVENT COLLAPSE.
   E) REPAIRING DAMAGED PROPERTY TO ITS ORIGINAL CONDITION IMMEDIATELY AFTER THE DAMAGE OCCURS.
   F) TAKING EFFECTIVE MEASURES TO PREVENT DUST MIGRATION.
4. MAINTAIN ALL UTILITIES EXCEPT THOSE REQUIRING REMOVAL OR RELOCATION. KEEP UTILITIES IN SERVICE AND PROTECT FROM DAMAGE. DO NOT INTERRUPT UTILITIES SERVING AREAS OUTSIDE OF PRESENT SCOPE WITHOUT FIRST OBTAINING PERMISSION FROM OWNER. PROVIDE TEMPORARY SERVICES AS REQUIRED.
5. REMOVE AND DISPOSE OF EXISTING FIRE PROTECTION EQUIPMENT AS SHOWN, UNLESS NOTED OTHERWISE. COORDINATE WITH ARCHITECTURAL PLANS, AREAS OF DEMOLITION AROUND, ADJACENT, OR CONNECTED TO EXISTING MECHANICAL EQUIPMENT THAT IS TO REMAIN.

FIRE PROTECTION GENERAL NOTES

1. ALL WORK SHALL BE COMPLETED IN STRICT ACCORDANCE WITH THE CURRENT VA GUIDES AND LOCAL FIRE PROTECTION CODES AND ORDINANCES.
2. CONTRACTOR SHALL INSTALL ALL EQUIPMENT IN STRICT ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS. IN CASES OF CONFLICT BETWEEN MANUFACTURER REQUIREMENTS, DRAWINGS, OR SPECIFICATIONS, THE MORE STRINGENT REQUIREMENT SHALL GOVERN.
3. THE CONTRACTOR SHALL PROVIDE FIRE CAULKING AT ALL PIPING PENETRATIONS OF FIRE RATED ASSEMBLIES AS REQUIRED.
4. IF FLOOR OR RATED WALL PENETRATIONS CANNOT BE FIRE STOPPED AT THE END OF THE WORK SHIFT, TEMPORARY FIRESTOPPING COMPOSED OF MINERAL WOOL SHALL BE INSTALLED IN THE PENETRATION TO PROVIDE PROTECTION AGAINST FIRE/SMOKE SPREAD THROUGH THE UNSEALED PENETRATION.
5. ACCESS PANELS IN HARD SUSPENDED CEILINGS ARE REQUIRED FOR ALL VALVES, TRAPS, CONTROLS, ETC. ACCESS PANELS SHALL BE FURNISHED AND INSTALLED IN ACCORDANCE WITH THE ARCHITECTURAL SPECIFICATIONS. COORDINATE LOCATION WITH FIRE PROTECTION INSTALLATION AND DEMONSTRATE ACCESS TO EQUIPMENT SERVED.
6. ROOMS THAT DO NOT HAVE CEILINGS (EXPOSED TO STRUCTURE) SHALL HAVE THE BRANCH PIPING MODIFIED TO TURN THE SPRINKLER HEAD UPRIGHT. PROVIDE SPRINKLER PROTECTION CAGE. ALL EXPOSED FIRE PROTECTION LINES SHALL BE PAINTED RED.
7. ROOMS WITH FINISHED CEILINGS SHALL HAVE SPRINKLER LOCATIONS ADJUSTED AS NEEDED FOR APPROPRIATE COVERAGE PER LATEST EDITION OF NFPA 13.
8. HAZARD CLASSIFICATION AND SPRINKLER DENSITY ARE TO BE IN ACCORDANCE WITH THE LATEST VERSIONS OF NFPA 13 AND THE VA FIRE PROTECTION DESIGN GUIDE.
9. CONTRACTOR SHALL HAVE NICET III/IV TECHNICIAN DESIGN DRAWINGS OR A LICENSED FIRE PROTECTION ENGINEER STAMP ON ALL SHOP DRAWINGS.

PIPING SYSTEMS

FPW	FIRE PROTECTION WET

PIPING SYMBOLS

- CONTINUATION
- DROP IN PIPE
- ELBOW
- TEE
- UNION
- TOP CONNECTION
- BOTTOM CONNECTION
- TOP CONNECTION, 45(DEG) OR 90° (DEG)
- BOTTOM CONNECTION, 45(DEG) OR 90° (DEG)
- PIPE UP
- PIPE DOWN

ADDITIONAL SYMBOLS

- 2 / PL4 — DETAIL NUMBER / DRAWING NUMBER WHERE DRAWN
- A / PL7 — SECTION LETTER / DRAWING NUMBER WHERE SHOWN
- 26-P 3 — BUILDING NO. WHERE EQUIPMENT IS LOCATED. / EQUIPMENT ABBREVIATION (PUMP) / PUMP NO. 3 IN BUILDING NO. 26 / TYPICAL UNIT NO.
- POINT OF CONNECTION BETWEEN NEW AND EXISTING WORK
- LIMIT OF DEMOLITION

FIRE PROTECTION SYMBOLS

- PENDENT SPRINKLER
- UPRIGHT SPRINKLER WITH GUARD

ABBREVIATIONS

A/E:	ARCHITECT/ENGINEER
AFF:	ABOVE FINISH FLOOR
AFG:	ABOVE FINISH GRADE
COR:	CONTRACTING OFFICER'S REPRESENTATIVE
CV:	CONTROL VALVE
CXA:	COMMISSIONING AGENT
DWG:	DRAWING
E:	EXISTING
EL:	ELEVATION
FDC:	FIRE DEPARTMENT (HOSE) CONNECTION
FS:	FLOW SWITCH
MAX:	MAXIMUM
MIN:	MINIMUM
NTS:	NOT TO SCALE
SF:	SQUARE FEET
SPEC:	SPECIFICATION
SQFT:	SQUARE FEET
STD:	STANDARD
TYP:	TYPICAL
VA:	VETERANS ADMINISTRATION
VAMC:	VETERANS ADMINISTRATION MEDICAL CENTER
VA TIL:	WWW.CFM.VA.GOV/TIL/INDEX.ASP
VHA:	VETERANS HEALTH ADMINISTRATION

Revisions:	Date:

CONSULTANT/ DISCIPLINE

DISCIPLINE:

ARCHITECT/ ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HIGHWAY S. SUITE 300
KENT, WA 98032
SPEESDESIGNBUILD

STAMP

MICHAEL G. HUBBARD — STATE OF WASHINGTON — 3/24/2026 — 39485 — REGISTERED PROFESSIONAL ENGINEER

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title	FIRE PROTECTION GENERAL NOTES & ABBREVIATIONS
Phase	100% CONSTRUCTION DOCUMENTS
Project Title	REPLACE ELEVATORS IN BLDG 7 & BLDG 9
Project Number	502-24-102
Building Number	7
Approved:	
Location	2495 Shreveport Hwy, Pineville, LA 71360
Issue Date	03/24/2026
Checked	MGH/JW
Drawn	NH/JM/CY/RQ/BC
Drawing Number	F-001

Autodesk Docs://502-24-102 VA LA Pineville Replace Elevators/VHA_7_ME_SDB.rvt
3/18/2026 4:33:17 PM

VA FORM 08 - 6231

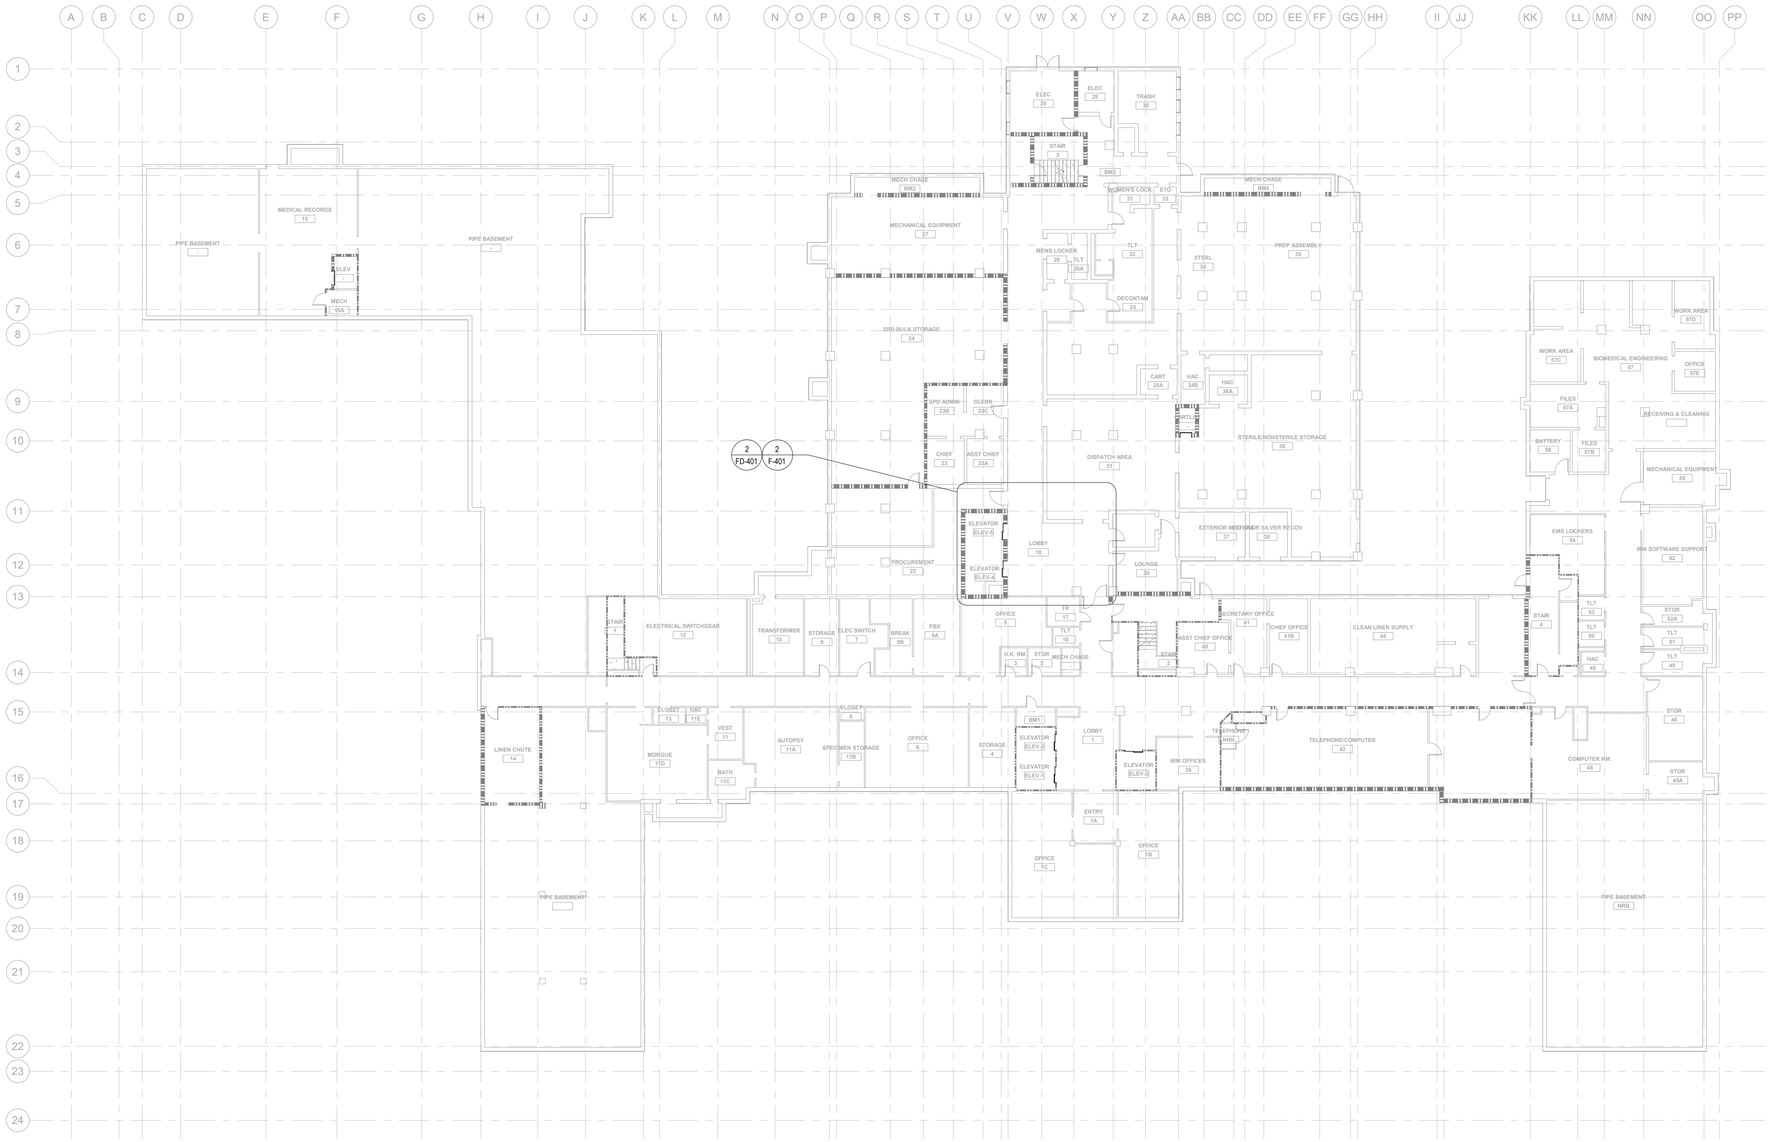

1 BUILDING 7 - BASEMENT - OVERALL FLOOR PLAN

1/16" = 1'-0"

PROJECT NORTH

0' 8' 16' 32'

KEY PLAN



KEY AREA SHOWN

PROJECT NORTH

Revisions:	**Date:**

CONSULTANT/ DISCIPLINE

DISCIPLINE:

ARCHITECT/ ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HIGHWAY S. SUITE 300
KENT, WA 98032

SDB SPEESDESIGNBUILD

STAMP

MICHAEL G. HUBBARD — STATE OF WASHINGTON — 3/24/2026 — 39485 — REGISTERED PROFESSIONAL ENGINEER

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title
BUILDING 7 - BASEMENT - OVERALL FIRE PROTECTION FLOOR PLAN

Approved:

Phase
100% CONSTRUCTION DOCUMENTS

FULLY SPRINKLERED

Project Title
REPLACE ELEVATORS IN BLDG 7 & BLDG 9

Location
2495 Shreveport Hwy, Pineville, LA 71360

Issue Date 03/24/2026
Checked MGH/JW
Drawn NH/JM/CY/RQ/BC

Project Number 502-24-102
Building Number 7
Drawing Number F-101

Autodesk Docs://502-24-102 VA LA Pineville Replace Elevators/VAH_07_ME_SDB.rvt
3/18/2026 4:33:18 PM

VA FORM 08 - 6231

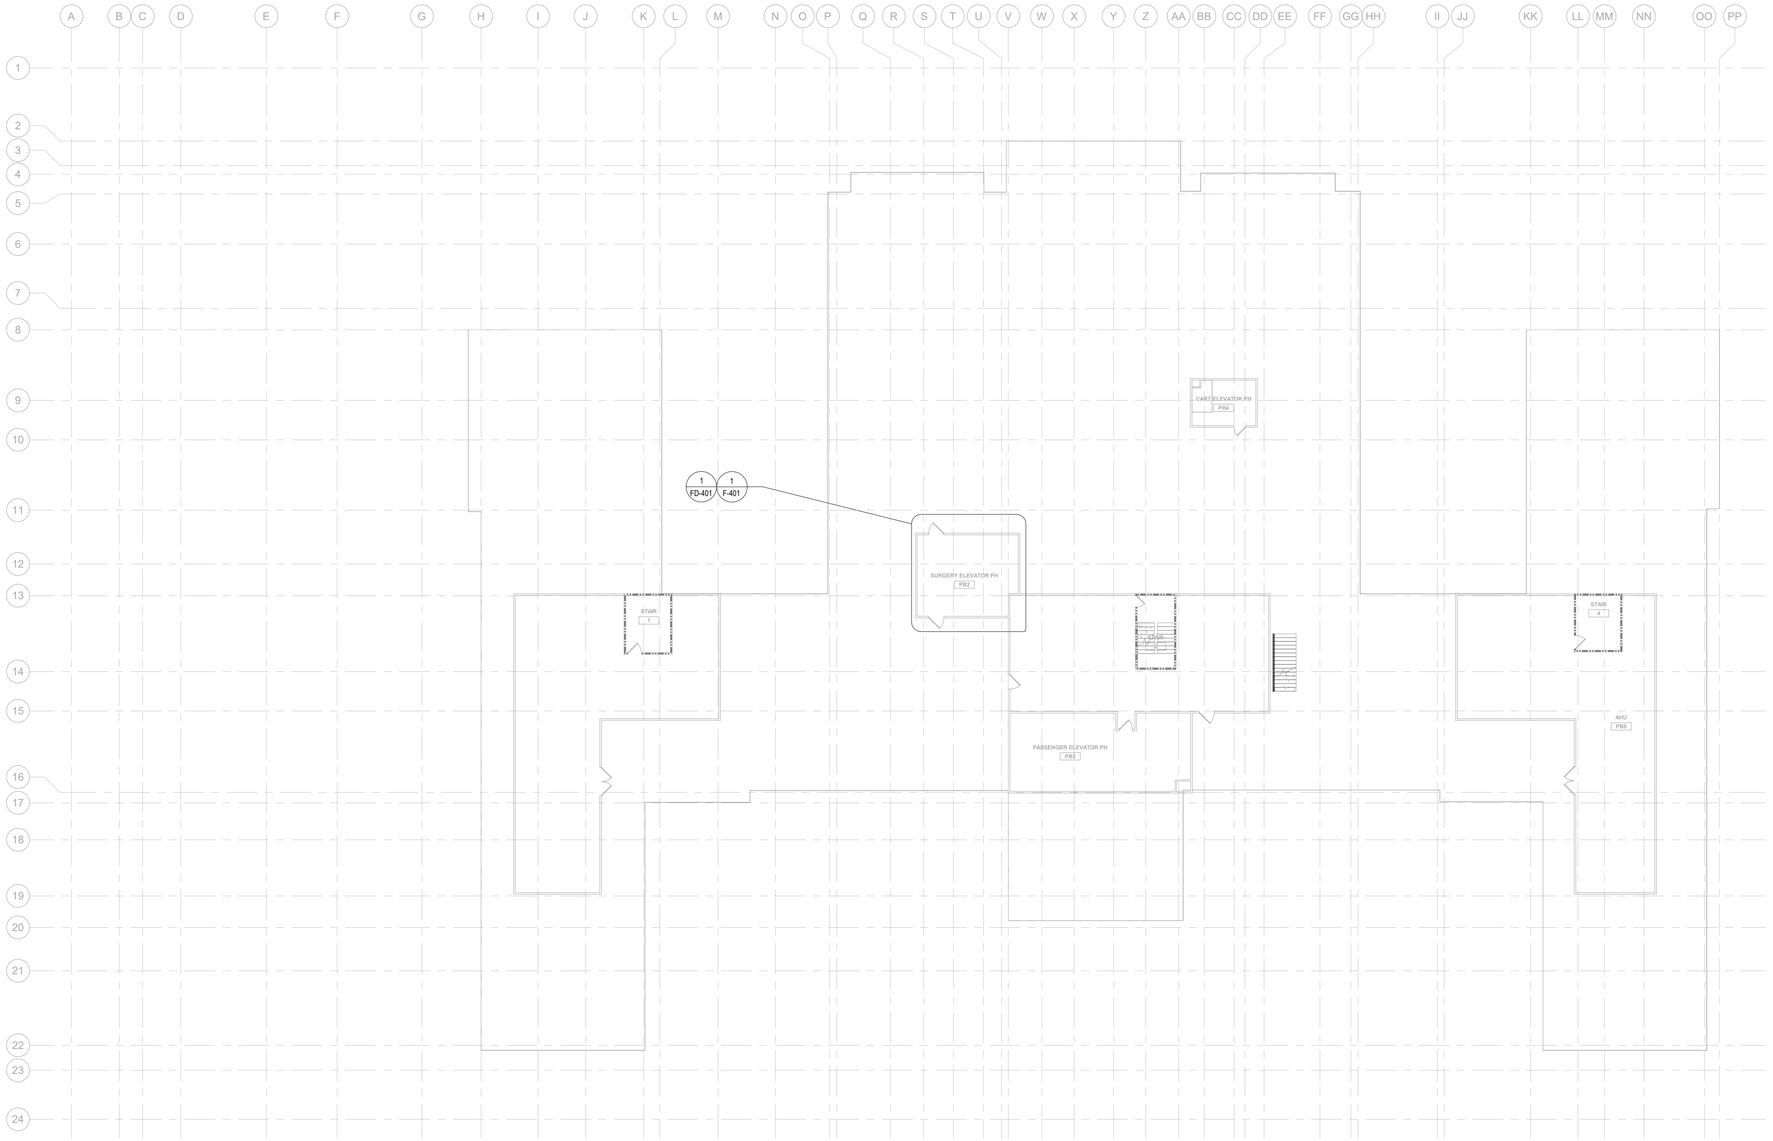

1 BUILDING 7 - PENTHOUSE - OVERALL FLOOR PLAN

1/16" = 1'-0"

PROJECT NORTH

0' 8' 16' 32'

KEY PLAN



KEY AREA SHOWN

TRUE NORTH

Revisions:	Date:

CONSULTANT/ DISCIPLINE

DISCIPLINE:

ARCHITECT/ ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HIGHWAY S. SUITE 300
KENT, WA 98032

SDB SPEESDESIGNBUILD

STAMP

MICHAEL G. HUBBARD — STATE OF WASHINGTON — 3/24/2026 — 39485 — REGISTERED PROFESSIONAL ENGINEER

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title
BUILDING 7 - PENTHOUSE - OVERALL FIRE PROTECTION FLOOR PLAN

Approved:

Phase
100% CONSTRUCTION DOCUMENTS

FULLY SPRINKLERED

Project Title
REPLACE ELEVATORS IN BLDG 7 & BLDG 9

Location
2495 Shreveport Hwy, Pineville, LA 71360

Project Number
502-24-102

Building Number
7

Drawing Number
F-102

Issue Date	Checked	Drawn
03/24/2026	MGH/JW	NH/JM/CY/RQ/BC

Autodesk Docs://502-24-102 VA LA Pineville Replace Elevators/AHP1-07_ME_SDB.rvt
3/18/2026 4:33:19 PM

VA FORM 08 - 6231

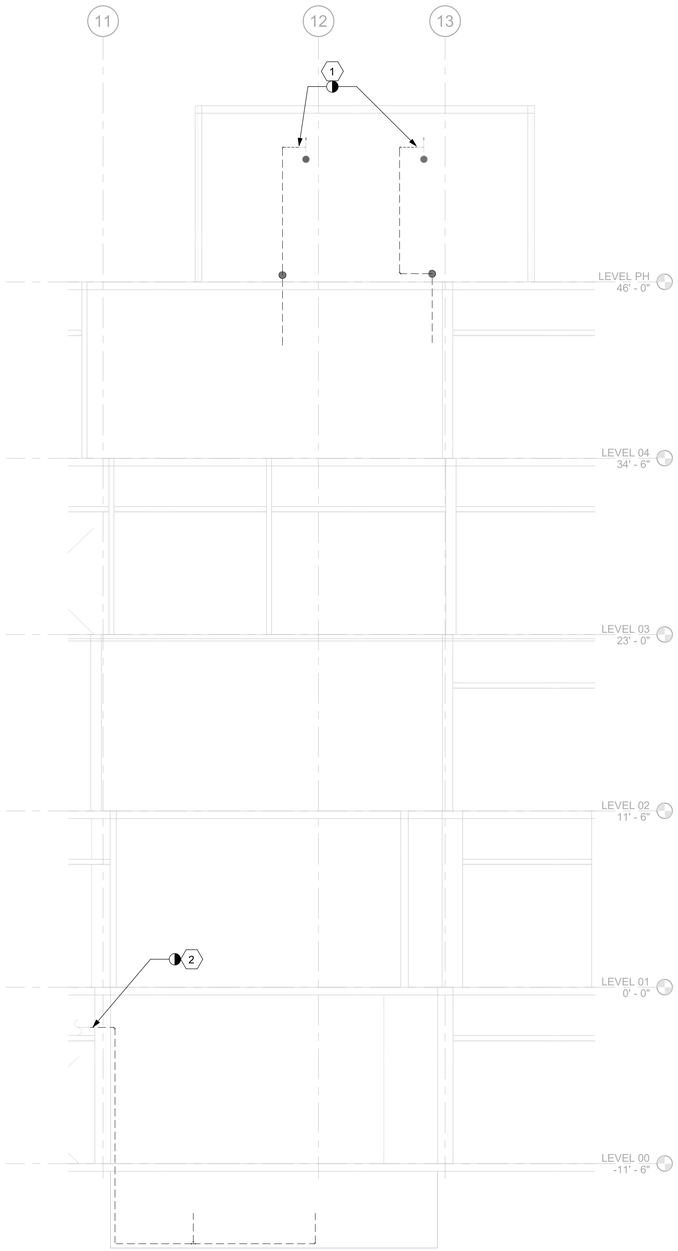

3 BUILDING 7 - ELEVATOR HOISTWAY - DEMOLITION SECTION VIEW
1/4" = 1'-0"

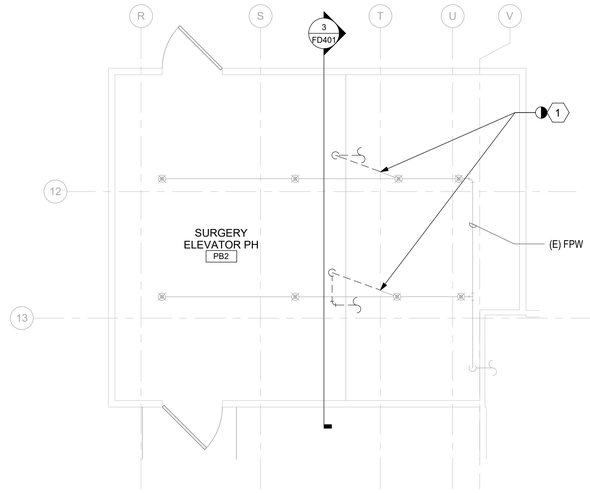

1 BUILDING 7 - PENTHOUSE - DEMOLITION FIRE PROTECTION FLOOR PLAN - ENLARGE
1/4" = 1'-0"

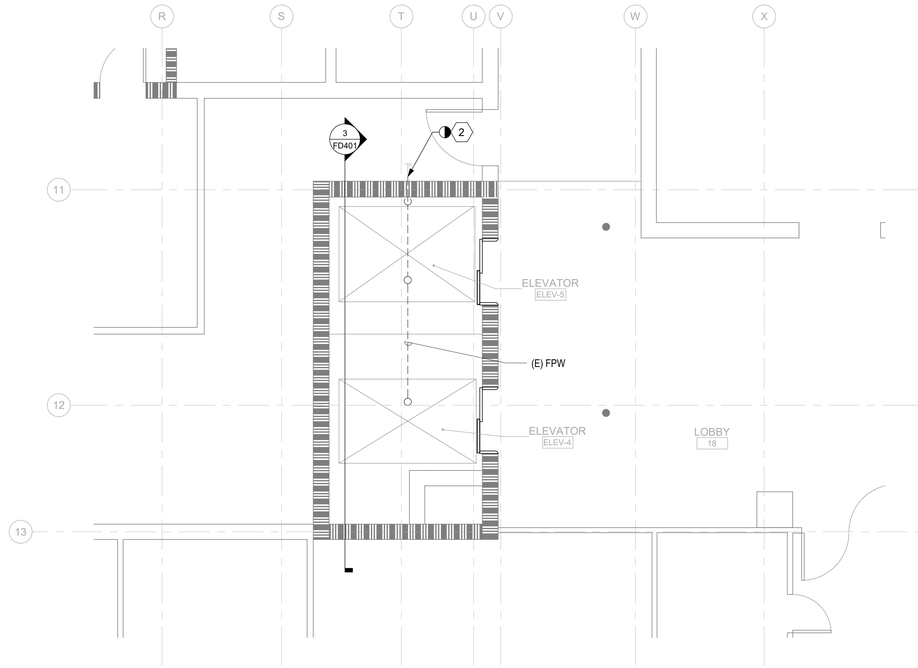

2 BUILDING 7 - BASEMENT - DEMOLITION FIRE PROTECTION ENLARGED
1/4" = 1'-0"

GENERAL NOTES

1. NEW WORK SHOWN DARK, EXISTING WORK SHOWN LIGHT.

DEMOLITION GENERAL NOTES

1. REFER TO ALL DRAWINGS FOR COORDINATION BETWEEN DEMOLITION AND NEW WORK. COORDINATE DEMOLITION WORK WITH THAT OF OTHER TRADES.
2. COORDINATE SALVAGE AND REUSE OF EXISTING EQUIPMENT WITH OWNER. ITEMS OF VALUE WHICH ARE NOT DIRECTED TO BE RETURNED TO THE OWNER, SHALL BECOME THE PROPERTY OF THE CONTRACTOR. STORAGE OR SALE OF ITEMS ON THE PROJECT SITE IS PROHIBITED.
3. CONTRACTOR SHALL BE RESPONSIBLE FOR THE FOLLOWING:
   A) PROTECTING, COVERING AND SEALING EXISTING EQUIPMENT AND SURROUNDINGS DURING DEMOLITION FROM DIRT, DUST, AND DEBRIS.
   B) ENSURING THE SAFE PASSAGE OF PERSONS IN AND AROUND THE BUILDING DURING DEMOLITION.
   C) PREVENTING INJURY TO PERSONS AND DAMAGE TO PROPERTY.
   D) PROVIDING ADEQUATE SHORING AND BRACING TO PREVENT COLLAPSE.
   E) IMMEDIATELY REPAIRING DAMAGED PROPERTY TO ITS CONDITION BEFORE BEING DAMAGED.
   F) TAKING EFFECTIVE MEASURES TO PREVENT DUST MIGRATION.
4. UTILITIES: MAINTAIN ALL UTILITIES EXCEPT THOSE REQUIRING REMOVAL OR RELOCATION. KEEP UTILITIES IN SERVICE AND PROTECT FROM DAMAGE. DO NOT INTERRUPT UTILITIES SERVING AREAS OUTSIDE OF PRESENT SCOPE WITHOUT FIRST OBTAINING PERMISSION FROM OWNER. PROVIDE TEMPORARY SERVICES AS REQUIRED.
5. REMOVE AND DISPOSE OF EXISTING MECHANICAL EQUIPMENT AS SHOWN. UNLESS NOTED OTHERWISE, COORDINATE WITH ARCHITECTURAL PLANS, AREAS OF DEMOLITION AROUND, ADJACENT, OR CONNECTED TO EXISTING MECHANICAL EQUIPMENT THAT IS TO REMAIN.
6. WORK TO BE DEMOLISHED SHOWN DARK AND DASHED, EXISTING WORK TO REMAIN SHOWN LIGHT.

KEYNOTES (#)

1. DEMOLISH SPRINKLER HEAD SERVING ELEVATOR HOIST WAY BACK TO TEE AND CAP.
2. DEMOLISH EXISTING ELEVATOR PIT WET FIRE PROTECTION PIPING BACK TO MAIN AND CAP.

KEY PLAN



KEY AREA SHOWN

Revisions:	Date:

CONSULTANT/ DISCIPLINE

DISCIPLINE:

ARCHITECT/ ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HIGHWAY S. SUITE 300
KENT, WA 98032

SDB SPEESDESIGNBUILD

STAMP

MICHAEL G. HUBBARD — STATE OF WASHINGTON — 3/04/2026 — 39485 — REGISTERED PROFESSIONAL ENGINEER

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: BUILDING 7 - FIRE PROTECTION - DEMOLITION ENLARGED PLANS	Phase: 100% CONSTRUCTION DOCUMENTS	Project Title: REPLACE ELEVATORS IN BLDG 7 & BLDG 9	Project Number: 502-24-102
			Building Number: 7
Approved:	FULLY SPRINKLERED	Location: 2495 Shreveport Hwy, Pineville, LA 71360	Drawing Number: FD401
		Issue Date: 03/24/2026 / Checked: MGH/JW / Drawn: NH/JM/CY/RQ/BC	

Autodesk Docs://502-24-102 VA LA Pineville Replace Elevators/VAPI_07_PHE_SDB.rvt
3/18/2026 4:33:23 PM

VA FORM 08 - 6231

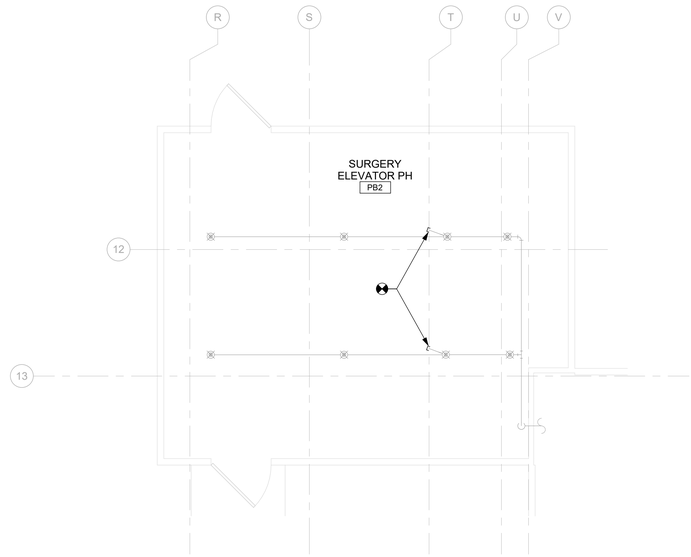

1 BUILDING 7 - PENTHOUSE - FIRE PROTECTION FLOOR PLAN -ENLARGED

1/4" = 1'-0"

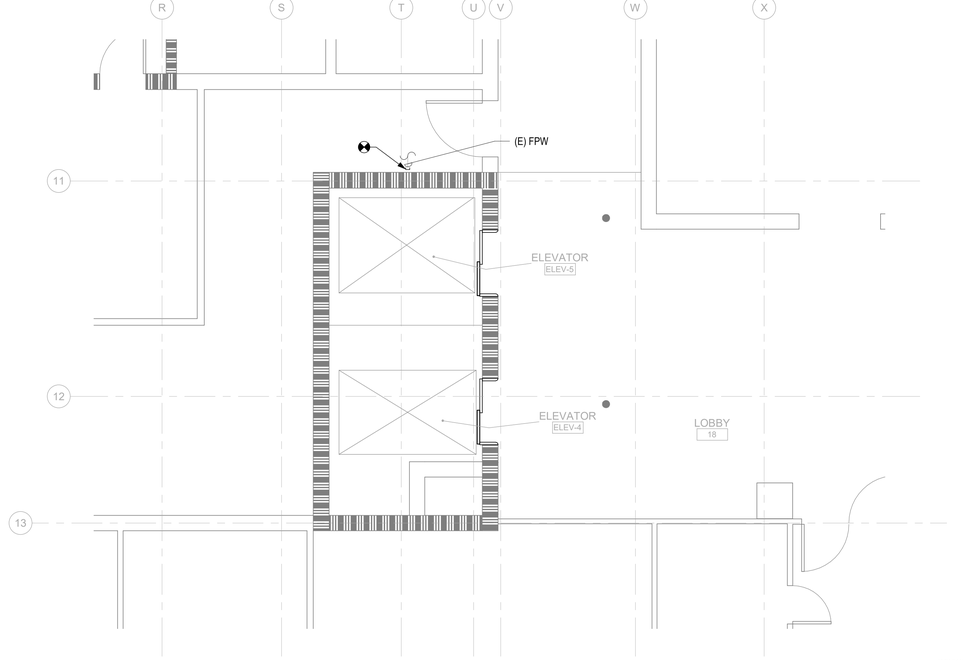

2 BUILDING 7 - BASEMENT - FIRE PROTECTION ENLARGED

1/4" = 1'-0"

GENERAL NOTES

1. NEW WORK SHOWN DARK, EXISTING WORK SHOWN LIGHT.

FIRE PROTECTION NOTES

1. FOR THE PURPOSES OF CLEARNESS AND LEGIBILITY, DRAWINGS ARE DIAGRAMMATIC AND FOR DESIGN INTENT ONLY. CONTRACTOR MUST VERIFY ALL DIMENSIONS BY FIELD MEASUREMENT BEFORE BEGINNING ANY FABRICATION OR CONSTRUCTION.
2. ALL WORK SHALL BE COMPLETED IN STRICT ACCORDANCE WITH THE CURRENT VA GUIDES AND LOCAL FIRE PROTECTION CODES AND ORDINANCES.
3. COORDINATE EXACT LOCATION OF PIPING, SPRINKLERS, EQUIPMENT AND MATERIALS WITH OTHER TRADES IN ACCORDANCE WITH NFPA 13.
4. THE CONTRACTOR SHALL PROVIDE FIRE CAULKING AT ALL PIPING PENETRATIONS OF FIRE RATED ASSEMBLIES AS REQUIRED.

KEY PLAN

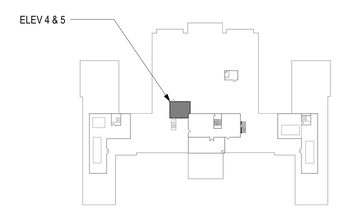

KEY AREA SHOWN

Revisions:	Date:

CONSULTANT/ DISCIPLINE

DISCIPLINE:

ARCHITECT/ ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HIGHWAY S. SUITE 300
KENT, WA 98032

SPEESDESIGNBUILD

STAMP

MICHAEL G. HUBBARD
STATE OF WASHINGTON
3/24/2026
39485
REGISTERED
PROFESSIONAL ENGINEER

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title
BUILDING 7 - FIRE PROTECTION - ENLARGED PLANS

Phase
100% CONSTRUCTION DOCUMENTS

Approved:

FULLY SPRINKLERED

Project Title
REPLACE ELEVATORS IN BLDG 7 & BLDG 9

Project Number
502-24-102

Building Number
7

Location
2495 Shreveport Hwy, Pineville, LA 71360

Drawing Number
F-401

Issue Date
03/24/2026

Checked
MGH/JW

Drawn
NH/JM/CY/RQ/BC

Autodesk Docs://502-24-102 VA LA Pineville Replace Elevators/VAFP_07_ME_SDB.rvt
3/18/2026 4:33:23 PM

VA FORM 08 - 6231

GENERAL NOTES

MECHANICAL DEMOLITION GENERAL NOTES

1. REFER TO ALL DRAWINGS FOR COORDINATION BETWEEN DEMOLITION AND NEW WORK. COORDINATE DEMOLITION WORK WITH THAT OF OTHER TRADES.
2. COORDINATE SALVAGE AND REUSE OF EXISTING EQUIPMENT WITH OWNER. ITEMS OF VALUE WHICH ARE NOT DIRECTED TO BE RETURNED TO THE OWNER SHALL BECOME THE PROPERTY OF THE CONTRACTOR. STORAGE OR SALE OF ITEMS ON THE PROJECT SITE IS PROHIBITED.
3. CONTRACTOR SHALL BE RESPONSIBLE FOR THE FOLLOWING:
   A) PROTECTING, COVERING, AND SEALING EXISTING EQUIPMENT AND SURROUNDINGS DURING DEMOLITION FROM DIRT, DUST, AND DEBRIS.
   B) ENSURING THE SAFE PASSAGE OF PERSONS IN AND AROUND THE BUILDING DURING DEMOLITION.
   C) PREVENTING INJURY TO PERSONS AND DAMAGE TO PROPERTY.
   D) PROVIDING ADEQUATE SHORING AND BRACING TO PREVENT COLLAPSE.
   E) REPAIRING DAMAGED PROPERTY TO ITS ORIGINAL CONDITION IMMEDIATELY AFTER THE DAMAGE OCCURS.
   F) TAKING EFFECTIVE MEASURES TO PREVENT DUST MIGRATION.
4. MAINTAIN ALL UTILITIES EXCEPT THOSE REQUIRING REMOVAL OR RELOCATION. KEEP UTILITIES IN SERVICE AND PROTECT FROM DAMAGE. DO NOT INTERRUPT UTILITIES SERVING AREAS OUTSIDE OF PRESENT SCOPE WITHOUT FIRST OBTAINING PERMISSION FROM OWNER. PROVIDE TEMPORARY SERVICES AS REQUIRED.
5. REMOVE AND DISPOSE OF EXISTING MECHANICAL EQUIPMENT AS SHOWN, UNLESS NOTED OTHERWISE. COORDINATE WITH ARCHITECTURAL PLANS, AREAS OF DEMOLITION AROUND, ADJACENT, OR CONNECTED TO EXISTING MECHANICAL EQUIPMENT THAT IS TO REMAIN.

MECHANICAL GENERAL NOTES

1. CONTRACTOR MUST VERIFY ALL DIMENSIONS BY FIELD MEASUREMENT BEFORE BEGINNING ANY FABRICATION OR CONSTRUCTION.
2. ALL WORK SHALL BE IN ACCORDANCE WITH APPLICABLE CODES, VA STANDARDS, AND SPECIFICATIONS.
3. CONTRACTOR SHALL INSTALL ALL EQUIPMENT IN STRICT ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS. IN CASES OF CONFLICT BETWEEN MANUFACTURER REQUIREMENTS, DRAWINGS, OR SPECIFICATIONS, THE MORE STRINGENT REQUIREMENT SHALL GOVERN.
4. COORDINATE INSTALLATION OF EQUIPMENT AND MATERIALS WITH OTHER TRADES.
5. DO NOT ROUTE CONDENSATE PIPING OVER ELECTRICAL PANELS OR ELECTRONIC EQUIPMENT.
6. CONTRACTOR SHALL COORDINATE WITH GENERAL CONTRACTOR AND VA COR PRIOR TO ANY CUTTING OF WALLS AND ROOF.
7. IF FLOOR OR RATED WALL PENETRATIONS CANNOT BE FIRE STOPPED AT THE END OF THE WORK SHIFT, TEMPORARY FIRESTOPPING COMPOSED OF MINERAL WOOL SHALL BE INSTALLED IN THE PENETRATION TO PROVIDE PROTECTION AGAINST FIRE/SMOKE SPREAD THROUGH THE UNSEALED PENETRATION.
8. INSTALL GRAVITY CONDENSATE DRAIN PIPING WITH A MINIMUM OF 1/8" PER LINEAR FOOT (1%) SLOPE.
9. ALL PIPING AND DUCTS IN FINISHED ROOMS OR SPACES SHALL BE CONCEALED IN A FURRED CHASE, ABOVE HARD SUSPENDED CEILING, OR ABOVE AN ACOUSTICAL CEILING.
10. THE FIRST FIGURE OF DUCT SIZE INDICATES DIMENSION OF FACE SHOWN OR INDICATED. DUCT SIZES ARE NET INSIDE DIMENSIONS.
11. ACCESS PANELS IN HARD SUSPENDED CEILINGS ARE REQUIRED FOR ALL VALVES, TRAPS, DAMPERS, CLEANOUTS, CONTROLS, ETC. ACCESS PANELS SHALL BE FURNISHED AND INSTALLED IN ACCORDANCE WITH THE ARCHITECTURAL SPECIFICATIONS. COORDINATE LOCATION WITH MECHANICAL INSTALLATION AND DEMONSTRATE ACCESS TO EQUIPMENT SERVED.
12. DIFFUSER, REGISTER, AND GRILLE SIZES SHOWN ON FLOOR PLANS ARE NECK SIZES.
13. WATER PIPE CONNECTIONS TO AIR HEATING AND COOLING COILS SHALL BE MADE TO PROVIDE COUNTER FLOW BETWEEN WATER AND AIR.
14. REFER TO ARCHITECTURAL REFLECTED CEILING PLANS FOR EXACT LOCATIONS OF CEILING DIFFUSERS, REGISTERS, AND GRILLES.
15. ALL PRESSURES LISTED ARE GAUGE PRESSURE UNLESS OTHERWISE NOTED.

ABBREVIATIONS

A/E:	ARCHITECT / ENGINEER
ACC:	AIR COOLED CONDENSER
ACCH:	AIR COOLED CHILLER
ACCU:	AIR COOLED CONDENSING UNIT
ACD:	AUTOMATIC CONTROL DAMPER, MODULATING
ACD-TP:	AUTOMATIC CONTROL DAMPER, TWO POSITION
ACU:	AIR CONDITIONING UNIT
AFF:	ABOVE FINISHED FLOOR
AP:	ACCESS PANEL
APD:	AIR PRESSURE DROP
ASHRAE:	AMERICAN SOCIETY OF HEATING REFRIGERATION AIR CONDITIONING ENGINEERS
BDD:	BACKDRAFT DAMPER
BFP:	BACKFLOW PREVENTER
BHP:	BRAKE HORSEPOWER
BTU:	BRITISH THERMAL UNIT
BTUH:	BRITISH THERMAL UNIT PER HOUR
CAV:	CONSTANT AIR VOLUME
CC:	COOLING COIL
CCD:	COOLING COIL CONDENSATE DRAIN
CD:	CEILING DIFFUSER
CD-1:	CONSTRUCTION DOCUMENTS (SUBMISSION1)
CD-2:	CONSTRUCTION DOCUMENTS (SUBMISSION2)
CFH:	CUBIC FEET PER HOUR
CFM:	CUBIC FEET PER MINUTE
COP:	COEFFICIENT OF PERFORMANCE
CP:	CONDENSATE PUMP
CS:	CONDENSATE STORAGE TANK
CU:	CONDENSING UNIT
CV:	CONSTANT VOLUME
CW:	COLD WATER (POTABLE)
CWP:	CONDENSER WATER PUMP
Db:	DRY-BULB TEMPERATURE
DB:	DECIBELS
DD-1:	DESIGN DEVELOPMENT (SUBMISSION 1)
DD-2:	DESIGN DEVELOPMENT (SUBMISSION 2)
DP:	DEW POINT TEMPERATURE
DX:	DIRECT EXPANSION
DXCC:	DIRECT EXPANSION COOLING COIL
EA:	EXHAUST AIR
EAT:	ENTERING AIR TEMPERATURE
EDH:	ELECTRIC DUCT HEATER
EER:	ENERGY EFFICIENCY RATIO
EF:	EXHAUST FAN
EG:	EXHAUST GRILLE
EH:	EXHAUST HOOD
ENT:	ENTERING
ER:	EXHAUST REGISTER
ESP:	EXTERNAL STATIC PRESSURE
EX:	EXISTING
F:	FAHRENHEIT
F/SDPR:	COMBINATION FIRE SMOKE DAMPER
FCU:	FAN COIL UNIT
FCUC:	FAN COIL UNIT COOLING ONLY
FCUH:	FAN COIL UNIT HEATING ONLY
FD:	FLOOR DRAIN
FD:	FIRE DAMPER
FF:	FINAL FILTER
FPM:	FEET PER MINUTE
FPS:	FEET PER SECOND
FPTU:	FAN POWERED TERMINAL UNIT
FS:	FLOW SWITCH
FT:	FEET
FT WC:	FEET OF WATER COLUMN
FT-LB:	FOOT-POUND
FV:	FACE VELOCITY
GA:	GAUGE
GAL:	GALLONS
GPH:	GALLONS PER HOUR
GPM:	GALLONS PER MINUTE
H:	HUMIDIFIER
HAC:	HOUSEKEEPING AID CLOSET
HP:	HEAT PUMP
HP:	HORSEPOWER
HSTAT:	HUMIDISTAT
HZ:	HERTZ
I/O:	INPUT/OUTPUT
IAQ:	INDOOR AIR QUALITY
IBT:	INVERTED BUCKET TRAP
ICU:	INTENSIVE CARE UNIT
ID:	INSIDE DIAMETER
IN:	INCHES
IN HG:	INCHES OF MERCURY
IN WC:	INCH WATER COLUMN
IN WG:	INCH WATER GAUGE
IN-LB:	INCH-POUND
IRH:	INTRARED HEATER
IU:	INDUCTION UNIT
KW:	KILOWATT
KWH:	KILOWATT HOUR
LAT:	LEAVING AIR TEMPERATURE
LBS/HR:	POUNDS PER HOUR
LF:	LINEAR FOOT (FEET)
LH:	LATENT HEAT
LVG:	LEAVING
LVR:	LOUVER
LWT:	LEAVING WATER TEMPERATURE
MAV:	MANUAL AIR VENT
MAX:	MAXIMUM
MB:	MIXING BOX
MBH:	1,000 BTUH
MERV:	MINIMUM EFFICIENCY REPORTING VALUE
MIN:	MINIMUM
MRI:	MAGNETIC RESONANCE IMAGING
MVD:	MANUAL VOLUME DAMPER
NA:	NOT APPLICABLE
NC:	NOISE CRITERIA
NC:	NORMALLY CLOSED
NO:	NORMALLY OPEN
NOM:	NOMINAL
NTS:	NOT TO SCALE
OA:	OUTSIDE AIR
OAD:	OUTDOOR AIR DAMPER
OAG:	OUTSIDE AIR GRILLE
OAI:	OUTSIDE AIR INTAKE
OD:	OUTSIDE DIAMETER
OR:	OPERATING ROOM
P:	PUMP
Pa:	PASCAL
PC:	PUMPED CONDENSATE
PCF:	POUNDS PER CUBIC FOOT (FEET)
PD:	PRESSURE DROP
PF:	PRE-FILTER
PG:	PRESSURE GAUGE
PHC:	PREHEAT COIL
PPM:	PARTS PER MILLION
PSI:	POUNDS PER SQUARE INCH
PSIA:	POUNDS PER SQUARE INCH – ABSOLUTE
PSIG:	POUNDS PER SQUARE INCH – GAUGE
PTAC:	PACKAGED TERMINAL AIR CONDITIONER
RA:	RETURN AIR
RAD:	RETURN AIR DAMPER
RAT:	RETURN AIR TEMPERATURE
RD:	REFRIGERANT DISCHARGE
RDS:	ROOM DATA SHEETS
REA:	RELIEF AIR
RF:	RETURN FAN
RG:	RETURN GRILLE
RH:	RELATIVE HUMIDITY
RHG:	REFRIGERANT HOT GAS
RL:	REFRIGERANT LIQUID LINE
RPM:	REVOLUTIONS PER MINUTE
RR:	RETURN REGISTER
RS:	REFRIGERANT SUCTION
RTU:	ROOF TOP UNIT
SA:	SUPPLY AIR
SAD:	SOUND ATTENUATING DEVICE
SAT:	SUPPLY AIR TEMPERATURE
SCFM:	STANDARD CUBIC FEET PER MINUTE
SD:	SMOKE DETECTOR
SD-1:	SCHEMATIC DESIGN (SUBMISSION1)
SD-2:	SCHEMATIC DESIGN (SUBMISSION2)
SDPR:	SMOKE DAMPER
SEN:	SENSIBLE HEAT
SF:	SUPPLY FAN
SG:	SUPPLY AIR GRILLE
SP:	STATIC PRESSURE
SQ FT:	SQUARE FOOT (FEET)
SR:	SUPPLY AIR REGISTER
SS:	STAINLESS STEEL
TAB:	TESTING, ADJUSTING, BALANCE
TD:	TEMPERATURE DIFFERENCE
TSTAT:	THERMOSTAT
TU:	TERMINAL UNIT
UH:	UNIT HEATER
V:	VALVE
VAV:	VARIABLE AIR VOLUME
VD:	VOLUME DAMPER (MANUAL OPPOSED BLADE)
VFD:	VARIABLE FREQUENCY DRIVE
VP:	VACUUM PUMP
VPS:	VARIABLE PRIMARY SYSTEM
VR:	VACUUM (STEAM CONDENSATE) RETURN
VSD:	VARIABLE SPEED DRIVE
W:	WATTS
WB:	WET-BULB (TEMPERATURE)
YR:	YEAR

Revisions:	Date:
CONSULTANT/ DISCIPLINE	
DISCIPLINE:	
ARCHITECT/ ENGINEER OF RECORD	
A/E:	
SPEES DESIGN BUILD	
23830 PACIFIC HIGHWAY S. SUITE 300	
KENT, WA 98032	
STAMP	
MICHAEL G. HUBBARD, STATE OF WASHINGTON, 3/24/2026, 39485, REGISTERED PROFESSIONAL ENGINEER	
Office of Construction and Facilities Management	
VA U.S. Department of Veterans Affairs	
Drawing Title: MECHANICAL GENERAL NOTES & ABBREVIATIONS	
Phase: 100% CONSTRUCTION DOCUMENTS	
Approved:	
Project Title: REPLACE ELEVATORS IN BLDG 7 & BLDG 9	
Location: 2495 Shreveport Hwy, Pineville, LA 71360	
Issue Date: 03/24/2026	Checked: MGH/JW
Drawn: NH/JM/CY/RQ/BC	
Project Number: 502-24-102	
Building Number: -	
Drawing Number: M-001	

Autodesk Docs://502-24-102 VA LA Pineville Replace Elevators/M-EP_ME_SDB.rvt
3/18/2026 4:54:16 PM

VA FORM 08 - 6231

LEGEND

PIPING LEGEND

S-60	HIGH PRESSURE STEAM (60 PSIG AND ABOVE)
CR-60	HIGH PRESSURE STEAM CONDENSATE RETURN
S-30	MEDIUM PRESSURE STEAM (16 PSIG THRU 59 PSIG)
CR-30	MEDIUM PRESSURE STEAM CONDENSATE RETURN
S-15	LOW PRESSURE STEAM (15 PSIG AND BELOW)
CR-15	LOW PRESSURE STEAM CONDENSATE RETURN
PC	CONDENSATE PUMP DISCHARGE
HWS	HOT WATER HEATING SUPPLY
HWR	HOT WATER HEATING RETURN
GHS	GLYCOL-WATER HEATING SUPPLY
GHR	GLYCOL-WATER HEATING RETURN
RL/RS	REFRIGERANT LIQUID/SUCTION
RHG	REFRIGERANT HOT GAS
CWS	CONDENSER WATER SUPPLY
CWR	CONDENSER WATER RETURN
CHS	CHILLED WATER SUPPLY
CHR	CHILLED WATER RETURN
GCS	CHILLED GLYCOL-WATER SUPPLY
GCR	CHILLED GLYCOL-WATER RETURN
D	CONDENSATE DRAIN
G	NATURAL GAS (1/2 PSI OR LESS)
X	EXISTING PIPE TO BE REMOVED

ADDITIONAL SYMBOLS

- 2 / H4 — DETAIL NUMBER / DRAWING NUMBER WHERE DRAWN
- A / H7 — SECTION LETTER / DRAWING NUMBER WHERE SHOWN
- 26-SF 3 — BUILDING NO. WHERE EQUIPMENT IS LOCATED. EQUIPMENT ABBREVIATION (SUPPLY FAN) / SUPPLY FAN NO. 3 IN BUILDING NO. 26 / TYPICAL UNIT NO.
- 26-TU-1-1 — BUILDING NO. WHERE EQUIPMENT IS LOCATED / ITEM (TERMINAL UNIT SHOWN) / ITEM NUMBER (TERMINAL UNIT NO. 1) / SERVED BY AIR HANDLER UNIT NO. 1
- POINT OF CONNECTION BETWEEN NEW AND EXISTING WORK
- LIMIT OF DEMOLITION

FLOOR PLAN CONTROL SYMBOLS

- (T) TEMPERATURE SENSOR OR THERMOSTAT
- (H) ROOM HUMIDISTAT
- (M) MOISTURE SENSOR
- (R) REFRIGERANT SENSOR

DUCTWORK SYMBOLS

SINGLE LINE	DOUBLE LINE	SINGLE LINE	DOUBLE LINE

- ROUND DUCT UP
- ROUND DUCT DOWN
- SUPPLY DUCT UP
- SUPPLY DUCT DOWN
- OR — STANDARD RADIUS ELBOW (R= W) SUPPLY/RETURN /EXHAUST (W, R)
- TURNING VANES
- OR — BULLHEAD SPLIT SUPPLY
- CEILING DUCT MTD. DIFF/GRILLE
- TAKEOFF TO DIFF/GRILLE — HARD ELBOW
- CEILING DUCT MTD. DIFF/GRILLE
- ACOUSTICALLY LINED DUCT
- DUCTWORK OR EQUIPMENT TO BE REMOVED
- OPEN END DUCT W/ 1/4"x1/4" WMS
- FLEXIBLE DUCT
- RETURN DUCT UP
- EXHAUST DUCT UP
- RETURN DUCT DOWN
- EXHAUST DUCT DOWN
- HORIZONTAL OFFSET SUPPLY/RETURN /EXHAUST
- RISE/DROP — RISE OR DROP SUPPLY/RETURN /EXHAUST (RISE UP / DROP DN)
- 45°F TAP TAKE-OFF
- RECTANGULAR MAIN DUCT — 90°F TAP TAKE-OFF — RECT. TAP — ROUND DUCT — ROUND TAP — RECT TAP
- ROUND MAIN DUCT — 90°F TAP TAKE-OFF — ROUND TAKEOFF
- BULLHEAD CONVERGE RETURN /EXHAUST
- SIDEWALL DUCT MTD. REG./GRILLE
- SUPPLY SIDEWALL LINEAR DIFFUSER (W/SHEET METAL PLENUM W/1" LINING & BRANCH CONN FOR EVERY 4' OF LENGTH) — VD
- SUPPLY CEILING LINEAR DIFFUSER (W/SHEET METAL PLENUM W/1" LINING & BRANCH CONN FOR EVERY 4' OF LENGTH) — VD — BOOT BY LD MF'R

ADDITIONAL DUCTWORK SYMBOLS

- (1) FIRE DAMPER
- BD — BACKDRAFT DAMPER
- M — MOTORIZED DAMPER
- STANDARD 4-WAY BLOW SUPPLY DIFFUSER
- 3-WAY BLOW SUPPLY DIFFUSER
- OR — 2-WAY BLOW SUPPLY DIFFUSER
- 1-WAY BLOW SUPPLY DIFFUSER
- W"/H" — WIDTH AND HEIGHT IN INCHES FOR FLAT OVAL DUCT

AIR OUTLET CALLOUT



- (1) AIR OUTLET TYPE
- (2) NECK SIZE (IN)
- (3) AIRFLOW (CFM)

FIRE PROTECTION

- PENDENT SPRINKLER
- UPRIGHT SPRINKLER WITH GUARD

GENERAL PIPING SYMBOLS

- DIRECTION OF PIPE PITCH (DOWN)
- DIRECTION OF FLOW
- ANCHOR
- REDUCER OR INCREASER
- ECCENTRIC REDUCER
- TOP CONNECTION. 45° OR 90°
- BOTTOM CONNECTION, 45° OR 90°
- SIDE CONNECTION
- CAPPED OUTLET
- RISE OR DROP IN PIPE
- UNION
- PIPE UP
- PIPE DOWN
- INVERTED BUCKET TRAP SET INCLUDING PIPING ACCESSORIES SEE DETAIL
- FLOAT & THERMOSTATIC TRAP SET INCLUDING PIPING ACCESSORIES SEE DETAIL
- THERMOSTATIC TRAP SET INCLUDING PIPING ACCESSORIES SEE DETAIL
- THERMOMETER
- PRESSURE GAUGE
- VENTURI FLOW METER
- REFRIGERANT SIGHT GLASS
- TEST PLUG (PRESSURE/TEMPERATURE)
- AUTOMATIC AIR VENT
- MANUAL AIR VENT
- QUICK-COUPLE HOSE CONNECTOR
- TOP TAKEOFF
- BOTTOM TAKEOFF
- PIPE BREAK
- BLIND FLANGE

VALVE SYMBOLS

- GATE VALVE - THREADED/FLANGED
- GLOBE VALVE - THREADED/FLANGED
- GATE VALVE WITH 3/4" HOSE ADAPTER
- CHECK VALVE
- WYE STRAINER (WITH BALL VALVE & HOSE CONNECTION)
- WYE STRAINER WITH VALVED DRAIN AND QUICK-COUPLE HOSE CONNECTOR
- FLEXIBLE CONNECTION
- ANGLE GLOBE VALVE
- BUTTERFLY VALVE
- BALL VALVE
- MODULATING CONTROL VALVE
- MODULATING CONTROL BUTTERFLY VALVE
- TWO POSITION CONTROL VALVE
- THREE-WAY MODULATING CONTROL VALVE
- THREE-WAY TWO POSITION CONTROL VALVE
- PRESSURE REGULATING VALVE
- PRESSURE SAFETY VALVE
- AUTOMATIC BALANCING CONTROL VALVE
- WATER BALANCE DEVICE
- CIRCUIT SETTER VALVE
- GATE VALVE WITH GLOBE-VALVED BYPASS
- PLUG VALVE
- CONTROL VALVE (CV) - FLOAT-OPERATED
- PRESSURE REDUCING VALVE (PRV)
- (LC) WATER LEVEL CONTROLLER
- (M) FLOW METER

CONTROLS DIAGRAM SYMBOLS

- (T) ROOM THERMOSTAT/TRANSMITTER – WALL MOUNT
- (M) ROOM HUMIDISTAT (MOISTURE)/TRANSMITTER – WALL MOUNT
- TT — TEMPERATURE TRANSMITTER
- TT — TEMPERATURE TRANSMITTER, AVERAGING ELEMENT
- MT — MOISTURE (HUMIDITY) TRANSMITTER
- PT — PRESSURE TRANSMITTER
- SPS — STATIC PRESSURE SENSOR
- FT — FLOW TRANSMITTER
- IT — CURRENT TRANSMITTER
- CT — CONDUCTIVITY TRANSMITTER
- SD — SMOKE DETECTOR
- PDT — PRESSURE DIFFERENTIAL TRANSMITTER
- PDS — PRESSURE DIFFERENTIAL SWITCH
- HS — HAND SWITCH (HAND—OFF—AUTO SWITCH)
- ZC — VALVE OR DAMPER POSITION CONTROLLER
- KR — LOCAL RECORDING TIME CLOCK (RUNTIME)
- TSL — TEMPERATURE SWITCH, LOW (FREEZESTAT)
- SHT — TEMPERATURE SWITCH, HIGH (FREEZESTAT)
- LC — LEVEL CONTROLLER
- LT — LEVEL TRANSMITTER
- PSH — PRESSURE SWITCH HIGH
- PSL — PRESSURE SWITCH LOW
- EPT — ELECTRONIC TO PNEUMATIC TRANSDUCER
- AT CO2 — CARBON DIOXIDE TRANSMITTER
- AT CO — CARBON MONOXIDE TRANSMITTER
- AT OC — OCCUPANCY SENSOR
- LTCP — LOCAL TEMPERATURE CONTROL PANEL
- HVAC — HVAC CONTROL PANEL
- VSMC — VARIABLE SPEED MOTOR CONTROLLER INTEGRATE CONTROL POINT ON REMOTE GRAPHICS
- ECC — WORKSTATION AT ENERGY CONTROL CENTER
- TC — TEMPERATURE CONTROLLER. SEE SEQUENCE OF OPERATION
- PC — PRESSURE CONTROLLER. SEE SEQUENCE OF OPERATION
- SC — SPEED CONTROLLER. SEE SEQUENCE OF OPERATION
- FC — FLOW CONTROLLER. SEE SEQUENCE OF OPERATION
- FSH — FLOW SWITCH HIGH
- FSL — FLOW SWITCH LOW
- KC — TIME CLOCK CONTROLLING EQUIPMENT ON A SCHEDULE
- TEMPERATURE SENSING ELEMENT FOR TRANSMITTING TEMPERATURE TO EMCS (PROVIDE 12 INCHES [200mm] MINIMUM LENGTH IN DUCT WHEN SPACE PERMITS.)
- A — SENSOR WITH AVERAGING ELEMENT TO TRANSMIT TEMPERATURE TO EMCS
- M — MOTOR STARTER
- ELECTRIC OPERATED CONTROL DAMPER/OR VALVE

INDOOR DESIGN CONDITIONS

ROOM TYPE	SUMMER		WINTER	
	TEMP DB (°F)	REL HUM (%)	TEMP DB (°F)	REL HUM (%)
MACHINE ROOM	77	N/A	77	N/A

OUTDOOR DESIGN CONDITIONS

STATE	COUNTY	WMO STATION IDENTIFIER	ALTITUDE (FT)	CLIMATE ZONE	SUMMER		WINTER
					TEMP DB (°F)	TEMP WB (°F)	TEMP DB (°F)
LOUISIANA	RAPIDES PARISH	747540	84	3A	97.2	76.8	26.9

Revisions:	Date:

CONSULTANT/ DISCIPLINE

DISCIPLINE:

ARCHITECT/ ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HIGHWAY S. SUITE 300
KENT, WA 98032

SPEESDESIGNBUILD

STAMP

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title	MECHANICAL LEGENDS
Phase	100% CONSTRUCTION DOCUMENTS
Project Title	REPLACE ELEVATORS IN BLDG 7 & BLDG 9
Project Number	502-24-102
Building Number	-
Approved:	
Location	2495 Shreveport Hwy, Pineville, LA 71360
Drawing Number	M-002
Issue Date	03/24/2026
Checked	MGH/JW
Drawn	NH/JM/CY/RQ/BC

Autodesk Docs://502-24-102 VA LA Pineville Replace Elevators/VAMC_DT_ME_SDB.rvt
3/18/2026 4:54:16 PM

VA FORM 08 - 6231

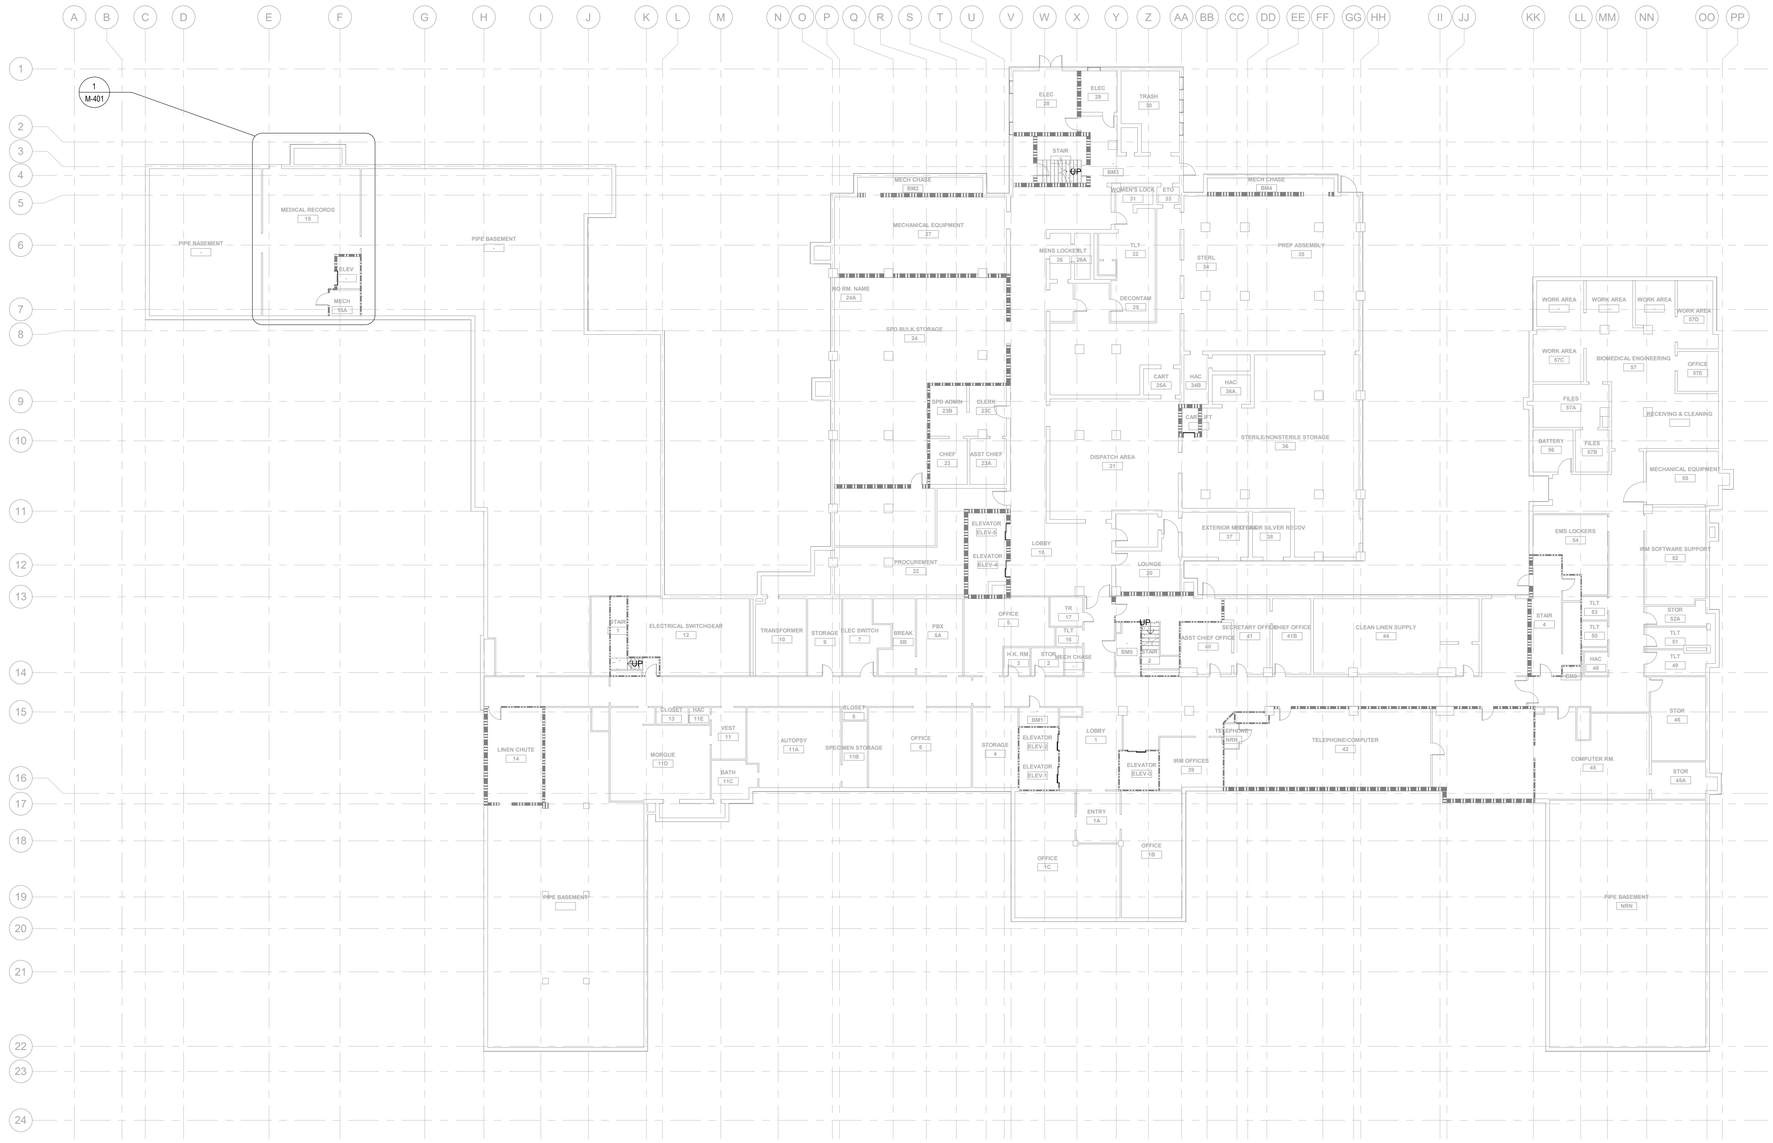

1 BUILDING 7 - BASEMENT - FLOOR PLAN

1/16" = 1'-0"

PROJECT NORTH

0' 8' 16' 32'

KEY PLAN



KEY AREA SHOWN

PROJECT NORTH

Revisions:	**Date:**

CONSULTANT/ DISCIPLINE

DISCIPLINE:

ARCHITECT/ ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HIGHWAY S. SUITE 300
KENT, WA 98032

SDB SPEESDESIGNBUILD

STAMP

MICHAEL G. HUBBARD — STATE OF WASHINGTON — 3/24/2026 — 39485 — REGISTERED PROFESSIONAL ENGINEER

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title BUILDING 7 - BASEMENT - OVERALL FLOOR PLAN	**Phase** 100% CONSTRUCTION DOCUMENTS	**Project Title** REPLACE ELEVATORS IN BLDG 7 & BLDG 9	**Project Number** 502-24-102
Approved:	FULLY SPRINKLERED	**Location** 2495 Shreveport Hwy, Pineville, LA 71360	**Building Number** 7
		Issue Date 03/24/2026 / **Checked** MGH/JW / **Drawn** NH/JM/CY/RQ/BC	**Drawing Number** M-101

Autodesk Docs://502-24-102 VA LA Pineville Replace Elevators/VAHQ_07_ME_SDB.rvt
3/18/2026 4:33:26 PM

VA FORM 08 - 6231

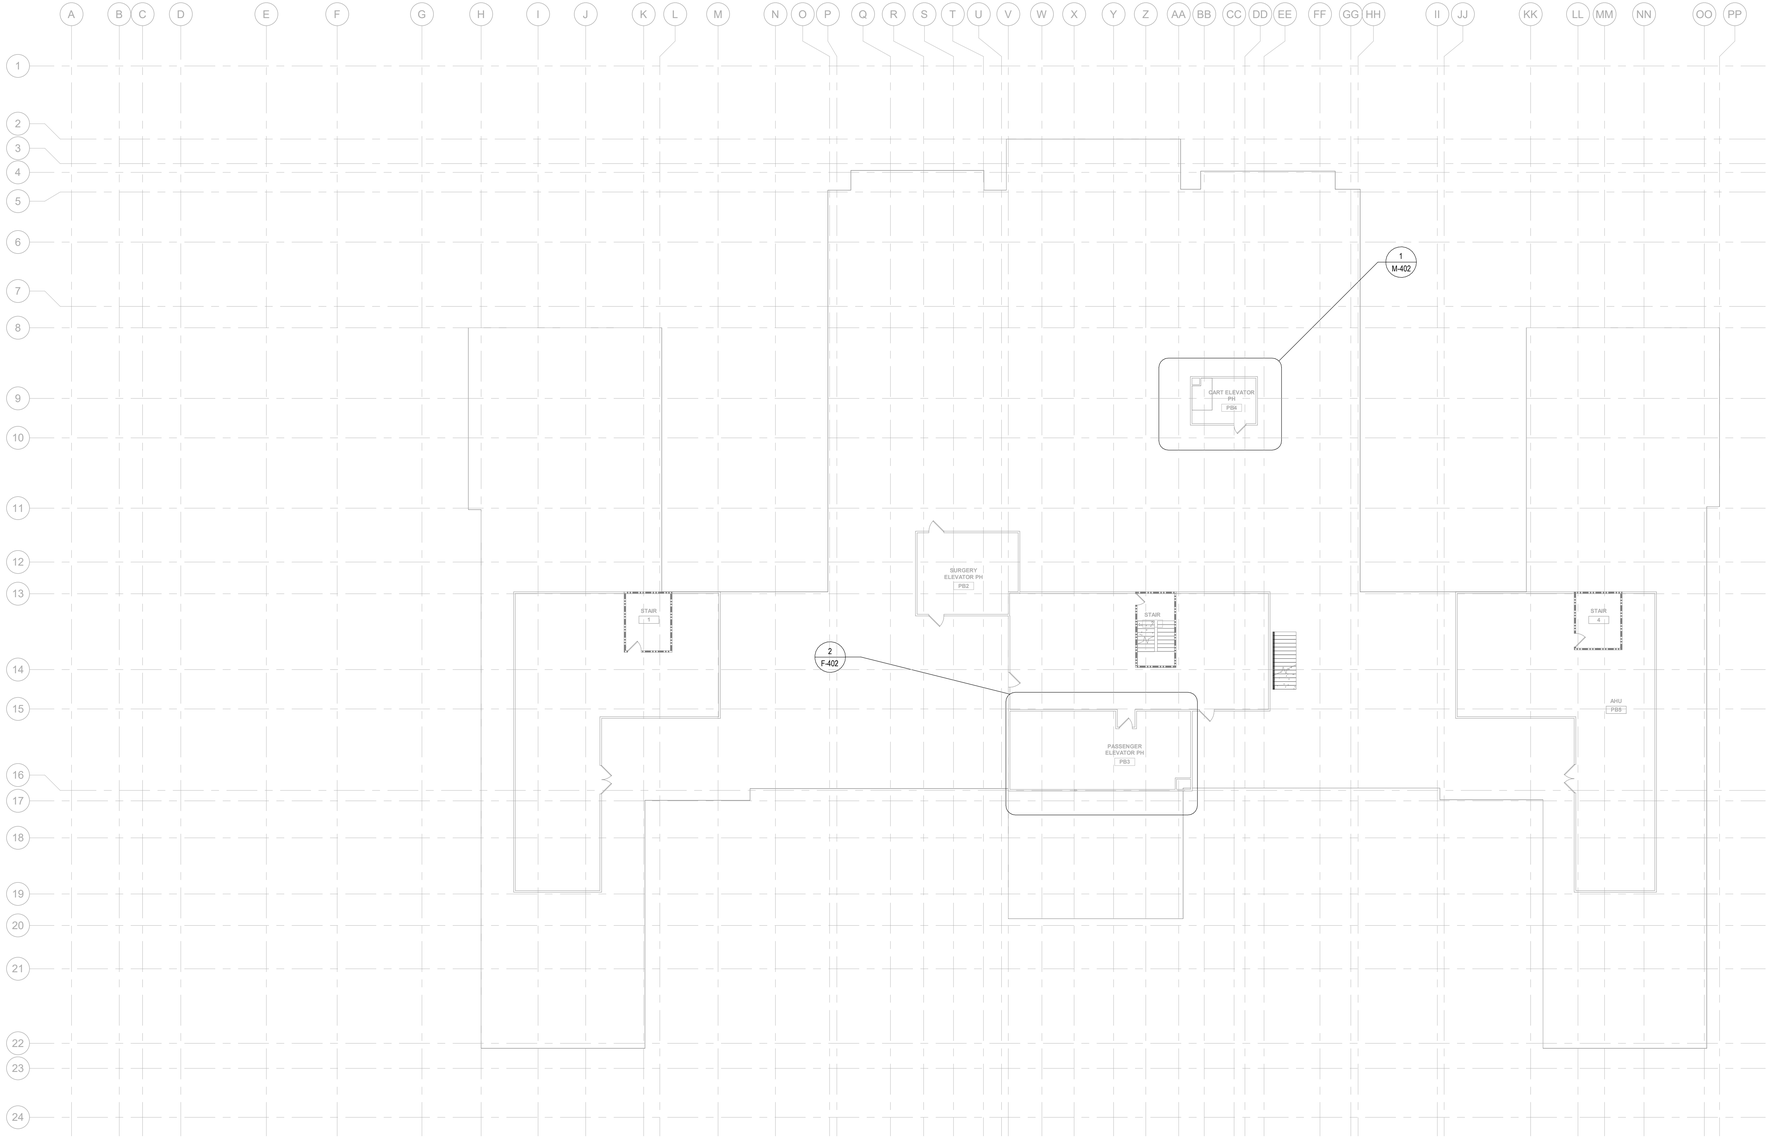

1 BUILDING 7 - PENTHOUSE - FLOOR PLAN

1/16" = 1'-0"

PROJECT NORTH

0' 8' 16' 32'

KEY PLAN



KEY AREA SHOWN

TRUE NORTH

Revisions:	Date:

CONSULTANT/ DISCIPLINE

DISCIPLINE:

ARCHITECT/ ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HIGHWAY S. SUITE 300
KENT, WA 98032

SPEESDESIGNBUILD

STAMP

MICHAEL G. HUBBARD — STATE OF WASHINGTON — 3/24/2026 — 39485 — REGISTERED PROFESSIONAL ENGINEER

Office of Construction and Facilities Management

U.S. Department of Veterans Affairs

Drawing Title
BUILDING 7 - PENTHOUSE - OVERALL FLOOR PLAN

Approved:

Phase
100% CONSTRUCTION DOCUMENTS

FULLY SPRINKLERED

Project Title
REPLACE ELEVATORS IN BLDG 7 & BLDG 9

Location
2495 Shreveport Hwy, Pineville, LA 71360

Issue Date 03/24/2026
Checked MGH/JW
Drawn NH/JM/CY/RQ/BC

Project Number 502-24-102
Building Number 7
Drawing Number M-102

Autodesk Docs://502-24-102 VA LA Pineville Replace Elevators/VAPF1_07_ME_SDB.rvt
3/18/2026 4:33:26 PM

VA FORM 08 - 6231

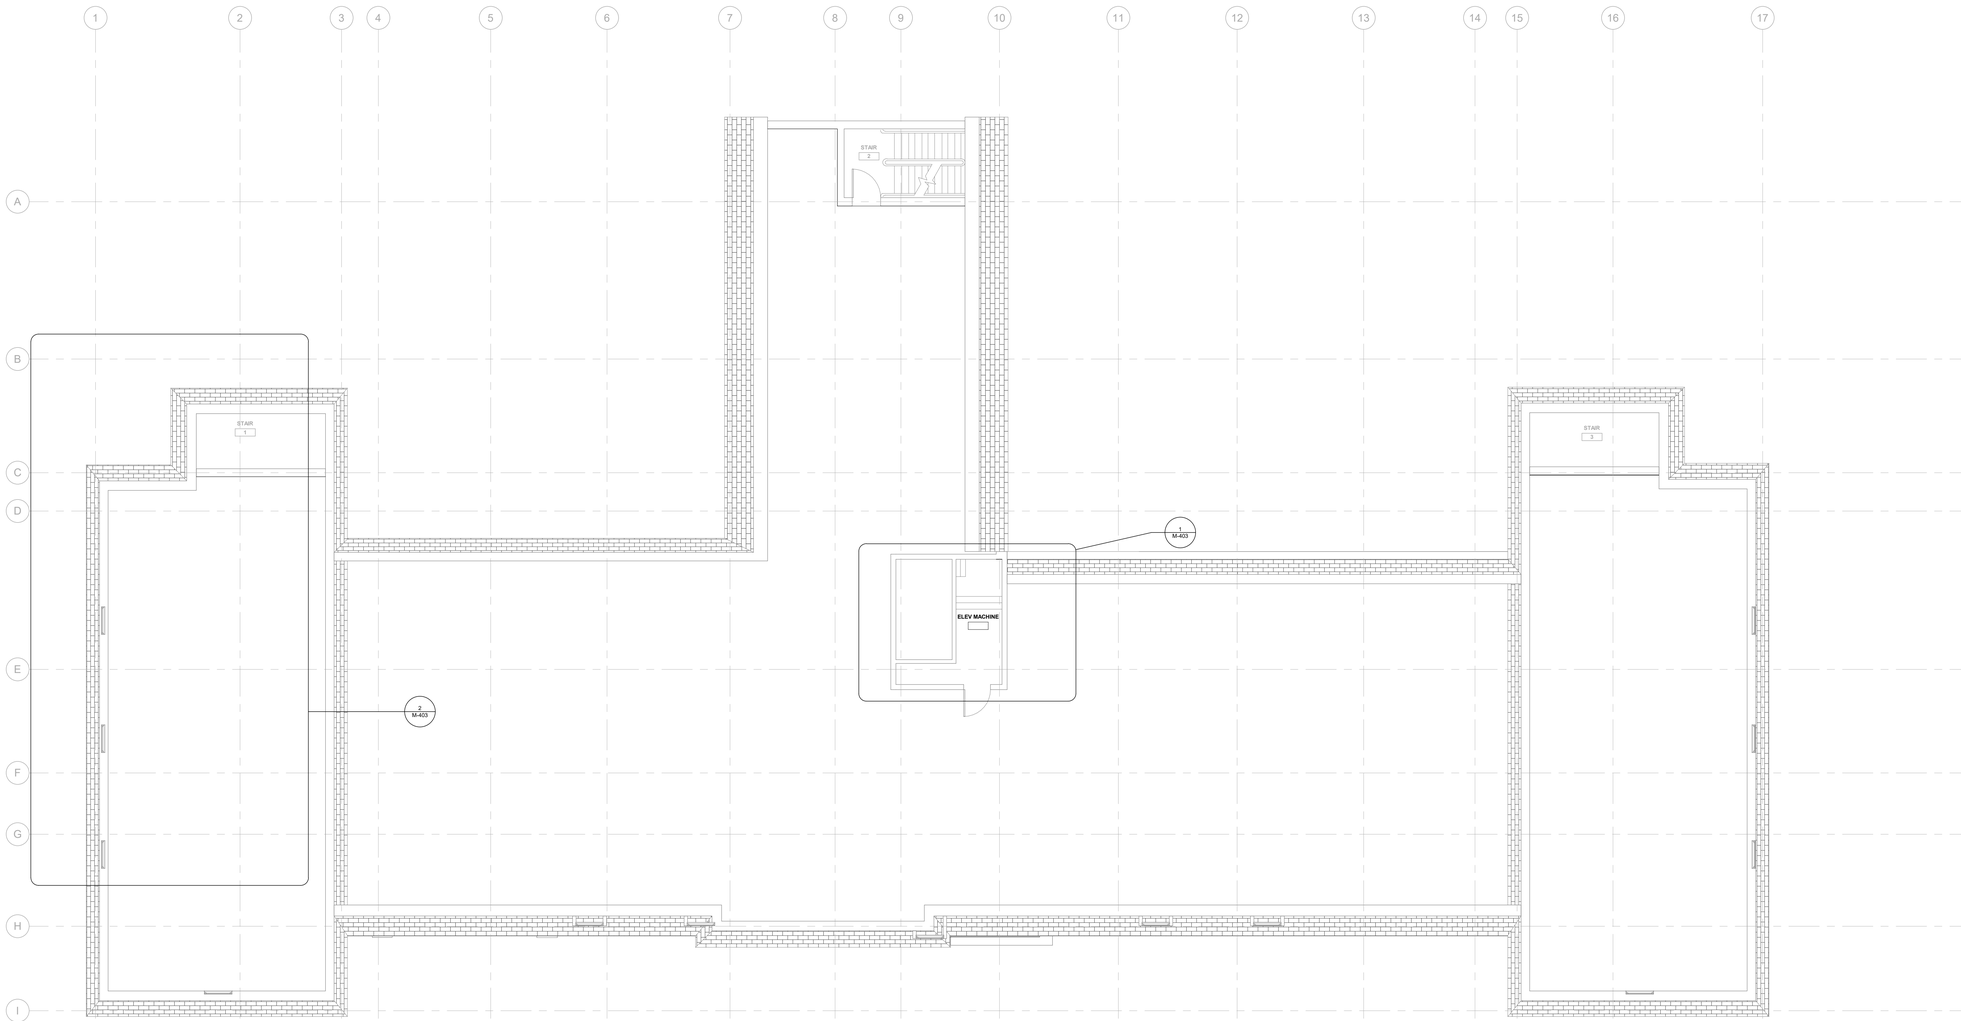

1 BUILDING 9 - PENTHOUSE - OVERALL FLOOR PLAN

1/8" = 1'-0"

PROJECT NORTH

0' 4' 8' 16'

KEY PLAN



KEY AREA SHOWN

PROJECT NORTH

Revisions:	Date:

CONSULTANT/ DISCIPLINE

DISCIPLINE:

ARCHITECT/ ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HIGHWAY S. SUITE 203
KENT, WA 98032

SDB SPEESDESIGNBUILD

STAMP

MICHAEL G. HUBBARD — STATE OF WASHINGTON — 39485 — REGISTERED — PROFESSIONAL ENGINEER — 3/24/2026

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title
BUILDING 9 - PENTHOUSE - OVERALL FLOOR PLAN

Phase
100% CONSTRUCTION DOCUMENTS

Approved:

FULLY SPRINKLERED

Project Title
REPLACE ELEVATORS IN BLDG 7 & BLDG 9

Project Number
502-24-102

Building Number
9

Location
2495 Shreveport Hwy, Pineville, LA 71360

Issue Date
03/24/2026

Checked
MGH/JW

Drawn
NH/JM/CY/RQ/BC

Drawing Number
M-103

Autodesk Docs://502-24-102 VA LA Pineville Replace Elevators/VA_502_ME_SDB.rvt
3/18/2026 4:34:00 PM

VA FORM 08 - 6231

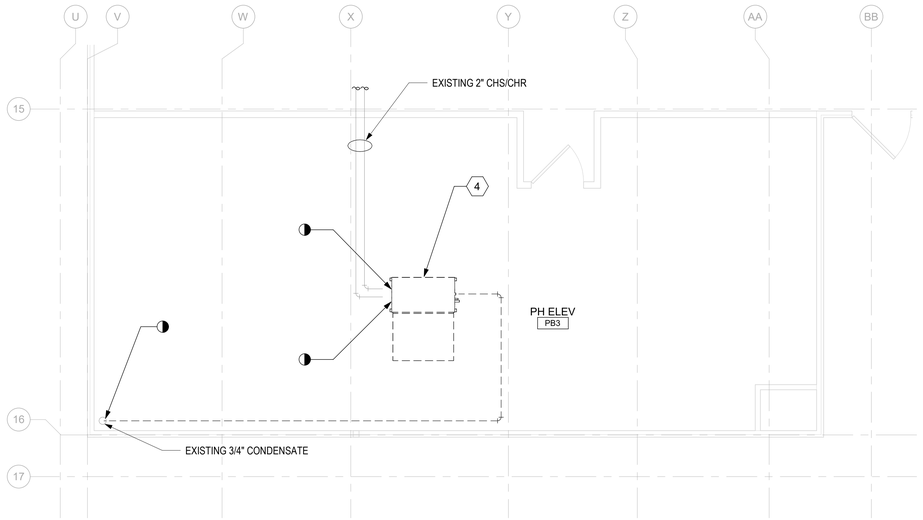

3 BUILDING 7 - PENTHOUSE - DEMOLITION ELEV 1, 2 & 3 - ENLARGED

1/4" = 1'-0"

PROJECT NORTH

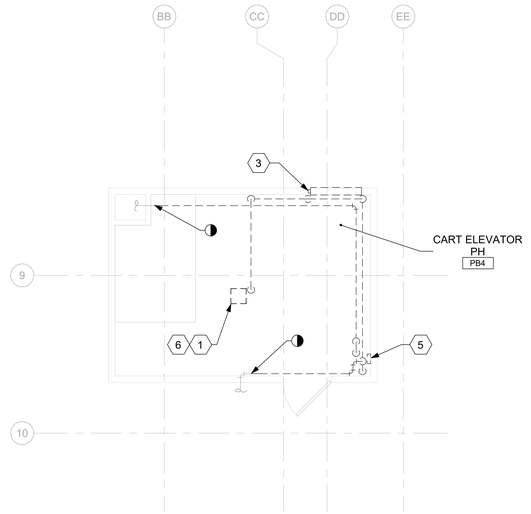

1 BUILDING 7 - PENTHOUSE - DEMOLITION CART ELEVATOR PH - ENLARGED

1/4" = 1'-0"

PROJECT NORTH

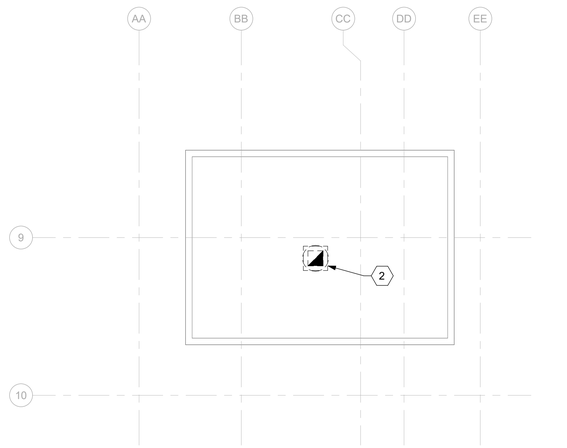

2 BUILDING 7 - ROOF - DEMOLITION CART ELEV PLAN - ENLARGED

1/4" = 1'-0"

PROJECT NORTH

GENERAL NOTES

1. NEW WORK SHOWN DARK, EXISTING WORK SHOWN LIGHT.

DEMOLITION GENERAL NOTES

1. REFER TO ALL DRAWINGS FOR COORDINATION BETWEEN DEMOLITION AND NEW WORK. COORDINATE DEMOLITION WORK WITH THAT OF OTHER TRADES.
2. COORDINATE SALVAGE AND REUSE OF EXISTING EQUIPMENT WITH OWNER. ITEMS OF VALUE WHICH ARE NOT DIRECTED TO BE RETURNED TO THE OWNER, SHALL BECOME THE PROPERTY OF THE CONTRACTOR. STORAGE OR SALE OF ITEMS ON THE PROJECT SITE IS PROHIBITED.
3. CONTRACTOR SHALL BE RESPONSIBLE FOR THE FOLLOWING:
   A) PROTECTING, COVERING AND SEALING EXISTING EQUIPMENT AND SURROUNDINGS DURING DEMOLITION FROM DIRT, DUST, AND DEBRIS.
   B) ENSURING THE SAFE PASSAGE OF PERSONS IN AND AROUND THE BUILDING DURING DEMOLITION.
   C) PREVENTING INJURY TO PERSONS AND DAMAGE TO PROPERTY.
   D) PROVIDING ADEQUATE SHORING AND BRACING TO PREVENT COLLAPSE.
   E) IMMEDIATELY REPAIRING DAMAGED PROPERTY TO ITS CONDITION BEFORE BEING DAMAGED.
   F) TAKING EFFECTIVE MEASURES TO PREVENT DUST MIGRATION.
4. UTILITIES: MAINTAIN ALL UTILITIES EXCEPT THOSE REQUIRING REMOVAL OR RELOCATION. KEEP UTILITIES IN SERVICE AND PROTECT FROM DAMAGE. DO NOT INTERRUPT UTILITIES SERVING AREAS OUTSIDE OF PRESENT SCOPE WITHOUT FIRST OBTAINING PERMISSION FROM OWNER. PROVIDE TEMPORARY SERVICES AS REQUIRED.
5. REMOVE AND DISPOSE OF EXISTING MECHANICAL EQUIPMENT AS SHOWN. UNLESS NOTED OTHERWISE. COORDINATE WITH ARCHITECTURAL PLANS, AREAS OF DEMOLITION AROUND, ADJACENT, OR CONNECTED TO EXISTING MECHANICAL EQUIPMENT THAT IS TO REMAIN.
6. WORK TO BE DEMOLISHED SHOWN DARK AND DASHED, EXISTING WORK TO REMAIN SHOWN LIGHT.

KEYNOTES (#)

1. DEMOLISH EXISTING 12" X 12" EXHAUST DUCT.
2. DEMOLISH EXISTING EXHAUST FAN.
3. DEMOLISH EXISTING PNEUMATIC WALL MOUNTED LOUVER AND ASSOCIATED PNEUMATIC PIPING.
4. DEMOLISH EXISTING DUCTED HYDRONIC FAN COIL. DEMOLISH ASSOCIATED CONDENSATE PIPING AND DUCTWORK. PRESERVE HYDRONIC PIPING.
5. DEMOLISH PNEUMATIC PIPING ACTUATORS.
6. DEMOLISH EXISTING PNEUMATIC CEILING MOUNTED LOUVER AND ASSOCIATED PNEUMATIC PIPING.

KEY PLAN

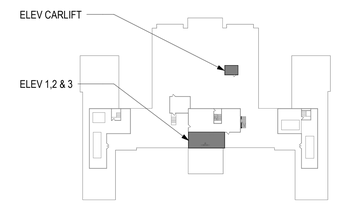

Revisions:	Date:

CONSULTANT/ DISCIPLINE

DISCIPLINE:

ARCHITECT/ ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HIGHWAY S. SUITE 300
KENT, WA 98032

SPEESDESIGNBUILD

STAMP

MICHAEL G. HUBBARD — STATE OF WASHINGTON — 3/24/2026 — 39485 — REGISTERED PROFESSIONAL ENGINEER

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: BUILDING 7 - PENTHOUSE - ENLARGED DEMOLITION PLANS	Phase: 100% CONSTRUCTION DOCUMENTS
Approved:	FULLY SPRINKLERED

Project Title: REPLACE ELEVATORS IN BLDG 7 & BLDG 9	Project Number: 502-24-102
	Building Number: 7
Location: 2495 Shreveport Hwy, Pineville, LA 71360	Drawing Number: MD-401
Issue Date: 03/24/2026	Checked: MGH/JW
Drawn: NH/JM/CY/RQ/BC	

Autodesk Docs://502-24-102 VA LA Pineville Replace Elevators/VAPJ_07_ME_SDB.rvt
3/19/2026 3:23:52 PM

VA FORM 08 - 6231

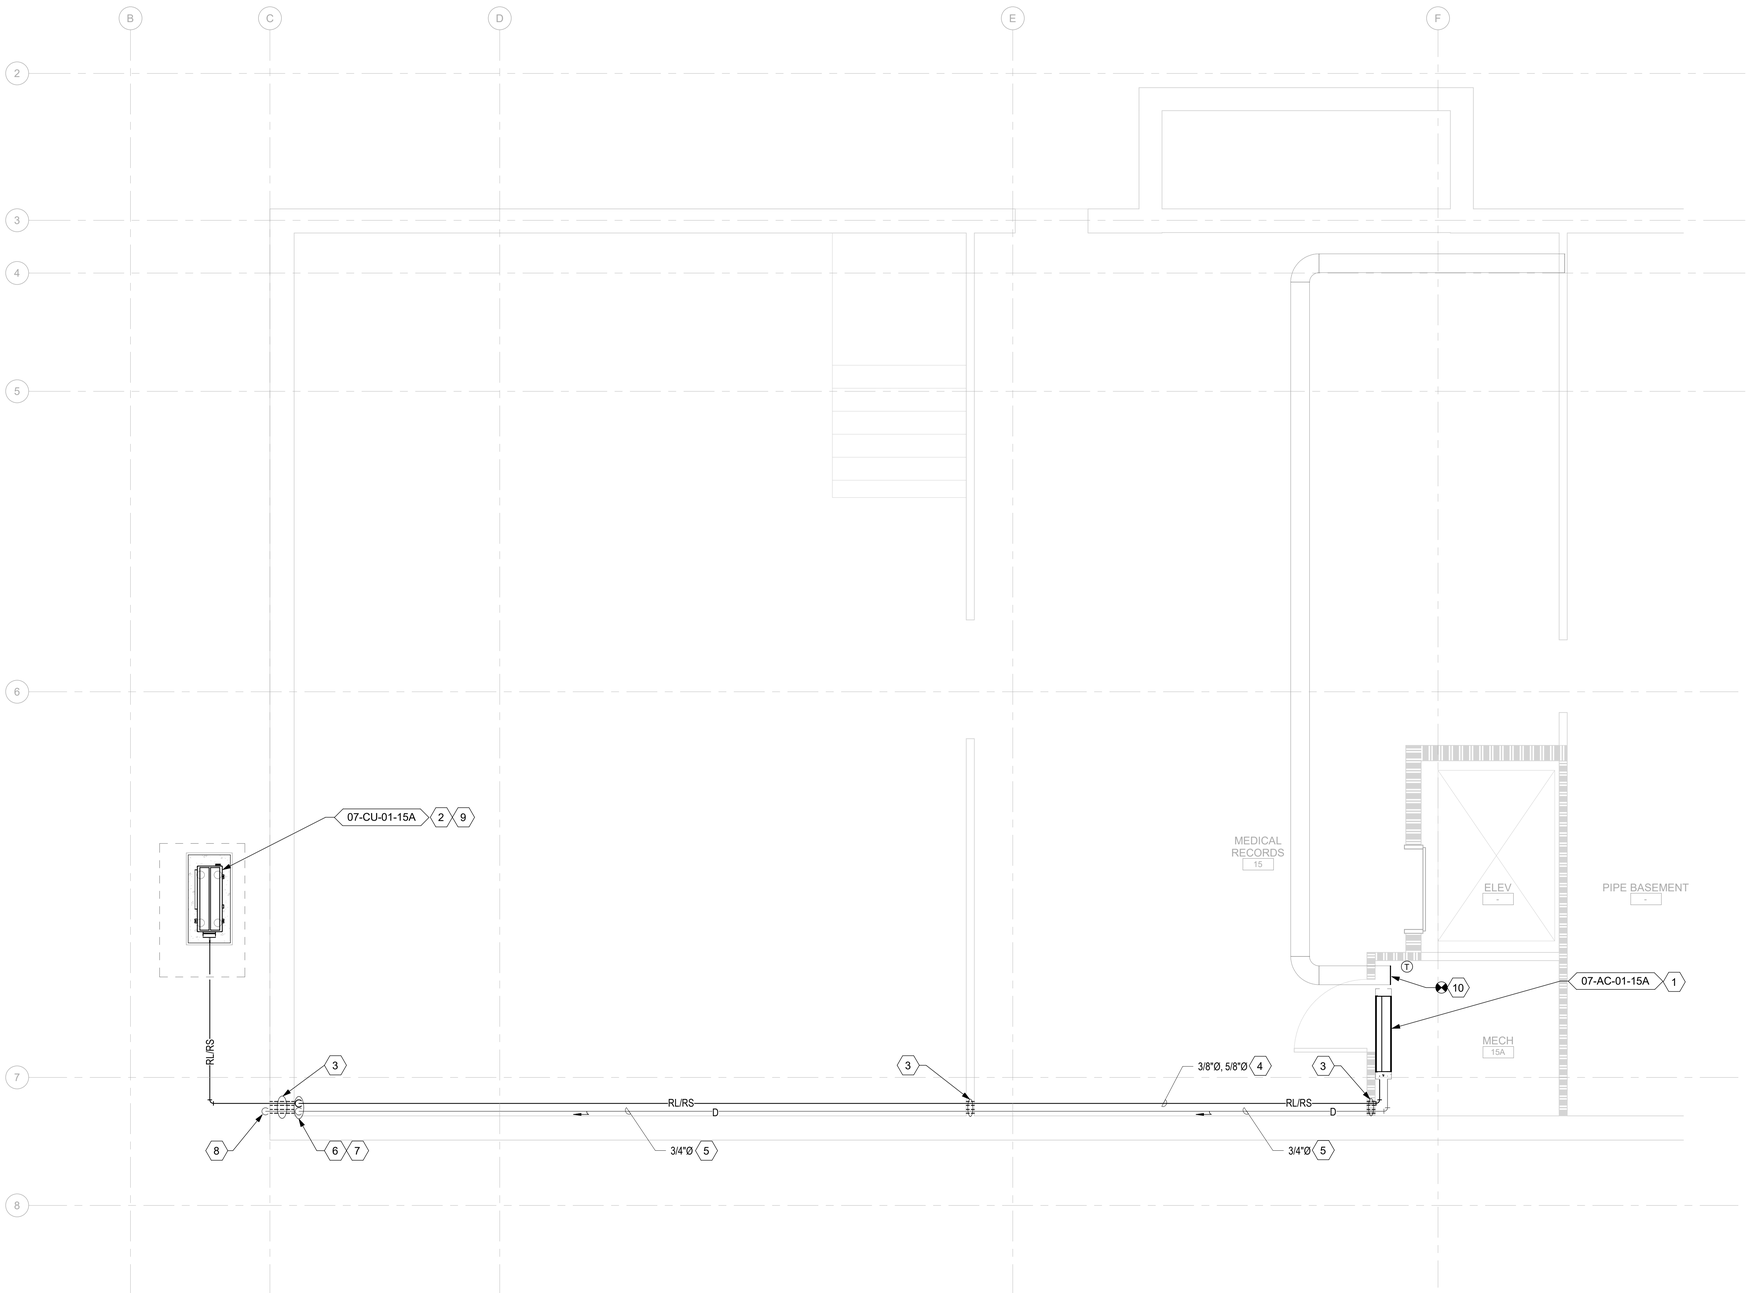

1 BUILDING 7 - BASEMENT - MED RECORDS ELEV

3/8" = 1'-0"

PROJECT NORTH

GENERAL NOTES

1. NEW WORK SHOWN DARK, EXISTING WORK SHOWN LIGHT.
2. A SINGLE LINE IS USED TO INDICATE ALL REFRIGERANT PIPING ROUTED BETWEEN THE INDOOR AND OUTDOOR UNIT(S). THIS SINGLE LINE REPRESENTS ALL PIPING REQUIRED TO PROVIDE A COMPLETE AND FUNCTIONING SYSTEM.
3. ROUTE ALL CONDENSATE AND REFRIGERANT PIPING CONCEALED IN WALLS, CHASES OR CEILING SPACES.

KEYNOTES (#)

1. FURNISH AND INSTALL NEW DUCTLESS SPLIT FAN COIL.
2. SEE "CONDENSING UNIT GROUND MOUNT SUPPORT DETAIL" ON SHEET M-501.
3. PROVIDE WALL OPENING AND PIPE SLEEVE. SEE "PIPE THRU WALL (RATED/UNRATED) DETAIL" ON SHEET M-501.
4. INSTALL NEW REFRIGERANT LINES PER MANUFACTURER REQUIREMENTS (INDOOR UNIT TO OUTDOOR UNIT). PROVIDE PIPE INSULATION FOR ALL REFRIGERANT LINES PER SPECIFICATION SECTION 23 07 11. PROVIDE PIPE SUPPORT PER SPECIFICATION SECTION 23 05 11. PIPE SIZES SHOWN ON PLANS ARE ONLY APPLICABLE TO BASIS OF DESIGN MANUFACTURER.
5. INSTALL NEW CONDENSATE LINE. PROVIDE PIPE SUPPORT PER SPECIFICATION SECTION 23 05 11.
6. ROUTE REFRIGERANT AND CONDENSATE LINE DOWN TO 1'-0" ABOVE FINISH FLOOR LEVEL BEFORE PENETRATING WALL.
7. CONTRACTOR TO PROVIDE 20 GAGE METAL SHEET SHROUDING/CLADDING TO COVER REFRIGERANT PIPING. USE LOW PROFILE UNISTRUT FOR REFRIGERANT PIPING. PAINT SHROUD TO MATCH ADJACENT WALL AND COORDINATE COLOR WITH COR.
8. CONDENSATE TO BE DISCHARGED TO THE GROUND. TERMINATE CONDENSATE PIPING WITH A DOWNTURNED ELBOW 12" ABOVE FINISHED GRADE.
9. INSTALL NEW GROUND MOUNTED CONDENSING UNIT. SEE EQUIPMENT SCHEDULES ON SHEET M-601.
10. CAP AND SEAL EXISTING 10" EXHAUST DUCT. DUCT IS EXISTING TO REMAIN.

KEY PLAN

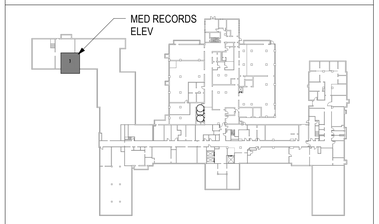

KEY AREA SHOWN

Revisions:	Date:

CONSULTANT/ DISCIPLINE

DISCIPLINE:

ARCHITECT/ ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HIGHWAY S. SUITE 300
KENT, WA 98032

SPEESDESIGNBUILD

STAMP

MICHAEL G. HUBBARD
STATE OF WASHINGTON
3/24/2026
39485
REGISTERED
PROFESSIONAL ENGINEER

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title BUILDING 7 - BASEMENT - ENLARGED PLANS	**Phase** 100% CONSTRUCTION DOCUMENTS	**Project Title** REPLACE ELEVATORS IN BLDG 7 & BLDG 9	**Project Number** 502-24-102
Approved:	FULLY SPRINKLERED	**Location** 2495 Shreveport Hwy, Pineville, LA 71360	**Building Number** 7
		Issue Date 03/24/2026 / **Checked** MGH/JW / **Drawn** NH/JM/CY/RQ/BC	**Drawing Number** M-401

Autodesk Docs://502-24-102 VA LA Pineville Replace Elevators/VAF_07_ME_SDB.rvt
3/19/2026 3:38:19 PM

VA FORM 08 - 6231

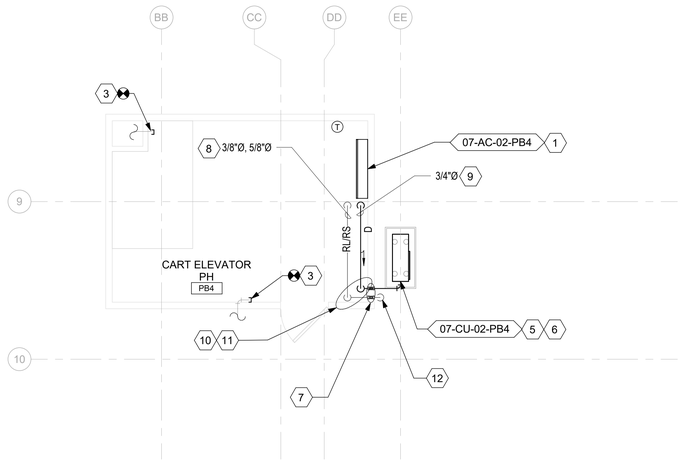

1 BUILDING 7 - PENTHOUSE - FLOOR PLAN - CART ELEVATOR PH - ENLARGED

1/4" = 1'-0"

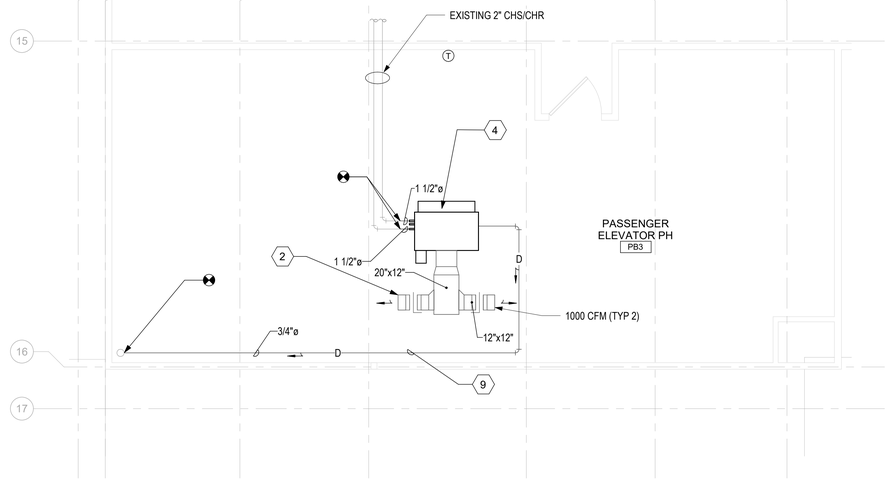

2 BUILDING 7 - PENTHOUSE - FLOOR PLAN -ENLARGED

1/4" = 1'-0"

GENERAL NOTES

1. NEW WORK SHOWN DARK, EXISTING WORK SHOWN LIGHT.

DEMOLITION GENERAL NOTES

1. REFER TO ALL DRAWINGS FOR COORDINATION BETWEEN DEMOLITION AND NEW WORK. COORDINATE DEMOLITION WORK WITH THAT OF OTHER TRADES.
2. COORDINATE SALVAGE AND REUSE OF EXISTING EQUIPMENT WITH OWNER. ITEMS OF VALUE WHICH ARE NOT DIRECTED TO BE RETURNED TO THE OWNER, SHALL BECOME THE PROPERTY OF THE CONTRACTOR. STORAGE OR SALE OF ITEMS ON THE PROJECT SITE IS PROHIBITED.
3. CONTRACTOR SHALL BE RESPONSIBLE FOR THE FOLLOWING:
   A) PROTECTING, COVERING AND SEALING EXISTING EQUIPMENT AND SURROUNDINGS DURING DEMOLITION FROM DIRT, DUST, AND DEBRIS.
   B) ENSURING THE SAFE PASSAGE OF PERSONS IN AND AROUND THE BUILDING DURING DEMOLITION.
   C) PREVENTING INJURY TO PERSONS AND DAMAGE TO PROPERTY.
   D) PROVIDING ADEQUATE SHORING AND BRACING TO PREVENT COLLAPSE.
   E) IMMEDIATELY REPAIRING DAMAGED PROPERTY TO ITS CONDITION BEFORE BEING DAMAGED.
   F) TAKING EFFECTIVE MEASURES TO PREVENT DUST MIGRATION.
4. UTILITIES: MAINTAIN ALL UTILITIES EXCEPT THOSE REQUIRING REMOVAL OR RELOCATION. KEEP UTILITIES IN SERVICE AND PROTECT FROM DAMAGE. DO NOT INTERRUPT UTILITIES SERVING AREAS OUTSIDE OF PRESENT SCOPE WITHOUT FIRST OBTAINING PERMISSION FROM OWNER. PROVIDE TEMPORARY SERVICES AS REQUIRED.
5. REMOVE AND DISPOSE OF EXISTING MECHANICAL EQUIPMENT AS SHOWN. UNLESS NOTED OTHERWISE. COORDINATE WITH ARCHITECTURAL PLANS, AREAS OF DEMOLITION AROUND, ADJACENT, OR CONNECTED TO EXISTING MECHANICAL EQUIPMENT THAT IS TO REMAIN.
6. WORK TO BE DEMOLISHED SHOWN DARK AND DASHED, EXISTING WORK TO REMAIN SHOWN LIGHT.

KEYNOTES (#)

1. FURNISH AND INSTALL NEW DUCTLESS SPLIT FAN COIL.
2. PROVIDE WIRE MESH SCREEN ON DUCT OPENING, BOTH SIDES.
3. CAP AND SEAL PNEUMATIC PIPING.
4. FURNISH AND INSTALL NEW DUCTED HYDRONIC FAN COIL. MODIFY PIPING AS REQUIRED FOR NEW FAN COIL. SEE "TERMINAL UNIT WATER COILS - PIPING CONNECTIONS" ON SHEET M-501.
5. INSTALL NEW GROUND MOUNTED CONDENSING UNIT. SEE EQUIPMENT SCHEDULES ON SHEET M-601.
6. SEE CONDENSING UNIT GROUND MOUNT SUPPORT DETAIL "ON SHEET M-501.
7. PROVIDE WALL OPENING AND PIPE SLEEVE. SEE "PIPE THRU WALL (RATED/UNRATED) DETAIL" ON SHEET M-501.
8. INSTALL NEW REFRIGERANT LINES PER MANUFACTURER REQUIREMENTS (INDOOR UNIT TO OUTDOOR UNIT). PROVIDE PIPE INSULATION FOR ALL REFRIGERANT LINES PER SPECIFICATION SECTION 23 07 11. PROVIDE PIPE SUPPORT PER SPECIFICATION SECTION 23 05 11. PIPE SIZES SHOWN ON PLANS ARE ONLY APPLICABLE TO BASIS OF DESIGN MANUFACTURER.
9. INSTALL NEW CONDENSATE LINE. PROVIDE INSULATION FOR ALL CONDENSATE LINES PER SPECIFICATION SECTION 23 07 11. PROVIDE PIPE SUPPORT PER SPECIFICATION SECTION 23 05 11.
10. ROUTE REFRIGERANT AND CONDENSATE LINE DOWN TO 1'-0" ABOVE FINISH FLOOR LEVEL BEFORE PENETRATING WALL.
11. CONTRACTOR TO PROVIDE 20 GAGE METAL SHEET SHROUDING/CLADDING TO COVER REFRIGERANT PIPING. USE LOW PROFILE UNISTRUT FOR REFRIGERANT PIPING. PAINT SHROUD TO MATCH ADJACENT WALL AND COORDINATE COLOR WITH COR.
12. CONDENSATE TO BE DISCHARGED TO THE GROUND. TERMINATE CONDENSATE PIPING WITH A DOWNTURNED ELBOW 12" ABOVE FINISHED GRADE.

KEY PLAN

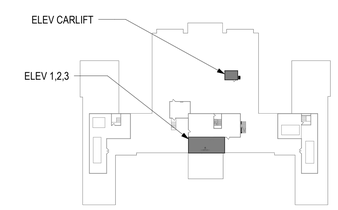

KEY AREA SHOWN

Revisions:	Date:

CONSULTANT/ DISCIPLINE

DISCIPLINE:

ARCHITECT/ ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HIGHWAY S. SUITE 300
KENT, WA 98032

SPEESDESIGNBUILD

STAMP

MICHAEL G. HUBBARD
STATE OF WASHINGTON
3/24/2026
39485
REGISTERED
PROFESSIONAL ENGINEER

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title BUILDING 7 - PENTHOUSE - ENLARGED PLANS	**Phase** 100% CONSTRUCTION DOCUMENTS	**Project Title** REPLACE ELEVATORS IN BLDG 7 & BLDG 9	**Project Number** 502-24-102
Approved:	FULLY SPRINKLERED	**Location** 2495 Shreveport Hwy, Pineville, LA 71360	**Building Number** 7
		Issue Date 03/24/2026 / **Checked** MGH/JW / **Drawn** NH/JM/CY/RQ/BC	**Drawing Number** M-402

Autodesk Docs://502-24-102 VA LA Pineville Replace Elevators/VA_7_ME_SDB.rvt
3/18/2026 4:33:29 PM

VA FORM 08 - 6231

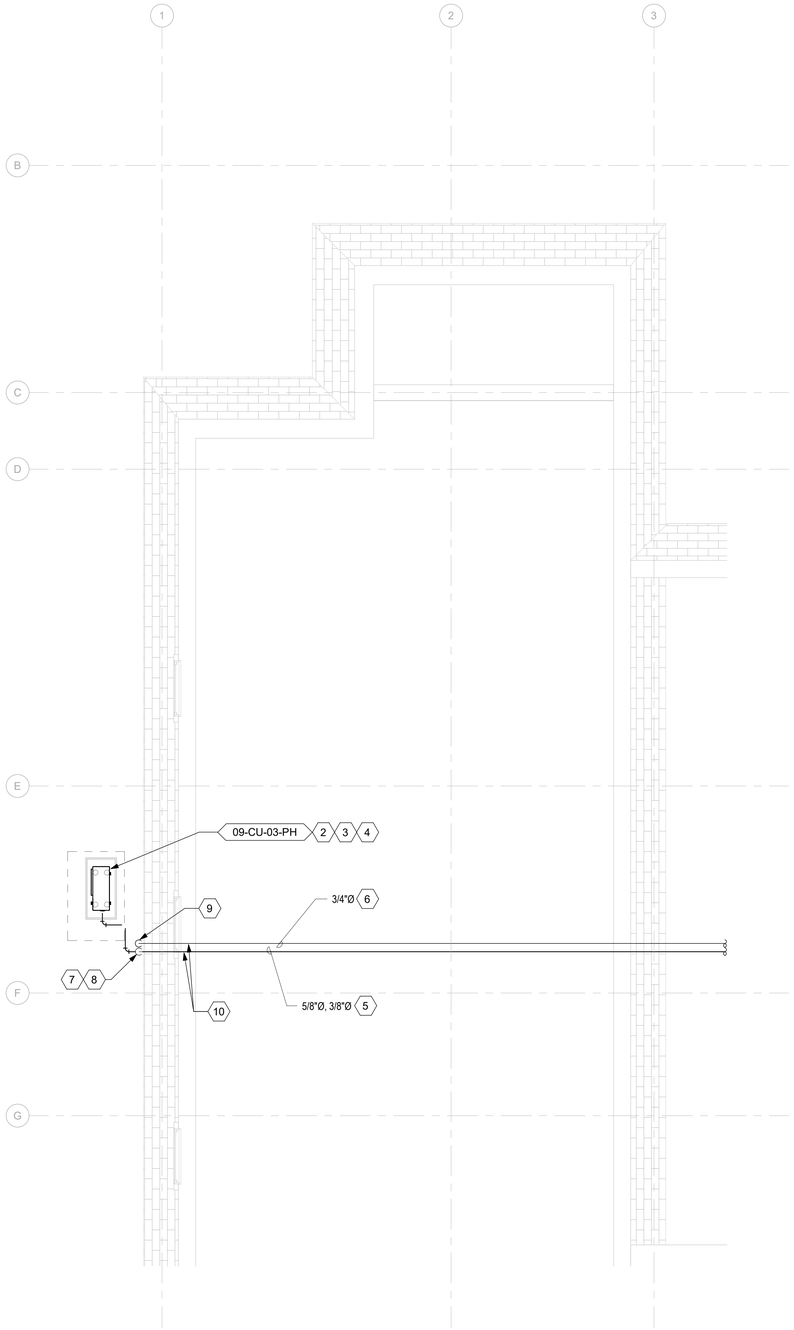

2 BUILDING 9 - GROUND LEVEL - FLOOR PLAN - OUTDOOR UNIT LOCATION

1/4" = 1'-0"

PROJECT NORTH

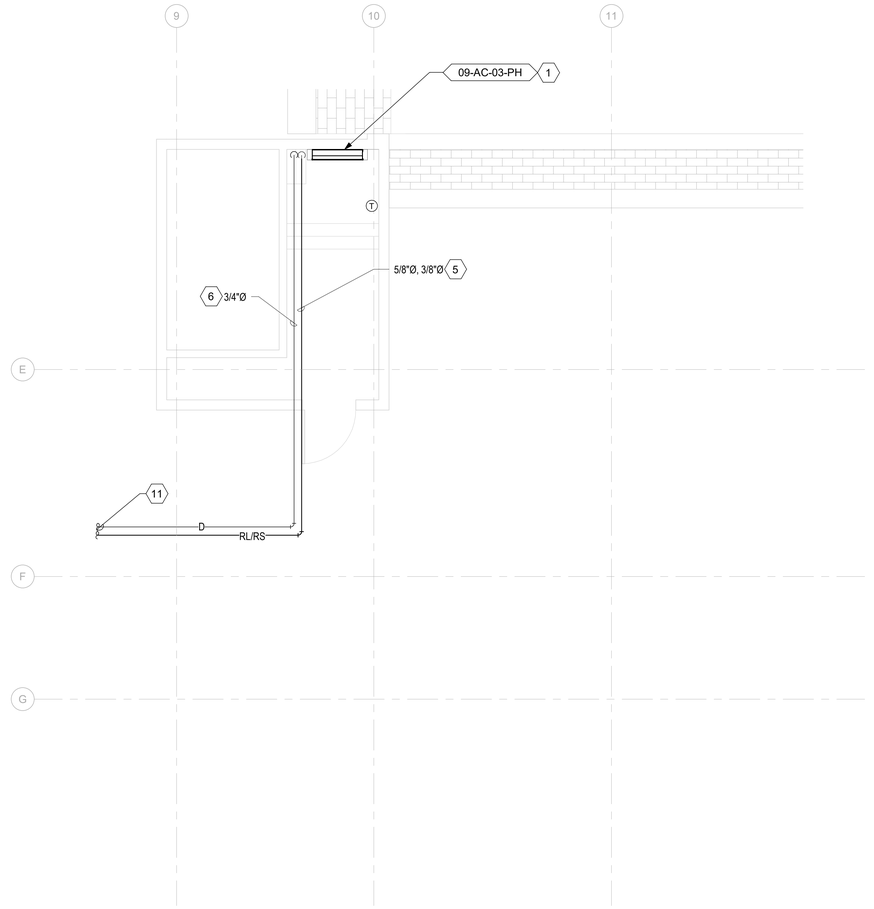

1 BUILDING 9 - PENTHOUSE - FLOOR PLAN - ENLARGED

1/4" = 1'-0"

PROJECT NORTH

GENERAL NOTES

1. ALL PIPING IS SHOWN OFFSET AND DIAGRAMMATIC FOR CLARITY. CONTRACTOR SHALL RACK PIPING AS LOSE AS POSSIBLE TO INSIDE WALL OF TELECOM ROOM.
2. NEW WORK SHOWN DARK, EXISTING WORK SHOWN LIGHT.
3. A SINGLE LINE IS USED TO INDICATE ALL REFRIGERANT PIPING ROUTED BETWEEN THE INDOOR AND OUTDOOR UNIT(S). THIS SINGLE LINE REPRESENTS ALL PIPING REQUIRED TO PROVIDE A COMPLETE AND FUNCTIONING SYSTEM.
4. ROUTE ALL CONDENSATE AND REFRIGERANT PIPING CONCEALED IN WALLS, CHASES OR CEILING SPACES.

KEYNOTES (#)

1. FURNISH AND INSTALL NEW DUCTLESS SPLIT FAN COIL.
2. CONDENSING UNIT LOCATION AT GROUND LEVEL.
3. SEE "CONDENSING UNIT GROUND MOUNT SUPPORT DETAIL" ON SHEET M-501.
4. INSTALL NEW GROUND MOUNTED CONDENSING UNIT. SEE EQUIPMENT SCHEDULES ON SHEET M-601.
5. INSTALL NEW REFRIGERANT LINES PER MANUFACTURER REQUIREMENTS (INDOOR UNIT TO OUTDOOR UNIT). PROVIDE PIPE INSULATION FOR ALL REFRIGERANT LINES PER SPECIFICATION SECTION 23 07 11. PROVIDE PIPE SUPPORT PER SPECIFICATION SECTION 23 05 11. PIPE SIZES SHOWN ON PLANS ARE ONLY APPLICABLE TO BASIS OF DESIGN MANUFACTURER.
6. INSTALL NEW CONDENSATE LINE. PROVIDE INSULATION FOR ALL CONDENSATE LINES PER SPECIFICATION SECTION 23 07 11. PROVIDE PIPE SUPPORT PER SPECIFICATION SECTION 23 05 11.
7. ROUTE REFRIGERANT AND CONDENSATE LINE DOWN TO 1'-0" ABOVE FINISH FLOOR LEVEL BEFORE PENETRATING WALL.
8. CONTRACTOR TO PROVIDE 20 GAGE METAL SHEET SHROUDING/CLADDING TO COVER REFRIGERANT PIPING. USE LOW PROFILE UNISTRUT FOR REFRIGERANT PIPING. PAINT SHROUD TO MATCH ADJACENT WALL AND COORDINATE COLOR WITH COR.
9. CONDENSATE TO BE DISCHARGED TO THE GROUND. TERMINATE CONDENSATE PIPING WITH A DOWNTURNED ELBOW 12" ABOVE FINISHED GRADE.
10. PROVIDE WALL OPENING AND PIPE SLEEVE. SEE "PIPE THRU WALL (RATED/UNRATED) DETAIL" ON SHEET M-501.
11. CONTINUATION FOR APPROXIMATELY 50'

KEY PLAN

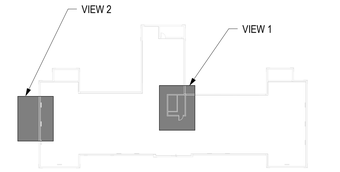

KEY AREA SHOWN

Revisions:	Date:

CONSULTANT/ DISCIPLINE

DISCIPLINE:

ARCHITECT/ ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HIGHWAY S. SUITE 203
KENT, WA 98032

SPEESDESIGNBUILD

STAMP

MICHAEL G. HUBBARD — STATE OF WASHINGTON — 3/24/2026 — 39485 — REGISTERED PROFESSIONAL ENGINEER

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title
BUILDING 9 - PENTHOUSE - ENLARGED FLOOR PLAN

Approved:

Phase
100% CONSTRUCTION DOCUMENTS

FULLY SPRINKLERED

Project Title
REPLACE ELEVATORS IN BLDG 7 & BLDG 9

Location
2495 Shreveport Hwy, Pineville, LA 71360

Issue Date 03/24/2026
Checked MGH/JW
Drawn NH/JM/CY/RQ/BC

Project Number 502-24-102
Building Number 9
Drawing Number M-403

Autodesk Docs://502-24-102 VA LA Pineville Replace Elevators/VA_9_ME_SDB.rvt
3/18/2026 4:34:00 PM

VA FORM 08 - 6231

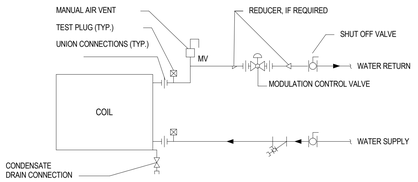

6 TERMINAL UNIT WATER COILS - PIPING CONNECTIONS

SCALE: NTS

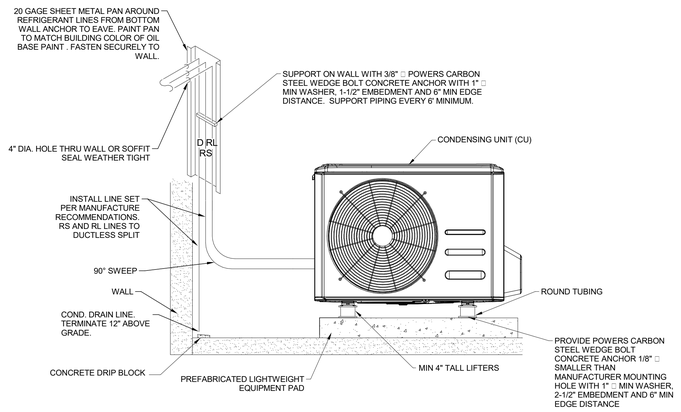

4 CONDENSING UNIT GROUND MOUNT SUPPORT DETAIL

SCALE: NTS

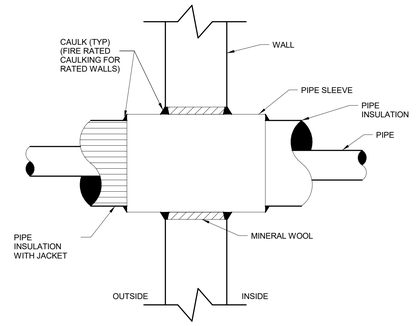

NOTE: PROVIDE ESCUTCHEON AT WALL FOR EXPOSED PIPING

1 PIPE THRU WALL (RATED/UNRATED) DETAIL

SCALE: NTS

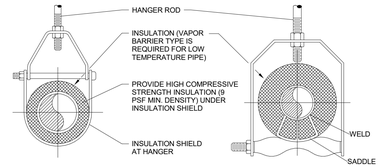

ADJUSTABLE CLEVIS HANGER TYPE 1 - SEE SPECIFICATIONS ADJUSTABLE CLEVIS HANGER TYPE 43 - SEE SPECIFICATIONS

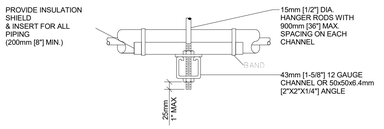

SIDE VIEW TRAPEZE HANGER FOR UP TO 453KG [1000 LB] UNIFORM LOAD

MAXIMUM PIPE/TUBING SUPPORT SPACING

NOM. SIZE		THRU 20 [THRU ¾]	25 [1]	32 [1¼]	40 [1½]	50 [2]	65 [2½]	75 [3]	100 [4]	125 [5]	150 [6]	200 [8]	250 [10]	300 [12]	350 [14]	400 [16]	450 [18]	500 [20]	600 [24]
PIPE	mm [FT]	2100 [7]	2100 [7]	2100 [7]	2700 [9]	3000 [10]	3400 [11]	3700 [12]	4100 [14]	4900 [16]	5200 [17]	5800 [19]	6700 [22]	7000 [23]	7600 [25]	8200 [27]	8500 [28]	9100 [30]	9600 [32]
TUBING	mm [FT]	1500 [5]	1800 [6]	2100 [7]	2400 [8]	2700 [9]	3000 [10]	3700 [12]	4000 [13]	4100 [14]	4900 [16]	- -	- -	- -	- -	- -	- -	- -	- -

NOTE: FOR TRAPEZE HANGER TAKE SPACING OF SMALLEST SIZE ON TRAPEZE.

2 PIPE HANGERS

SCALE: NTS

FAN COIL SEQUENCE OF OPERATION:

1. GENERAL
1.1 FAN COIL SHALL OPERATE CONTINUOUSLY AS SET BY ECC.

1.2 SPACE TEMPERATURE SETPOINT IS 77 F° (VAR) AS SENSED BY T-1.

2. TEMPERATURE CONTROL
2.1 MODULATE V-1 TO MAINTAIN SPACE TEMPERATURE SET POINT.

3. AIRFLOW CONTROL
3.1 FAN SHALL OPERATE CONTINUOUSLY IN RESPONSE TO SPACE TEMPERATURE.

4. ALARMS
4.1 FAN STATUS SHALL BE MONITORED AND AN ALARM MESSAGE SHALL BE GENERATED IN THE EVENT THE UNIT FAILS TO RUN.

4.2 IF THE SPACE TEMPERATURE AS SENSED BY T-1 FALLS OUTSIDE OF THE RANGE OF 60°F-85°F (VAR) AN ALARM SHALL BE GENERATED.

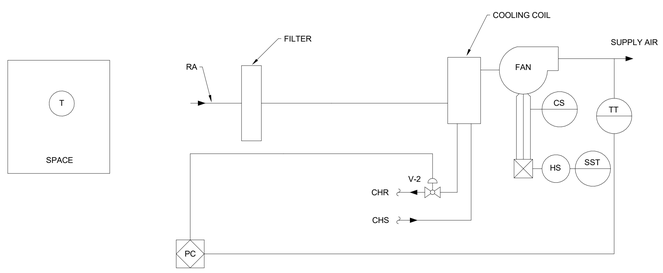

7 FAN COIL UNIT - CONTROL DIAGRAM

SCALE: NTS

SEQUENCE OF OPERATION

1.TEMPERATURE CONTROL AND MONITORING

1.1 THE DUCTLESS SPLIT(S) SHALL OPERATE CONTINUOUSLY TO MAINTAIN A SPACE TEMPERATURE OF 80°(ADJ).

1.2 SHOW SPACE TEMPERATURE AT THE GRAPHIC DISPLAY. PROVIDE TEMPERATURE TRENDS.

2. ALARMS
2.1 IF THE TEMPERATURE EXCEEDS 85°F IN THE SPACE, AN ALARM STATE SHALL BE GENERATED AT THE OPERATOR WORKSTATION.

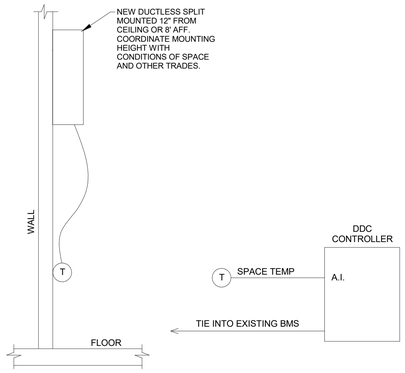

5 HEAT PUMP - CONTROL DIAGRAM

SCALE: NTS

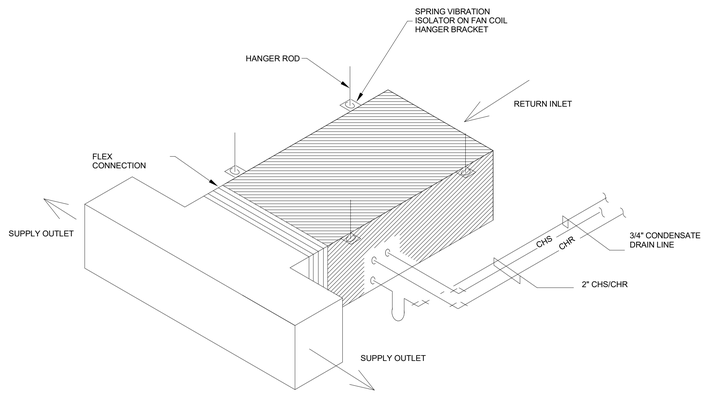

3 FAN COIL UNIT - HORIZONTAL EXPOSED

SCALE: NTS

Revisions:	Date:

CONSULTANT/ DISCIPLINE

DISCIPLINE:

ARCHITECT/ ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HIGHWAY S. SUITE 300
KENT, WA 98032

SPEESDESIGNBUILD

STAMP

MICHAEL G. HUBBARD — STATE OF WASHINGTON — 3/24/2026 — 39485 — REGISTERED PROFESSIONAL ENGINEER

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title
MECHANICAL DETAILS

Phase
100% CONSTRUCTION DOCUMENTS

Approved:

Project Title
REPLACE ELEVATORS IN BLDG 7 & BLDG 9

Project Number
502-24-102

Building Number
-

Location
2495 Shreveport Hwy, Pineville, LA 71360

Issue Date
03/24/2026

Checked
MGH/JW

Drawn
NH/JM/CY/RQ/BC

Drawing Number
M-501

Autodesk Docs://502-24-102 VA LA Pineville Replace_Elevators/VA-LA_CF_ME_SDB.rvt
3/19/2026 3:23:53 PM

VA FORM 08 - 6231

HEAT PUMP SYSTEM SCHEDULE

OUTDOOR HEAT PUMP

EQUIP#	MFR	MODEL #	TOTAL WEIGHT (LBS)	SEER2	COOLING @ 95° F (BTU/H)	HSPF2	HEATING @ 7° F (BTU/H)	ELECTRICAL			REFRIGERATION			NOTES
								MCA	MOCP	VOLTS / PH	TYPE	SUCTION (INCH)	LIQUID (INCH)	
07-CU-01-15A	LG	KUSAE121A	75	21.7	10470	10.1	8170	13.4	15	208/1	R32	3/8	1/4	1, 2, 3, 4, 5
07-CU-02-PB4	LG	KUSAP241A	135	22	20380	9.7	16690	19	30	208/1	R32	5/8	3/8	1, 2, 3, 4, 5
09-CU-03-PH	LG	KUSAP361A	147	20	29890	8.5	22750	23	30	208/1	R32	3/4	3/8	1, 2, 3, 4, 5

OUTDOOR NOTES:
1. PROVIDE 18" BASE SUPPORT CURB
2. PROVIDE REFRIGERANT LINE SETS
3. PROVIDE DRAIN PAN HEATER.

INDOOR FAN COIL

EQUIP#	MFR	MODEL #	TYPE	CFM	ESP (" WC)	SPEED	WATT	TOTAL COOLING @ 95° F (BTU/H)	SENS COOLING @ 95° F (BTU/H)	TOTAL HEATING @ 7° F (BTU/H)	ELECTRICAL		NOTES
											VOLTS / PH	MCA	
07-AC-01-15A	LG	KNSAE121A	HIGH WALL	597	-	HIGH	-	10,470	8,300	8,170	208 / 1	19	1, 2, 3, 4, 5
07-AC-02-PB4	LG	KNSAP241A	HIGH WALL	813	-	HIGH	-	20380	16360	16690	208 / 1	10	1, 2, 3, 4, 5
09-AC-03-PH	LG	KNSAP36A	HIGH WALL	1095	-	HIGH	-	29890	24520	22750	208 / 1	23	1, 2, 3, 4, 5

INDOOR NOTES:
1. PROVIDE FACTORY WALL MOUNTED T-STAT.
2. PROVIDE CONDENSATE DRAIN PUMP
3. POWERED BY OUTDOOR UNIT

INDOOR FAN COIL

EQUIP#	MFR	MODEL #	WEIGHT (LBS)	TYPE	CFM	ESP (" WC)	SPEED	HP	CHILLED WATER COIL PERFORMANCE										ELECTRICAL		NOTES
									COIL ROW/ CIRCUIT QTY.	PRESSURE DROP (FT W.G.)	FLOW (GPM)	EWT (F°)	LWT (F°)	EAT DB (F°)	EAT WB (F°)	LAT DB (F°)	LAT WB (F°)	TOTAL COOLING (BTU/H)	SENS COOLING (BTU/H)	VOLTS / PH	FLA	
01-FC-01-PB3	INTERNATIONAL ENVIRNMENTAL	HDY20	317	DUCTED HORIZONTAL	2000	0.1	HIGH	1	6/7	10.7	15	45	55	80	67	55.8	54.7	76,360	53,448	120/1	10.7	1, 2, 3, 4, 5, 6, 7

NOTES:
1. PROVIDE 2 WAY MODULATING CONTROL VALVE FOR CHILLED WATER COIL
2. PROVIDE WITH 2" MERV 8 FILTER RACK
3. PROVIDE WITH EC MOTOR
4. PROVIDE WITH LEFT HAND COIL CONNECTION
5. PROVIDE STRAINER AND THERMO WELLS ON SUPPLY AND RETURN.
6. PROVIDE SPRING ISOLATORS, SEISMIC RESTRAINT AND CEILING SUPPORT HARDWARE.
7. PROVIDE STRAINER, MANUAL AIR BLEED VALVE, ISOLATION VALVES AND ACCESSORIES FOR A COMPLETE INSTALLATION

Autodesk Docs://502-24-102 VA LA Pineville Replace_Elevators/VA-LA_PV_ME_SDB.rvt
3/18/2026 4:33:29 PM

Revisions:	Date:

CONSULTANT/ DISCIPLINE

DISCIPLINE:

ARCHITECT/ ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HIGHWAY S. SUITE 300
KENT, WA 98032

SPEESDESIGNBUILD

STAMP

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title	MECHANICAL SCHEDULES
Approved:	
Phase	100% CONSTRUCTION DOCUMENTS
Project Title	REPLACE ELEVATORS IN BLDG 7 & BLDG 9
Location	2495 Shreveport Hwy, Pineville, LA 71360
Issue Date	03/24/2026
Checked	MGH/JW
Drawn	NH/JM/CY/RQ/BC
Project Number	502-24-102
Building Number	-
Drawing Number	M-601

VA FORM 08 - 6231

ABBREVIATIONS

1PH	SINGLE-PHASE
1P	SINGLE POLE
2/C	TWO-CONDUCTOR
3/C	THREE-CONDUCTOR
3PH	THREE-PHASE
4/C	FOUR-CONDUCTOR
4W	FOUR-WIRE
A/C	AIR CONDITIONING UNIT
A/E	ARCHITECT/ENGINEER
AAP	ALARM ANNUNCIATOR PANEL
AC	ALTERNATING CURRENT OR ARMORED CABLE
ACC	ACCESSIBLE
ADDL	ADDITIONAL
ADJ	ADJACENT, ADJOINING
AF	AMPERE FRAME OR AMP FUSE
AFC	ABOVE FINISHED COUNTER, AUTOMATIC FREQUENCY CONTROL, OR AVAILABLE FAULT CURRENT
AFCI	ARC-FAULT CURRENT INTERRUPTER
AFF	ABOVE FINISHED FLOOR
AFG	ABOVE FINISHED GRADE
AH	AMPERE HOUR
AHJ	AUTHORITY HAVING JURISDICTION
AIC	AMPERE INTERRUPTING CAPACITY
ALT	ALTERNATE
AMB	AMBIENT
AMP	AMPERE
ARCH	ARCHITECT
ASC	AMPS SHORT CIRCUIT
AT	AMPERE TRIP
ATS	AUTOMATIC TRANSFER SWITCH
AUTO	AUTOMATIC
AV	AUDIO VISUAL
BAT	BATTERY
BD	BOARD
BFF	BELOW FINISH FLOOR
BLDG	BUILDING
BRKR	BREAKER
BYP	BY PASS
C	CONDUIT
CAB	CABINET
CALC	CALCULATE
CAP	CAPACITY
CAT	CATALOG
CATV	COMMUNITY ANTENNA TELEVISION
CCR	CONTROL CONTACTOR
CCTV	CLOSED CIRCUIT TELEVISION
CD	CANDELA
CD	CONSTRUCTION DOCUMENTS
CF	CONTRACTOR FURNISHED
CF/CI	CONTRACTOR FURNISHED/ CONTRACTOR INSTALLED
CF/OI	CONTRACTOR FURNISHED/ OWNER INSTALLED
CFE	CONTRACTOR FURNISHED EQUIPMENT
CHW	CHILLED WATER
CHWP	CHILLED WATER PUMP
CKT	CIRCUIT
C/B	CIRCUIT BREAKER
CL	CONNECTOR LIGHTING
CLF	CURRENT LIMITING FUSE
CLG	CEILING
CO	CONDUIT ONLY
COAX	COAX CABLE
COMM	COMMUNICATION
COMPT	COMPARTMENT
CONC	CONCRETE
CONT	CONTINUE
CONTR	CONTRACTOR
COORD	COORDINATE
CPT	CONTROL POWER TRANSFORMER
CRI	COLOR RENDERING INDEX
CT	CURRENT TRANSFORMER
CTV	CABLE TELEVISION
CU	COPPER
CUR	CURRENT
DB	DECIBEL
DC	DIRECT CURRENT
DCP	DIMMER CONTROL PANEL
DDC	DIRECT DIGITAL CONTROLS
DEG C	DEGREES CELSIUS
DEG F	DEGREES FAHRENHEIT
DEMO	DEMOLITION
DIAG	DIAGRAM
DISC	DISCONNECT
DP	DISTRIBUTION PANEL
DMR SW	DIMMER SWITCH
DPDT	DOUBLE POLE, DOUBLE THROW
DPST	DOUBLE POLE, SINGLE THROW
DRSW	DOOR SWITCH
DS	DISCONNECT SWITCH
DWG	DRAWING
EC	ELECTRICAL CONTRACTOR
EL	ELEVATION OR EXISTING TO BE RELOCATED
ELEC	ELECTRIC OR ELECTRICAL
ELEV	ELEVATOR
EMER/EM	EMERGENCY
EMI	ELECTROMAGNETIC INTERFERENCE
EMT	ELECTRICAL METALLIC TUBING
EN	EXISTING IN NEW LOCATION
ENCL	ENCLOSURE
EPO	EMERGENCY POWER OFF
EPRF	EXPLOSION PROOF
ER	EXISTING TO REMAIN
ESMT	EASEMENT
EWC	ELECTRIC WATER COOLER
EWH	ELECTRIC WATER HEATER
EXIST(E)	EXISTING
FA	FIRE ALARM
FAAP	FIRE ALARM ANNUNCIATOR PANEL
FACP	FIRE ALARM CONTROL PANEL
FC	FOOTCANDLE
FCIO	FURNISHED BY CONTRACTOR, INSTALLED BY OWNER
FOIC	FURNISHED BY OWNER, INSTALLED BY CONTRACTOR
FIXT	FIXTURE
FLA	FULL LOAD AMPS
FLUOR	FLUORESCENT
FP	FIRE PROTECTION
FT	FEET OR FOOT
FU SW	FUSED SWITCH
FVNR	FULL VOLTAGE NON-REVERSING
FVR	FULL VOLTAGE REVERSING
G	ELECTRICAL GROUND
GEN	GENERATOR
GFCI	GROUND FAULT CIRCUIT INTERRUPTER
GFP	GROUND FAULT PROTECTION
GND	GROUND
HID	HIGH INTENSITY DISCHARGE
HOA	HAND-OFF-AUTOMATIC
HP	HORSEPOWER
HT	HEIGHT
HZ	HERTZ
IG	ISOLATED GROUND
IESNA	ILLUMINATION ENGINEERING SOCIETY OF NORTH AMERICA
IMC	INTERMEDIATE METAL CONDUIT
INCAND	INCANDESCENT
IR	INFRARED
IWH	INSTANTANEOUS WATER HEATER
J-BOX	JUNCTION BOX
KV	KILOVOLT
KVA	KILOVOLT AMPERE
KVAH	KILOVOLT AMPERE PER HOUR
KVAR	KILOVOLT AMPERE REACTIVE
KW	KILOWATT
KWH	KILOWATT HOUR
KWHM	KILOWATT HOUR METER
LCP	LIGHTING CONTROL PANEL
LED	LIGHT EMITTING DIODE
LF	LINEAR FEET (FOOT)
LP	LIGHT POLE
LPS	LOW PRESSURE SODIUM
LRA	LOCKED ROTOR AMPS
LT	LIGHT
LTG	LIGHTING
LTG PNL	LIGHTING PANEL
LTNG	LIGHTNING
LV	LOW VOLTAGE
MAX	MAXIMUM
MC	METAL-CLAD
MCA	MINIMUM CIRCUIT AMPS
MCB	MAIN CIRCUIT BREAKER
MCC	MOTOR CONTROL CENTER
MDP	MAIN DISTRIBUTION PANEL
MECH	MECHANICAL
MH	MANHOLE
MIN	MINIMUM
MOCP	MAXIMUM OVERCURRENT PROTECTION
MLO	MAIN LUGS ONLY
MS	MOTOR STARTER
MT	MOUNT
MTD	MOUNTED
MTG	MOUNTING
MTS	MANUAL TRANSFER SWITCH
MV	MEDIUM VOLTAGE
MVA	MEGAVOLT-AMPERE
MW	MEGAWATT
NA	NOT APPLICABLE
NAC	NOTIFICATION APPLIANCE CABINET
NC	NORMALLY CLOSED
NEC	NATIONAL ELECTRICAL CODE
NEMA	NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION
NEUT, N	NEUTRAL
NFC	NOT FOR CONSTRUCTION
NFPA	NATIONAL FIRE PROTECTION ASSOCIATION
NIC	NOT IN CONTRACT
NL	NIGHT LIGHT
NO	NORMALLY OPEN
NTS	NOT TO SCALE
OC	ON CENTER
OD	OUTSIDE DIAMETER
OH	OVERHEAD
OL	OVERLOAD
OS	OCCUPANCY SENSOR
P	POLE
PB	PULL BOX
PEC	PHOTOELECTRIC CELL
PED	PEDESTAL
PEND	PENDANT
PIV	POST INDICATOR VALVE
PF	POWER FACTOR
PH	PHASE
PNL	PANEL
PS	POWER SUPPLY
PT	POTENTIAL TRANSFORMER
PVC	POLYVINYL CHLORIDE (PLASTIC)
PWR	POWER
R	EXISTING TO BE REMOVED
RCP	REFLECTED CEILING PLAN
REC	RECESSED
RECPT	RECEPTACLE
RM	ROOM
RMC	RIGID METAL CONDUIT
RMS	ROOT MEAN SQUARE
REQD	REQUIRED
SAC	SMALL APPLIANCE CIRCUIT
SCC	SHORT CIRCUIT CAPACITY
SD	SMOKE DETECTOR
SF	SQUARE FOOT (FEET)
SHT	SHEET
SI	INTERNATIONAL SYSTEM OF UNITS
SM	SMART METER
SPD	SURGE PROTECTIVE DEVICE
SPEC	SPECIFICATION
SPST	SINGLE POLE, SINGLE THROW
ST	SHUNT TRIP
SURF	SURFACE
SW	SWITCH
SWBD OR SB	SWITCHBOARD
SWGR OR SG	SWITCHGEAR
TEL	TELEPHONE
TR	TAMPER RESISTANT
TV	TELEVISION
TYP	TYPICAL
UFD	UNDERFLOOR DUCT
UGND	UNDERGROUND
UL	UNDERWRITERS LABORATORY
UON	UNLESS OTHERWISE NOTED
UPS	UNINTERRUPTIBLE POWER POWER SUPPLY
UTIL	UTILITY
V	VOLT
VA	VOLT AMPERE
VAR	VOLT AMPERE REACTIVE
VFD	VARIABLE FREQUENCY DRIVE
VOLT	VOLTAGE
W	WATT/WEATHERPROOF (WHILE IN USE)
WH	WATER HEATER
WP/W	WEATHERPROOF
XFER	TRANSFER
XFMR	TRANSFORMER

GENERAL NOTES

1. THESE "GENERAL NOTES" SHALL APPLY TO ALL DRAWINGS WITHIN THIS DRAWING SET.
2. BLACKENED OR BOLDED EQUIPMENT INDICATES THE EQUIPMENT SHALL BE PROVIDED AND INSTALLED BY THE CONTRACTOR. ITEMS NOT DIRECTLY FURNISHED BY THE CONTRACTOR SHALL HAVE A DESIGNATION SUCH AS OFCI (OWNER FURNISHED CONTRACTOR INSTALLED), OFOI (OWNER FURNISHED OWNER INSTALLED), OR NIC (NOT IN CONTRACT). GRAY OR GRAY-SCALED EQUIPMENT SHALL BE ASSUMED TO BE EXISTING OR SHOWN FOR EQUIPMENT LOCATION COORDINATION.
3. EXISTING CIRCUITS ASSOCIATED WITH THE PROJECT AREA OF WORK ARE TO BE DE-ENERGIZED DURING CONSTRUCTION.
4. ALL ELECTRICAL WORK SHALL BE COMPLETED WITH ALL PROXIMATE ELECTRICAL CIRCUITS DE-ENERGIZED (i.e. A NEW BREAKER OR CIRCUIT CANNOT BE ADDED TO A PANEL UNLESS THE PANEL IS COMPLETELY DE-ENERGIZED), OR THE CONTRACTOR MUST COMPLY WITH NFPA 70E FOR WORK ON ENERGIZED SERVICE. THE VA WILL DETERMINE IF THE ELECTRICAL SERVICE CAN BE SHUT DOWN OR IT WILL HAVE TO BE WORKED HOT DEPENDING ON THE CRITICALITY OF THE AREA BEING AFFECTED. IF THE WORK MUST BE DONE WITH THE SERVICE LIVE, THE CONTRACTOR IS RESPONSIBLE FOR PROVIDING ALL REQUIRED PROTECTIVE TOOLS, EQUIPMENT, AND CLOTHING, AND MUST FOLLOW THE JOB SPECIFIC WORK PLAN PREPARED BY THE CONTRACTOR AND APPROVED BY THE VA. WORK THAT REQUIRES SHUTTING DOWN ELECTRICAL SERVICE MAY HAVE TO BE ACCOMPLISHED DURING OTHER THAN NORMAL DUTY HOURS.
5. PROVIDE RACEWAYS AND CONDUCTORS/CABLING FROM LUMINAIRES TO THEIR CORRESPONDING CONTROL DEVICES AS INDICATED ON PLANS.
6. LUMINAIRE INSTALLATIONS AND LAYOUTS SHALL BE COORDINATED WITH ALL OBSTACLES, EQUIPMENT AND ARCHITECTURAL FEATURES.
7. WHERE NOT SPECIFICALLY INDICATED ON DRAWINGS, BRANCH CIRCUIT CONDUCTORS SHALL BE 12 AWG MINIMUM FOR RUNS EQUAL TO OR LESS THAN 65 FEET AND 10 AWG MINIMUM FOR RUNS GREATER THAN 65 FEET. RACEWAYS AND CONDUCTORS SHALL BE SIZED AND QUANTIFIED TO SERVE AND CONTROL APPLICABLE EQUIPMENT WITH VOLTAGE DROP NO GREATER THAN THREE PERCENT. CONDUCTOR SIZE SHALL BE INCREASED TO COMPENSATE FOR DERATING REQUIRED PER NEC 310.15 WHERE MORE THAN THREE CURRENT CARRYING CONDUCTORS WITHIN ONE RACEWAY; CONDUCTOR AMPACITIES SHALL BE TAKEN FROM THE 75°C COLUMN. INDIVIDUAL CIRCUITS SHALL NOT SHARE NEUTRAL CONDUCTORS.
8. MINIMUM CONDUIT SIZE SHALL BE 1" FOR EXTERIOR AND UNDERGROUND CONDUIT. MINIMUM CONDUIT SIZE SHALL BE 3/4 " FOR INTERIOR CONDUIT. ADDITIONAL CONDUCTORS FOR UNSWITCHED HOT CONDUCTOR TO LUMINAIRES WITH EMERGENCY BATTERY POWERED BACKUP UNITS OR TRANSFER DEVICES SHALL BE PROVIDED. ALL CONDUIT SHALL BE CONCEALED. THE ABOVE COMMENTS SHALL BE ADHERED TO UNLESS OTHERWISE NOTED ON THE DRAWINGS.
9. EMERGENCY LIGHTING OR EQUIPMENT CIRCUITS SHALL BE ROUTED INDEPENDENT FROM OTHER CIRCUIT TYPES; ENSURE NEC 700.10 REQUIREMENTS ARE MET.
10. PROVIDE ALL CONDUIT AND WIRE FOR ALL CIRCUITS INDICATED AND/OR NOTED ON THE DRAWINGS AND/OR SPECIFICATIONS. ALL AUXILIARY OR REQUIRED APPURTENANCES FOR PROVIDED EQUIPMENT SHALL BE PROVIDED WITH ALL CONNECTIONS AS REQUIRED.
11. ALL EQUIPMENT AND DEVICES INCLUDING, BUT NOT LIMITED TO, ELECTRICAL DISTRIBUTION EQUIPMENT, RECEPTACLES, DATA OUTLETS, AND SPECIAL SYSTEM DEVICES, SHALL HAVE THEIR EXACT LOCATION COORDINATED WITH ARCHITECTURAL DRAWINGS AND ALL TRADES PRIOR TO COMMENCING WORK.
12. COORDINATE WITH LIGHTING MANUFACTURER FOR ALL LIGHTING CONTROL EQUIPMENT AND APPURTENANCES; PROVIDE ANY ADDITIONAL SENSORS TO PROVIDE FULL COVERAGE OF THE SPACE AS REQUIRED. ALL CONDUIT, WIRE, POWER SUPPLIES, AND APPURTENANCES REQUIRED FOR THE LIGHTING CONTROL SYSTEM SHALL BE PROVIDED TO PROVIDE A COMPLETE AND FULLY FUNCTIONAL SYSTEM.
13. ALL EXTERIOR MOUNTED RECEPTACLES AND LUMINAIRE INSTALLATIONS SHALL COORDINATE EXACT LOCATIONS WITH ARCHITECTURAL SHEETS. ADDITIONALLY, WHERE MASONRY IS USED, SMOOTH BLOCK SHALL BE UTILIZED TO PROVIDE A PROPER MOUNTING SURFACE TO ALL EQUIPMENT; RECEPTACLES SHALL BE INSTALLED FLUSH.
14. ALL CONDUIT/SLEEVE FLOOR AND WALL PENETRATIONS SHALL BE SEALED WITH FIRE RATED ASSEMBLIES, CAULKING, AND APPURTENANCES. ELECTRICAL BOXES LOCATED IN FIRE RATED WALLS SHALL BE RATED FOR USE IN FIRE RATED WALLS.
15. ALL EQUIPMENT AND INSTALLATION METHODS SHALL BE LISTED AND LABELED PER NEC, UL LISTED, OR REVIEWED EQUAL.
16. FOR ALL EQUIPMENT, COORDINATE WITH ALL TRADES (ARCHITECTURAL, MECHANICAL, PLUMBING, ETC) FOR ELECTRICAL REQUIREMENTS AND INSTALLATION LOCATIONS PRIOR TO INSTALLATION.
17. ALL LOW-VOLTAGE SYSTEM CABLING NOT RAN IN CONDUIT TO WALL MOUNTED DEVICE SHALL HAVE A MINIMUM 1"C ROUTED FROM DEVICE THROUGH WALL INTO THE ACCESSIBLE CEILING SPACE; CABLING SHALL NOT BE ROUTED IN WALLS OR IN AN INACCESSIBLE LOCATION WITHOUT CONDUIT.
18. GFCI RECEPTACLES SHALL BE PROVIDED WITHIN 6 ' OF A SINK/OR WATER SOURCE, WITHIN DAMP ROOMS, OR WHEN MOUNTED OUTDOORS/EXTERIOR TO THE BUILDING.
19. NO STRUCTURAL MEMBERS SHALL BE CUT, DRILLED, OR NOTCHED WITHOUT PRIOR WRITTEN CONSENT FROM THE STRUCTURAL ENGINEER OR ARCHITECT.
20. ALL FINAL LOCATIONS AND ARRANGEMENTS OF LIGHTING FIXTURES SHALL BE OBTAINED FROM THE ARCHITECTURAL REFLECTED CEILING PLAN.
21. EACH BRANCH CIRCUIT HOMERUN SHALL HAVE NO MORE THAN THREE CIRCUITS. EACH BRANCH CIRCUIT HOMERUN SHALL HAVE A SEPARATE GREEN INSULATED EQUIPMENT GROUNDING CONDUCTOR SIZED PER NEC TABLE 250.122. ALL WIRING IS BASED ON Cu COPPER PER NEC TABLE 310.15(B)(16), USING 75°C AMPACITIES FOR FEEDERS.
22. MULTI-GANG BACKBOXES FOR DIFFERENT VOLTAGES AND TYPES OF EMERGENCY AND NORMAL BRANCH WIRING DEVICES SHALL HAVE DIVIDERS BETWEEN DEVICES.
23. FOR EXISTING EQUIPMENT, SUCH AS LIGHTING FIXTURES, WIRING DEVICES, CONDUITS, ETC., SHOWN ON PLANS TO BE REMOVED, COMPLETELY CUT/CAP CONDUITS AT THE AREA OF WORK PERIMETER AND REMOVE CONDUIT WITHIN THE WORK AREA, DISCONNECT WIRING AT THE OVERCURRENT PROTECTIVE DEVICE AND REMOVE WIRING COMPLETELY FROM THE ABANDONED CONDUITS.
24. DISCONNECT ALL ABANDONED WIRING OF ALL TYPES AT THE OVERCURRENT PROTECTIVE DEVICE. COMPLETELY REMOVE ALL ABANDONED WIRING.
25. MAINTAIN AND RESTORE, IF INTERRUPTED, ALL CONDUITS AND CONDUCTORS PASSING THROUGH RENOVATED AREAS AND SERVICING UNDISTURBED AREAS.
26. PRIOR TO EQUIPMENT PROCUREMENT, CONTRACTOR SHALL PROVIDE DETAILED AND DIMENSIONED SHOP DRAWINGS INDICATING PROPOSED ELECTRICAL EQUIPMENT LAYOUT FOR ALL ELECTRICAL EQUIPMENT INSTALLATIONS DURING THE SUBMITTAL PROCESS FOR VA AND ENGINEER REVIEW AND APPROVAL. LAYOUT SHALL INCLUDE COORDINATION WITH ALL EXISTING/RELOCATED EQUIPMENT, ARCHITECTURAL FEATURES, ETC.
27. CONTRACTOR SHALL DISPOSE OF REMOVED DEVICES. DISPOSAL OF DEVICES SHALL COMPLY WITH ALL APPROPRIATE CODES. REUSE EXISTING CONDUITS AND JUNCTION BOXES AS PRACTICAL.
28. PRIOR TO RELOCATING FIRE ALARM EQUIPMENT, CONTRACTOR SHALL TEST AND VERIFY EXISTING EQUIPMENT FUNCTIONALITY IN CONJUCTION WITH VA COORDINATION. CONTRACTOR SHALL PROVIDE ALL REQUIRED RACEWAYS, CONDUCTORS, CABLING, PROGRAMMING, TEMPORARY FIRE SYSTEM PANELS AND DEVICES, AND TESTING FOR RELOCATING AND MAINTAINING A FULLY FUNCTIONAL FIRE ALARM SYSTEM. CONTRACTOR SHALL PROVIDE PHASING PLANS FOR VA REVIEW AND APPROVAL PRIOR TO COMMENCING WORK; ALL PLANS SHALL BE SUBMITTED FOR REVIEW 30 DAYS PRIOR TO IMPLEMENTATION. ALL WORK REQUIRED TO RELOCATE EXISTING FIRE ALARM EQUIPMENT SHALL BE INCLUDED IN THE CONTRACTOR'S SOW.
29. WHERE CORE DRILLING IS REQUIRED, CONTRACTOR SHALL COORDINATE WITH STRUCTURAL DRAWINGS AND PROVIDE X-RAY SURVEY VIA SUBMITTAL PROCESS PRIOR TO DRILLING.
30. PROTECT ALL EXISTING WORK FROM DAMAGE DURING CONSTRUCTION. ANY DAMAGED MATERIALS, SYSTEMS, COMPONENTS, AND FINISHES SHALL BE REPAIRED OR REPLACED AT EXPENSE OF CONTRACTOR TO ACCEPTANCE OF OWNER.
31. ALL PENETRATIONS SHALL BE PERMITTED, LOGGED, AND INSPECTED BY ALEXANDRIA VA FIRE DEPARTMENT PRIOR TO FINAL CLOSURE.
32. CONTRACTOR SHALL COORDINATE NORMAL/ESSENTIAL ELECTRICAL SYSTEM SHUTDOWNS AND PHASING WITH THE VA PRIOR TO PERFORMING REQUIRED EQUIPMENT UPGRADES. CONTRACTOR TO PROVIDE BACKUP EMERGENCY POWER AND DETERMINE TIE-IN/CONNECTION PLAN WITH EXISTING EQUIPMENT. POWER TO ALL EXISTING ESSENTIAL EQUIPMENT CANNOT BE INTERRUPTED AND SHALL REMAIN ACTIVE DURING CONSTRUCTION. BACKUP POWER AND TIE-IN SHALL CONFORM WITH VA STANDARDS.

SHEET INDEX

E-001 - ABBREVIATIONS, GENERAL NOTES, AND SHEET INDEX
E-002 - ELECTRICAL LEGENDS
E-100 - BLDG 07 - BASEMENT - OVERALL FLOOR PLAN
E-101 - BLDG 07 - PENTHOUSE - OVERALL FLOOR PLAN
E-102 - BLDG 09 - LEVEL 01 - OVERALL FLOOR PLAN
E-103 - BLDG 09 - PENTHOUSE - OVERALL FLOOR PLAN
E-401 - BLDG 07 - PENTHOUSE - ENLARGED ELECTRICAL PLANS
E-402 - BLDG 07 - BASEMENT - ENLARGED ELECTRICAL PLANS
E-403 - BLDG 07 - ELECTRICAL ROOM 29 - ENLARGED ELECTRICAL PLANS
E-404 - BLDG 07 - BASEMENT - ENLARGED ELECTRICAL PLANS
E-405 - BLDG 07 - PENTHOUSE - ENLARGED ELECTRICAL PLANS
E-406 - BLDG 07 - BASEMENT - ENLARGED ELECTRICAL PLANS
E-407 - BLDG 07 - BASEMENT - ENLARGED ELECTRICAL PLANS
E-408 - BLDG 07 - BASEMENT - ENLARGED ELECTRICAL PLANS
E-409 - BLDG 09 - PENTHOUSE - ENLARGED ELECTRICAL PLANS
E-410 - BLDG 09 - LEVEL 01 - ENLARGED ELECTRICAL PLANS
E-501 - ELECTRICAL DETAILS
E-502 - BUILDING 07 ELECTRICAL DETAILS
E-503 - BUILDING 09 ELECTRICAL DETAILS
EF601 - FIRE ALARM RISER DIAGRAMS
E-601 - BUILDING 07 - ONE-LINE DIAGRAMS - EXISTING - PART 1 OF 2
E-602 - BUILDING 07 - ONE-LINE DIAGRAMS - EXISTING - PART 2 OF 2
E-603 - BUILDING 09 - ONE-LINE DIAGRAMS - EXISTING
E-611 - BUILDING 07 - ONE-LINE DIAGRAMS - REVISED - PART 1 OF 2
E-612 - BUILDING 07 - ONE-LINE DIAGRAMS - REVISED - PART 2 OF 2
E-613 - BUILDING 09 - ONE-LINE DIAGRAMS - REVISED
E-701 - ELECTRICAL SCHEDULES
E-702 - ELECTRICAL SCHEDULES
E-703 - ELECTRICAL SCHEDULES

Revisions:	Date:

CONSULTANT/ DISCIPLINE

DISCIPLINE:

ARCHITECT/ ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HIGHWAY S. SUITE 300
KENT, WA 98032

SPEESDESIGNBUILD

STAMP

LOUIS R. LITZAU — STATE OF WASHINGTON — 55681 — 3-24-26 — REGISTERED PROFESSIONAL ENGINEER

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: ABBREVIATIONS, GENERAL NOTES, AND SHEET INDEX

Phase: 100% CONSTRUCTION DOCUMENTS

Project Title: REPLACE ELEVATORS IN BLDG 07 & BLDG 09

Project Number: 502-24-102

Building Number: -

Approved:

FULLY SPRINKLERED

Location: ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA

Issue Date: 03/24/2026 | **Checked:** DCW/NVP | **Drawn:** JNV/GPB

Drawing Number: E-001

DIV 26 - LEGEND

POWER

- MOTOR, X = HORSEPOWER RATING
- TRANSFORMER
- DELTA CONNECTION
- WYE CONNECTION
- EARTH GROUND
- JUNCTION BOX
- PB — PULL BOX
- SWITCH, MULTIPOSITION
- SWITCH, SINGLE BREAK
- NORMALLY CLOSED RELAY CONTACT
- NORMALLY OPEN RELAY CONTACT
- FUSE WITH RATING
- CIRCUIT BREAKER
- DRAWOUT AIR CIRCUIT BREAKER
- 50 — RELAY; NUMBER INDICATES RELAY TYPE
  50 = INSTANTANEOUS OVER CURRENT OR RATE-OF-RISE
  51 = AC-TIME OVER CURRENT
  67 = AC-DIRECTIONAL OVER CURRENT
  86 = LOCKING OUT
- DISCONNECT SWITCH
- G — GENERATOR, POWER
- BATTERY
- CAPACITOR
- M — METER
- A — AMMETER
- V — VOLTMETER
- W — WATTMETER
- WH — WATT-HOUR METER
- ST — SHUNT TRIP
- T — TRANSFORMER, PLAN
- VFD (X) — VARIABLE FREQUENCY DRIVE, X= HORSEPOWER RATING
- LADDER CABLE TRAY
- PANELBOARD, FLUSH MOUNTED
- PANELBOARD, SURFACE MOUNTED
- RECEPTACLE, DUPLEX
- RECEPTACLE, DUPLEX ON EMERGENCY POWER
- RECEPTACLE, DUPLEX WITH GROUND FAULT CIRCUIT INTERRUPTER
- RECEPTACLE, QUADRUPLEX
- RECEPTACLE, SINGLE

- RECEPTACLE, SPECIAL PURPOSE
  A = 120V, 20A, 1 PHASE, 2-POLE, 3W, NEMA 5-20R.
  B = 208V, 20A, 1 PHASE, 2-POLE, 3W, NEMA 6-20R.
  C = 120V, 30A, 1 PHASE, 2-POLE, 3W, NEMA 5-30R.
  D = 208V, 30A, 1 PHASE, 2-POLE, 3W, NEMA 6-30R.
  E = 208V, 60A, 1 PHASE, 3-POLE, 4W, NEMA 14-60R.
  F = 208V, 30A, 3 PHASE, 3-POLE 4W, NEMA 15-30R.
  G = 208V, 50A, 3 PHASE, 3 POLE, 4W, NEMA 15-30R.
  H = 208V, 60A, 3 PHASE, 3 POLE, 4W, NEMA 15-60R.
- RECEPTACLE, SINGLE WITH SWITCH
- HARDWIRED
- RECEPTACLE, SWITCHED DUPLEX
- DROP CORD, SINGLE CONVENIENCE OUTLET, 3-WIRE, GROUNDING TYPE, 20A, W/#12 CONDUCTORS IN FLEXIBLE CORD (CENTER LINE OF OUTLET: 6'-6" [1981mm] AFF. MINIMUM).
- ELECTRICAL STRIP MOLD (OUTLETS ON 2'-0" [610mm] CENTERS OR AS DESIGNATED ON DRAWINGS), MTD 3'-6" [1067mm] AFF OR AS INDICATED.
- $x — F = FUSED SWITCH; K = KEY OPERATED; L = LOCK; LM= LOW VOLTAGE MASTER; M = MANUAL MOTOR STARTING; MC= MOMENTARY CONTACT; MP= MOTOR SNAP WITH PILOT LIGHT (THERMAL TYPE); P = WITH PILOT LIGHT; PB= PUSH BUTTON STATION; RC= REMOTE CONTROL; WP= WEATHER PROOF; X = EXPLOSION PROOF

LIGHTING

- P — SWITCH, CEILING MOUNTED PULL
- $x — SWITCH (# SUBSCRIPT AS INDICATED BELOW):
  BLANK = SINGLE POLE; 2 = DOUBLE POLE; 3 = THREE-WAY; 4 = FOUR-WAY; D = DIMMER; K = KEY OPERATED; LV= LOW VOLTAGE; P = WITH PILOT LIGHT; LM= LOW VOLTAGE MASTER; RC= REMOTE CONTROL; PB= PUSH BUTTON STATION; WP= WEATHER PROOF; T = TIMER OPERATED; Mo= OCCUPANCY SENSOR
  x = LUMINAIRE SWITCH ZONE (ANY LOWER CASE LETTER APPLIES)

EMERGENCY / NORMAL — X = DENOTES LUMINAIRE TAG NAME

- RECESSED DOWNLIGHT FIXTURE
- LIGHT FIXTURE, RECESSED, 2'x4'
- LIGHT FIXTURE, RECESSED,1'x4'
- LIGHT FIXTURE, RECESSED, 1'x8'
- LIGHT FIXTURE, RECESSED, 2'x2'
- LIGHT FIXTURE, SURFACE MOUNTED, 2'x4'
- LIGHT FIXTURE, SURFACE MOUNTED, 1'x4'
- LIGHT FIXTURE, SURFACE MOUNTED, 1'x8'
- LIGHT FIXTURE, SURFACE MOUNTED, 2'x2'
- STRIP LIGHTING, 4' LONG
- LIGHT FIXTURE, WALL MOUNTED
- LIGHTING WALL PACK, EXTERIOR BUILDING

- EXIT SIGN, WALL MOUNTED WITH DIRECTIONAL ARROWS AND FACES AS SHOWN
- EXIT SIGN, CEILING MOUNTED WITH DIRECTIONAL ARROWS AND FACES AS SHOWN
- EXIT SIGN, ABOVE DOOR, CEILING MOUNTED
- OS x — ALL INTERIOR AREAS TO HAVE MANUAL "ON"/AUTO OFF LIGHTING CONTROL WITH THE USE OF DUAL TECHNOLOGY OCCUPANCY SENSORS. EXCEPT WHERE A WALL SWITCH OCCUPANCY SENSOR IS NOTED.
- PP x — POWER PACK FOR COMPLEX LIGHTING CONTROL. "X" DENOTES THE LIGHTING ZONE.
- LIGHTING, ONE HEAD EMERGENCY BATTERY POWER
- LIGHTING, TWO HEAD EMERGENCY BATTERY POWER
- LIGHTING, THREE HEAD EMERGENCY BATTERY POWER
- PS — POWER SUPPLY PROVIDED BY MANUFACTURER, UNLESS OTHERWISE NOTED

DIV 27 - LEGEND

DATA/COMMUNICATION

- OUTLET, COMBINATION TELEPHONE/DATA COMMUNICATION
- CATV — CABLE TELEVISION LINE = CATV
- CCTV — CLOSED CIRCUIT TELEVISION LINE = CCTV. MINIMUM 1" [25mm] CONDUIT
- FO — FIBEROPTICS LINE = FO
- T — TELEPHONE LINE = T
- I — INTERCOM LINE = I. MINIMUM 3/4" [19mm] CONDUIT.
- S — SOUND LINE = S
- NC — NURSE CALL LINE = NC. MINIMUM 3/4" [19mm] CONDUIT.
- R — RADIO CONDUIT RUN. MINIMUM 3/4" [19mm] CONDUIT.
- TELECOMMUNICATIONS MANHOLE
- X Y Z — OUTLET TELEPHONE; "X" INDICATES NUMBER OF OUTLET PORTS. "Y" INDICATES AS FOLLOWS:
  BLANK=EXISTING CONDUIT WITH NEW CAT6A CABLE
  P=POLE/ PEDESTAL MOUNTED
  F=FURNITURE MOUNTED
  C=OUTLET WITH NEW CONDUIT INSTALLED, 3/4" MINIMUM UNLESS OTHERWISE STATED "Z" INDICATES AS FOLLOWS:
  J = JACK TYPE W = WALL TYPE A = ANALOG PORT
- P X X — OUTLET DATA OR TELEPHONE, "X" INDICATES NUMBER OF OUTLET PORTS. BOX AROUND SYMBOL INDICATES FLOOR MOUNTED.
  P = POLE/PEDESTAL MOUNTED
- OUTLET; LETTER INDICATES AS FOLLOWS:
  A = AUDIO V = VIDEO I = INTERCOM H =HDMI
- X — SPEAKER, CEILING MOUNTED, "X" INDICATES THE TYPE, PROVIDE SCHEDULE ON LEGEND.
- X — SPEAKER, WALL MOUNTED, "X" INDICATES THE TYPE, PROVIDE SCHEDULE ON LEGEND. MTD. 7'-6" [2286mm] AFF UNLESS OTHERWISE NOTED.
- R — RADIO CHANNEL SELECTOR FACILITIES, MTD. 4'-6" [1372mm] AFF UNLESS OTHERWISE NOTED.
- R M — SPEAKER PROGRAM SELECTOR SWITCH & VOLUME CONTROL MTD. 4'-6" [1372mm] AFF UNLESS OTHERWISE NOTED.
- X — OUTLET, TELEVISION
  BLANK = 4 11/16" [119mm] MASTER ANTENNA OUTLET BOX W/BLANK COVER, MTD. 18" [457mm] AFF UNLESS OTHERWISE NOTED.
  C = CAMERA (CCTV SYSTEM), MTD 18" [457mm] AFF
  M = MONITOR (CTTV SYSTEM).
- WT VW — WIRELESS TRACKING MODULE, IR TECHNOLOGY
  VW - INDICATES VIRTUAL WALL TYPE.
- WAP X — WIRELESS ACCESS POINT.
  "S" = STAFF; "G" = GUEST. IF NOTED LIKE THIS "S,G", CONTRACTOR SHALL PROVIDE (2) SEPARATE WAPs, (1) WAP FOR EACH SERVICE.

DIV 28 - LEGEND

- FAC — ALARM, FIRE, COMMUNICATOR
- FACP — ALARM, FIRE, PANEL; LETTERS INDICATE AS FOLLOWS:
  FACC = CENTRAL CONSOLE FACP = CONTROL PANEL
  MFACP= MASTER CONTROL PANEL FAAP = ANNUNCIATOR
- BATT — ALARM, FIRE; LETTERS INDICATE AS FOLLOWS:
  BATT = BATTERIES CHR = CHARGER FAR = RECORDER
- OSY — ALARM, FIRE, VALVE SUPERVISORY SWITCH.
- FATC — ALARM, FIRE, TERMINAL CABINET.
- PIV — ALARM, FIRE, POST INDICATOR VALVE.
- FTR — ALARM, TRANSPONDER OR TRANSMITTER
- ALARM, HORN/LIGHT, ONE ASSEMBLY C = WITH CHIME
- C — ALARM, HORN/LIGHT, ONE ASSEMBLY WITH CHIME
- ALARM, HORN/LIGHT, SEPARATE ASSEMBLY
- X — ALARM, LAMP LIGHT, SIGNAL LIGHT, STROBE;
  LETTER INDICATES AS FOLLOWS:
  BLANK = SIGNAL STROBE PER FIRE ALARM SPECIFICATION
  C = SPECIALTY SIGNAL STROBE, CLEAN AGENT FIRE SUPPRESSION SYSTEM
  S = SMOKE DETECTOR ALARM INDICATOR STROBE, CLEAN AGENT FIRE SUPPRESSION SYSTEM
- M — ALARM, MINI HORN
  M-MULLION
- WB — ALARM, SPRINKLER SYSTEM WATER FLOW BELL
- B — ALARM BELL
- S — SOLENOID VALVE
- TS — ALARM, TAMPER SWITCH
- SCCP — DETECTION, SMOKE CONTROL AND PRESSURE PANEL
- DETECTION SWITCH, VALVE TAMPER

- A — SPECIALTY SWITCH, ABORT, CLEAN AGENT FIRE SUPPRESSION SYSTEM
- M — SPECIALTY SWITCH, MANUAL, CLEAN AGENT FIRE SUPPRESSION SYSTEM
- E — EMERGENCY POWER OFF PUSH BUTTON
- DETECTOR, FLOW SWITCH
- HD — DETECTOR, HEAT
- H — DETECTOR; LETTER INDICATES AS FOLLOWS:
  BLANK = SMOKE DETECTOR
  H = HEAT SMOKE
  I = IONIZATION SMOKE
  P = PHOTOELECTRIC SMOKE
  IH = IONIZATION AND HEAT SMOKE
  IP = IONIZATION AND PHOTOELECTRIC SMOKE
  PH = PHOTOELECTRIC AND HEAT SMOKE
  IPH = IONIZATION, PHOTOELECTRIC, AND HEAT
  UFS = UNDERFLOOR SMOKE DETECTOR, CLEAN AGENT FIRE SUPPRESSION SYSTEM
  S = SMOKE DETECTOR WITH INDICATOR STROBE, CLEAN AGENT FIRE SUPPRESSION SYSTEM
- DETECTOR, SMOKE, FOR DUCT
- FS — FIRE ALARM STATION, MANUAL PULL
- FA — FIRE ALARM LINE = FA
- PAS — PRESSURE ACTIVATED SWITCH
- PS — TANK PRESSURE SWITCH
- MBS — MAINTENANCE BYPASS SWITCH
- EOL — END OF LINE RESISTOR
- CR — CONTROL RELAY, ADDRESSABLE
- MM — MONITOR MODULE, ADDRESSABLE, DUAL OR SINGLE AS REQUIRED

GENERAL SYMBOL

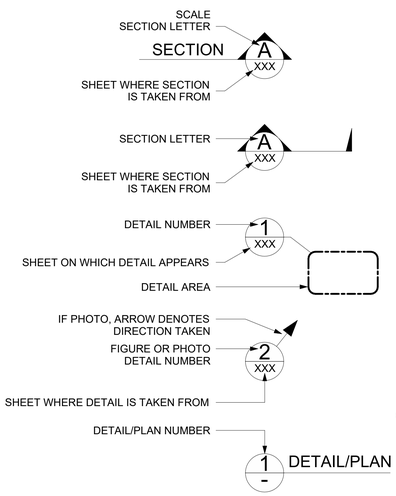

- 1 — KEY NOTE
- XXX — CONDUIT & WIRE TAG (REFER TO CONDUIT AND WIRE SCHEDULE)
- XX — SHORT CIRCUIT TAG. REFERENCE SCA TABLE ON ONE-LINE DIAGRAM
- 1 — METERING NOTE
- CONDUIT OR EQUIPMENT TO BE REMOVED
- CONDUIT UNDER FLOOR, IN FLOOR SLAB, OR ROUTED UNDERGROUND
- CONDUIT CONCEALED IN WALL, IN CEILING, OR ABOVE ACCESIBLE CEILING WHERE POSSIBLE, OTHERWISE EXPOSED
- EXTRA-HARD USAGE FLEXIBLE CORD
- FLEXIBLE CONDUIT
- CONDUIT / BONDING CONDUCTOR TURNED UP OR TOWARD
- CONDUIT / BONDING CONDUCTOR TURNED DOWN OR AWAY
- CONDUIT CAPPED
- 1 HR FIRE RATED WALL
- 2 HR FIRE RATED WALL
- SMOKE RATED WALL
- BOLD DOT INDICATES CONDUCTOR BOND / TERMINATION
- CONDUCTORS
- BOND / TERMINATION

CIRCUITING DESIGNATIONS

WHERE A PANEL NAME AND CORRESPONDING CIRCUIT ARE CALLED OUT ADJACENT TO A RECEPTACLE, LUMINAIRE, OR MISC LOAD, THAT LOAD SHALL BE CIRCUITED TO THE CORRESPONDING PANELBOARD CIRCUIT BREAKER. CONDUIT AND WIRE FOR CIRCUIT SHALL BE 3/4" CONDUIT WITH (2) 12 AWG AND (1) 12 AWG GND, UNLESS OTHERWISE NOTED; IF FURTHER THAN 70', PHASE AND GROUND WIRE SHALL BE UPSIZED TO 10 AWG TO ACCOUNT FOR VOLTAGE DROP. SEE EXAMPLES BELOW:

RECEPTACLE:
PANELBOARD OR POWER SOURCE NAME = "P1"
CIRCUIT NUMBER OF POWER SOURCE = "2"

P1-2 — 2 — PNL-P1 — P1-2

LUMINAIRE:
PANELBOARD OR POWER SOURCE NAME = "PP3"
CIRCUIT NUMBER OF POWER SOURCE = "4"
TYP LUMINAIRE TAG NAME, REFERENCE LUMINAIRE SCHEDULE = "L1"
LIGHTING CONTROL SWITCH LEG = "a"
ALL LUMINAIRES IN SAME ROOM ARE CIRCUITED TO SAME CIRCUIT = PP3-4

L1 a PP3-4

MISC LOAD:
PANELBOARD OR POWER SOURCE NAME = "PP"
CIRCUIT NUMBER OF POWER SOURCE = "7"

HEAT PUMP PP-7 — FACP PP-7

CONDUIT HOMERUN:
CONDUIT 3/4"C, 3#12 PHASE, 1#12 N, & 1#12 GND UNLESS SHOWN OTHERWISE. (EXAMPLE SHOWN: TO PANEL P1, CIRCUIT 1,3,5). LONG TICK FOR NEUTRAL WIRE; ONE SHORT TICK FOR EACH PHASE WIRE; GROUND SIZED PER NEC. NOTE THAT A SECOND SHORT TICK FOR LUMINAIRES IS FOR A TRAVELER WIRE.

CONDUIT HOME RUN - SEE CONDUIT AND WIRE SCHEDULE

P1-1,3,5
XXXX

Revisions:	Date:

CONSULTANT/ DISCIPLINE

DISCIPLINE:

ARCHITECT/ ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HIGHWAY S. SUITE 300
KENT, WA 98032

SPEESDESIGNBUILD

STAMP

LOUIS R. LITZKA — STATE OF WASHINGTON — 55681 — 3-24-26 — REGISTERED PROFESSIONAL ENGINEER

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: ELECTRICAL LEGENDS

Approved:

Phase: 100% CONSTRUCTION DOCUMENTS

FULLY SPRINKLERED

Project Title: REPLACE ELEVATORS IN BLDG 07 & BLDG 09

Location: ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA

Issue Date: 03/24/2026

Checked: DCW/NVP

Drawn: JNV/GPB

Project Number: 502-24-102

Building Number: -

Drawing Number: E-002

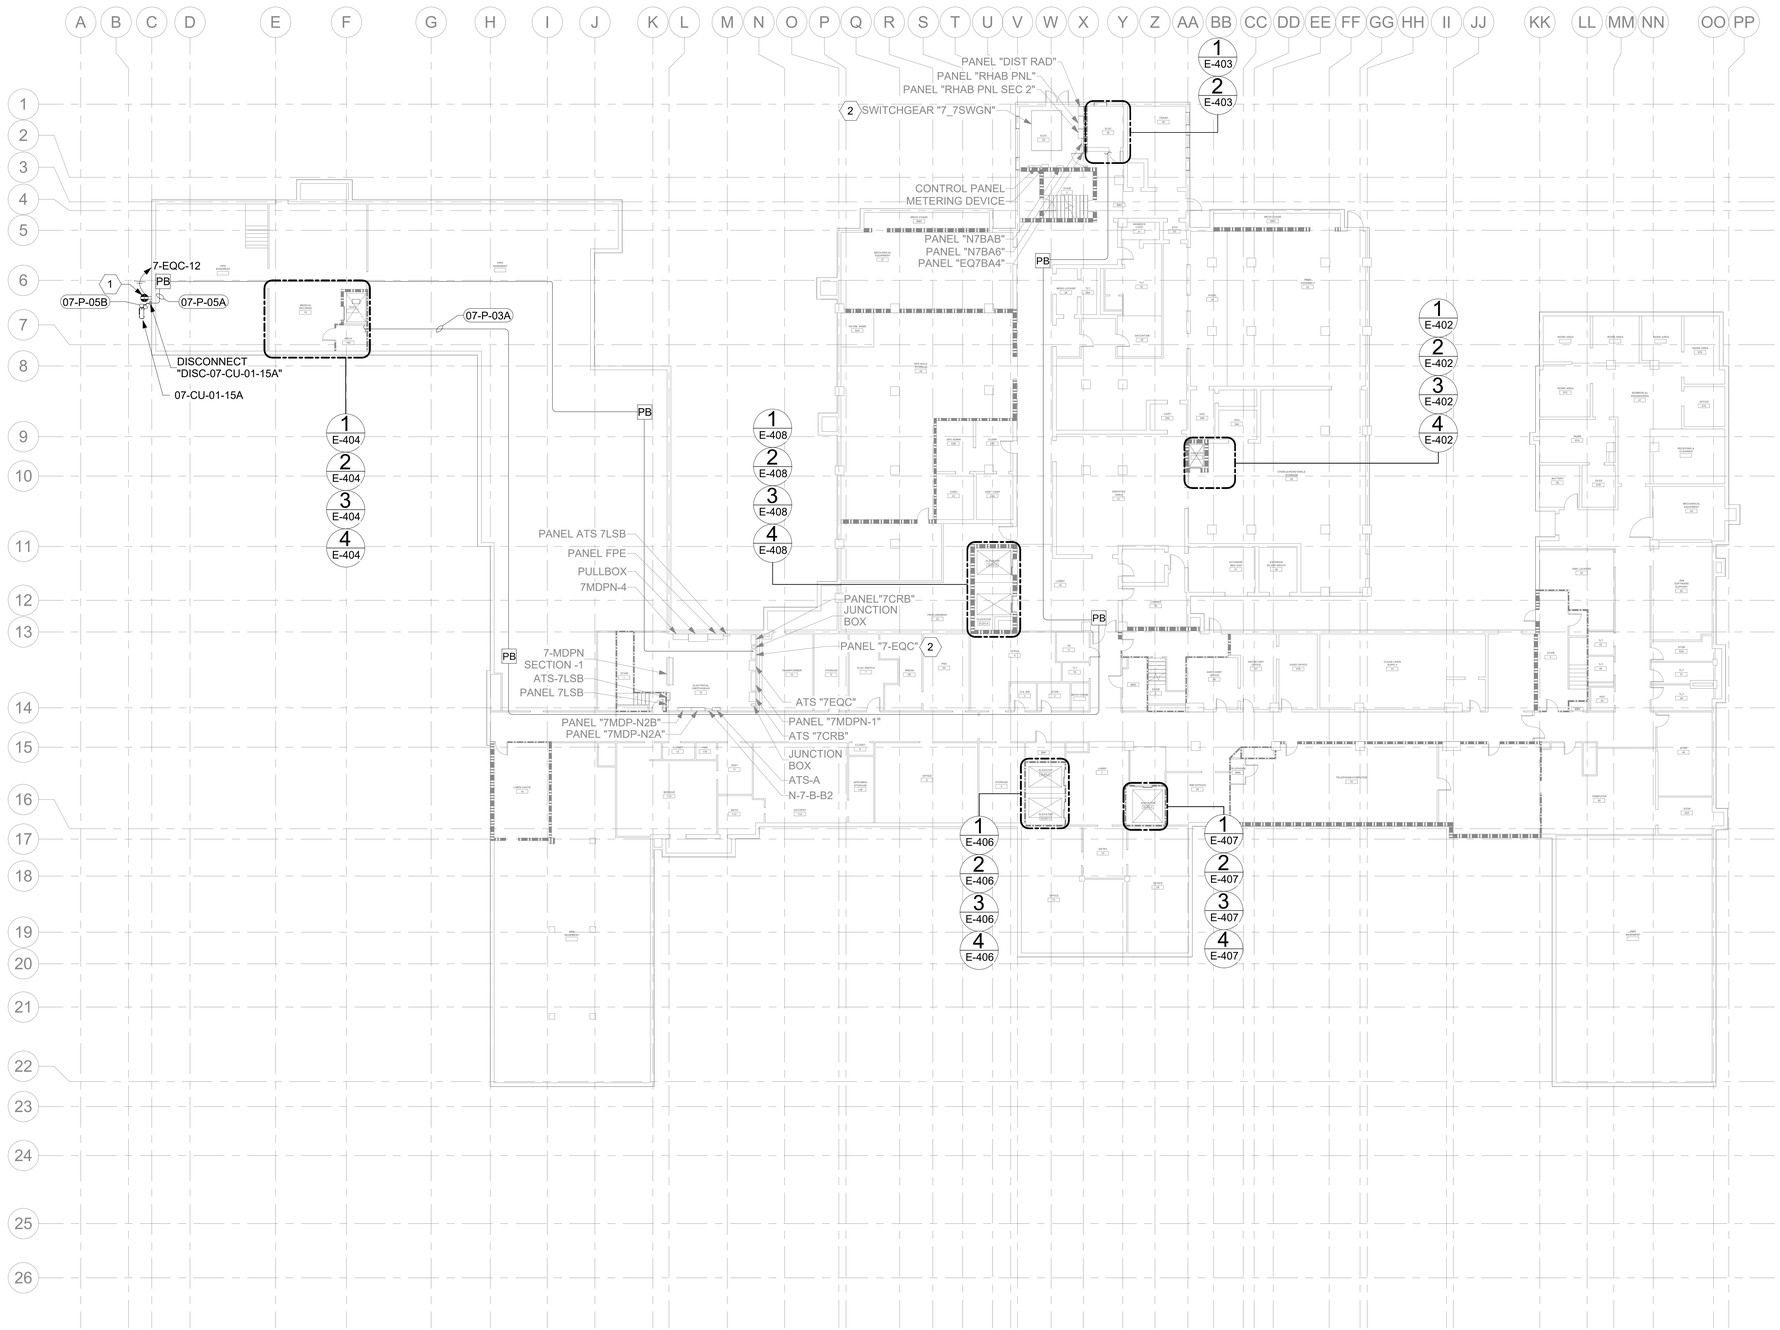

GENERAL NOTES

1. ALL EXISTING EQUIPMENT MAY NOT BE SHOWN FOR CLARITY. CONTRACTOR SHALL FIELD VERIFY ALL POWER, LIGHTING AND ASSOCIATED CIRCUITRY AS REQUIRED. ALL RACEWAYS AND CONDUCTORS ASSOCIATED WITH EQUIPMENT TO BE DEMOLISHED SHALL BE DEMOLISHED BACK TO THEIR SOURCE, UNLESS OTHERWISE NOTED.
2. CONTRACTOR SHALL PROVIDE UPDATED CIRCUIT PANEL DIRECTORIES FOR ALL PANELS THAT CONTAIN CIRCUITS IMPACTED BY THIS PROJECT.
3. SEAL ALL INTERIOR WALL AND CEILING PENETRATIONS TO MATCH EXISTING FIRE RATING OR NEW FIRE RATING; PROVIDE CORE DRILLING AS REQUIRED. COORDINATE WITH ARCHITECTURAL AND STRUCTURAL DRAWINGS AS REQUIRED.
4. CONTRACTOR SHALL PROVIDE UPDATED CIRCUIT PANEL DIRECTORIES FOR ALL PANELS THAT CONTAIN CIRCUITS IMPACTED BY THIS PROJECT.
5. CONTRACTOR SHALL PROVIDE PULL BOXES FOR ALL FEEDERS WHERE FEEDER RUNS EXCEED 250FT OR HAVE MORE THAN 270 DEGREES OF TOTAL BEND. PULLBOX PLACEMENT AND SIZING BY CONTACTOR. COORDINATE PULLBOX LOCATIONS WITH ALL OBSTRUCTIONS, TRADES, AND VA AS REQUIRED.
6. REFERENCE CORRESPONDING ONE-LINE DIAGRAM FOR ADDITIONAL INFORMATION.

KEY NOTES

1. PROVIDE CONVENIENCE RECEPTACLE, 20A,120V, GFCI, WP, WITH WHILE-IN-USE COVER.
2. ELECTRICAL DISTRIBUTION EQUIPMENT SHALL BE MODIFIED. REFERENCE ASSOCIATED ONE-LINE DIAGRAMS FOR ADDITIONAL INFORMATION.

KEY PLAN

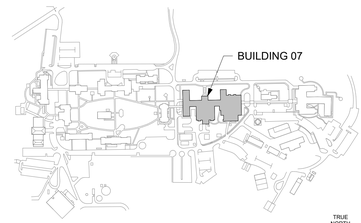

1/- BLDG 07 - BASEMENT - OVERALL FLOOR PLAN

1/16" = 1'-0"

PROJECT NORTH

0 8' 16' 32'

Revisions:	Date:

CONSULTANT/ DISCIPLINE

DISCIPLINE:

ARCHITECT/ ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HIGHWAY S. SUITE 300
KENT, WA 98032

SPEESDESIGNBUILD

STAMP

LOUIS R. LITZAU, STATE OF WASHINGTON, 120587, 3-24-26, REGISTERED PROFESSIONAL ENGINEER

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title	BLDG 07 - BASEMENT - OVERALL FLOOR PLAN
Approved:	
Phase	100% CONSTRUCTION DOCUMENTS
	FULLY SPRINKLERED
Project Title	REPLACE ELEVATORS IN BLDG 07 & BLDG 09
Location	ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA
Issue Date	03/24/2026
Checked	DCW/NVP
Drawn	JNV/GPB
Project Number	502-24-102
Building Number	07
Drawing Number	E-100

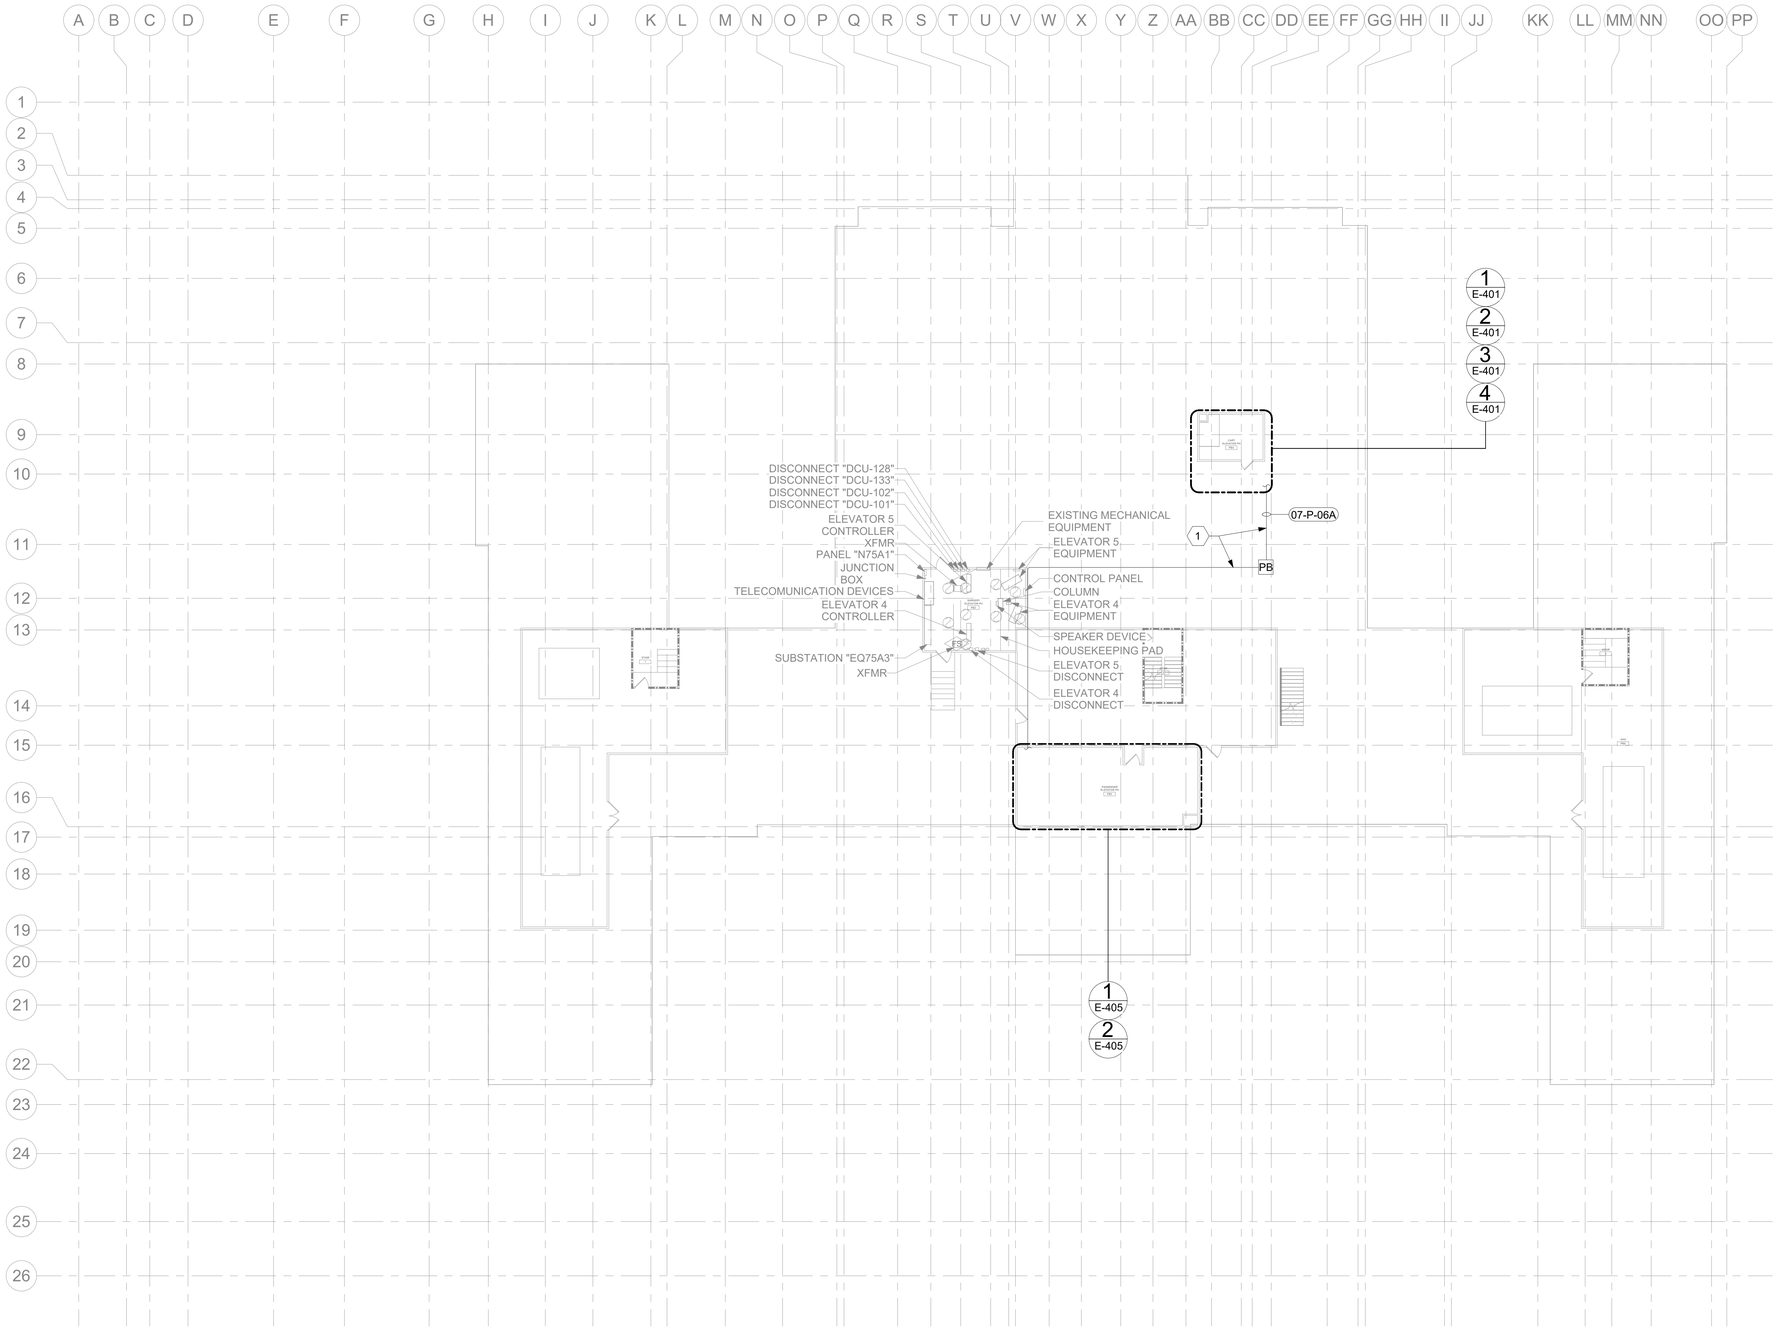

GENERAL NOTES

1. ALL EXISTING EQUIPMENT MAY NOT BE SHOWN FOR CLARITY. CONTRACTOR SHALL FIELD VERIFY ALL POWER, LIGHTING AND ASSOCIATED CIRCUITRY AS REQUIRED. ALL RACEWAYS AND CONDUCTORS ASSOCIATED WITH EQUIPMENT TO BE DEMOLISHED SHALL BE DEMOLISHED BACK TO THEIR SOURCE, UNLESS OTHERWISE NOTED.
2. CONTRACTOR SHALL PROVIDE UPDATED CIRCUIT PANEL DIRECTORIES FOR ALL PANELS THAT CONTAIN CIRCUITS IMPACTED BY THIS PROJECT.
3. SEAL ALL INTERIOR WALL AND CEILING PENETRATIONS TO MATCH EXISTING FIRE RATING OR NEW FIRE RATING; PROVIDE CORE DRILLING AS REQUIRED. COORDINATE WITH ARCHITECTURAL AND STRUCTURAL DRAWINGS AS REQUIRED.
4. CONTRACTOR SHALL PROVIDE UPDATED CIRCUIT PANEL DIRECTORIES FOR ALL PANELS THAT CONTAIN CIRCUITS IMPACTED BY THIS PROJECT.
5. CONTRACTOR SHALL PROVIDE PULL BOXES FOR ALL FEEDERS WHERE FEEDER RUNS EXCEED 250FT OR HAVE MORE THAN 270 DEGREES OF TOTAL BEND. PULLBOX PLACEMENT AND SIZING BY CONTACTOR. COORDINATE PULLBOX LOCATIONS WITH ALL OBSTRUCTIONS, TRADES, AND VA AS REQUIRED.
6. REFERENCE CORRESPONDING ONE-LINE DIAGRAM FOR ADDITIONAL INFORMATION.

KEY NOTES

1. PROVIDE ROOFTOP STRUT CHANNEL SUPPORT FOR MECHANICAL EQUIPMENT RACEWAYS, SUPPORT SPACING SHALL BE PER NEC; AVOID TRIPPING HAZARDS. STRUT CHANNEL SHALL BE HOT-DIPPED GALVANIZED; ALL FASTENING HARDWARE SHALL BE STAINLESS STEEL.

KEY PLAN

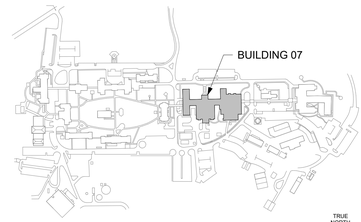

1 - BLDG 07 - PENTHOUSE - OVERALL FLOOR PLAN

1/16" = 1'-0"

PROJECT NORTH

0 8' 16' 32'

Revisions:	Date:

CONSULTANT/ DISCIPLINE

DISCIPLINE:

ARCHITECT/ ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HIGHWAY S. SUITE 300
KENT, WA 98032

SPEESDESIGNBUILD

STAMP

LOUIS R. LUTZKO — STATE OF WASHINGTON — 15508 — 3-24-24 — REGISTERED PROFESSIONAL ENGINEER

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: BLDG 07 - PENTHOUSE - OVERALL FLOOR PLAN	Phase: 100% CONSTRUCTION DOCUMENTS
Approved:	FULLY SPRINKLERED

Project Title: REPLACE ELEVATORS IN BLDG 07 & BLDG 09			Project Number: 502-24-102
			Building Number: 07
Location: ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA			Drawing Number: E-101
Issue Date: 03/24/2026	Checked: DCW/NVP	Drawn: JNV/GPB	

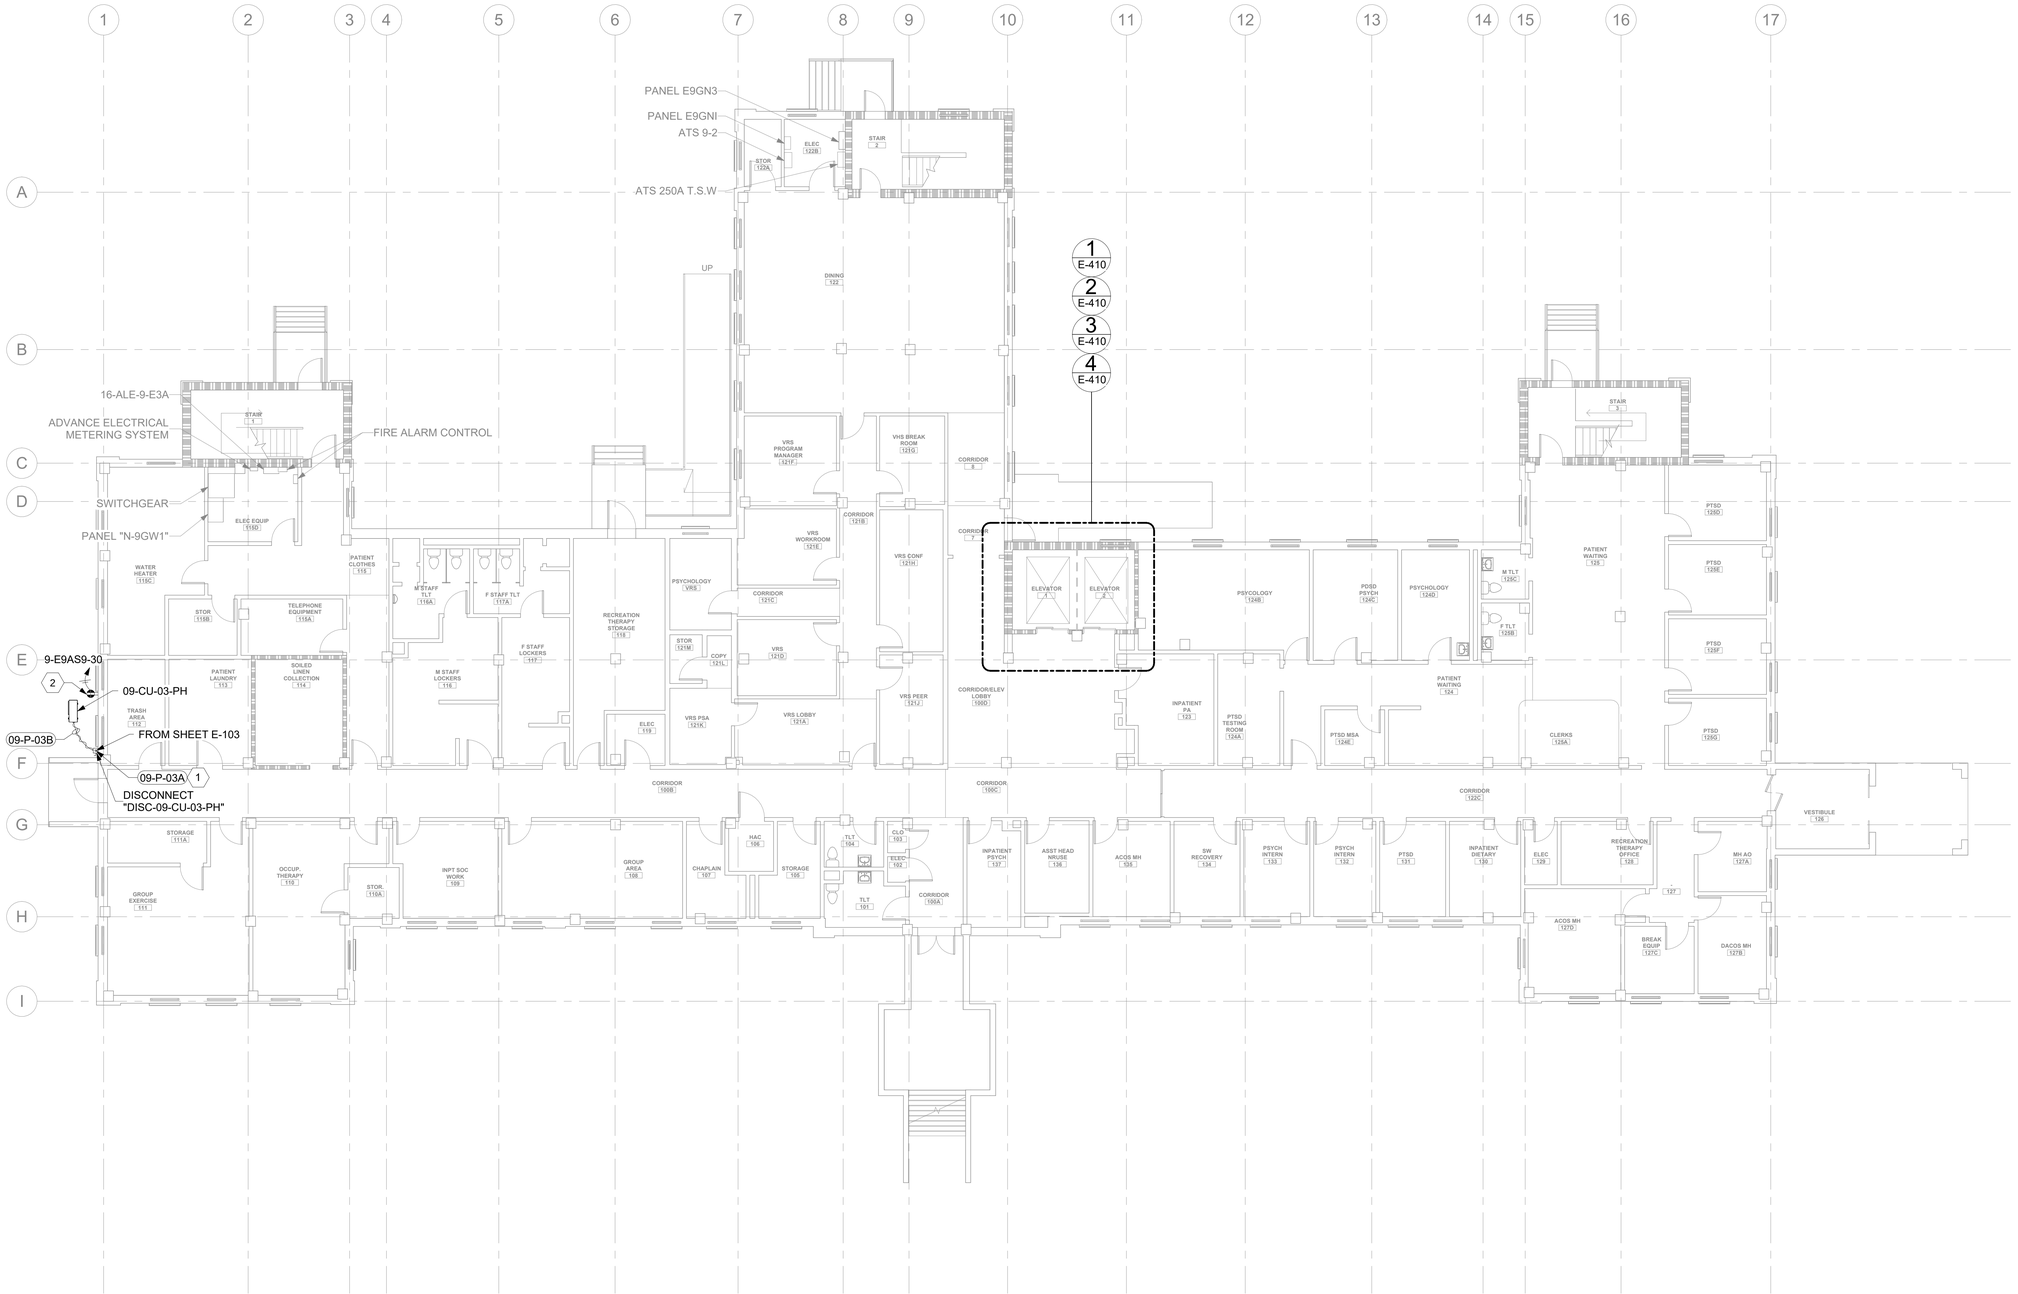

GENERAL NOTES

1. ALL EXISTING EQUIPMENT MAY NOT BE SHOWN FOR CLARITY. CONTRACTOR SHALL FIELD VERIFY ALL POWER, LIGHTING AND ASSOCIATED CIRCUITRY AS REQUIRED. ALL RACEWAYS AND CONDUCTORS ASSOCIATED WITH EQUIPMENT TO BE DEMOLISHED SHALL BE DEMOLISHED BACK TO THEIR SOURCE, UNLESS OTHERWISE NOTED.
2. CONTRACTOR SHALL PROVIDE UPDATED CIRCUIT PANEL DIRECTORIES FOR ALL PANELS THAT CONTAIN CIRCUITS IMPACTED BY THIS PROJECT.
3. SEAL ALL INTERIOR WALL AND CEILING PENETRATIONS TO MATCH EXISTING FIRE RATING OR NEW FIRE RATING; PROVIDE CORE DRILLING AS REQUIRED. COORDINATE WITH ARCHITECTURAL AND STRUCTURAL DRAWINGS AS REQUIRED.
4. CONTRACTOR SHALL PROVIDE UPDATED CIRCUIT PANEL DIRECTORIES FOR ALL PANELS THAT CONTAIN CIRCUITS IMPACTED BY THIS PROJECT.
5. CONTRACTOR SHALL PROVIDE PULL BOXES FOR ALL FEEDERS WHERE FEEDER RUNS EXCEED 250FT OR HAVE MORE THAN 270 DEGREES OF TOTAL BEND. PULLBOX PLACEMENT AND SIZING BY CONTACTOR. COORDINATE PULLBOX LOCATIONS WITH ALL OBSTRUCTIONS, TRADES, AND VA AS REQUIRED.
6. REFERENCE CORRESPONDING ONE-LINE DIAGRAM FOR ADDITIONAL INFORMATION.

KEY NOTES

1. ROUTE CONDUIT ALONG SIDE MECHANICAL PIPING UP TO PENTHOUSE LEVEL. REFERENCE MECHANICAL DRAWINGS FOR ADDITIONAL INFORMATION.
2. PROVIDE CONVENIENCE RECEPTACLE, 20A, 120V, GFCI, WP, WITH WHILE IN-USE COVER.

KEY PLAN

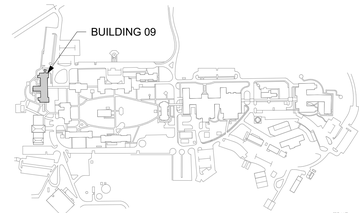

1 - BLDG 09 - LEVEL 01 - OVERALL FLOOR PLAN

1/8" = 1'-0"

PROJECT NORTH

0 4' 8' 16'

Revisions:	Date:

CONSULTANT/ DISCIPLINE

DISCIPLINE:

ARCHITECT/ ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HIGHWAY S. SUITE 300
KENT, WA 98032

SDB SPEESDESIGNBUILD

STAMP

LOUIS R. LITZKE — STATE OF WASHINGTON — 55681 — 3-24-26 — REGISTERED PROFESSIONAL ENGINEER

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title	BLDG 09 - LEVEL 01 - OVERALL FLOOR PLAN
Phase	100% CONSTRUCTION DOCUMENTS
Approved:	
	FULLY SPRINKLERED
Project Title	REPLACE ELEVATORS IN BLDG 07 & BLDG 09
Project Number	502-24-102
Building Number	09
Location	ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA
Drawing Number	E-102
Issue Date	03/24/2026
Checked	DCW/NVP
Drawn	JNV/GPB

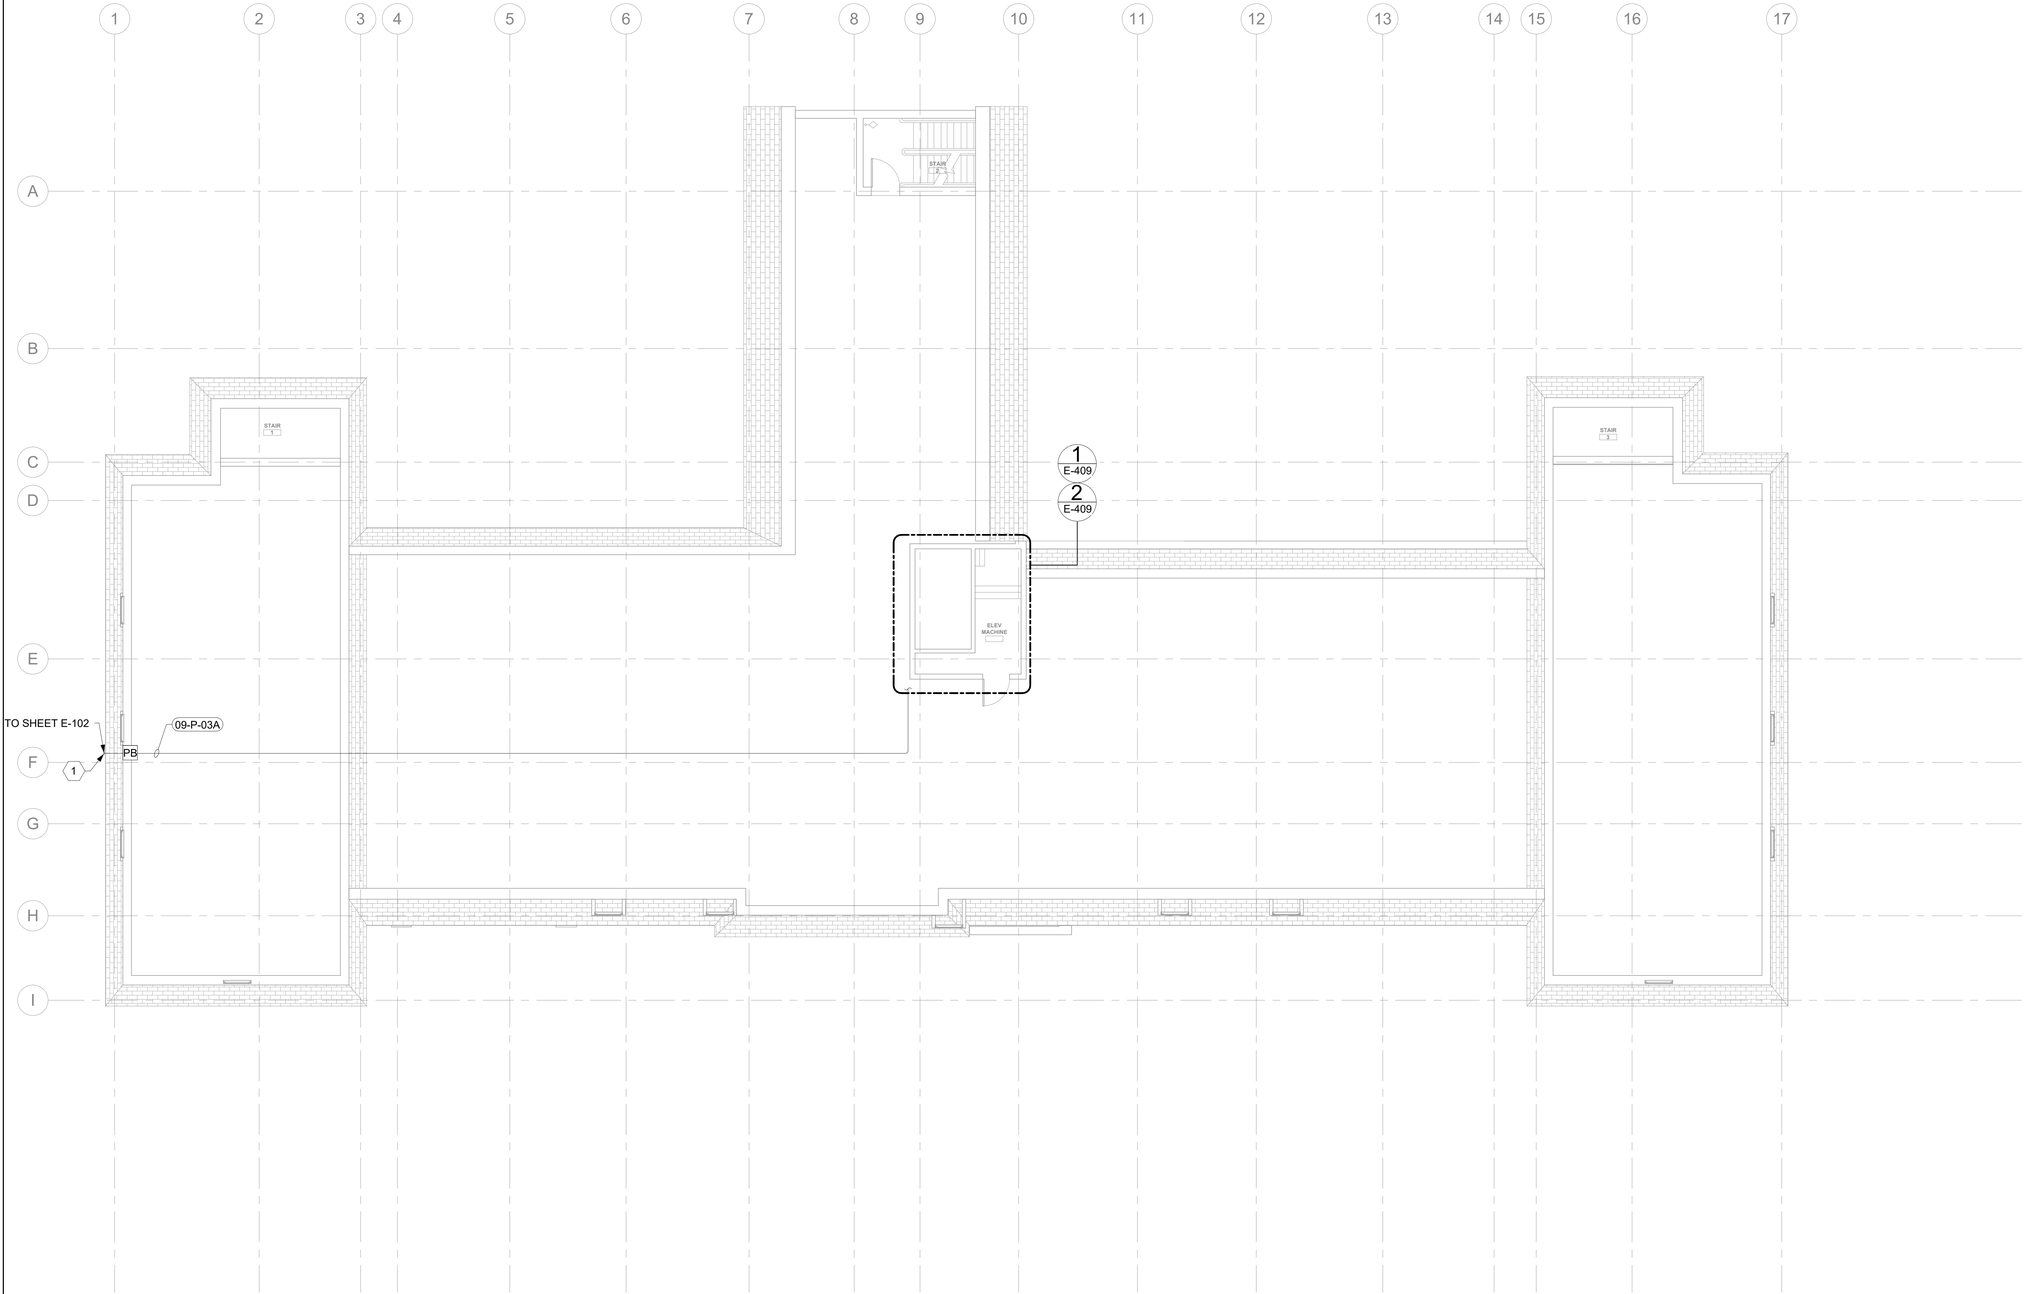

GENERAL NOTES

1. ALL EXISTING EQUIPMENT MAY NOT BE SHOWN FOR CLARITY. CONTRACTOR SHALL FIELD VERIFY ALL POWER, LIGHTING AND ASSOCIATED CIRCUITRY AS REQUIRED. ALL RACEWAYS AND CONDUCTORS ASSOCIATED WITH EQUIPMENT TO BE DEMOLISHED SHALL BE DEMOLISHED BACK TO THEIR SOURCE, UNLESS OTHERWISE NOTED.
2. CONTRACTOR SHALL PROVIDE UPDATED CIRCUIT PANEL DIRECTORIES FOR ALL PANELS THAT CONTAIN CIRCUITS IMPACTED BY THIS PROJECT.
3. SEAL ALL INTERIOR WALL AND CEILING PENETRATIONS TO MATCH EXISTING FIRE RATING OR NEW FIRE RATING; PROVIDE CORE DRILLING AS REQUIRED. COORDINATE WITH ARCHITECTURAL AND STRUCTURAL DRAWINGS AS REQUIRED.
4. CONTRACTOR SHALL PROVIDE UPDATED CIRCUIT PANEL DIRECTORIES FOR ALL PANELS THAT CONTAIN CIRCUITS IMPACTED BY THIS PROJECT.
5. CONTRACTOR SHALL PROVIDE PULL BOXES FOR ALL FEEDERS WHERE FEEDER RUNS EXCEED 250FT OR HAVE MORE THAN 270 DEGREES OF TOTAL BEND. PULLBOX PLACEMENT AND SIZING BY CONTACTOR. COORDINATE PULLBOX LOCATIONS WITH ALL OBSTRUCTIONS, TRADES, AND VA AS REQUIRED.
6. REFERENCE CORRESPONDING ONE-LINE DIAGRAM FOR ADDITIONAL INFORMATION.

KEY NOTES

1 ROUTE CONDUIT ALONG SIDE MECHANICAL PIPING DOWN TO GROUND LEVEL. REFERENCE MECHANICAL DRAWINGS FOR ADDITIONAL INFORMATION.

KEY PLAN

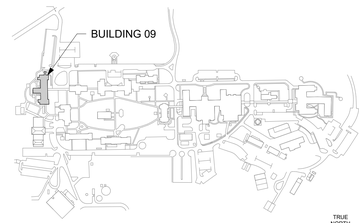

1 / – BLDG 09 - PENTHOUSE - OVERALL FLOOR PLAN

1/8" = 1'-0"

PROJECT NORTH

0 4" 8" 16"

Revisions:	Date:

CONSULTANT/ DISCIPLINE

DISCIPLINE:

ARCHITECT/ ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HIGHWAY S. SUITE 300
KENT, WA 98032

SDB SPEESDESIGNBUILD

STAMP

LOUIS R. LITZKE — STATE OF WASHINGTON — 55681 — 3-24-26 — REGISTERED PROFESSIONAL ENGINEER

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: BLDG 09 - PENTHOUSE - OVERALL FLOOR PLAN	Phase: 100% CONSTRUCTION DOCUMENTS
Approved:	FULLY SPRINKLERED

Project Title: REPLACE ELEVATORS IN BLDG 07 & BLDG 09		Project Number: 502-24-102
		Building Number: 09
Location: ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA		Drawing Number: E-103
Issue Date: 03/24/2026	Checked: DCW/NVP	Drawn: JNV/GPB

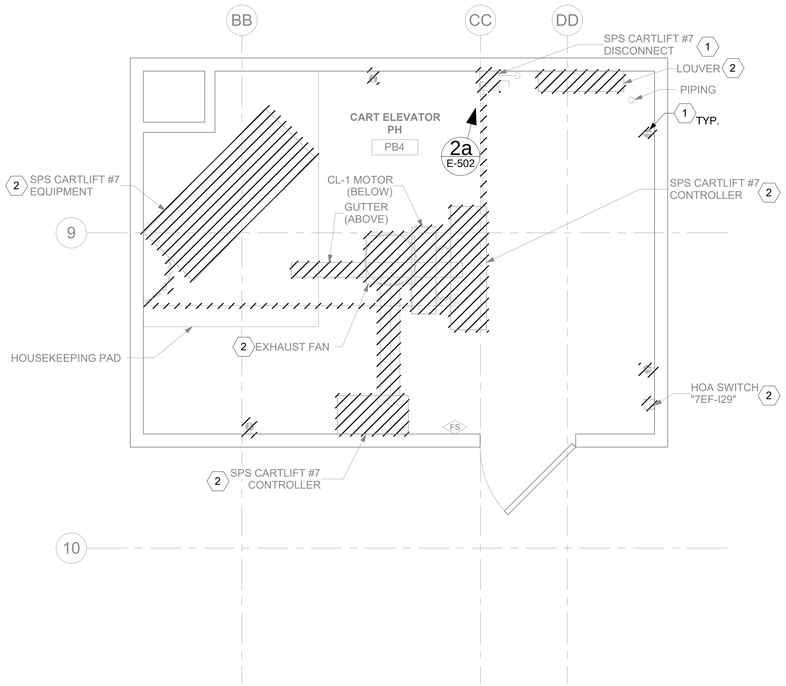

1 E-101 RM PB4 - DEMOLITION ELECTRICAL PLAN

1/2" = 1'-0"

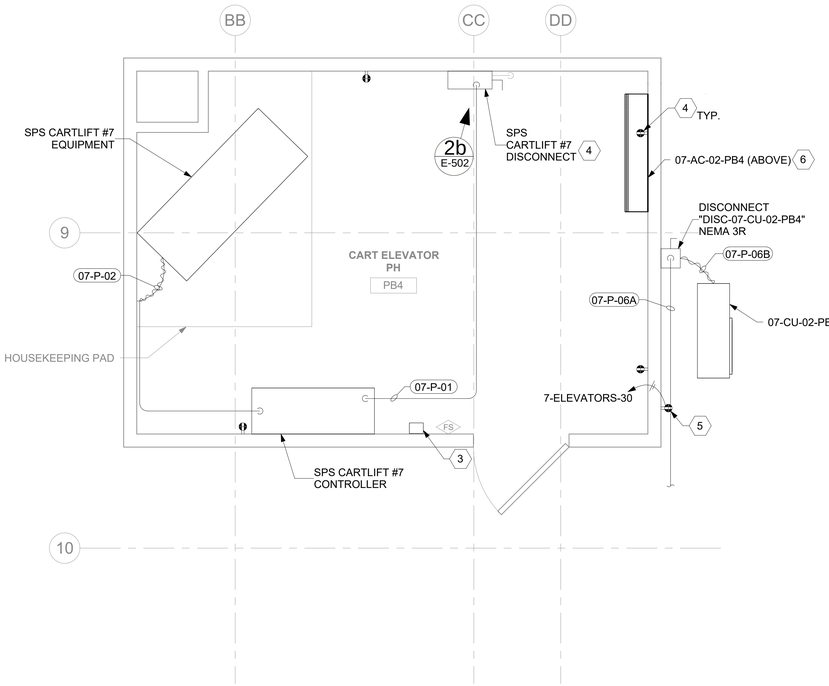

2 E-101 RM PB4 - ELECTRICAL PLAN

1/2" = 1'-0"

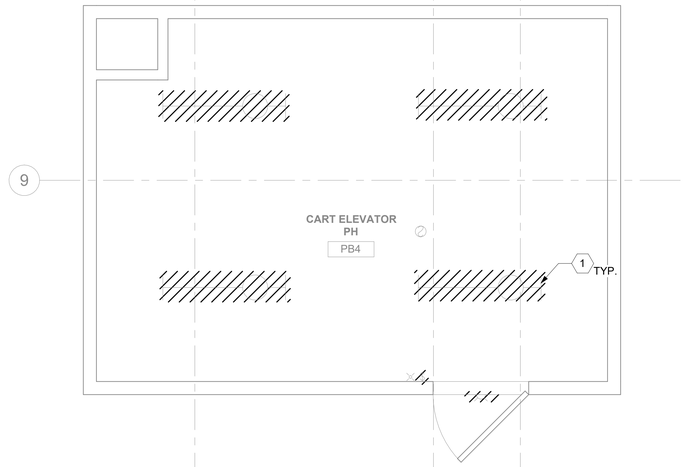

3 E-101 RM PB4 - DEMOLITION LIGHTING PLAN

1/2" = 1'-0"

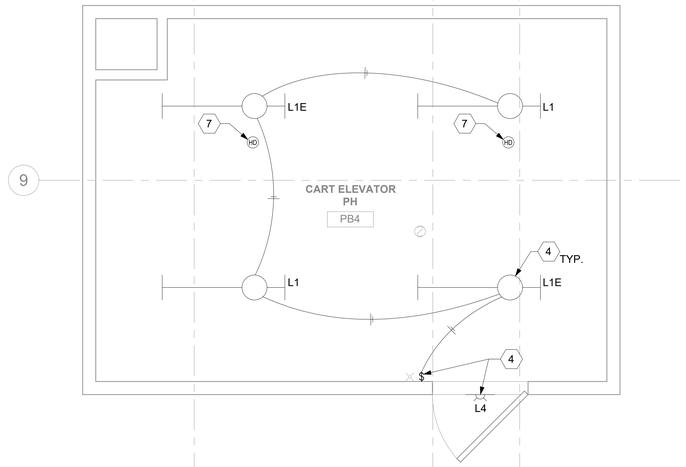

4 E-101 RM PB4 - LIGHTING PLAN

1/2" = 1'-0"

GENERAL NOTES

1. DRAWINGS ARE BASED ON SITE INVESTIGATIONS AND RECORD DRAWINGS. IF DISCREPANCIES ARE FOUND THAT MAY IMPACT WORK, PROMPTLY NOTIFY VA AND ENGINEER OF SAID DISCREPANCY.
2. ALL EXISTING EQUIPMENT MAY NOT BE SHOWN FOR CLARITY. CONTRACTOR SHALL FIELD VERIFY ALL POWER, LIGHTING AND ASSOCIATED CIRCUITRY AS REQUIRED. ALL RACEWAYS AND CONDUCTORS ASSOCIATED WITH EQUIPMENT TO BE DEMOLISHED SHALL BE DEMOLISHED BACK TO THEIR SOURCE, UNLESS OTHERWISE NOTED.
3. CONTRACTOR SHALL DEMOLISH ALL ELECTRICAL EQUIPMENT, CONDUCTORS AND RACEWAYS ASSOCIATED WITH WALLS BEING REMOVED, AND IN ALL LOCATIONS WHERE JUNCTION BOXES WILL NOT REMAIN ACCESSIBLE AFTER INSTALLATION, UNLESS OTHERWISE NOTED.
4. ALL RECEPTACLES AND SWITCHES SHALL BE PROVIDED WITH PANEL AND CIRCUIT LABELING LOCATED DIRECTLY ON THE WALL PLATE; IE."P4-1", PANEL "4", CIRCUIT "1". REFERENCE WIRING DEVICE SPECIFICATIONS FOR ADDITIONAL INFORMATION.
5. SEAL ALL INTERIOR WALL AND CEILING PENETRATIONS TO MATCH EXISTING FIRE RATING OR NEW FIRE RATING; PROVIDE CORE DRILLING AS REQUIRED. COORDINATE WITH ARCHITECTURAL AND STRUCTURAL DRAWINGS AS REQUIRED.
6. REFERENCE CORRESPONDING ONE-LINE DIAGRAM FOR ADDITIONAL INFORMATION.
7. CONTRACTOR SHALL PROVIDE UPDATED CIRCUIT PANEL DIRECTORIES FOR ALL PANELS THAT CONTAIN CIRCUITS IMPACTED BY THIS PROJECT.
8. CONTRACTOR SHALL PROVIDE PULL BOXES FOR ALL FEEDERS WHERE FEEDER RUNS EXCEED 250FT OR HAVE MORE THAN 270 DEGREES OF TOTAL BEND. PULL BOX PLACEMENT AND SIZING BY CONTRACTOR. COORDINATE PULL BOX LOCATIONS WITH ALL OBSTRUCTIONS, TRADES, AND VA AS REQUIRED.

KEY NOTES

1. EXISTING EQUIPMENT SHALL BE DEMOLISHED AND REPLACED. PRESERVE EXISTING FEEDER FOR RETERMINATION.
2. EXISTING EQUIPMENT SHALL BE DEMOLISHED. DEMOLISH RACEWAYS AND CONDUCTORS BACK TO SOURCE.
3. PROVIDE (6) ELEVATOR CONTROL RELAY JUNCTION BOXES (MINIMUM) AND REQUIRED CONDUIT AND WIRING FOR ELEVATOR AND FIRE ALARM SYSTEM INTERFACING. JUNCTION BOXES SHALL PROVIDE INTERFACING RECALLS AND APPURTENANCES REQUIRED TO PERFORM ALL REQUIRED FUNCTIONS INCLUDING, BUT NOT LIMITED TO, THE FOLLOWING: PRIMARY, ALTERNATE, MACHINE ROOM, HOIST WAY, CAR VISUAL, AND SHUNT TRIP. COORDINATE WITH ELEVATOR MANUFACTURER, INSTALLER, AND AHJ FOR A COMPLETE AND FULLY FUNCTIONAL SYSTEM AS REQUIRED.
4. UTILIZE EXISTING CIRCUITRY TO PROVIDE REPLACEMENT EQUIPMENT AS INDICATED. EXTEND CONDUIT AND WIRE AS REQUIRED.
5. PROVIDE CONVENIENCE RECEPTACLE, 20A,120V, GFCI, WP, WITH WHILE-IN-USE COVER.
6. INTERIOR MECHANICAL UNIT(S) POWERED FROM ASSOCIATED EXTERIOR UNIT. PROVIDE CONDUIT AND WIRE PER MANUFACTURER'S REQUIREMENTS. REFERENCE MECHANICAL DRAWINGS AND COORDINATE WITH MECHANICAL CONTRACTOR AS REQUIRED. PROVIDE LOCAL DISCONNECT.
7. PROVIDE HEAT DETECTORS AS INDICATED. HEAT DETECTOR SHALL BE MOUNTED 12 INCHES FROM SPRINKLER HEAD. CONTRACTOR SHALL FIELD VERIFY EXISTING FIRE ALARM MANUFACTURER AND PROVIDE COMPATIBLE HEAT DETECTOR. EXTEND EXISTING CONDUIT AND WIRE AS REQUIRED TO INTEGRATE INTO FIRE ALARM SYSTEM.

KEY PLAN



Revisions:	Date:

CONSULTANT/ DISCIPLINE

DISCIPLINE:

ARCHITECT/ ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HIGHWAY S. SUITE 300
KENT, WA 98032
SDB SPEESDESIGNBUILD

STAMP

LOUIS R. LITZAU — STATE OF WASHINGTON — 55681 — 3-24-26 — REGISTERED PROFESSIONAL ENGINEER

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title BLDG 07 - PENTHOUSE - ENLARGED ELECTRICAL PLANS	**Phase** 100% CONSTRUCTION DOCUMENTS
Approved:	FULLY SPRINKLERED

Project Title REPLACE ELEVATORS IN BLDG 07 & BLDG 09	**Project Number** 502-24-102
	Building Number 07
Location ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA	**Drawing Number** E-401
Issue Date 03/24/2026 / **Checked** DCW/NVP / **Drawn** JNV/GPB	

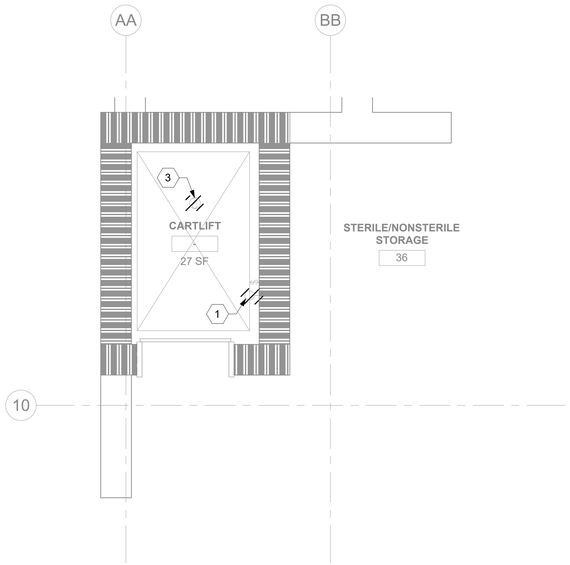

1 E-100 CARLIFT - DEMOLITION HOISTWAY ELECTRICAL PLAN

1/2" = 1'-0"

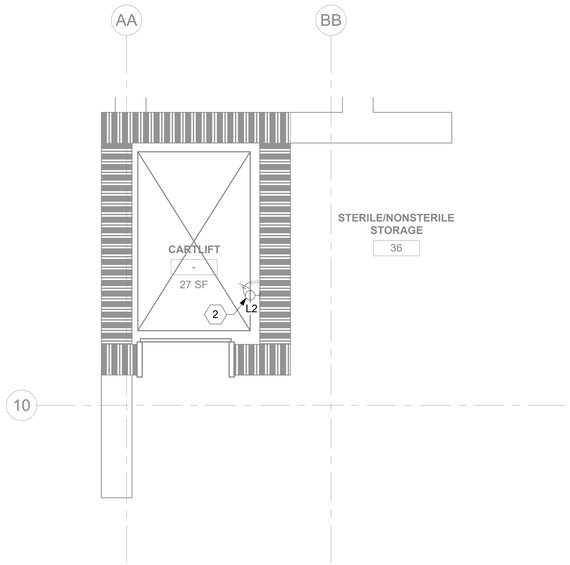

2 E-100 CARLIFT - HOISTWAY ELECTRICAL PLAN

1/2" = 1'-0"

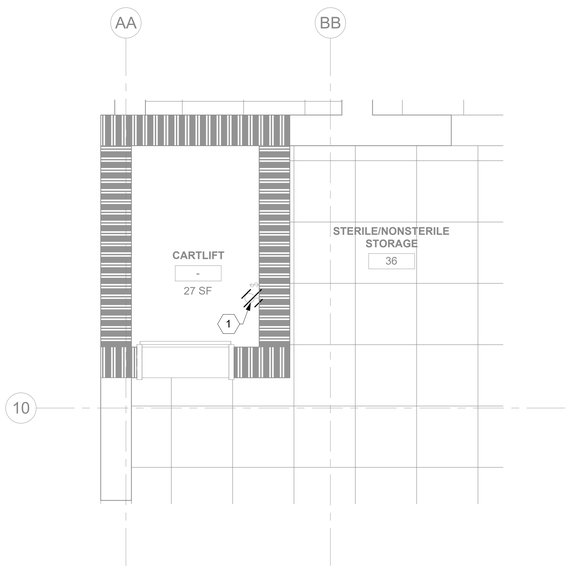

3 E-100 CARLIFT - DEMOLITION PIT LIGHTING PLAN

1/2" = 1'-0"

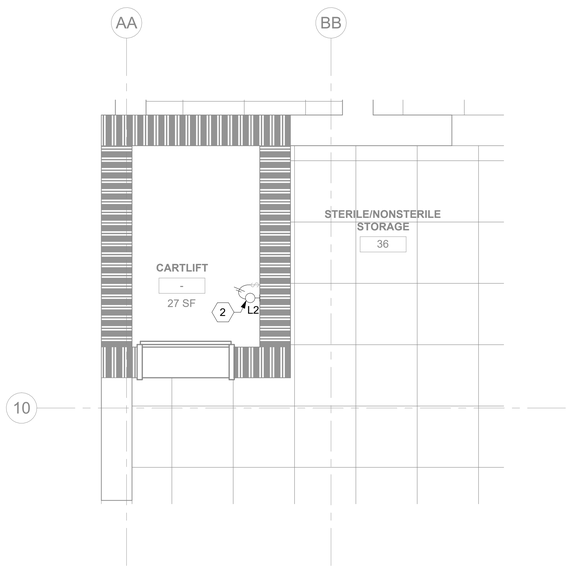

4 E-100 CARLIFT - PIT LIGHTING PLAN

1/2" = 1'-0"

GENERAL NOTES

1. DRAWINGS ARE BASED ON SITE INVESTIGATIONS AND RECORD DRAWINGS. IF DISCREPANCIES ARE FOUND THAT MAY IMPACT WORK, PROMPTLY NOTIFY VA AND ENGINEER OF SAID DISCREPANCY.
2. ALL EXISTING EQUIPMENT MAY NOT BE SHOWN FOR CLARITY. CONTRACTOR SHALL FIELD VERIFY ALL POWER, LIGHTING AND ASSOCIATED CIRCUITRY AS REQUIRED. ALL RACEWAYS AND CONDUCTORS ASSOCIATED WITH EQUIPMENT TO BE DEMOLISHED SHALL BE DEMOLISHED BACK TO THEIR SOURCE, UNLESS OTHERWISE NOTED.
3. CONTRACTOR SHALL DEMOLISH ALL ELECTRICAL EQUIPMENT, CONDUCTORS AND RACEWAYS ASSOCIATED WITH WALLS BEING REMOVED, AND IN ALL LOCATIONS WHERE JUNCTION BOXES WILL NOT REMAIN ACCESSIBLE AFTER INSTALLATION, UNLESS OTHERWISE NOTED.
4. ALL RECEPTACLES AND SWITCHES SHALL BE PROVIDED WITH PANEL AND CIRCUIT LABELING LOCATED DIRECTLY ON THE WALL PLATE; IE."P4-1", PANEL "4", CIRCUIT "1". REFERENCE WIRING DEVICE SPECIFICATIONS FOR ADDITIONAL INFORMATION.
5. SEAL ALL INTERIOR WALL AND CEILING PENETRATIONS TO MATCH EXISTING FIRE RATING OR NEW FIRE RATING; PROVIDE CORE DRILLING AS REQUIRED. COORDINATE WITH ARCHITECTURAL AND STRUCTURAL DRAWINGS AS REQUIRED.
6. REFERENCE CORRESPONDING ONE-LINE DIAGRAM FOR ADDITIONAL INFORMATION.
7. CONTRACTOR SHALL PROVIDE UPDATED CIRCUIT PANEL DIRECTORIES FOR ALL PANELS THAT CONTAIN CIRCUITS IMPACTED BY THIS PROJECT.
8. CONTRACTOR SHALL PROVIDE PULL BOXES FOR ALL FEEDERS WHERE FEEDER RUNS EXCEED 250FT OR HAVE MORE THAN 270 DEGREES OF TOTAL BEND. PULL BOX PLACEMENT AND SIZING BY CONTRACTOR. COORDINATE PULL BOX LOCATIONS WITH ALL OBSTRUCTIONS, TRADES, AND VA AS REQUIRED.

KEY NOTES

1. EXISTING EQUIPMENT SHALL BE DEMOLISHED AND REPLACED. PRESERVE CIRCUITING FOR RETERMINATION.
2. PROVIDE LUMINAIRE AS INDICATED. EXTEND EXISTING CONDUIT AND WIRE AS REQUIRED.
3. EXISTING SMOKE DETECTOR LOCATED AT TOP OF HOIST WAY SHALL BE DEMOLISHED. EXISTING RACEWAYS AND CABLING SHALL BE DEMOLISHED BACK TO SOURCE.

KEY PLAN

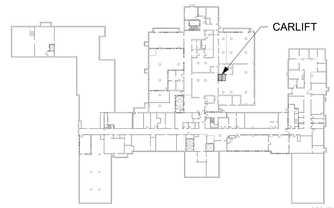

AREA SHOWN

Revisions:	Date:

CONSULTANT/ DISCIPLINE

DISCIPLINE:

ARCHITECT/ ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HIGHWAY S. SUITE 300
KENT, WA 98032

SPEESDESIGNBUILD

STAMP

LOUIS R. LITANO
STATE OF WASHINGTON
55681
3-24-26
REGISTERED PROFESSIONAL ENGINEER

Office of Construction and Facilities Management

U.S. Department of Veterans Affairs

Drawing Title BLDG 07 - BASEMENT - ENLARGED ELECTRICAL PLANS	**Phase** 100% CONSTRUCTION DOCUMENTS
Approved:	FULLY SPRINKLERED

Project Title REPLACE ELEVATORS IN BLDG 07 & BLDG 09			**Project Number** 502-24-102
			Building Number 07
Location ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA			**Drawing Number** E-402
Issue Date 03/24/2026	**Checked** DCW/NVP	**Drawn** JNV/GPB	

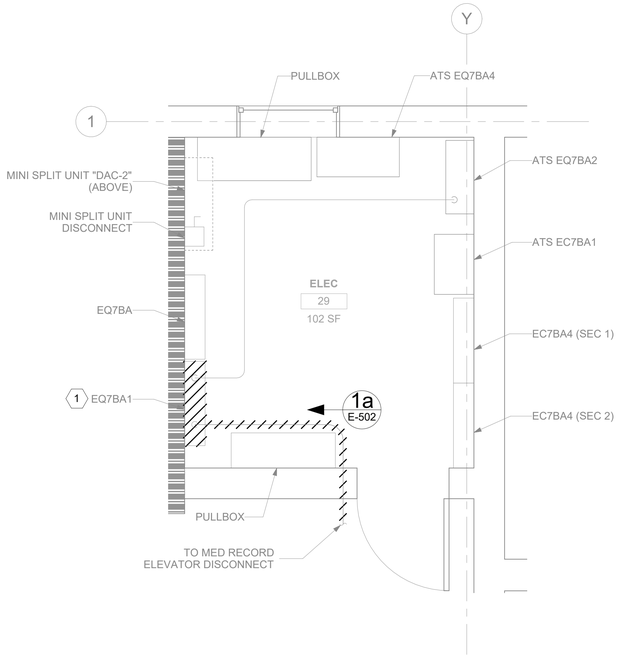

1 E-100 ELECTRICAL ROOM 29 - DEMOLITION PLAN

1/2" = 1'-0"

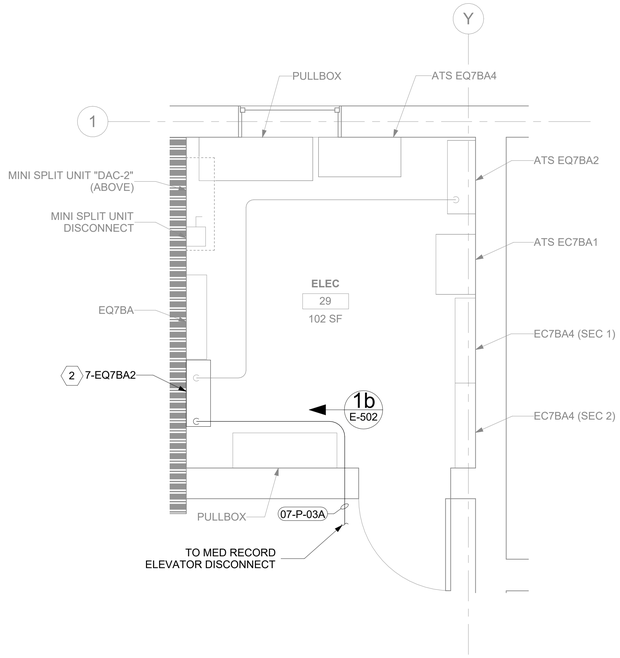

2 E-100 ELECTRICAL ROOM 29 - ELECTRICAL PLAN

1/2" = 1'-0"

GENERAL NOTES

1. DRAWINGS ARE BASED ON SITE INVESTIGATIONS AND RECORD DRAWINGS. IF DISCREPANCIES ARE FOUND THAT MAY IMPACT WORK, PROMPTLY NOTIFY VA AND ENGINEER OF SAID DISCREPANCY.
2. ALL EXISTING EQUIPMENT MAY NOT BE SHOWN FOR CLARITY. CONTRACTOR SHALL FIELD VERIFY ALL POWER, LIGHTING AND ASSOCIATED CIRCUITRY AS REQUIRED. ALL RACEWAYS AND CONDUCTORS ASSOCIATED WITH EQUIPMENT TO BE DEMOLISHED SHALL BE DEMOLISHED BACK TO THEIR SOURCE, UNLESS OTHERWISE NOTED.
3. CONTRACTOR SHALL DEMOLISH ALL ELECTRICAL EQUIPMENT, CONDUCTORS AND RACEWAYS ASSOCIATED WITH WALLS BEING REMOVED, AND IN ALL LOCATIONS WHERE JUNCTION BOXES WILL NOT REMAIN ACCESSIBLE AFTER INSTALLATION, UNLESS OTHERWISE NOTED.
4. ALL RECEPTACLES AND SWITCHES SHALL BE PROVIDED WITH PANEL AND CIRCUIT LABELING LOCATED DIRECTLY ON THE WALL PLATE; IE."P4-1", PANEL "4", CIRCUIT "1". REFERENCE WIRING DEVICE SPECIFICATIONS FOR ADDITIONAL INFORMATION.
5. SEAL ALL INTERIOR WALL AND CEILING PENETRATIONS TO MATCH EXISTING FIRE RATING OR NEW FIRE RATING; PROVIDE CORE DRILLING AS REQUIRED. COORDINATE WITH ARCHITECTURAL AND STRUCTURAL DRAWINGS AS REQUIRED.
6. REFERENCE CORRESPONDING ONE-LINE DIAGRAM FOR ADDITIONAL INFORMATION.
7. CONTRACTOR SHALL PROVIDE UPDATED CIRCUIT PANEL DIRECTORIES FOR ALL PANELS THAT CONTAIN CIRCUITS IMPACTED BY THIS PROJECT.
8. CONTRACTOR SHALL PROVIDE PULL BOXES FOR ALL FEEDERS WHERE FEEDER RUNS EXCEED 250FT OR HAVE MORE THAN 270 DEGREES OF TOTAL BEND. PULL BOX PLACEMENT AND SIZING BY CONTRACTOR. COORDINATE PULL BOX LOCATIONS WITH ALL OBSTRUCTIONS, TRADES, AND VA AS REQUIRED.

KEY NOTES

1. EXISTING PANELBOARD SHALL BE DEMOLISHED AND REPLACED. PRESERVE AND MAINTAIN EXISTING CIRCUITING FOR RETERMINATION INTO REPLACEMENT PANELBOARD.
2. PROVIDE REPLACEMENT PANELBOARD. PROVIDE CONDUIT AND WIRING AS REQUIRED TO RE-TERMINATE EXISTING CIRCUITING. PROVIDE ID PLACARD FOR REPLACMENT PANELBOARD TO READ AS FOLLOWS: "EQ7BA2". PRIOR TO PLACARD BEING MADE, CONTRACTOR SHALL CONFIRM WITH VA FOR NAMING CONVENTION.

KEY PLAN

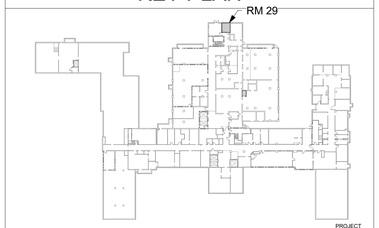

Revisions:	Date:

CONSULTANT/ DISCIPLINE

DISCIPLINE:

ARCHITECT/ ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HIGHWAY S. SUITE 300
KENT, WA 98032

SPEESDESIGNBUILD

STAMP

LOUIS R. LITZAU — STATE OF WASHINGTON — 55681 — 3-24-26 — REGISTERED PROFESSIONAL ENGINEER

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title
BLDG 07 - ELECTRICAL ROOM 29 - ENLARGED ELECTRICAL PLANS

Phase
100% CONSTRUCTION DOCUMENTS

Approved:

FULLY SPRINKLERED

Project Title
REPLACE ELEVATORS IN BLDG 07 & BLDG 09

Project Number
502-24-102

Building Number
07

Location
ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA

Drawing Number
E-403

Issue Date	Checked	Drawn
03/24/2026	DCW/NVP	JNV/GPB

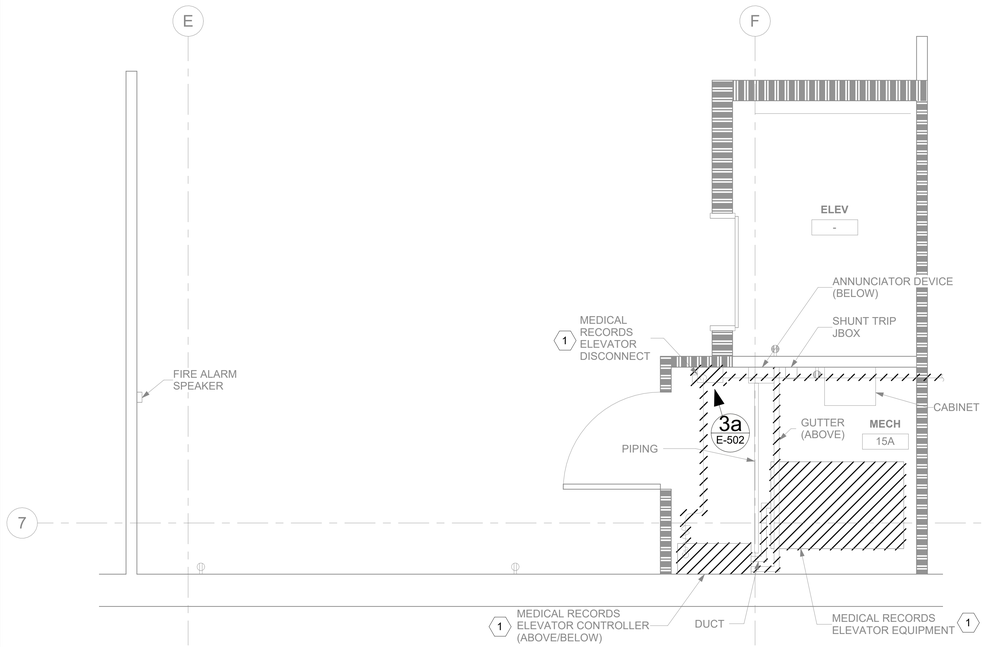

1 E-100 RM 15A - DEMOLITION ELECTRICAL PLAN

1/2" = 1'-0"

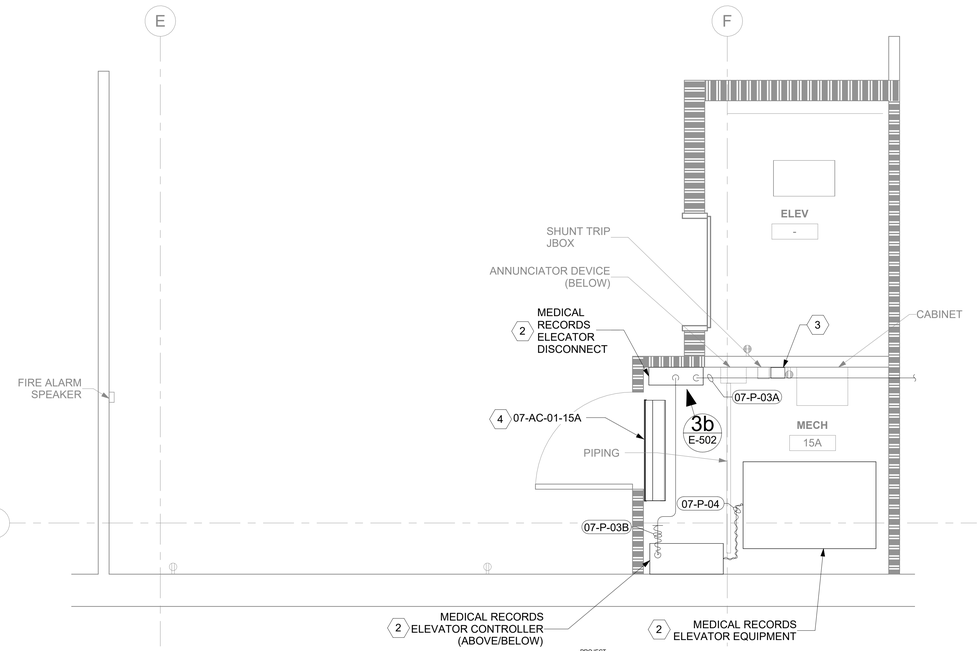

2 E-100 RM 15A - ELECTRICAL PLAN

1/2" = 1'-0"

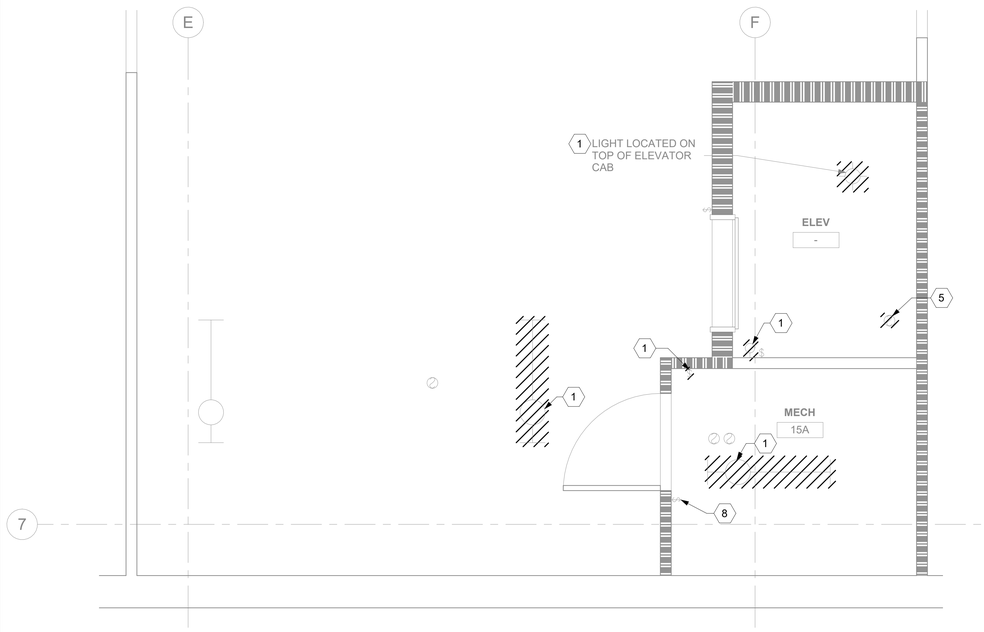

3 E-100 RM 15A - DEMOLITION LIGHTING PLAN

1/2" = 1'-0"

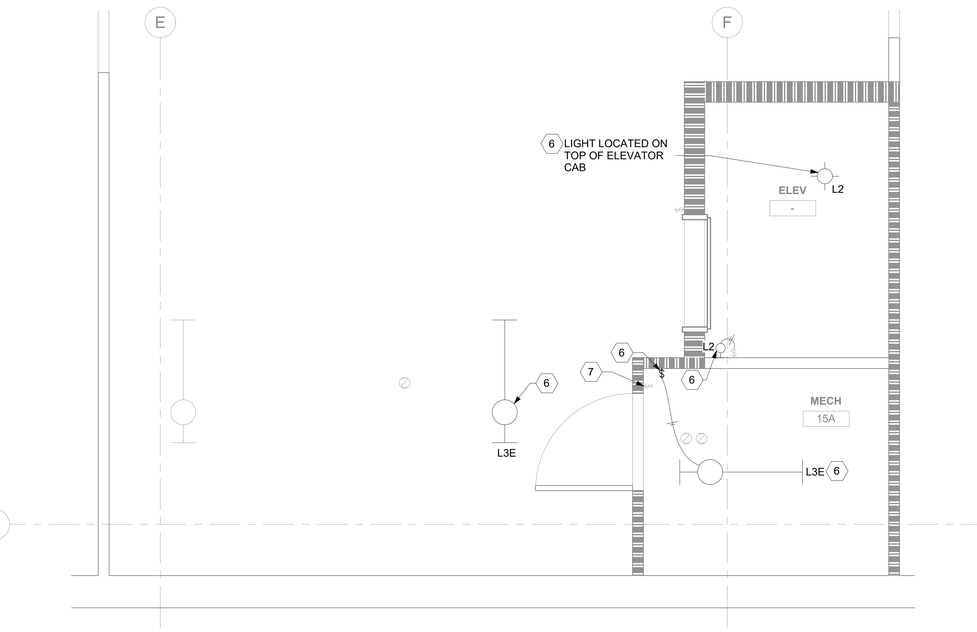

4 E-100 RM 15A - LIGHTING PLAN

1/2" = 1'-0"

GENERAL NOTES

1. DRAWINGS ARE BASED ON SITE INVESTIGATIONS AND RECORD DRAWINGS. IF DISCREPANCIES ARE FOUND THAT MAY IMPACT WORK, PROMPTLY NOTIFY VA AND ENGINEER OF SAID DISCREPANCY.
2. ALL EXISTING EQUIPMENT MAY NOT BE SHOWN FOR CLARITY. CONTRACTOR SHALL FIELD VERIFY ALL POWER, LIGHTING AND ASSOCIATED CIRCUITRY AS REQUIRED. ALL RACEWAYS AND CONDUCTORS ASSOCIATED WITH EQUIPMENT TO BE DEMOLISHED SHALL BE DEMOLISHED BACK TO THEIR SOURCE, UNLESS OTHERWISE NOTED.
3. CONTRACTOR SHALL DEMOLISH ALL ELECTRICAL EQUIPMENT, CONDUCTORS AND RACEWAYS ASSOCIATED WITH WALLS BEING REMOVED, AND IN ALL LOCATIONS WHERE JUNCTION BOXES WILL NOT REMAIN ACCESSIBLE AFTER INSTALLATION, UNLESS OTHERWISE NOTED.
4. ALL RECEPTACLES AND SWITCHES SHALL BE PROVIDED WITH PANEL AND CIRCUIT LABELING LOCATED DIRECTLY ON THE WALL PLATE; IE."P4-1", PANEL "4", CIRCUIT "1". REFERENCE WIRING DEVICE SPECIFICATIONS FOR ADDITIONAL INFORMATION.
5. SEAL ALL INTERIOR WALL AND CEILING PENETRATIONS TO MATCH EXISTING FIRE RATING OR NEW FIRE RATING; PROVIDE CORE DRILLING AS REQUIRED. COORDINATE WITH ARCHITECTURAL AND STRUCTURAL DRAWINGS AS REQUIRED.
6. REFERENCE CORRESPONDING ONE-LINE DIAGRAM FOR ADDITIONAL INFORMATION.
7. CONTRACTOR SHALL PROVIDE UPDATED CIRCUIT PANEL DIRECTORIES FOR ALL PANELS THAT CONTAIN CIRCUITS IMPACTED BY THIS PROJECT.
8. CONTRACTOR SHALL PROVIDE PULL BOXES FOR ALL FEEDERS WHERE FEEDER RUNS EXCEED 250FT OR HAVE MORE THAN 270 DEGREES OF TOTAL BEND. PULL BOX PLACEMENT AND SIZING BY CONTRACTOR. COORDINATE PULL BOX LOCATIONS WITH ALL OBSTRUCTIONS, TRADES, AND VA AS REQUIRED.

KEY NOTES

1. EXISTING EQUIPMENT SHALL BE DEMOLISHED AND REPLACED. PRESERVE CIRCUITING FOR RETERMINATION.
2. PROVIDE REPLACEMENT ELEVATOR EQUIPMENT. MAKE ALL CONNECTIONS PER MANUFACTURER REQUIREMENTS.
3. PROVIDE (6) ELEVATOR CONTROL RELAY JUNCTION BOXES (MINIMUM) AND REQUIRED CONDUIT AND WIRING FOR ELEVATOR AND FIRE ALARM SYSTEM INTERFACING. JUNCTION BOXES SHALL PROVIDE INTERFACING RECALLS AND APPURTENANCES REQUIRED TO PERFORM ALL REQUIRED FUNCTIONS INCLUDING, BUT NOT LIMITED TO, THE FOLLOWING: PRIMARY, ALTERNATE, MACHINE ROOM, HOIST WAY, CAR VISUAL, AND SHUNT TRIP. COORDINATE WITH ELEVATOR MANUFACTURER, INSTALLER, AND AHJ FOR A COMPLETE AND FULLY FUNCTIONAL SYSTEM AS REQUIRED.
4. INTERIOR MECHANICAL UNIT(S) POWERED FROM ASSOCIATED EXTERIOR UNIT. PROVIDE MOTOR RATED DISCONNECT AND CONDUIT AND WIRE PER MANUFACTURER'S REQUIREMENTS. REFERENCE MECHANICAL DRAWINGS AND COORDINATE WITH MECHANICAL CONTRACTOR AS REQUIRED. PROVIDE LOCAL DISCONNECT.
5. EXISTING SMOKE DETECTOR LOCATED AT TOP OF HOIST WAY SHALL BE DEMOLISHED. EXISTING RACEWAYS AND CABLING SHALL BE DEMOLISHED BACK TO SOURCE.
6. PROVIDE REPLACEMENT LUMINAIRE / CONTROLS. EXTEND EXISTING CIRCUITRY AS REQUIRED.
7. RELOCATE LIGHT SWITCH AS INDICATED. EXTEND EXISTING CONDUIT AND WIRE AS REQUIRED.
8. EXISTING LIGHT SWITCH SHALL BE RELOCATED. PRESERVE CIRCUITING FOR RETERMINATION.

KEY PLAN

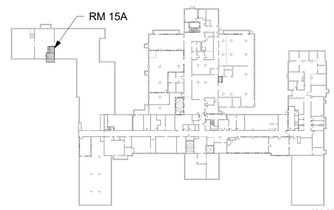

AREA SHOWN

Revisions:	Date:

CONSULTANT/ DISCIPLINE

DISCIPLINE:

ARCHITECT/ ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HIGHWAY S. SUITE 300
KENT, WA 98032

SPEESDESIGNBUILD

STAMP

LOUIS R. LITZKE — STATE OF WASHINGTON — 55681 — 3-24-26 — REGISTERED PROFESSIONAL ENGINEER

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title	BLDG 07 - BASEMENT - ENLARGED ELECTRICAL PLANS
Phase	100% CONSTRUCTION DOCUMENTS
Approved:	
	FULLY SPRINKLERED
Project Title	REPLACE ELEVATORS IN BLDG 07 & BLDG 09
Project Number	502-24-102
Building Number	07
Location	ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA
Drawing Number	E-404
Issue Date	03/24/2026
Checked	DCW/NVP
Drawn	JNV/GPB

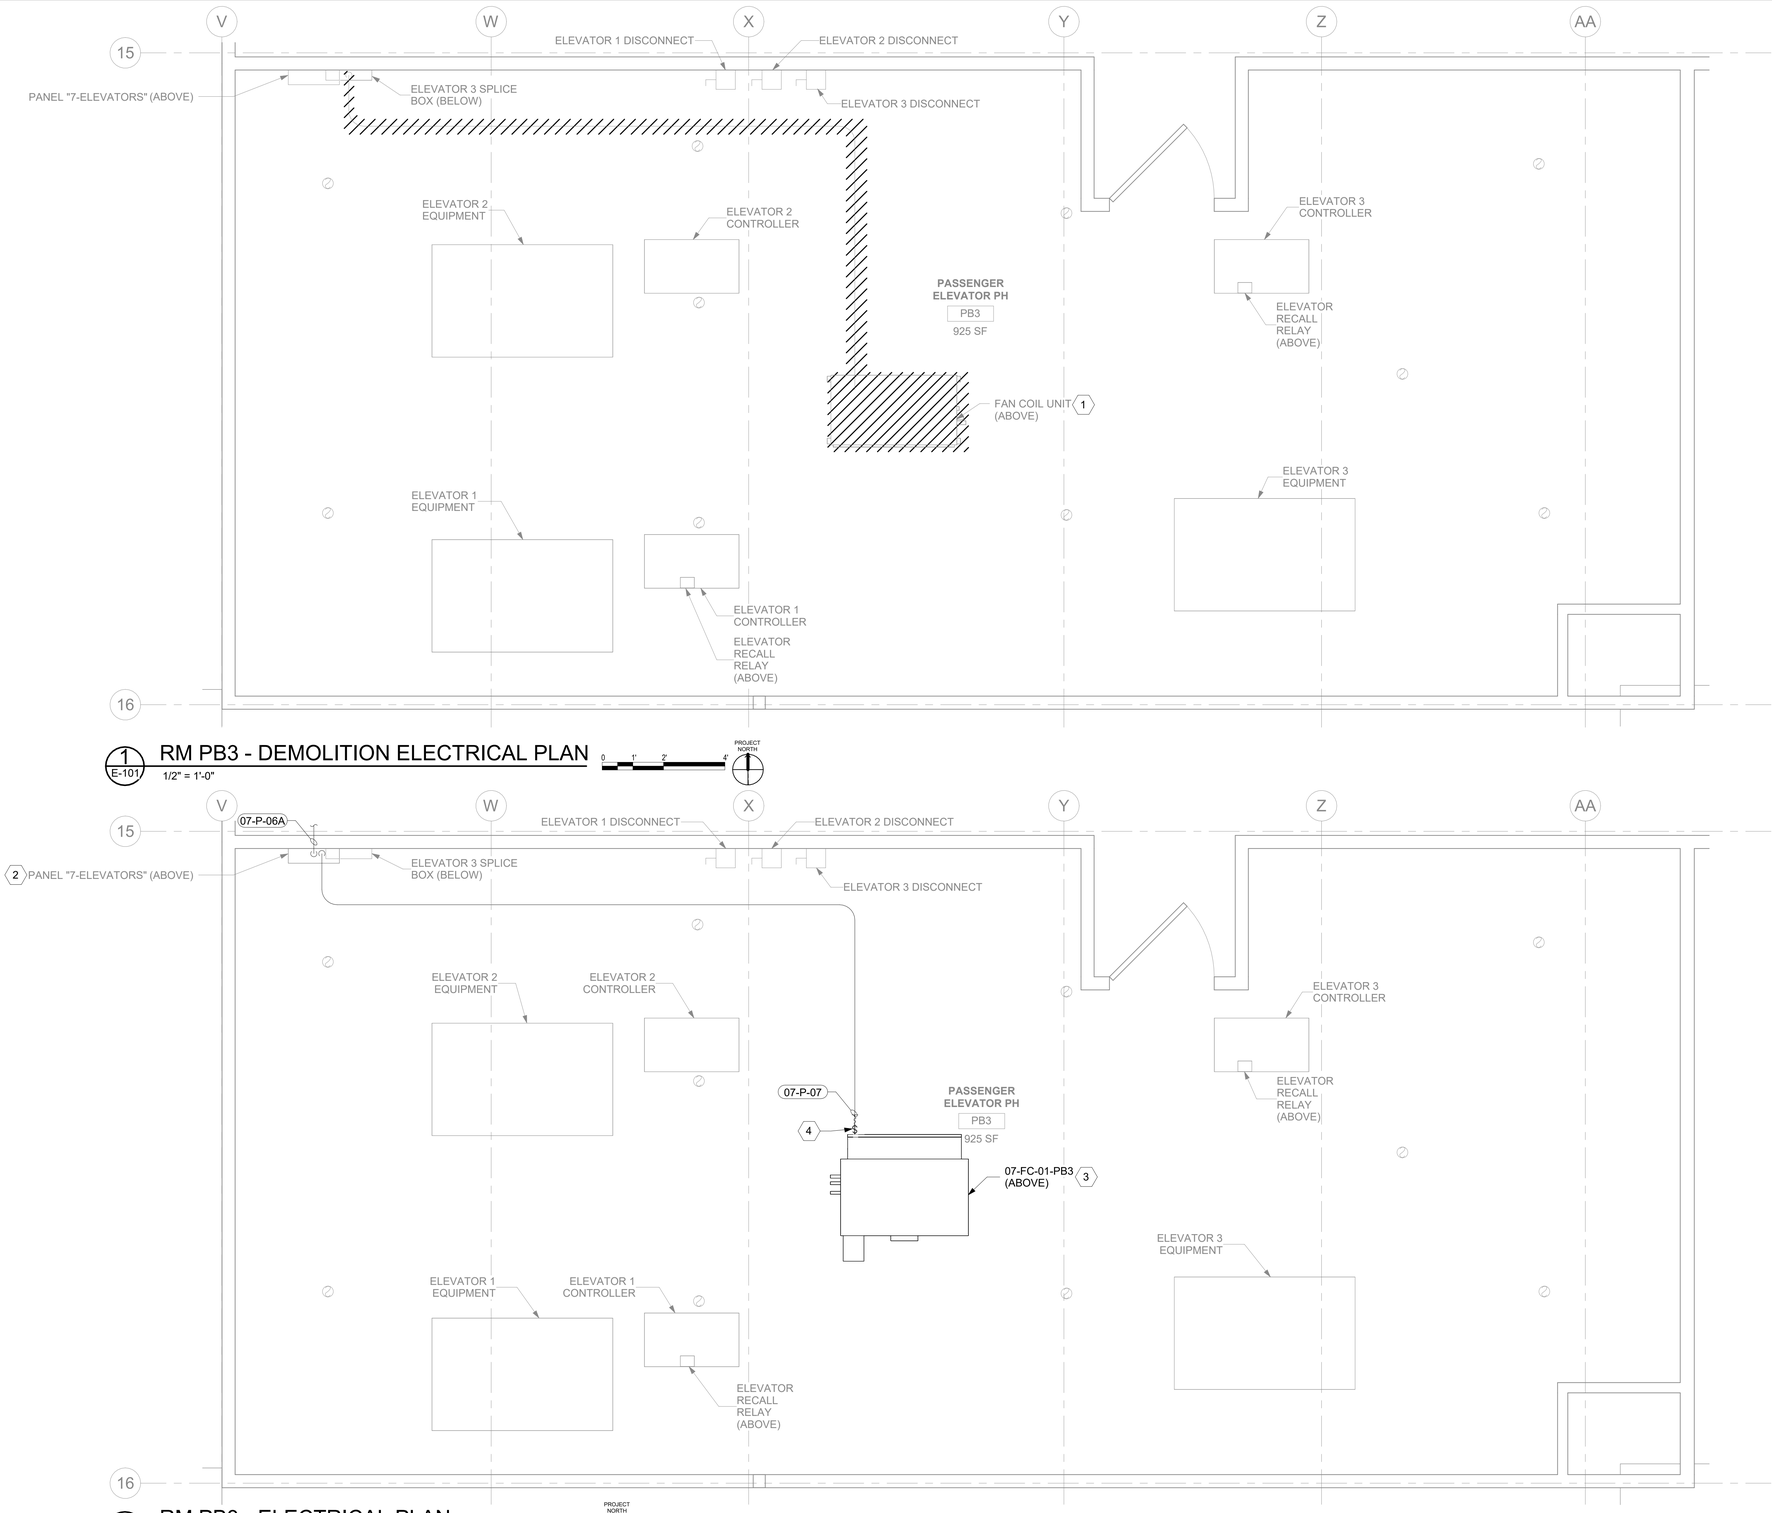

1 E-101 RM PB3 - DEMOLITION ELECTRICAL PLAN

1/2" = 1'-0"

2 E-101 RM PB3 - ELECTRICAL PLAN

1/2" = 1'-0"

GENERAL NOTES

1. DRAWINGS ARE BASED ON SITE INVESTIGATIONS AND RECORD DRAWINGS. IF DISCREPANCIES ARE FOUND THAT MAY IMPACT WORK, PROMPTLY NOTIFY VA AND ENGINEER OF SAID DISCREPANCY.
2. ALL EXISTING EQUIPMENT MAY NOT BE SHOWN FOR CLARITY. CONTRACTOR SHALL FIELD VERIFY ALL POWER, LIGHTING AND ASSOCIATED CIRCUITRY AS REQUIRED. ALL RACEWAYS AND CONDUCTORS ASSOCIATED WITH EQUIPMENT TO BE DEMOLISHED SHALL BE DEMOLISHED BACK TO THEIR SOURCE, UNLESS OTHERWISE NOTED.
3. CONTRACTOR SHALL DEMOLISH ALL ELECTRICAL EQUIPMENT, CONDUCTORS AND RACEWAYS ASSOCIATED WITH WALLS BEING REMOVED, AND IN ALL LOCATIONS WHERE JUNCTION BOXES WILL NOT REMAIN ACCESSIBLE AFTER INSTALLATION, UNLESS OTHERWISE NOTED.
4. ALL RECEPTACLES AND SWITCHES SHALL BE PROVIDED WITH PANEL AND CIRCUIT LABELING LOCATED DIRECTLY ON THE WALL PLATE; IE."P4-1", PANEL "4", CIRCUIT "1". REFERENCE WIRING DEVICE SPECIFICATIONS FOR ADDITIONAL INFORMATION.
5. SEAL ALL INTERIOR WALL AND CEILING PENETRATIONS TO MATCH EXISTING FIRE RATING OR NEW FIRE RATING; PROVIDE CORE DRILLING AS REQUIRED. COORDINATE WITH ARCHITECTURAL AND STRUCTURAL DRAWINGS AS REQUIRED.
6. REFERENCE CORRESPONDING ONE-LINE DIAGRAM FOR ADDITIONAL INFORMATION.
7. CONTRACTOR SHALL PROVIDE UPDATED CIRCUIT PANEL DIRECTORIES FOR ALL PANELS THAT CONTAIN CIRCUITS IMPACTED BY THIS PROJECT.
8. CONTRACTOR SHALL PROVIDE PULL BOXES FOR ALL FEEDERS WHERE FEEDER RUNS EXCEED 250FT OR HAVE MORE THAN 270 DEGREES OF TOTAL BEND. PULL BOX PLACEMENT AND SIZING BY CONTRACTOR. COORDINATE PULL BOX LOCATIONS WITH ALL OBSTRUCTIONS, TRADES, AND VA AS REQUIRED.

KEY NOTES

1. EXISTING FAN COIL UNIT SHALL BE DEMOLISHED. ASSOCIATED CONDUIT AND WIRE SHALL BE DEMOLISHED BACK TO SOURCE.
2. MODIFIED PANELBOARD. REFERENCE ASSOCIATED PANEL SCHEDULE FOR ADDITIONAL INFORMATION.
3. PROVIDE RACEWAYS AND CONDUCTORS PER MANUFACTURER'S REQUIREMENTS. REFERENCE MECHANICAL DRAWINGS AND COORDINATE WITH MECHANICAL CONTRACTOR AS REQUIRED.
4. PROVIDE MOTOR RATED SNAP-SWITCH DISCONNECT FOR MECHANICAL UNIT AS SHOWN.

KEY PLAN



Revisions:	Date:

CONSULTANT/ DISCIPLINE

DISCIPLINE:

ARCHITECT/ ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HIGHWAY S. SUITE 300
KENT, WA 98032

SPEESDESIGNBUILD

STAMP

LOUIS R. LITALO — STATE OF WASHINGTON — 55681 — 3-24-26 — REGISTERED PROFESSIONAL ENGINEER

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: BLDG 07 - PENTHOUSE - ENLARGED ELECTRICAL PLANS	Phase: 100% CONSTRUCTION DOCUMENTS
Approved:	FULLY SPRINKLERED

Project Title: REPLACE ELEVATORS IN BLDG 07 & BLDG 09	Project Number: 502-24-102
	Building Number: 07
Location: ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA	Drawing Number: E-405
Issue Date: 03/24/2026	Checked: DCW/NVP
	Drawn: JNV/GPB

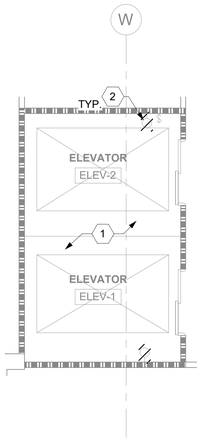

1 E-100 ELEV-1 & 2 - HOISTWAY DEMOLITION PLAN
1/4" = 1'-0"

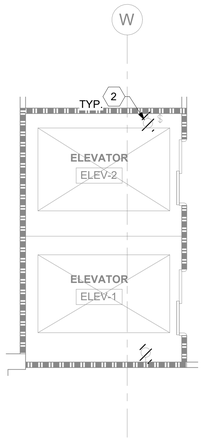

2 E-100 ELEV-1 & 2 - PIT DEMOLITION PLAN
1/4" = 1'-0"

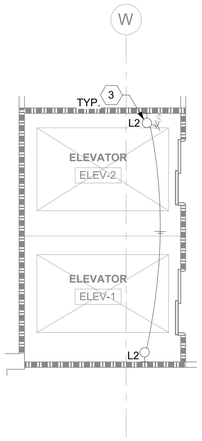

3 E-100 ELEV-1 & 2 - HOISTWAY ELECTRICAL PLAN
1/4" = 1'-0"

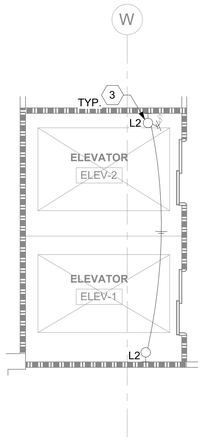

4 E-100 ELEV-1 & 2 - PIT ELECTRICAL PLAN
1/4" = 1'-0"

GENERAL NOTES

1. DRAWINGS ARE BASED ON SITE INVESTIGATIONS AND RECORD DRAWINGS. IF DISCREPANCIES ARE FOUND THAT MAY IMPACT WORK, PROMPTLY NOTIFY VA AND ENGINEER OF SAID DISCREPANCY.
2. ALL EXISTING EQUIPMENT MAY NOT BE SHOWN FOR CLARITY. CONTRACTOR SHALL FIELD VERIFY ALL POWER, LIGHTING AND ASSOCIATED CIRCUITRY AS REQUIRED. ALL RACEWAYS AND CONDUCTORS ASSOCIATED WITH EQUIPMENT TO BE DEMOLISHED SHALL BE DEMOLISHED BACK TO THEIR SOURCE, UNLESS OTHERWISE NOTED.
3. CONTRACTOR SHALL DEMOLISH ALL ELECTRICAL EQUIPMENT, CONDUCTORS AND RACEWAYS ASSOCIATED WITH WALLS BEING REMOVED, AND IN ALL LOCATIONS WHERE JUNCTION BOXES WILL NOT REMAIN ACCESSIBLE AFTER INSTALLATION, UNLESS OTHERWISE NOTED.
4. ALL RECEPTACLES AND SWITCHES SHALL BE PROVIDED WITH PANEL AND CIRCUIT LABELING LOCATED DIRECTLY ON THE WALL PLATE; IE."P4-1", PANEL "4", CIRCUIT "1". REFERENCE WIRING DEVICE SPECIFICATIONS FOR ADDITIONAL INFORMATION.
5. SEAL ALL INTERIOR WALL AND CEILING PENETRATIONS TO MATCH EXISTING FIRE RATING OR NEW FIRE RATING; PROVIDE CORE DRILLING AS REQUIRED. COORDINATE WITH ARCHITECTURAL AND STRUCTURAL DRAWINGS AS REQUIRED.
6. REFERENCE CORRESPONDING ONE-LINE DIAGRAM FOR ADDITIONAL INFORMATION.
7. CONTRACTOR SHALL PROVIDE UPDATED CIRCUIT PANEL DIRECTORIES FOR ALL PANELS THAT CONTAIN CIRCUITS IMPACTED BY THIS PROJECT.
8. CONTRACTOR SHALL PROVIDE PULL BOXES FOR ALL FEEDERS WHERE FEEDER RUNS EXCEED 250FT OR HAVE MORE THAN 270 DEGREES OF TOTAL BEND. PULL BOX PLACEMENT AND SIZING BY CONTRACTOR. COORDINATE PULL BOX LOCATIONS WITH ALL OBSTRUCTIONS, TRADES, AND VA AS REQUIRED.

KEY NOTES

1. EXISTING SMOKE DETECTOR LOCATED AT TOP OF HOIST WAY SHALL BE DEMOLISHED. EXISTING RACEWAYS AND CABLING SHALL BE DEMOLISHED BACK TO SOURCE.
2. EXISTING EQUIPMENT TO BE DEMOLISHED AND REPLACED. PRESERVE CIRCUITING FOR RETERMINATION.
3. PROVIDE EQUIPMENT AS INDICATED. EXTEND EXISTING CONDUIT AND WIRE AS REQUIRED.

KEY PLAN

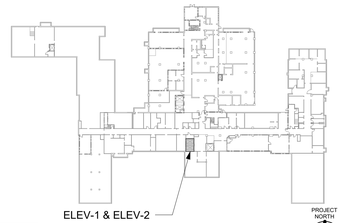

AREA SHOWN

Revisions:	Date:

CONSULTANT/ DISCIPLINE

DISCIPLINE:

ARCHITECT/ ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HIGHWAY S. SUITE 300
KENT, WA 98032

SPEESDESIGNBUILD

STAMP

LOUIS R. LITANO — STATE OF WASHINGTON — 55681 — 3-24-26 — REGISTERED PROFESSIONAL ENGINEER

Office of Construction and Facilities Management

U.S. Department of Veterans Affairs

Drawing Title
BLDG 07 - BASEMENT - ENLARGED ELECTRICAL PLANS

Phase
100% CONSTRUCTION DOCUMENTS

Approved:

FULLY SPRINKLERED

Project Title
REPLACE ELEVATORS IN BLDG 07 & BLDG 09

Project Number
502-24-102

Building Number
07

Location
ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA

Drawing Number
E-406

Issue Date	Checked	Drawn
03/24/2026	DCW/NVP	JNV/GPB

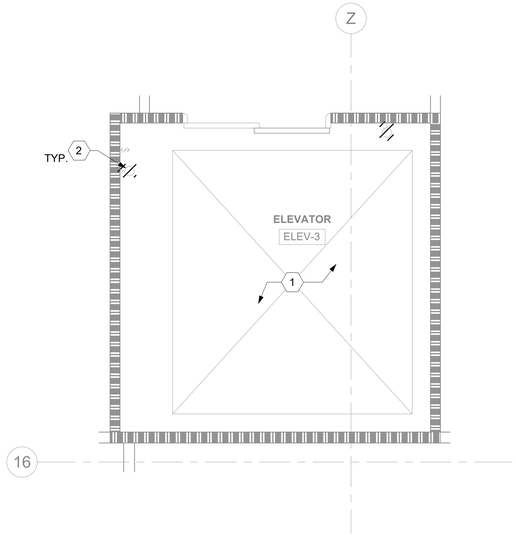

1 E-100 ELEV-3 - HOISTWAY DEMOLITION PLAN

1/2" = 1'-0"

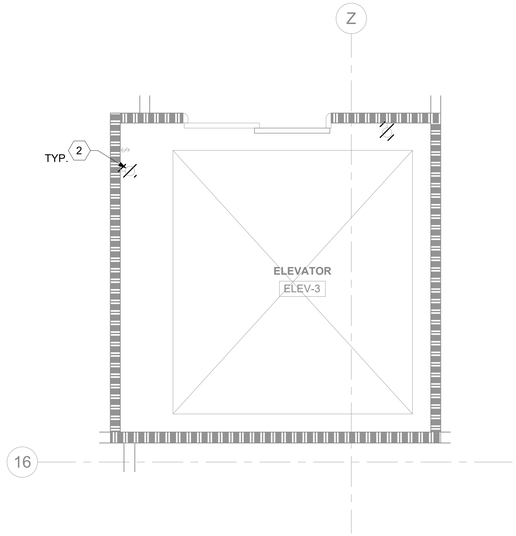

2 E-100 ELEV-3 - PIT DEMOLITION PLAN

1/2" = 1'-0"

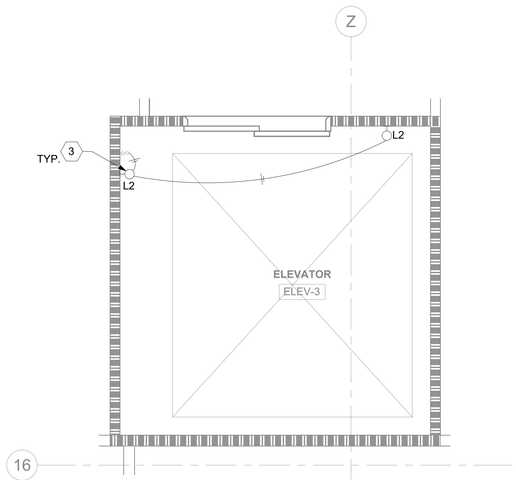

3 E-100 ELEV-3 - HOISTWAY ELECTRICAL PLAN

1/2" = 1'-0"

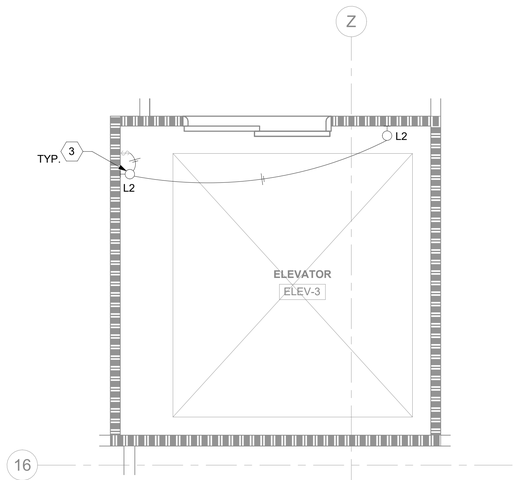

4 E-100 ELEV-3 - PIT ELECTRICAL PLAN

1/2" = 1'-0"

GENERAL NOTES

1. DRAWINGS ARE BASED ON SITE INVESTIGATIONS AND RECORD DRAWINGS. IF DISCREPANCIES ARE FOUND THAT MAY IMPACT WORK, PROMPTLY NOTIFY VA AND ENGINEER OF SAID DISCREPANCY.
2. ALL EXISTING EQUIPMENT MAY NOT BE SHOWN FOR CLARITY. CONTRACTOR SHALL FIELD VERIFY ALL POWER, LIGHTING AND ASSOCIATED CIRCUITRY AS REQUIRED. ALL RACEWAYS AND CONDUCTORS ASSOCIATED WITH EQUIPMENT TO BE DEMOLISHED SHALL BE DEMOLISHED BACK TO THEIR SOURCE, UNLESS OTHERWISE NOTED.
3. CONTRACTOR SHALL DEMOLISH ALL ELECTRICAL EQUIPMENT, CONDUCTORS AND RACEWAYS ASSOCIATED WITH WALLS BEING REMOVED, AND IN ALL LOCATIONS WHERE JUNCTION BOXES WILL NOT REMAIN ACCESSIBLE AFTER INSTALLATION, UNLESS OTHERWISE NOTED.
4. ALL RECEPTACLES AND SWITCHES SHALL BE PROVIDED WITH PANEL AND CIRCUIT LABELING LOCATED DIRECTLY ON THE WALL PLATE; IE."P4-1", PANEL "4", CIRCUIT "1". REFERENCE WIRING DEVICE SPECIFICATIONS FOR ADDITIONAL INFORMATION.
5. SEAL ALL INTERIOR WALL AND CEILING PENETRATIONS TO MATCH EXISTING FIRE RATING OR NEW FIRE RATING; PROVIDE CORE DRILLING AS REQUIRED. COORDINATE WITH ARCHITECTURAL AND STRUCTURAL DRAWINGS AS REQUIRED.
6. REFERENCE CORRESPONDING ONE-LINE DIAGRAM FOR ADDITIONAL INFORMATION.
7. CONTRACTOR SHALL PROVIDE UPDATED CIRCUIT PANEL DIRECTORIES FOR ALL PANELS THAT CONTAIN CIRCUITS IMPACTED BY THIS PROJECT.
8. CONTRACTOR SHALL PROVIDE PULL BOXES FOR ALL FEEDERS WHERE FEEDER RUNS EXCEED 250FT OR HAVE MORE THAN 270 DEGREES OF TOTAL BEND. PULL BOX PLACEMENT AND SIZING BY CONTRACTOR. COORDINATE PULL BOX LOCATIONS WITH ALL OBSTRUCTIONS, TRADES, AND VA AS REQUIRED.

KEY NOTES

1. EXISTING SMOKE DETECTOR LOCATED AT TOP OF HOIST WAY SHALL BE DEMOLISHED. EXISTING RACEWAYS AND CABLING SHALL BE DEMOLISHED BACK TO SOURCE.
2. EXISTING EQUIPMENT TO BE DEMOLISHED AND REPLACED. PRESERVE CIRCUITING FOR RETERMINATION.
3. PROVIDE EQUIPMENT AS INDICATED. EXTEND EXISTING CONDUIT AND WIRE AS REQUIRED.

KEY PLAN

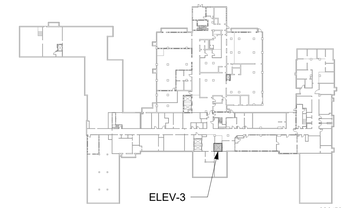

Revisions:	Date:

CONSULTANT/ DISCIPLINE

DISCIPLINE:

ARCHITECT/ ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HIGHWAY S. SUITE 300
KENT, WA 98032

SPEESDESIGNBUILD

STAMP

LOUIS R. LITANO — STATE OF WASHINGTON — 55681 — 3-24-26 — REGISTERED PROFESSIONAL ENGINEER

Office of Construction and Facilities Management

U.S. Department of Veterans Affairs

Drawing Title BLDG 07 - BASEMENT - ENLARGED ELECTRICAL PLANS	**Phase** 100% CONSTRUCTION DOCUMENTS
Approved:	FULLY SPRINKLERED

Project Title REPLACE ELEVATORS IN BLDG 07 & BLDG 09	**Project Number** 502-24-102
	Building Number 07
Location ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA	**Drawing Number** E-407
Issue Date 03/24/2026 / **Checked** DCW/NVP / **Drawn** JNV/GPB	

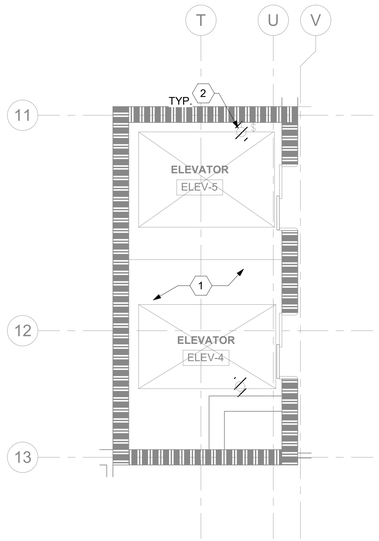

1 E-100 ELEV-4 & 5 - HOISTWAY DEMOLITION PLAN
1/4" = 1'-0"

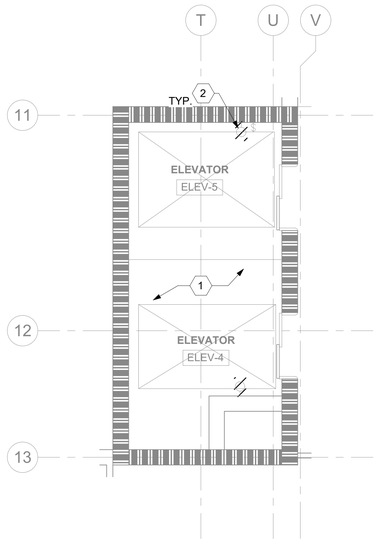

2 E-100 ELEV-4 & 5 - PIT DEMOLITION PLAN
1/4" = 1'-0"

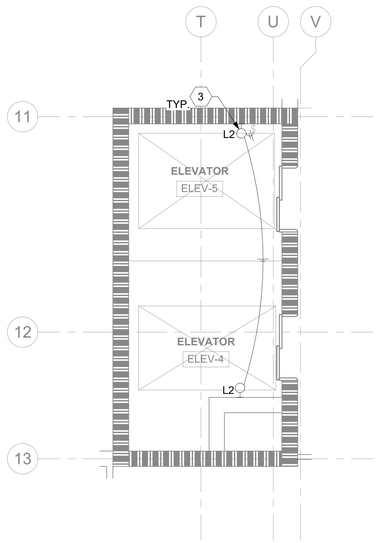

3 E-100 ELEV-4 & 5 - HOISTWAY ELECTRICAL PLAN
1/4" = 1'-0"

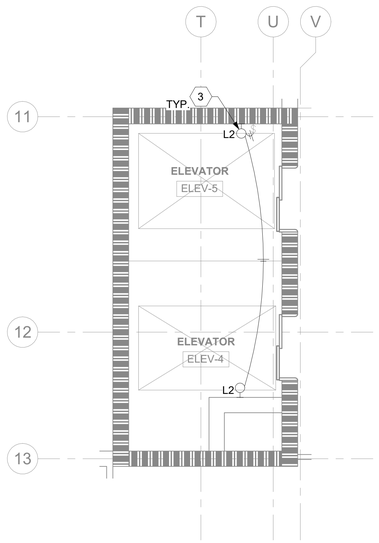

4 E-100 ELEV-4 & 5 - PIT ELECTRICAL PLAN
1/4" = 1'-0"

GENERAL NOTES

1. DRAWINGS ARE BASED ON SITE INVESTIGATIONS AND RECORD DRAWINGS. IF DISCREPANCIES ARE FOUND THAT MAY IMPACT WORK, PROMPTLY NOTIFY VA AND ENGINEER OF SAID DISCREPANCY.
2. ALL EXISTING EQUIPMENT MAY NOT BE SHOWN FOR CLARITY. CONTRACTOR SHALL FIELD VERIFY ALL POWER, LIGHTING AND ASSOCIATED CIRCUITRY AS REQUIRED. ALL RACEWAYS AND CONDUCTORS ASSOCIATED WITH EQUIPMENT TO BE DEMOLISHED SHALL BE DEMOLISHED BACK TO THEIR SOURCE, UNLESS OTHERWISE NOTED.
3. CONTRACTOR SHALL DEMOLISH ALL ELECTRICAL EQUIPMENT, CONDUCTORS AND RACEWAYS ASSOCIATED WITH WALLS BEING REMOVED, AND IN ALL LOCATIONS WHERE JUNCTION BOXES WILL NOT REMAIN ACCESSIBLE AFTER INSTALLATION, UNLESS OTHERWISE NOTED.
4. ALL RECEPTACLES AND SWITCHES SHALL BE PROVIDED WITH PANEL AND CIRCUIT LABELING LOCATED DIRECTLY ON THE WALL PLATE; IE."P4-1", PANEL "4", CIRCUIT "1". REFERENCE WIRING DEVICE SPECIFICATIONS FOR ADDITIONAL INFORMATION.
5. SEAL ALL INTERIOR WALL AND CEILING PENETRATIONS TO MATCH EXISTING FIRE RATING OR NEW FIRE RATING; PROVIDE CORE DRILLING AS REQUIRED. COORDINATE WITH ARCHITECTURAL AND STRUCTURAL DRAWINGS AS REQUIRED.
6. REFERENCE CORRESPONDING ONE-LINE DIAGRAM FOR ADDITIONAL INFORMATION.
7. CONTRACTOR SHALL PROVIDE UPDATED CIRCUIT PANEL DIRECTORIES FOR ALL PANELS THAT CONTAIN CIRCUITS IMPACTED BY THIS PROJECT.
8. CONTRACTOR SHALL PROVIDE PULL BOXES FOR ALL FEEDERS WHERE FEEDER RUNS EXCEED 250FT OR HAVE MORE THAN 270 DEGREES OF TOTAL BEND. PULL BOX PLACEMENT AND SIZING BY CONTRACTOR. COORDINATE PULL BOX LOCATIONS WITH ALL OBSTRUCTIONS, TRADES, AND VA AS REQUIRED.

KEY NOTES

1. EXISTING SMOKE DETECTOR LOCATED AT TOP OF HOIST WAY SHALL BE DEMOLISHED. EXISTING RACEWAYS AND CABLING SHALL BE DEMOLISHED BACK TO SOURCE.
2. EXISTING EQUIPMENT TO BE DEMOLISHED AND REPLACED. PRESERVE CIRCUITING FOR RETERMINATION.
3. PROVIDE EQUIPMENT AS INDICATED. EXTEND EXISTING CONDUIT AND WIRE AS REQUIRED.

KEY PLAN

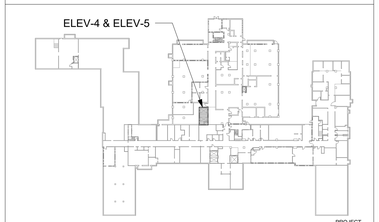

Revisions:	Date:

CONSULTANT/ DISCIPLINE

DISCIPLINE:

ARCHITECT/ ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HIGHWAY S. SUITE 300
KENT, WA 98032

SPEESDESIGNBUILD

STAMP

LOUIS R. LITANO
STATE OF WASHINGTON
55681
3-24-26
REGISTERED PROFESSIONAL ENGINEER

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: BLDG 07 - BASEMENT - ENLARGED ELECTRICAL PLANS	Phase: 100% CONSTRUCTION DOCUMENTS
Approved:	FULLY SPRINKLERED

Project Title: REPLACE ELEVATORS IN BLDG 07 & BLDG 09	Project Number: 502-24-102
	Building Number: 07
Location: ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA	Drawing Number: E-408
Issue Date: 03/24/2026	Checked: DCW/NVP
	Drawn: JNV/GPB

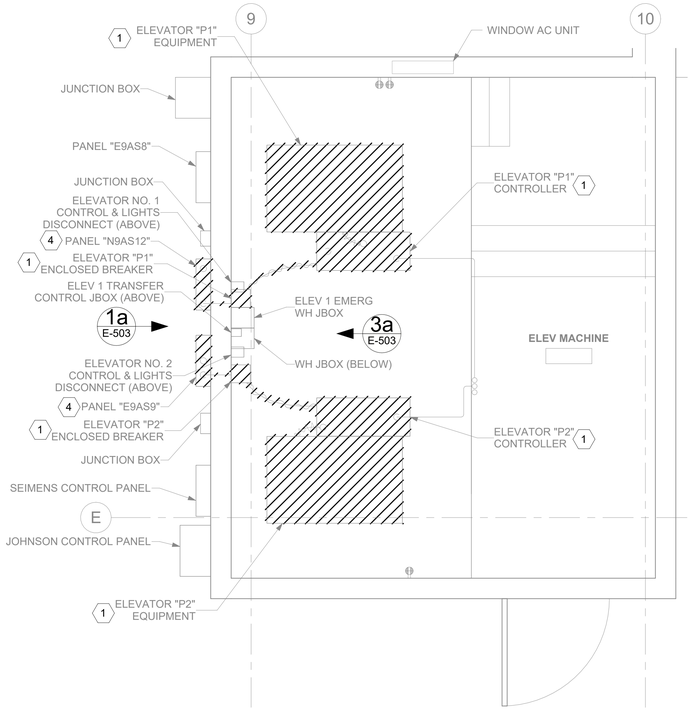

1 E-103 RM 2 -DEMOLITION ELECTRICAL PLAN

1/2" = 1'-0"

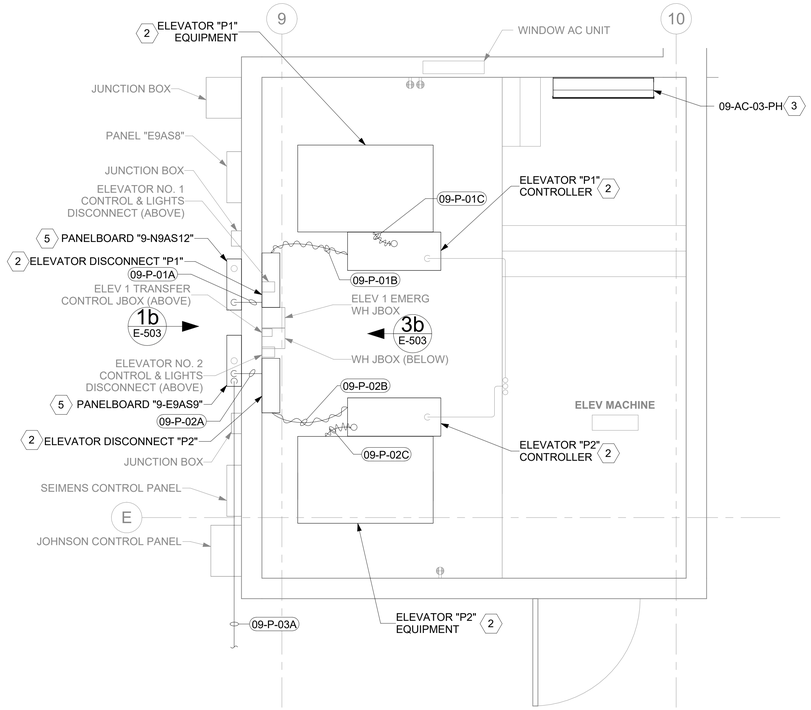

2 E-103 RM 2 -ELECTRICAL PLAN

1/2" = 1'-0"

GENERAL NOTES

1. DRAWINGS ARE BASED ON SITE INVESTIGATIONS AND RECORD DRAWINGS. IF DISCREPANCIES ARE FOUND THAT MAY IMPACT WORK, PROMPTLY NOTIFY VA AND ENGINEER OF SAID DISCREPANCY.
2. ALL EXISTING EQUIPMENT MAY NOT BE SHOWN FOR CLARITY. CONTRACTOR SHALL FIELD VERIFY ALL POWER, LIGHTING AND ASSOCIATED CIRCUITRY AS REQUIRED. ALL RACEWAYS AND CONDUCTORS ASSOCIATED WITH EQUIPMENT TO BE DEMOLISHED SHALL BE DEMOLISHED BACK TO THEIR SOURCE, UNLESS OTHERWISE NOTED.
3. CONTRACTOR SHALL DEMOLISH ALL ELECTRICAL EQUIPMENT, CONDUCTORS AND RACEWAYS ASSOCIATED WITH WALLS BEING REMOVED, AND IN ALL LOCATIONS WHERE JUNCTION BOXES WILL NOT REMAIN ACCESSIBLE AFTER INSTALLATION, UNLESS OTHERWISE NOTED.
4. ALL RECEPTACLES AND SWITCHES SHALL BE PROVIDED WITH PANEL AND CIRCUIT LABELING LOCATED DIRECTLY ON THE WALL PLATE; IE."P4-1", PANEL "4", CIRCUIT "1". REFERENCE WIRING DEVICE SPECIFICATIONS FOR ADDITIONAL INFORMATION.
5. SEAL ALL INTERIOR WALL AND CEILING PENETRATIONS TO MATCH EXISTING FIRE RATING OR NEW FIRE RATING; PROVIDE CORE DRILLING AS REQUIRED. COORDINATE WITH ARCHITECTURAL AND STRUCTURAL DRAWINGS AS REQUIRED.
6. REFERENCE CORRESPONDING ONE-LINE DIAGRAM FOR ADDITIONAL INFORMATION.
7. CONTRACTOR SHALL PROVIDE UPDATED CIRCUIT PANEL DIRECTORIES FOR ALL PANELS THAT CONTAIN CIRCUITS IMPACTED BY THIS PROJECT.
8. CONTRACTOR SHALL PROVIDE PULL BOXES FOR ALL FEEDERS WHERE FEEDER RUNS EXCEED 250FT OR HAVE MORE THAN 270 DEGREES OF TOTAL BEND. PULL BOX PLACEMENT AND SIZING BY CONTRACTOR. COORDINATE PULL BOX LOCATIONS WITH ALL OBSTRUCTIONS, TRADES, AND VA AS REQUIRED.

KEY NOTES

1. EXISTING EQUIPMENT SHALL BE DEMOLISHED AND REPLACED. DEMOLISH RACEWAYS AND CONDUCTORS BACK TO SOURCE AS INDICATED ON EXISTING ONE-LINE DIAGRAMS ON SHEET E-603.
2. PROVIDE EQUIPMENT AS INDICATED. REFERENCE REVISED ONE-LINE DIAGRAMS ON SHEET E-613 FOR ADDITIONAL INFORMATION.
3. INTERIOR MECHANICAL UNIT(S) POWERED FROM ASSOCIATED EXTERIOR UNIT. PROVIDE CONDUIT AND WIRE PER MANUFACTURERS REQUIREMENTS. REFERENCE MECHANICAL DRAWINGS AND COORDINATE WITH MECHANICAL CONTRACTOR AS REQUIRED. PROVIDE LOCAL DISCONNECT.
4. EXISTING PANELBOARD SHALL BE DEMOLISHED AND REPLACED. PRESERVE AND MAINTAIN EXISTING CIRCUITING FOR RETERMINATION INTO REPLACEMENT PANELBOARD.
5. REPLACEMENT PANELBOARD. PROVIDE CONDUIT AND WIRING AS REQUIRED TO RE-TERMINATE EXISTING CIRCUITING.

KEY PLAN



AREA SHOWN

PROJECT NORTH

Revisions:	Date:

CONSULTANT/ DISCIPLINE

DISCIPLINE:

ARCHITECT/ ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HIGHWAY S. SUITE 300
KENT, WA 98032

SPEESDESIGNBUILD

STAMP

LOUIS R. LITANO
STATE OF WASHINGTON
55681
3-24-26
REGISTERED PROFESSIONAL ENGINEER

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title BLDG 09 - PENTHOUSE - ENLARGED ELECTRICAL PLANS	**Phase** 100% CONSTRUCTION DOCUMENTS	**Project Title** REPLACE ELEVATORS IN BLDG 07 & BLDG 09	**Project Number** 502-24-102
Approved:	FULLY SPRINKLERED	**Location** ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA	**Building Number** 09
		Issue Date 03/24/2026 / **Checked** DCW/NVP / **Drawn** JNV/GPB	**Drawing Number** E-409

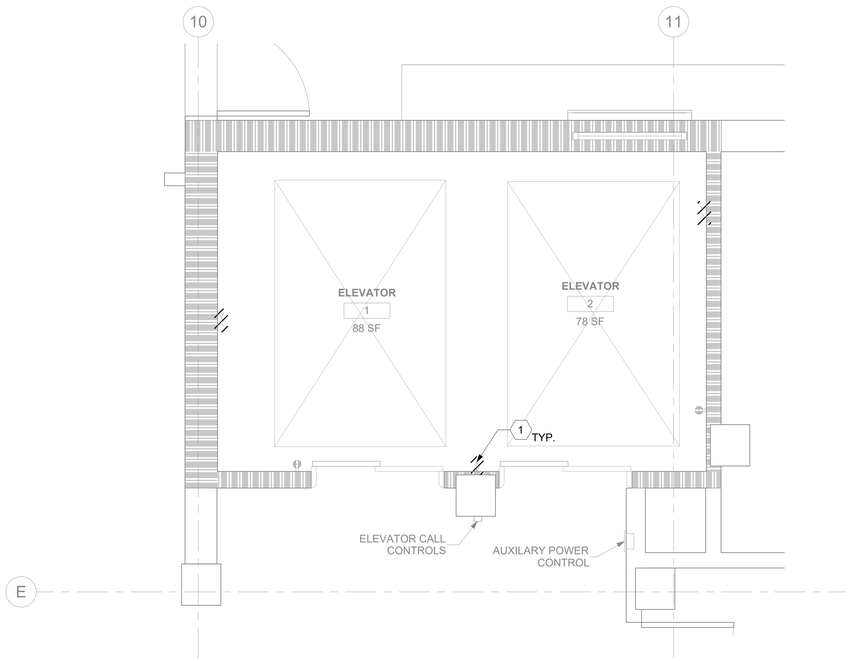

1 E-103 ELEV-1 & 2 - DEMOLITION PIT ELECTRICAL PLAN

1/2" = 1'-0"

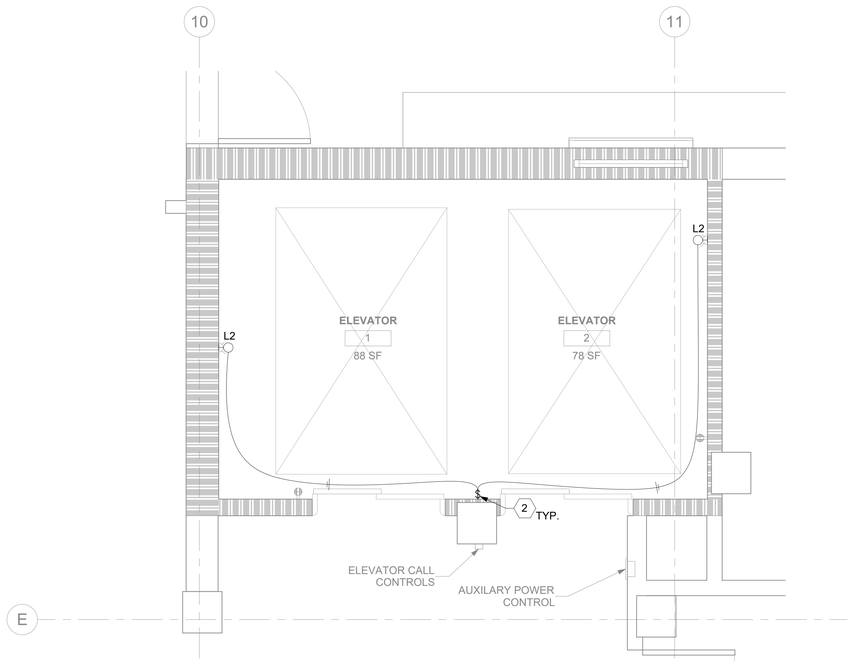

2 E-103 ELEV-1 & 2 - PIT ELECTRICAL PLAN

1/2" = 1'-0"

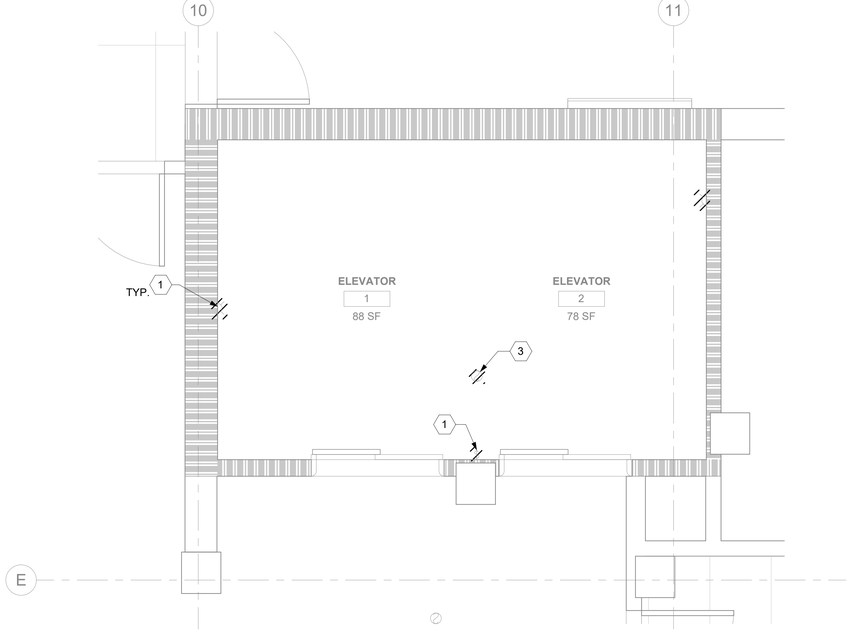

3 E-103 ELEV-1 & 2 - DEMOLITION HOISTWAY ELECTRICAL PLAN

1/2" = 1'-0"

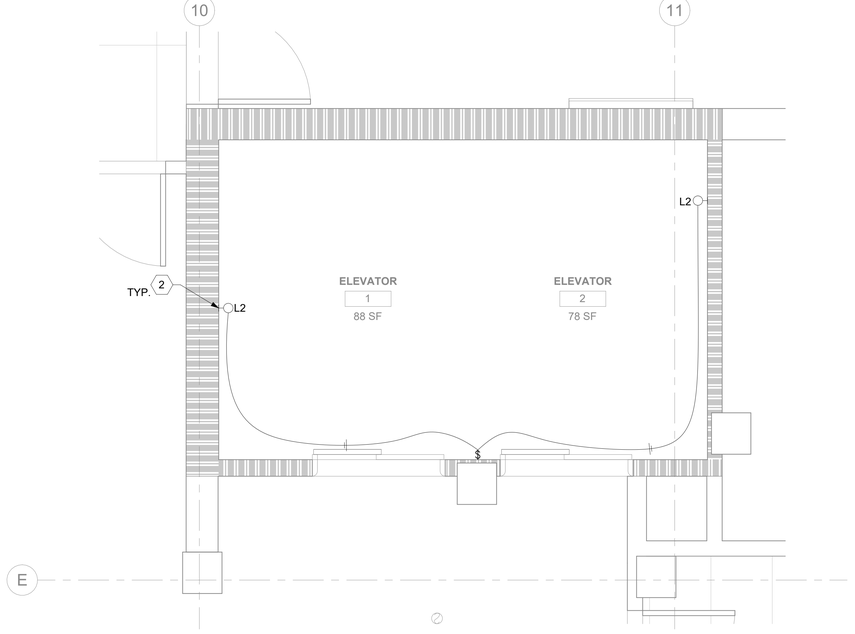

4 E-103 ELEV-1 & 2 - HOISTWAY ELECTRICAL PLAN

1/2" = 1'-0"

GENERAL NOTES

1. DRAWINGS ARE BASED ON SITE INVESTIGATIONS AND RECORD DRAWINGS. IF DISCREPANCIES ARE FOUND THAT MAY IMPACT WORK, PROMPTLY NOTIFY VA AND ENGINEER OF SAID DISCREPANCY.
2. ALL EXISTING EQUIPMENT MAY NOT BE SHOWN FOR CLARITY. CONTRACTOR SHALL FIELD VERIFY ALL POWER, LIGHTING AND ASSOCIATED CIRCUITRY AS REQUIRED. ALL RACEWAYS AND CONDUCTORS ASSOCIATED WITH EQUIPMENT TO BE DEMOLISHED SHALL BE DEMOLISHED BACK TO THEIR SOURCE, UNLESS OTHERWISE NOTED.
3. CONTRACTOR SHALL DEMOLISH ALL ELECTRICAL EQUIPMENT, CONDUCTORS AND RACEWAYS ASSOCIATED WITH WALLS BEING REMOVED, AND IN ALL LOCATIONS WHERE JUNCTION BOXES WILL NOT REMAIN ACCESSIBLE AFTER INSTALLATION, UNLESS OTHERWISE NOTED.
4. ALL RECEPTACLES AND SWITCHES SHALL BE PROVIDED WITH PANEL AND CIRCUIT LABELING LOCATED DIRECTLY ON THE WALL PLATE; IE."P4-1", PANEL "4", CIRCUIT "1". REFERENCE WIRING DEVICE SPECIFICATIONS FOR ADDITIONAL INFORMATION.
5. SEAL ALL INTERIOR WALL AND CEILING PENETRATIONS TO MATCH EXISTING FIRE RATING OR NEW FIRE RATING; PROVIDE CORE DRILLING AS REQUIRED. COORDINATE WITH ARCHITECTURAL AND STRUCTURAL DRAWINGS AS REQUIRED.
6. REFERENCE CORRESPONDING ONE-LINE DIAGRAM FOR ADDITIONAL INFORMATION.
7. CONTRACTOR SHALL PROVIDE UPDATED CIRCUIT PANEL DIRECTORIES FOR ALL PANELS THAT CONTAIN CIRCUITS IMPACTED BY THIS PROJECT.
8. CONTRACTOR SHALL PROVIDE PULL BOXES FOR ALL FEEDERS WHERE FEEDER RUNS EXCEED 250FT OR HAVE MORE THAN 270 DEGREES OF TOTAL BEND. PULL BOX PLACEMENT AND SIZING BY CONTRACTOR. COORDINATE PULL BOX LOCATIONS WITH ALL OBSTRUCTIONS, TRADES, AND VA AS REQUIRED.

KEY NOTES

1. EXISTING EQUIPMENT SHALL BE DEMOLISHED AND REPLACED. PRESERVE CIRCUITING FOR RETERMINATION.
2. PROVIDE EQUIPMENT AS INDICATED. EXTEND EXISTING CONDUIT AND WIRE AS REQUIRED.
3. EXISTING SMOKE DETECTOR SHALL BE DEMOLISHED. EXISTING RACEWAYS AND CABLING SHALL BE DEMOLISHED BACK TO SOURCE.

KEY PLAN

AREA SHOWN

Revisions:	Date:

CONSULTANT/ DISCIPLINE

DISCIPLINE:

ARCHITECT/ ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HIGHWAY S. SUITE 300
KENT, WA 98032

SPEESDESIGNBUILD

STAMP

LOUIS R. LITANO
STATE OF WASHINGTON
55681
3-24-26
REGISTERED PROFESSIONAL ENGINEER

Office of Construction and Facilities Management

U.S. Department of Veterans Affairs

Drawing Title BLDG 09 - LEVEL 01 - ENLARGED ELECTRICAL PLANS	**Phase** 100% CONSTRUCTION DOCUMENTS
Approved:	FULLY SPRINKLERED

Project Title REPLACE ELEVATORS IN BLDG 07 & BLDG 09	**Project Number** 502-24-102
	Building Number 09
Location ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA	**Drawing Number** E-410

Issue Date	Checked	Drawn
03/24/2026	DCW/NVP	JNV/GPB

DETAIL NOTE(S):
1. MODIFY CHAIN LENGTH TO PROVIDE MOUNTING HEIGHT AS REQUIRED ON DRAWINGS. (9'-0" A.F.F. TO BOTTOM OF LUMINAIRE UNLESS OTHERWISE NOTED OR REQUIRED).

2. PROVIDE TWO CHAIN HANGERS FOR EACH LUMINAIRE, ADJUST TO HANG LUMINAIRE LEVEL.

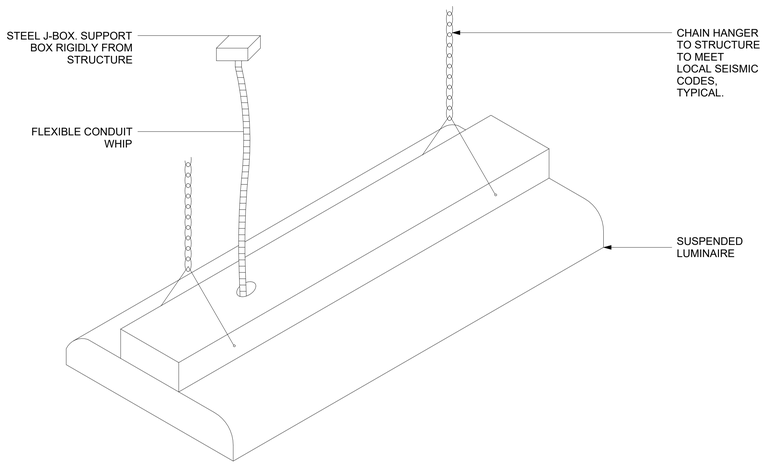

1 E-404 TYPICAL SUSPENDED LUMINAIRE INSTALLATION
NTS

DETAIL NOTE(S):
1. THESE TYPICAL MOUNTING HEIGHTS SHALL BE USED UNLESS OTHERWISE NOTED ON THE PLANS.

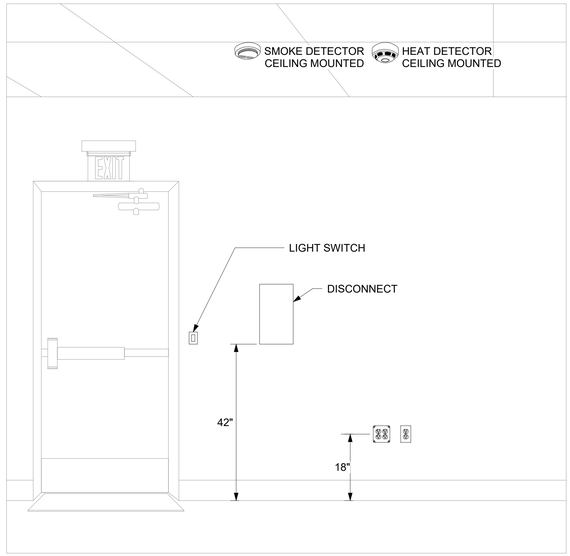

2 - TYPICAL MOUNTING HEIGHT DETAIL
NTS

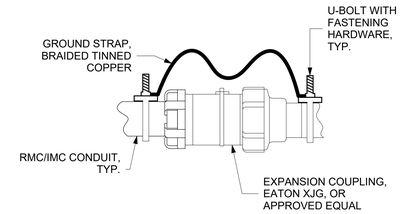

3 - CONDUIT EXPANSION JOINT DETAIL
NTS

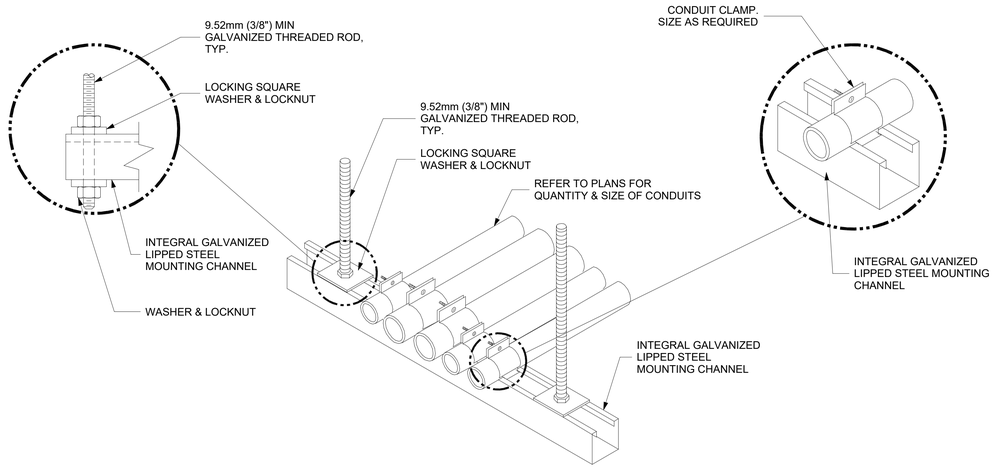

GENERAL NOTES:
1. INTEGRAL GALVANIZED LIPPED STEEL MOUNTING CHANNEL LONGER THAN 915mm (36") SHALL BE INSTALLED WITH A CENTER SUPPORT ROD. SUPPORT RODS SHALL NOT BE GREATER THAN 457mm (18") APART.
2. FASTEN THREADED ROD TO STRUCTURE BY APPROVED METHOD PER SPECIFICATION 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS. FIELD VERIFY EXACT CONDITIONS.
3. FOR TRAPEZE INSTALLATIONS IN SEISMIC AREAS REFER TO SPECIFICATION SECTION 13 05 41, SEISMIC RESTRAINT REQUIREMENTS FOR NON-STRUCTURAL COMPONENTS.

4 - TYPICAL TRAPEZE MOUNTING DETAIL
NTS

5 - NOT USED
NTS

Revisions:	Date:

CONSULTANT/ DISCIPLINE

DISCIPLINE:

ARCHITECT/ ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HIGHWAY S. SUITE 300
KENT, WA 98032

SPEESDESIGNBUILD

STAMP

LOUIS R. LITZINO — STATE OF WASHINGTON — 356881 — REGISTERED PROFESSIONAL ENGINEER — 3-24-26

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title ELECTRICAL DETAILS	**Phase** 100% CONSTRUCTION DOCUMENTS	**Project Title** REPLACE ELEVATORS IN BLDG 07 & BLDG 09	**Project Number** 502-24-102
Approved:	FULLY SPRINKLERED	**Location** ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA	**Building Number** -
		Issue Date 03/24/2026 / **Checked** DCW/NVP / **Drawn** JNV/GPB	**Drawing Number** E-501

1a EXISTING
-

1b REVISED
-

1 E-403 BUILDING 07 - ELECTRICAL ROOM 29 - PANELBOARD "EQ7BA2" PHOTO DETAIL

NTS

2a EXISTING
-

2b REVISED
-

2 E-405 BUILDING 07 - RM PB-4 - SPS CARTLIFT #7 DISCONNECT PHOTO DETAIL

NTS

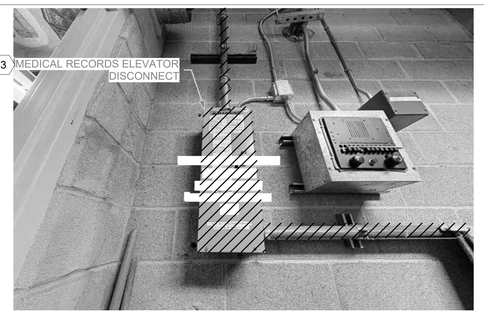

3a EXISTING
-

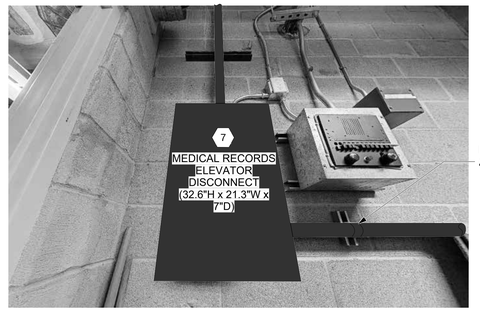

3b REVISED
-

3 E-404 BUILDING 07 - ROOM 15A - SURGE PROTECTION DEVICE PHOTO DETAIL

NTS

GENERAL NOTES

1. NOT ALL RACEWAYS, BOXES, OR CONNECTIONS MAY BE SHOWN FOR CLARITY. REFERENCE ONE-LINE DIAGRAMS AND FLOOR PLANS FOR ADDITIONAL INFORMATION.
2. CONTRACTOR SHALL ENSURE ALL ELECTRICAL CLEARANCES ARE MET PRIOR TO INSTALLATION.
3. ALL DIMENSIONS FOR NEW EQUIPMENT ARE BASED ON BASIS-OF-DESIGN EQUIPMENT SELECTIONS.
4. DETAILS SHALL BE USED FOR CONSTRUCTABILITY REFERENCE. EXACT DIMENSIONS, MOUNTING SUPPORTS, AND FASTENING HARDWARE MAY DIFFER FROM FIELD INSTALLATION. CONTRACTOR SHALL PROVIDE ALL MOUNTING AND FASTENING HARDWARE AS REQUIRED.
5. NOT ALL CONDUIT MAY BE SHOWN FOR CLARITY.
6. PROVIDE SEISMIC BRACING AS REQUIRED.

KEY NOTES

1. EXISTING PANELBOARD SHALL BE DEMOLISHED AND REPLACED. PRESERVE AND MAINTAIN EXISTING CIRCUITING FOR RETERMINATION.
2. REPLACEMENT PANELBOARD. PROVIDE CONDUIT AND WIRE AS REQUIRED TO RE-TERMINATE EXISTING CIRCUITING. REPLACEMENT PANELBOARD SHALL MEET ALL NEC ELECTRICAL CLEARANCE REQUIREMENTS.
3. EXISTING FUSIBLE DISCONNECT SHALL BE DEMOLISHED AND REPLACED. DEMOLISH RACEWAYS AND CONDUCTORS AS INDICATED.
4. EXISTING CONDUCTOR FEEDING EXISTING DISCONNECT SHALL BE PRESERVED REUSE.
5. PROVIDE REPLACEMENT DISCONNECT AS INDICATED. EXTEND AND TERMINATE EXISTING RACEWAY AND CONDUCTORS TO DISCONNECT AS REQUIRED.
6. EXISTING LOUVER SHALL BE DEMOLISHED. ASSOCIATED RACEWAYS AND CONDUCTORS SHALL BE DEMOLISHED BACK TO SOURCE.
7. PROVIDE REPLACEMENT DISCONNECT AS INDICATED.

Revisions:	Date:

CONSULTANT/ DISCIPLINE

DISCIPLINE:

ARCHITECT/ ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HIGHWAY S. SUITE 300
KENT, WA 98032

SPEESDESIGNBUILD

STAMP

LOUIS R. LITERNO
STATE OF WASHINGTON
35681
3-24-26
REGISTERED PROFESSIONAL ENGINEER

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: BUILDING 07 ELECTRICAL DETAILS	Phase: 100% CONSTRUCTION DOCUMENTS
Approved:	FULLY SPRINKLERED

Project Title: REPLACE ELEVATORS IN BLDG 07 & BLDG 09		Project Number: 502-24-102
		Building Number: -
Location: ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA		Drawing Number: E-502
Issue Date: 03/24/2026	Checked: DCW/NVP	Drawn: JNV/GPB

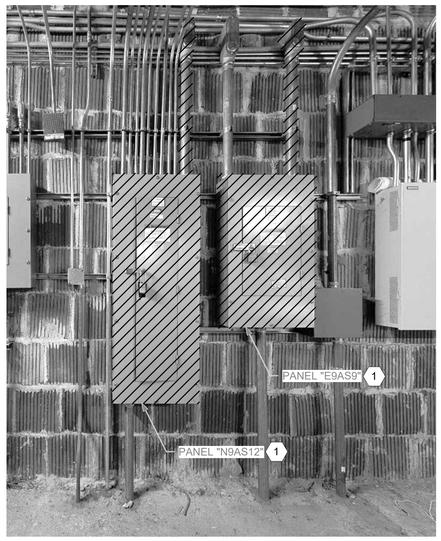

1a – EXISTING

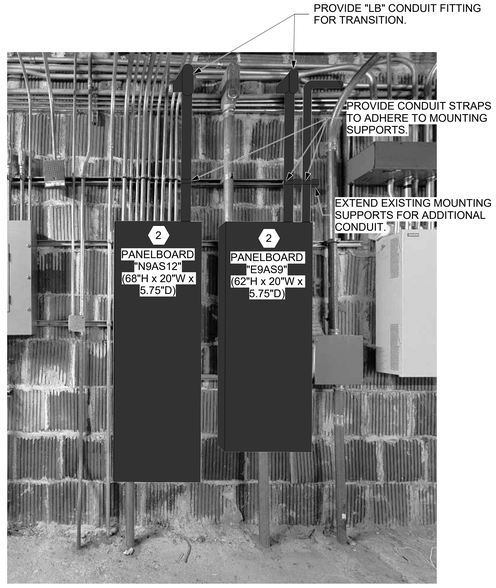

1b – REVISED

1 E-409 BUILDING 09 - ATTIC - PANELBOARDS "N9AS12" AND "E9AS9" PHOTO DETAIL
NTS

2 – NOT USED
NTS

GENERAL NOTES

1. NOT ALL RACEWAYS, BOXES, OR CONNECTIONS MAY BE SHOWN FOR CLARITY. REFERENCE ONE-LINE DIAGRAMS AND FLOOR PLANS FOR ADDITIONAL INFORMATION.
2. CONTRACTOR SHALL ENSURE ALL ELECTRICAL CLEARANCES ARE MET PRIOR TO INSTALLATION.
3. ALL DIMENSIONS FOR NEW EQUIPMENT ARE BASED ON BASIS-OF-DESIGN EQUIPMENT SELECTIONS.
4. DETAILS SHALL BE USED FOR CONSTRUCTABILITY REFERENCE. EXACT DIMENSIONS, MOUNTING SUPPORTS, AND FASTENING HARDWARE MAY DIFFER FROM FIELD INSTALLATION. CONTRACTOR SHALL PROVIDE ALL MOUNTING AND FASTENING HARDWARE AS REQUIRED.
5. NOT ALL CONDUIT MAY BE SHOWN FOR CLARITY.
6. PROVIDE SEISMIC BRACING AS REQUIRED.

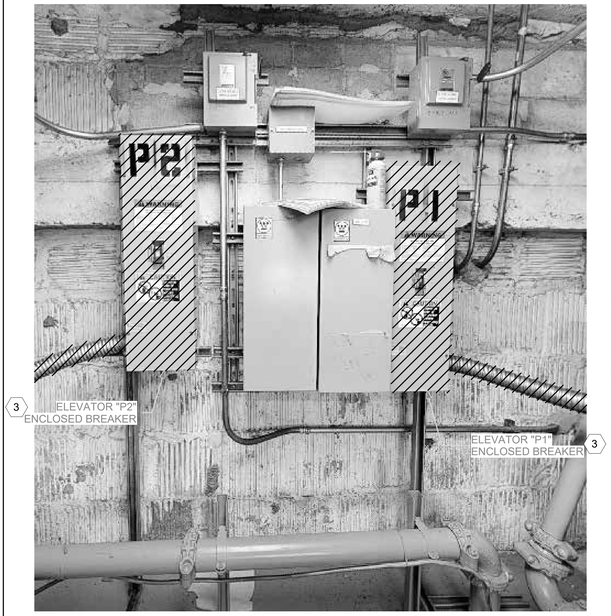

3a – EXISTING

3b – REVISED

3 E-409 BUILDING 09 - ELECTRICAL ROOM 2 - SURGE PROTECTION DEVICES PHOTO DETAIL
NTS

4 – NOT USED
NTS

KEY NOTES

1. EXISTING PANELBOARD SHALL BE DEMOLISHED AND REPLACED. PRESERVE AND MAINTAIN EXISTING CIRCUITING FOR RETERMINATION.
2. PROVIDE REPLACEMENT PANELBOARD. PROVIDE CONDUIT AND WIRE AS REQUIRED TO RE-TERMINATE EXISTING CIRCUITING.
3. EXISTING ELEVATOR ENCLOSED BREAKER SHALL BE DEMOLISHED AND REPLACED. RACEWAYS AND CONDUCTORS SHALL BE DEMOLISHED BACK TO SOURCE. REFERENCE ASSOCIATED FLOOR PLANS AND EXISTING ONE-LINE DIAGRAMS FOR ADDITIONAL INFORMATION.
4. PROVIDE FUSABLE ELEVATOR DISCONNECT WHERE INDICATED. UTILIZE EXISTING UNISTRUT MOUNTING SUPPORTS FROM PREVIOUS ELEVATOR ENCLOSED BREAKERS. EXTEND UNISTRUT MOUNTING SUPPORTS AS REQUIRED. REFERENCE ASSOCIATED FLOOR PLANS AND REVISED ONE-LINE DIAGRAMS FOR ADDITIONAL INFORMATION.

Revisions:	Date:

CONSULTANT/ DISCIPLINE

DISCIPLINE:

ARCHITECT/ ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HIGHWAY S. SUITE 300
KENT, WA 98032

SDB SPEESDESIGNBUILD

STAMP

LOUIS R. LITZKO, STATE OF WASHINGTON, 55681, 3-24-26, REGISTERED PROFESSIONAL ENGINEER

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: BUILDING 09 ELECTRICAL DETAILS	Phase: 100% CONSTRUCTION DOCUMENTS
Approved:	FULLY SPRINKLERED

Project Title: REPLACE ELEVATORS IN BLDG 07 & BLDG 09	Project Number: 502-24-102
	Building Number: -
Location: ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA	Drawing Number: E-503
Issue Date: 03/24/2026 / Checked: DCW/NVP / Drawn: JNV/GPB	

DETAIL NOTE(S):
1. REFERENCE SHEET E-401 AND E-404 FOR EXACT DEVICE QUANTITIES AND LOCATIONS.
2. FIRE ALARM RISER DIAGRAM SHOWN FOR INFORMATIONAL PURPOSES ONLY. COORDINATE WITH EXISTING FACILITY INFRASTRUCTURE, EQUIPMENT, NATIONAL/LOCAL CODES AND MANUFACTURE TO PROVIDE A COMPLETE AND FULLY FUNCTIONAL SYSTEM AS REQUIRED.
3. PROVIDE FIRE ALARM DEVICES IN FIELD AS REQUIRED. COORDINATE FIELD CONNECTIONS WITH ALL EQUIPMENT; PROVIDE CONNECTIONS, CABLING AND TERMINATIONS AS REQUIRED.
4. PROVIDE CONDUIT FOR ALL NEW CABLE AS REQUIRED. ALL FIRE ALARM CONDUIT SHALL BE PAINTED RED.

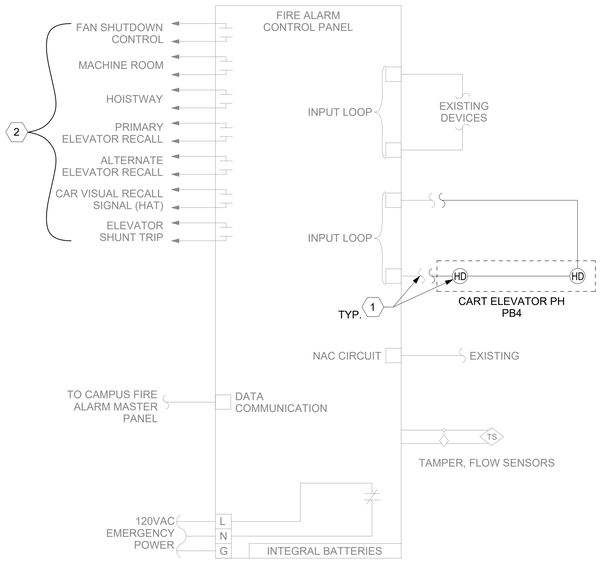

	OUTPUT											
INPUT DEVICE	1. Sound general building alarm for Other and High Rise (non-Health Care). See VAFPDM Section 7.2.1.	2. Notify necessary staff for response for Health Care, Ambulatory Health Care, and High Rise buildings only (alarm signal may be different on different floors).	3. Notify Fire Department.	4. Initiate supervisory signal to a 24-hour manned point for immediate response.	5. Close associate smoke barrier doors on the floor.	6. Close dampers on fan proximate detector.	7. Shutdown air handeler serverved by the detector.	8. Recall elevator.	9. Initiate the elevator shutdown and disconnect elevator power.	10. Open locked egress doors on floor of fire origin.	11. Disconnect fuel source from cooking equipment.
Duct Smoke Detector					N/A						
Area Smoke Detector					N/A						
Door Release Smoke Detector					N/A						
Elevator Smoke Detector					N/A						
Manual Pull Station					N/A						
Elevator Machine Room Heat Detector	X	X	X						X		
Generator Room Heat Detector					N/A						
Sprinkler Waterflow / Pressure Switch					N/A						
Water Control Valve Tamper					N/A						
Fire Pump (Any Alarm Condition Required by NFPA 20)					N/A						
High/Low Pressure Dry-Pipe Sprinkler System					N/A						
Kitchen Hood Suppression System					N/A						
Gas Extinguishing Systems					N/A						
Dry-Pipe Valve Room Temperature Alarm					N/A						
Dedicated Fire Water Storage Tank Low Level					N/A						
Dedicated Fire Water Storage Tank Low Temperature					N/A						

NOTES:
1. I/O MATRIX IS INTENDED TO SHOW EQUIPMENT ADDED TO FIRE ALARM SYSTEM. ALL OTHER EQUIPMENT SHALL MAINTAIN FUNCTIONALITY.

1 - BUILDING 07 FIRE ALARM RISER DIAGRAM AND I/O MATRIX
NTS

DETAIL NOTE(S):
1. REFERENCE SHEET E-409 FOR EXACT DEVICE QUANTITIES AND LOCATIONS.
2. FIRE ALARM RISER DIAGRAM SHOWN FOR INFORMATIONAL PURPOSES ONLY. COORDINATE WITH EXISTING FACILITY INFRASTRUCTURE, EQUIPMENT, NATIONAL/LOCAL CODES AND MANUFACTURE TO PROVIDE A COMPLETE AND FULLY FUNCTIONAL SYSTEM AS REQUIRED.
3. PROVIDE FIRE ALARM DEVICES IN FIELD AS REQUIRED. COORDINATE FIELD CONNECTIONS WITH ALL EQUIPMENT; PROVIDE CONNECTIONS, CABLING AND TERMINATIONS AS REQUIRED.
4. PROVIDE CONDUIT FOR ALL NEW CABLE AS REQUIRED. ALL FIRE ALARM CONDUIT SHALL BE PAINTED RED.

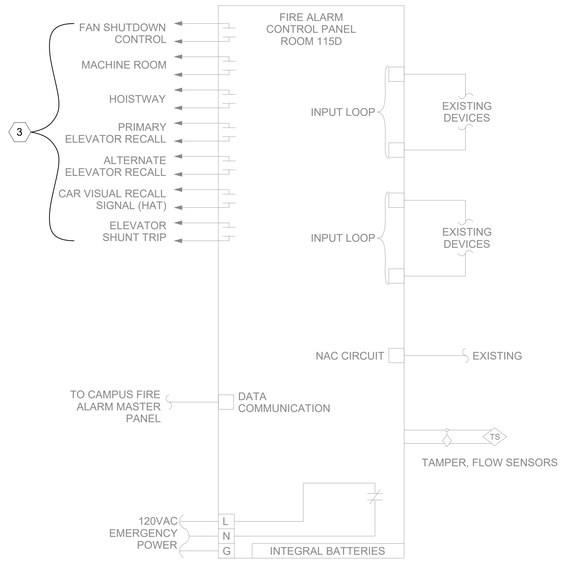

3 - BUILDING 09 FIRE ALARM RISER DIAGRAM
NTS

GENERAL NOTES

1. FIRE ALARM DETAILS ARE PROVIDED FOR GENERAL FUNCTIONAL REQUIREMENTS ONLY. CONTRACTOR SHALL PROVIDE ALL REQUIRED EQUIPMENT; RACEWAYS, CABLING, CONNECTIONS, PROGRAMMING, AND COMMISSIONING. COORDINATE WITH MECHANICAL, FIRE ALARM SYSTEM VENDOR, AND VENDOR AS REQUIRED. CONTRACTOR SHALL PROVIDE FIRE ALARM SHOP DRAWINGS REVIEWED AND STAMPED BY A LICENSED FIRE PROTECTION ENGINEER. REFERENCE SPECIFICATIONS 28 31 00 AND DIVISION 26 FOR ALL REQUIREMENTS TO PROVIDE A COMPLETE AND FULLY FUNCTIONAL SYSTEM.
2. REFERENCE SHEET E-401, E-404, AND E-409 FOR DEVICE QUANTITIES AND LOCATIONS. DEVICE LOCATIONS AND QUANTITIES MAY CHANGE DEPENDING ON SYSTEM SELECTED. CONTRACTOR SHALL PROVIDE A COMPLETE SUBMITTAL INCLUDING, BUT NOT LIMITED TO: FUNCTIONAL NARRATIVE, WIRING DIAGRAMS, SHOP DRAWINGS, BILL OF MATERIALS, AND RED-LINED FLOOR PLANS STAMPED BY A LICENSED FIRE PROTECTION ENGINEER INDICATING INSTALLATION LOCATIONS FOR REVIEW PRIOR TO COMMENCING WORK.
3. COORDINATE WITH VA, CAMPUS FIRE ALARM CONTRACTOR, AND MECHANICAL CONTRACTOR AS REQUIRED.
4. ALL WIRING SHALL BE ROUTED IN 3/4" CONDUIT (MINIMUM SIZE). ALL RACEWAYS AND BOXES SHALL BE COLORED RED.
5. COORDINATE WITH EXISTING FACILITY INFRASTRUCTURE, EQUIPMENT, NATIONAL/LOCAL CODES AND MANUFACTURER TO PROVIDE A COMPLETE AND FULLY FUNCTIONAL SYSTEM AS REQUIRED.

KEY NOTES

1. EXTEND EXISTING CABLING TO NEW DEVICES AS SHOWN. REFERENCE SHEET E-401 FOR ADDITIONAL INFORMATION.
2. PROVIDE CABLING AND RACEWAYS AS REQUIRED TO SERVE NEW FIRE ALARM RELAY JUNCTION BOXES. REFERENCE SHEETS E-401 AND E-404 FOR ADDITIONAL INFORMATION.
3. PROVIDE CABLING AND RACEWAYS AS REQUIRED TO SERVE NEW FIRE ALARM RELAY JUNCTION BOXES. REFERENCE SHEETS E-409 FOR ADDITIONAL INFORMATION.

Revisions:	Date:

CONSULTANT/ DISCIPLINE
DISCIPLINE:

ARCHITECT/ ENGINEER OF RECORD
A/E:
SPEES DESIGN BUILD
23830 PACIFIC HIGHWAY S. SUITE 300
KENT, WA 98032
SDB SPEESDESIGNBUILD

STAMP
LOUIS R. LITANO
STATE OF WASHINGTON
155681
3-24-26
REGISTERED PROFESSIONAL ENGINEER

Office of Construction and Facilities Management
VA U.S. Department of Veterans Affairs

Drawing Title: FIRE ALARM RISER DIAGRAMS
Phase: 100% CONSTRUCTION DOCUMENTS
Approved:
FULLY SPRINKLERED

Project Title: REPLACE ELEVATORS IN BLDG 07 & BLDG 09
Project Number: 502-24-102
Building Number: -
Location: ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA
Drawing Number: EF601
Issue Date: 03/24/2026
Checked: DCW/NVP
Drawn: JNV/GPB

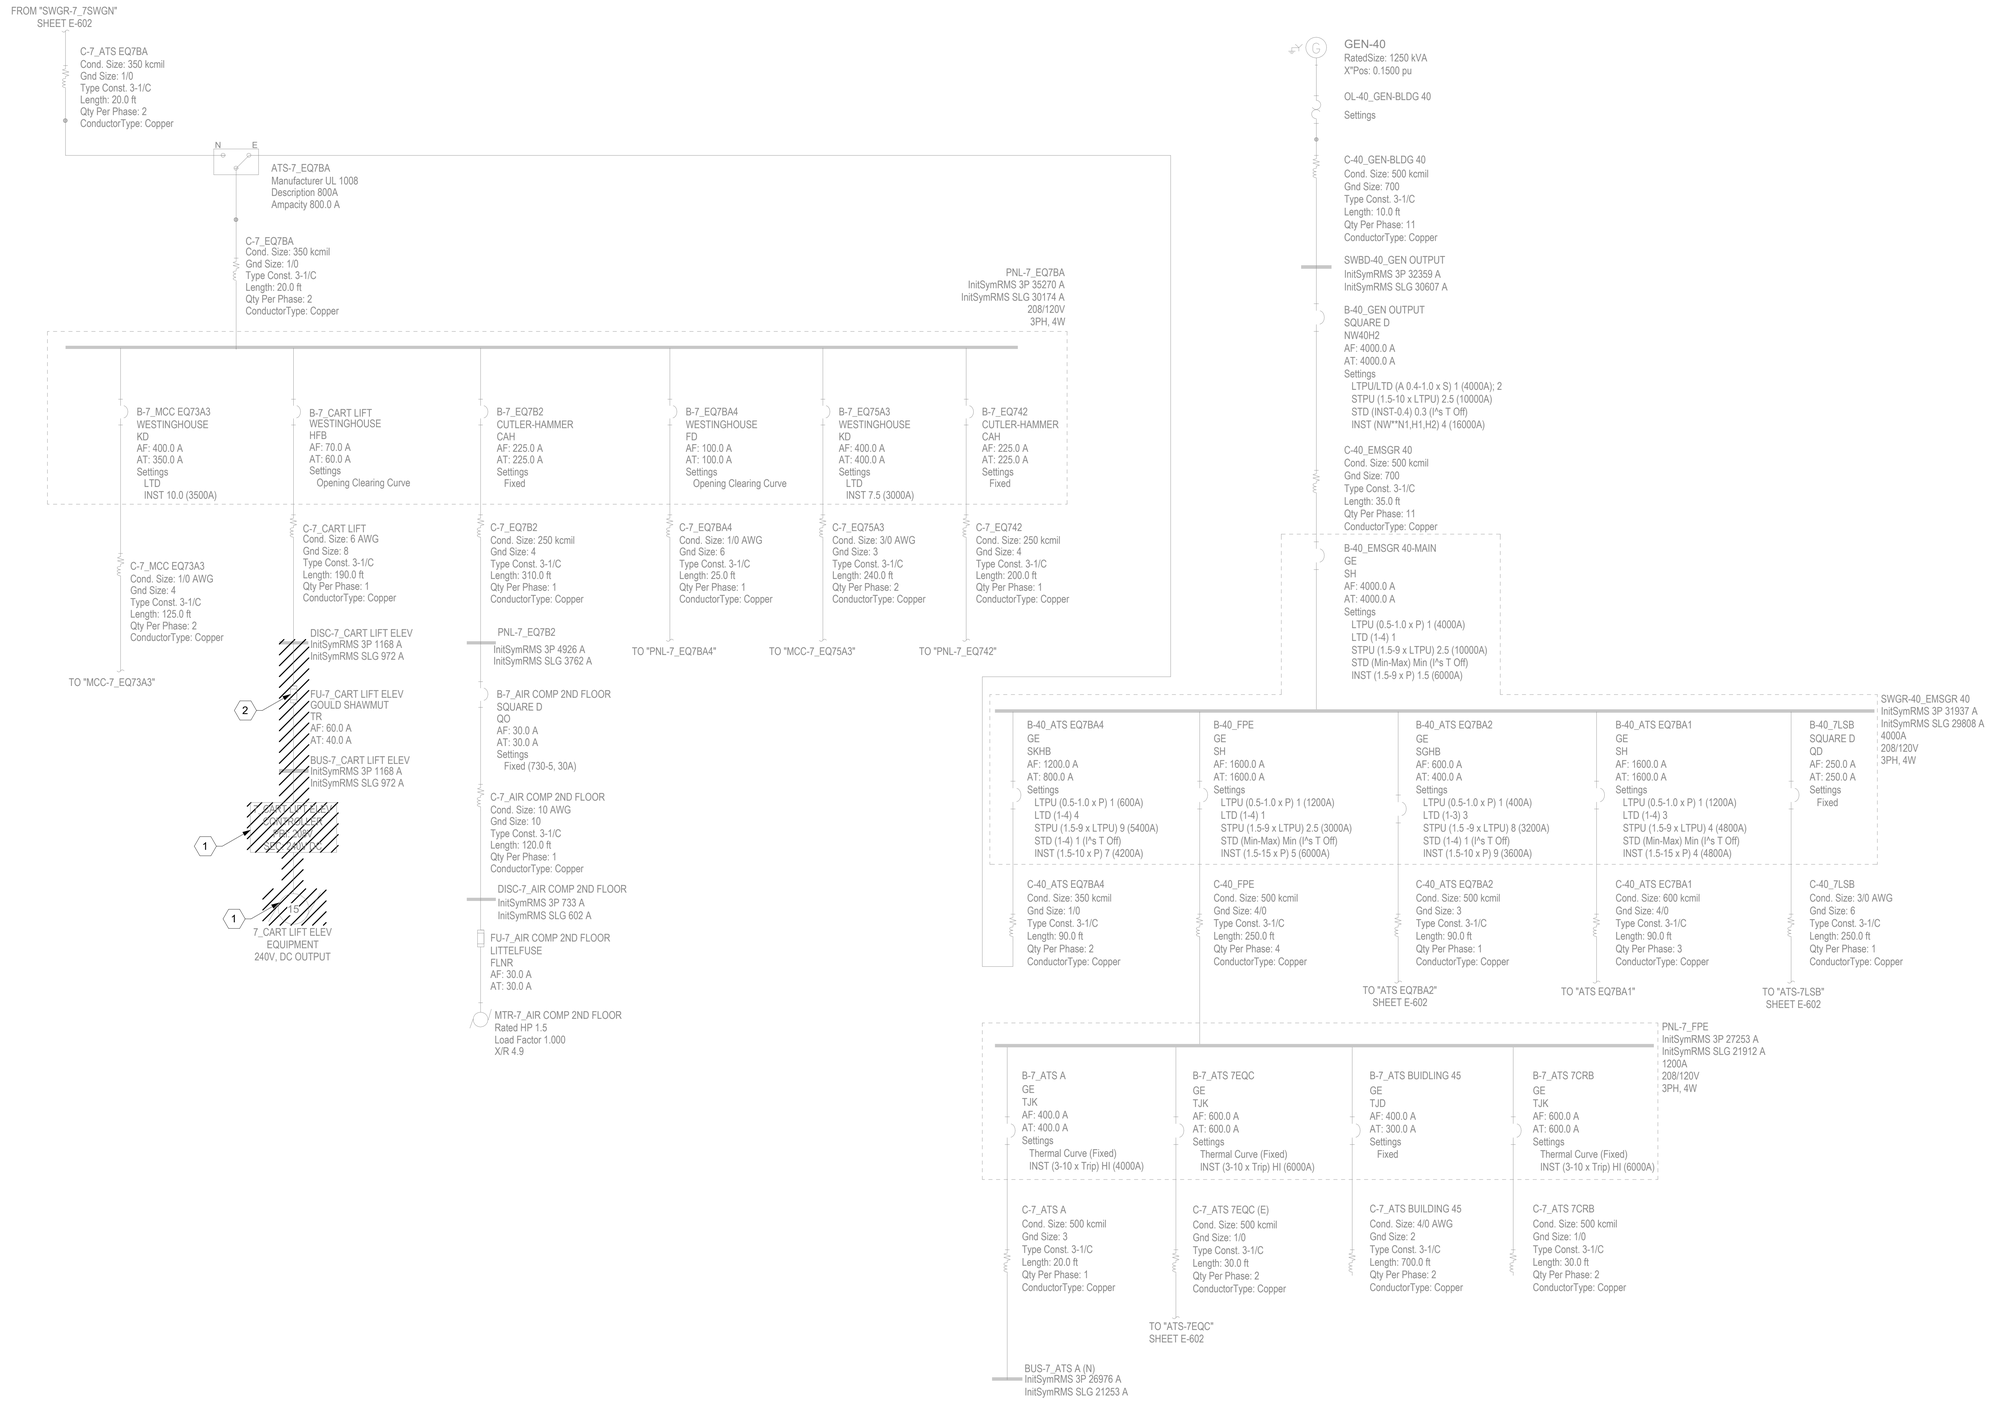

GENERAL NOTES

1. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS AS IT PERTAINS TO SUBJECT PROJECT. ANY DISCREPANCIES FOUND SHALL BE REPORTED TO THE ENGINEER.
2. CONTRACTOR SHALL PROVIDE ALL SHUTDOWN PLANS, TEMPORARY POWER PLANS, TEMPORARY POWER, AND PHASING PLANS FOR VA REVIEW AND APPROVAL PRIOR TO COMMENCING WORK. ALL PLANS SHALL BE SUBMITTED FOR REVIEW 30 DAYS PRIOR TO IMPLEMENTATION.

KEY NOTES

1. EXISTING EQUIPMENT SHALL BE DEMOLISHED AND REPLACED. RACEWAYS AND CONDUCTORS SHALL BE DEMOLISHED BACK TO SOURCE.
2. EXISTING CART-LIFT ELEVATOR DISCONNECT SHALL BE DEMOLISHED. PRESERVE FEEDER RACEWAYS AND CONDUCTORS FOR REUSE.

1 – BUILDING 07 - ONE-LINE DIAGRAMS - EXISTING - PART 1 OF 2

NTS

Revisions:	Date:

CONSULTANT/ DISCIPLINE

DISCIPLINE:

ARCHITECT/ ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HIGHWAY S. SUITE 300
KENT, WA 98032

SPEESDESIGNBUILD

STAMP

LOUIS R. LITANO
STATE OF WASHINGTON
55681
3-24-26
REGISTERED PROFESSIONAL ENGINEER

Office of Construction and Facilities Management

U.S. Department of Veterans Affairs

Drawing Title: BUILDING 07 - ONE-LINE DIAGRAMS - EXISTING - PART 1 OF 2	Phase: 100% CONSTRUCTION DOCUMENTS
Approved:	FULLY SPRINKLERED

Project Title: REPLACE ELEVATORS IN BLDG 07 & BLDG 09	Project Number: 502-24-102
	Building Number: 07
Location: ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA	Drawing Number: E-601
Issue Date: 03/24/2026 / Checked: DCW/NVP / Drawn: JNV/GPB	

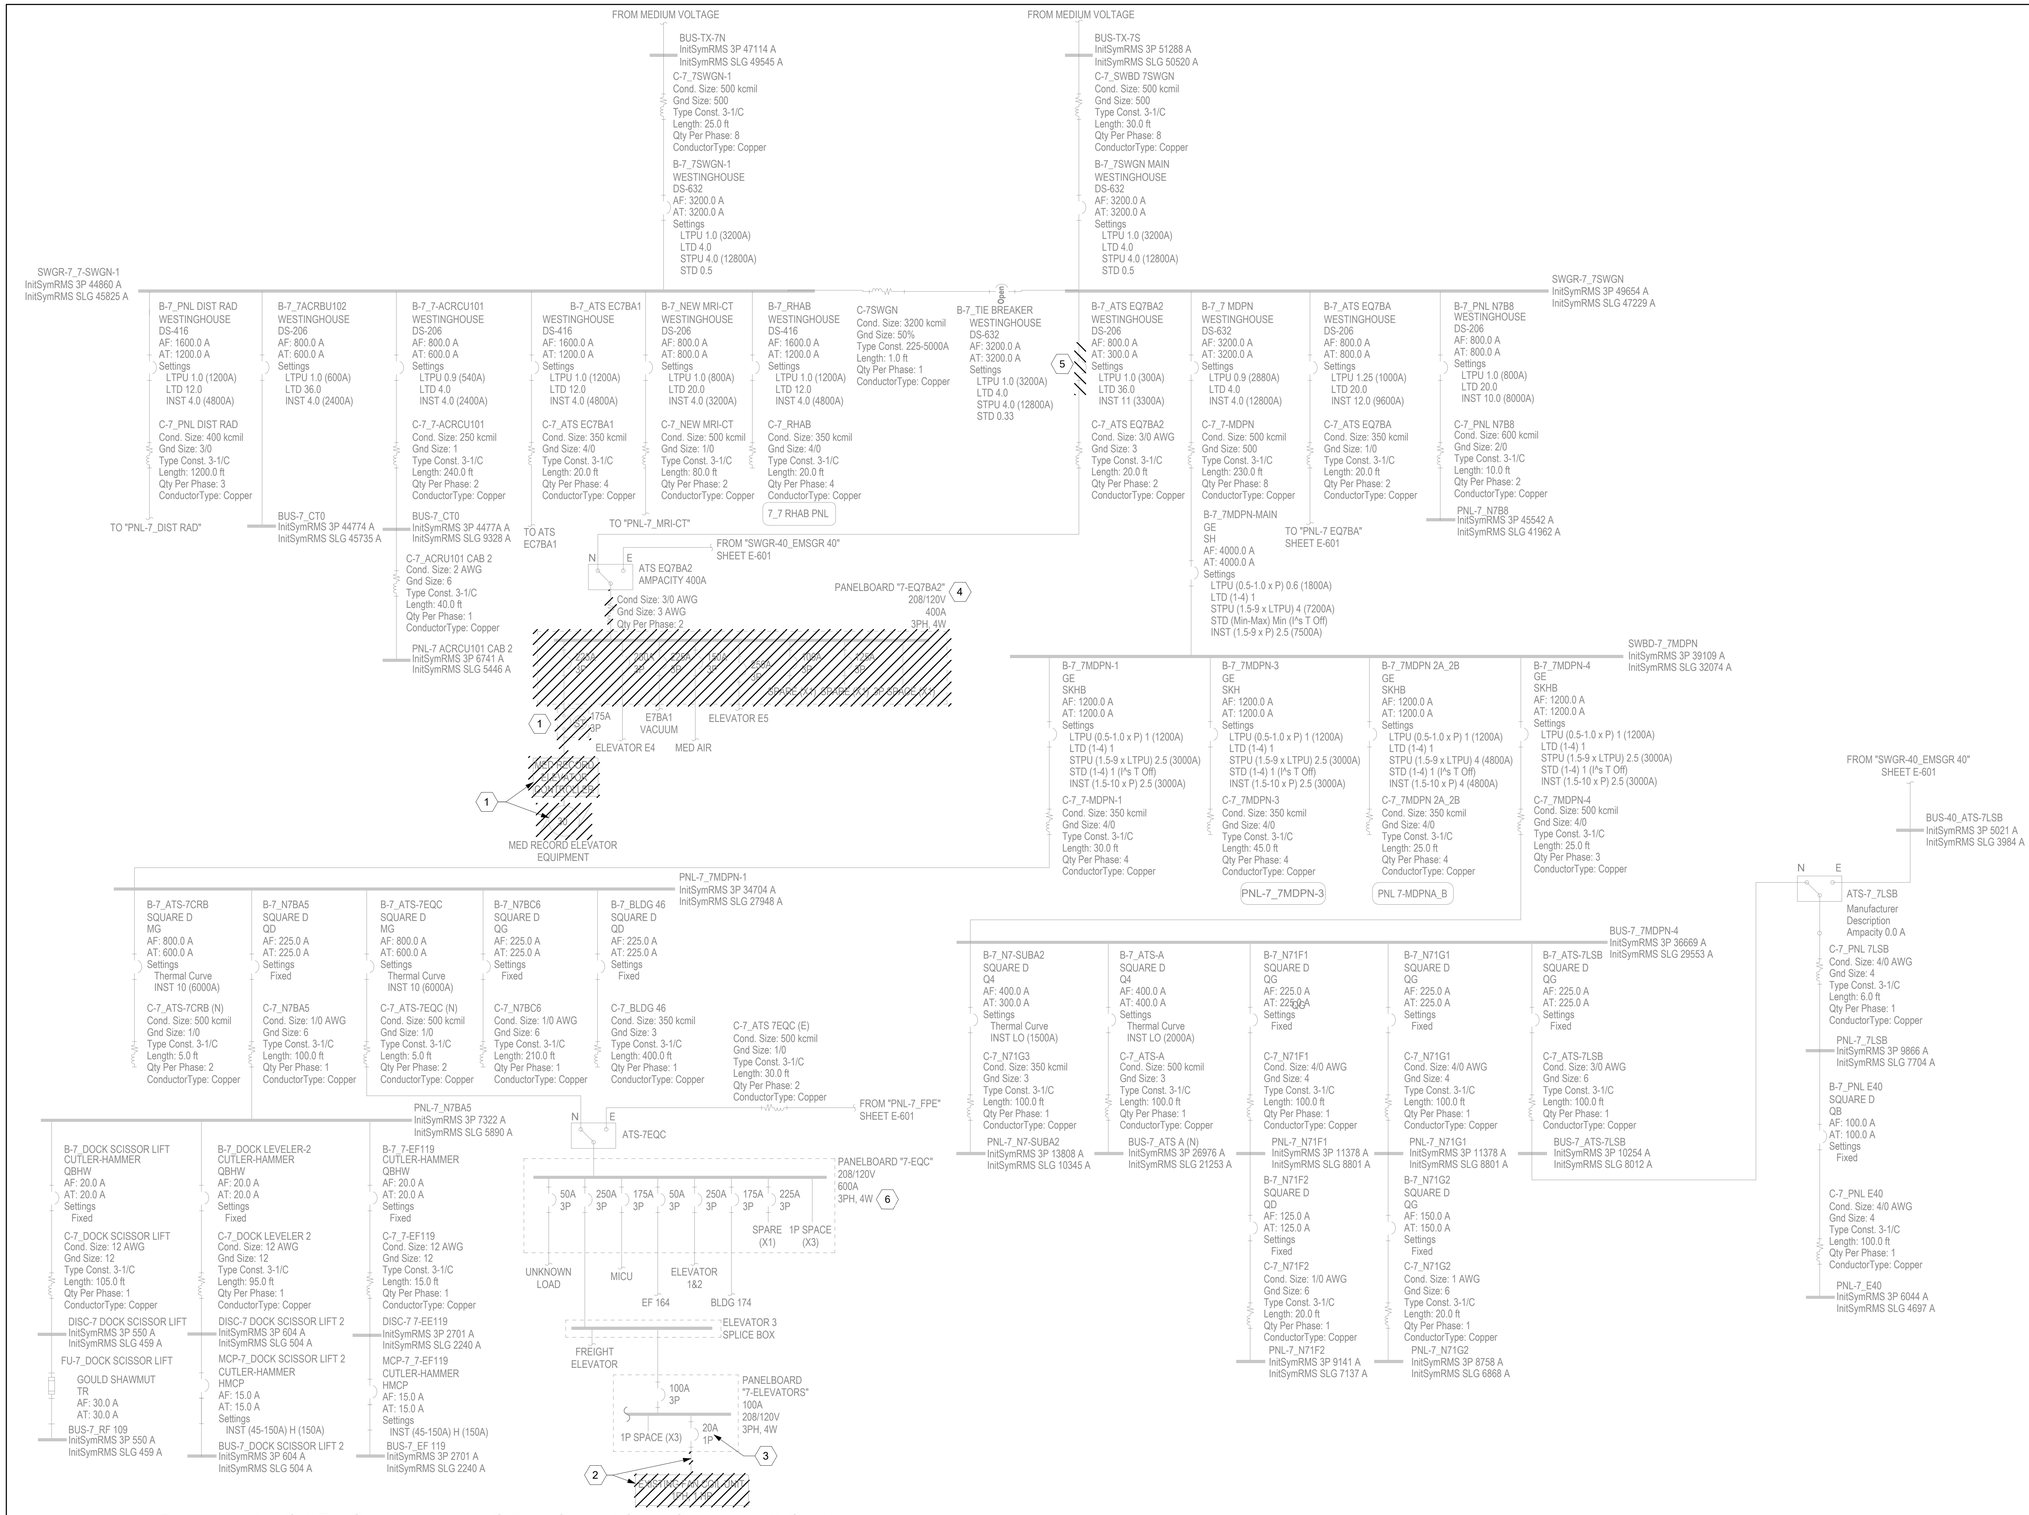

GENERAL NOTES

1. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS AS IT PERTAINS TO SUBJECT PROJECT. ANY DISCREPANCIES FOUND SHALL BE REPORTED TO THE ENGINEER.
2. CONTRACTOR SHALL PROVIDE ALL SHUTDOWN PLANS, TEMPORARY POWER PLANS, TEMPORARY POWER, AND PHASING PLANS FOR VA REVIEW AND APPROVAL PRIOR TO COMMENCING WORK. ALL PLANS SHALL BE SUBMITTED FOR REVIEW 30 DAYS PRIOR TO IMPLEMENTATION.

KEY NOTES

1. EXISTING EQUIPMENT SHALL BE DEMOLISHED AND REPLACED.
2. EXISTING EQUIPMENT SHALL BE DEMOLISHED. ALL RACEWAYS AND CONDUCTORS SHALL BE DEMOLISHED BACK TO SOURCE.
3. EXISTING CIRCUIT BREAKER SERVING DEMOLISHED LOADS SHALL BE PRESERVED.
4. EXISTING PANELBOARD AND SOURCE FEEDER SHALL BE DEMOLISHED AND REPLACED. PRESERVE AND MAINTAIN EXISTING CIRCUITING FOR RETERMINATION INTO REPLACEMENT PANELBOARD. REFERENCE REVISED ONE-LINE DIAGRAM AND ASSOCIATED PANEL SCHEDULE FOR ADDITIONAL INFORMATION.
5. EXISTING CIRCUIT BREAKER SHALL BE DEMOLISHED AND REPLACED.
6. EXISTING PANELBOARD SHALL BE MODIFIED. REFERENCE REVISED ONE-LINE DIAGRAM AND ASSOCIATED PANEL SCHEDULE FOR ADDITIONAL INFORMATION.

1 - BUILDING 07 - ONE-LINE DIAGRAMS - EXISTING - PART 2 OF 2

NTS

Revisions:	Date:

CONSULTANT/ DISCIPLINE

DISCIPLINE:

ARCHITECT/ ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HIGHWAY S. SUITE 300
KENT, WA 98032

SPEESDESIGNBUILD

STAMP

LOUIS R. LITZKO — STATE OF WASHINGTON — 15508 — REGISTERED PROFESSIONAL ENGINEER — 3-24-26

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title
BUILDING 07 - ONE-LINE DIAGRAMS - EXISTING - PART 2 OF 2

Approved:

Phase
100% CONSTRUCTION DOCUMENTS

FULLY SPRINKLERED

Project Title
REPLACE ELEVATORS IN BLDG 07 & BLDG 09

Project Number
502-24-102

Building Number
07

Location
ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA

Drawing Number
E-602

Issue Date
03/24/2026

Checked
DCW/NVP

Drawn
JNV/GPB

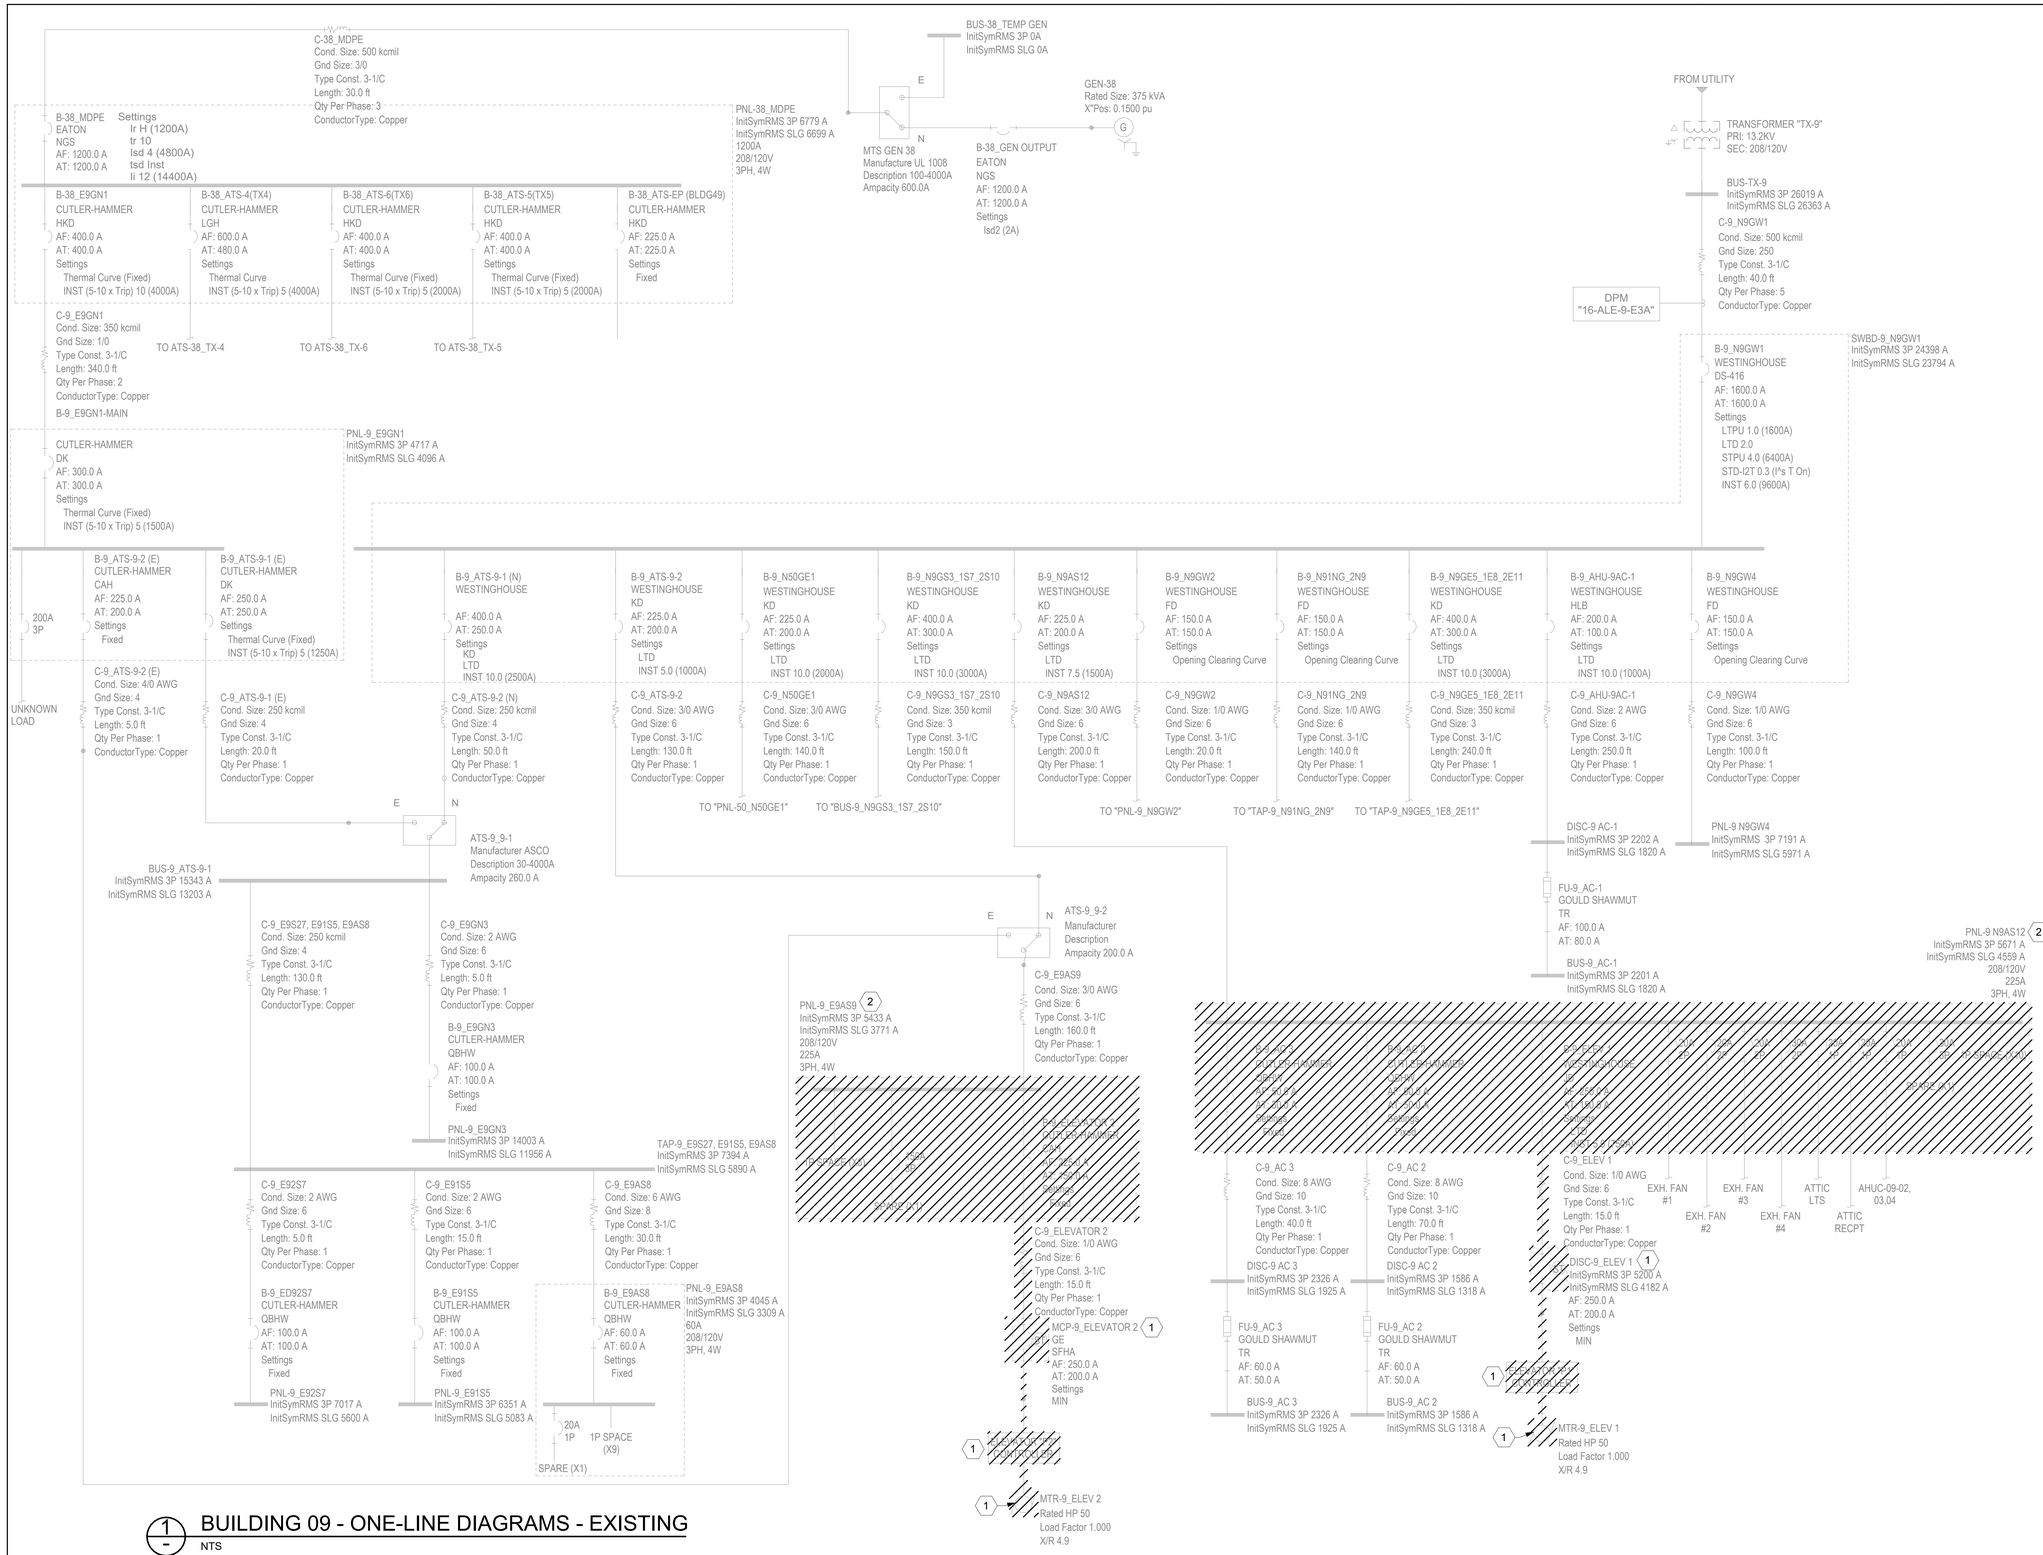

1 BUILDING 09 - ONE-LINE DIAGRAMS - EXISTING
NTS

GENERAL NOTES

1. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS AS IT PERTAINS TO SUBJECT PROJECT. ANY DISCREPANCIES FOUND SHALL BE REPORTED TO THE ENGINEER.
2. CONTRACTOR SHALL PROVIDE ALL SHUTDOWN PLANS, TEMPORARY POWER PLANS, TEMPORARY POWER, AND PHASING PLANS FOR VA REVIEW AND APPROVAL PRIOR TO COMMENCING WORK. ALL PLANS SHALL BE SUBMITTED FOR REVIEW 30 DAYS PRIOR TO IMPLEMENTATION.

KEY NOTES

1. EXISTING EQUIPMENT SHALL BE DEMOLISHED AND REPLACED. DEMOLISH CONDUCTOR AND RACEWAY BACK TO SOURCE.
2. EXISTING PANELBOARD SHALL BE DEMOLISHED AND REPLACED. PRESERVE AND MAINTAIN EXISTING CIRCUITING AND MAIN FEEDER FOR RETERMINATION INTO REPLACEMENT PANELBOARD. REFERENCE REVISED ONE-LINE DIAGRAM AND ASSOCIATED PANEL SCHEDULE FOR ADDITIONAL INFORMATION.

Revisions:	Date:

CONSULTANT/ DISCIPLINE

DISCIPLINE:

ARCHITECT/ ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HIGHWAY S. SUITE 300
KENT, WA 98032
SPEESDESIGNBUILD

STAMP

LEWIS R. LITZAU
STATE OF WASHINGTON
55681
3-24-26
REGISTERED PROFESSIONAL ENGINEER

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title	BUILDING 09 - ONE-LINE DIAGRAMS - EXISTING
Phase	100% CONSTRUCTION DOCUMENTS
Approved:	
	FULLY SPRINKLERED
Project Title	REPLACE ELEVATORS IN BLDG 07 & BLDG 09
Project Number	502-24-102
Building Number	09
Location	ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA
Drawing Number	E-603
Issue Date	03/24/2026
Checked	DCW/NVP
Drawn	JNV/GPB

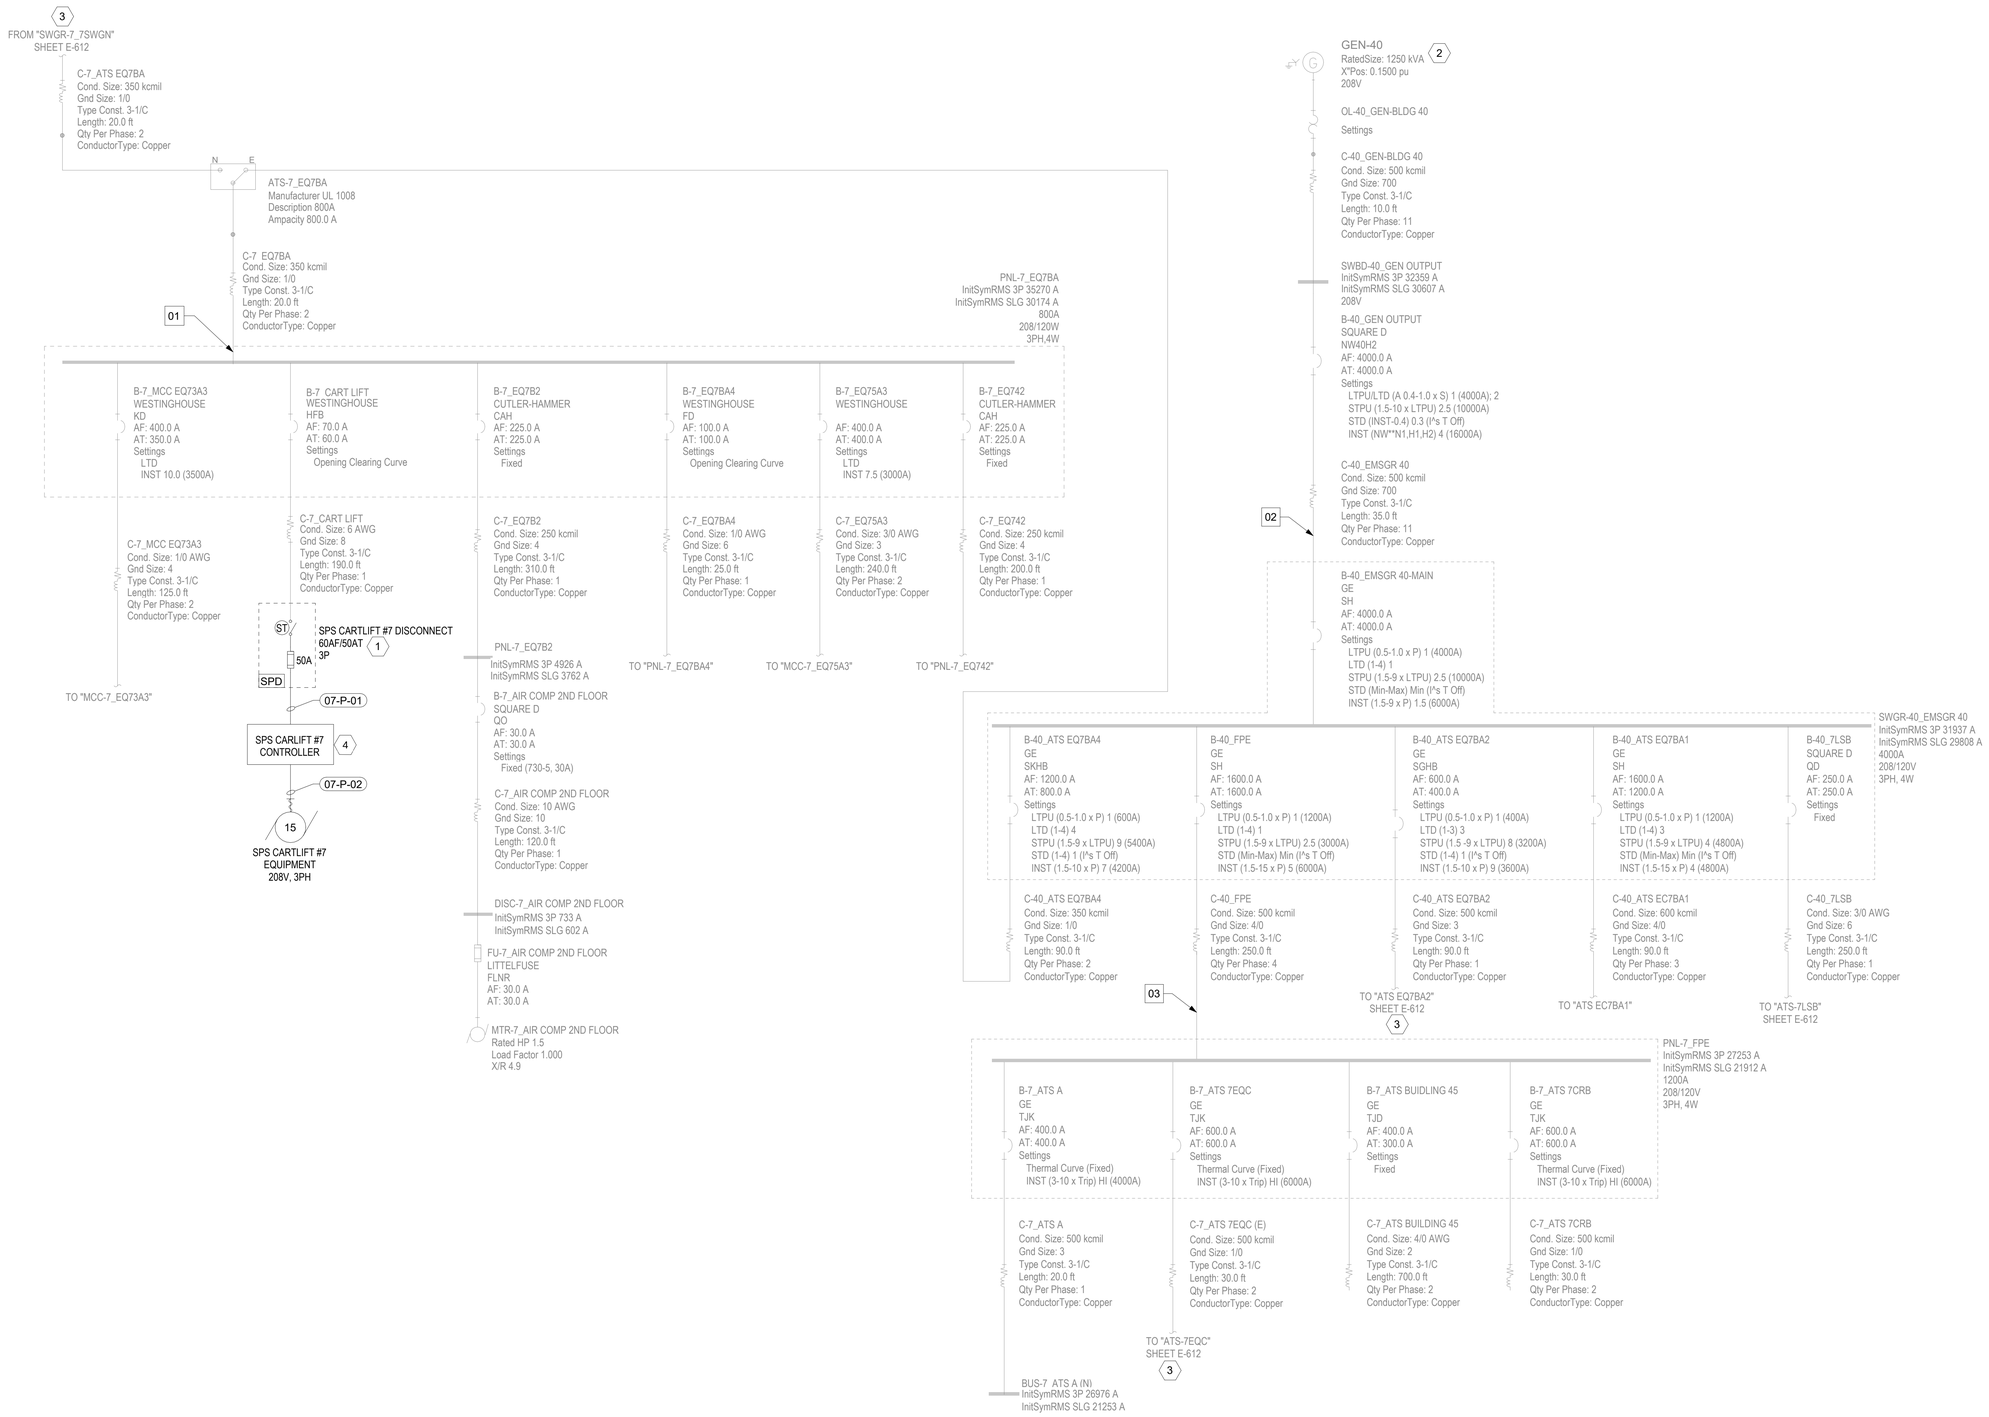

GENERAL NOTES

1. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONGS AS IT PERTAINS TO SUBJECT PROJECT. ANY DISCREPANCIES FOUND SHALL BE REPORTED TO THE ENGINEER.
2. CONTRACTOR SHALL PROVIDE ALL SHUTDOWN PLANS. TEMPORARY POWER PLANS, AND PHASING PLANS FOR VA REVIEW AND APPROVAL PRIOR TO COMMENCING WORK. ALL PLANS SHALL BE SUBMITTED FOR REVIEW 30 DAYS PRIOR TO IMPLEMENTATION.
3. SHORT CIRCUIT CALCULATIONS BASED ON VA PROVIDED AS-BUILTS.
4. CONTRACTOR SHALL PROVIDE CIRCUIT BREAKERS WITH AIC RATING EQUAL TO OR GREATER THAN HIGHEST FAULT CURRENT RATING INDICATED ON ASSOCIATED PANELBOARD SCHEDULE AND ONE-LINE DIAGRAM.

KEY NOTES

1. ELEVATOR CONTROL SWITCH SHALL INCLUDE SHUNT TRIP DISCONNECT SWITCH AND SHALL BE INTERFACED WITH EXISTING FIRE ALARM CONTROL SYSTEM TO DE-ENERGIZE CIRCUIT UPON ACTIVATION; PROVIDE CONDUIT AND WIRE AS REQUIRED. PROVIDE FUSES PER ELEVATOR MANUFACTURER'S REQUIREMENTS. COORDINATE WITH ELEVATOR MANUFACTURER.
2. REFERENCE ASSOCIATED GENERATOR CAPACITY AND LOAD INFORMATION SCHEDULE ON SHEET E-701 FOR ADDITIONAL INFORMATION.
3. ADDITIONAL LOAD HAS BEEN ADDED TO FEEDER. REFERENCE CONTINUED ONE-LINE DIAGRAM AS INDICATED ON DRAWING AND ASSOCIATED PANEL SCHEDULE FOR ADDITIONAL LOADING INFORMATION.
4. PROVIDE (1) 1" CONDUIT FROM CONTROLLER TO UPSTREAM ATS FOR ALL COMMUNICATION / CONTROL CABLING AS REQUIRED.

LOAD DATA POINT NOTES

01 LOAD DATA POINT: EXISTING PANELBOARD "7-EQ7BA" MAIN FEED. REFERENCE 'PANELBOARD "7-EQ7BA" CALCULATED LOAD INFORMATION SCHEDULE' ON SHEET E-702 FOR ADDITIONAL INFORMATION.

02 LOAD DATA POINT: EXISTING SWITCHGEAR "40_EMSGR 40" MAIN FEED. REFERENCE 'SWITCHGEAR "40_EMSGR 40" CALCULATED LOAD INFORMATION SCHEDULE' ON SHEET E-702 FOR ADDITIONAL INFORMATION.

03 LOAD DATA POINT: EXISTING PANELBOARD "7-FPE" MAIN FEED. REFERENCE 'PANELBOARD "7-FPE" CALCULATED LOAD INFORMATION SCHEDULE' ON SHEET E-702 FOR ADDITIONAL INFORMATION.

1 BUILDING 07 - ONE-LINE DIAGRAMS - REVISED - PART 1 OF 2

NTS

Revisions:	Date:

CONSULTANT/ DISCIPLINE

DISCIPLINE:

ARCHITECT/ ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HIGHWAY S. SUITE 300
KENT, WA 98032

SPEESDESIGNBUILD

STAMP

LOUIS R. UTANO
STATE OF WASHINGTON
19568
3-24-26
REGISTERED
PROFESSIONAL ENGINEER

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title	BUILDING 07 - ONE-LINE DIAGRAMS - REVISED - PART 1 OF 2
Phase	100% CONSTRUCTION DOCUMENTS
Approved:	
	FULLY SPRINKLERED
Project Title	REPLACE ELEVATORS IN BLDG 07 & BLDG 09
Project Number	502-24-102
Building Number	07
Location	ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA
Drawing Number	E-611
Issue Date	03/24/2026
Checked	DCW/NVP
Drawn	JNV/GPB

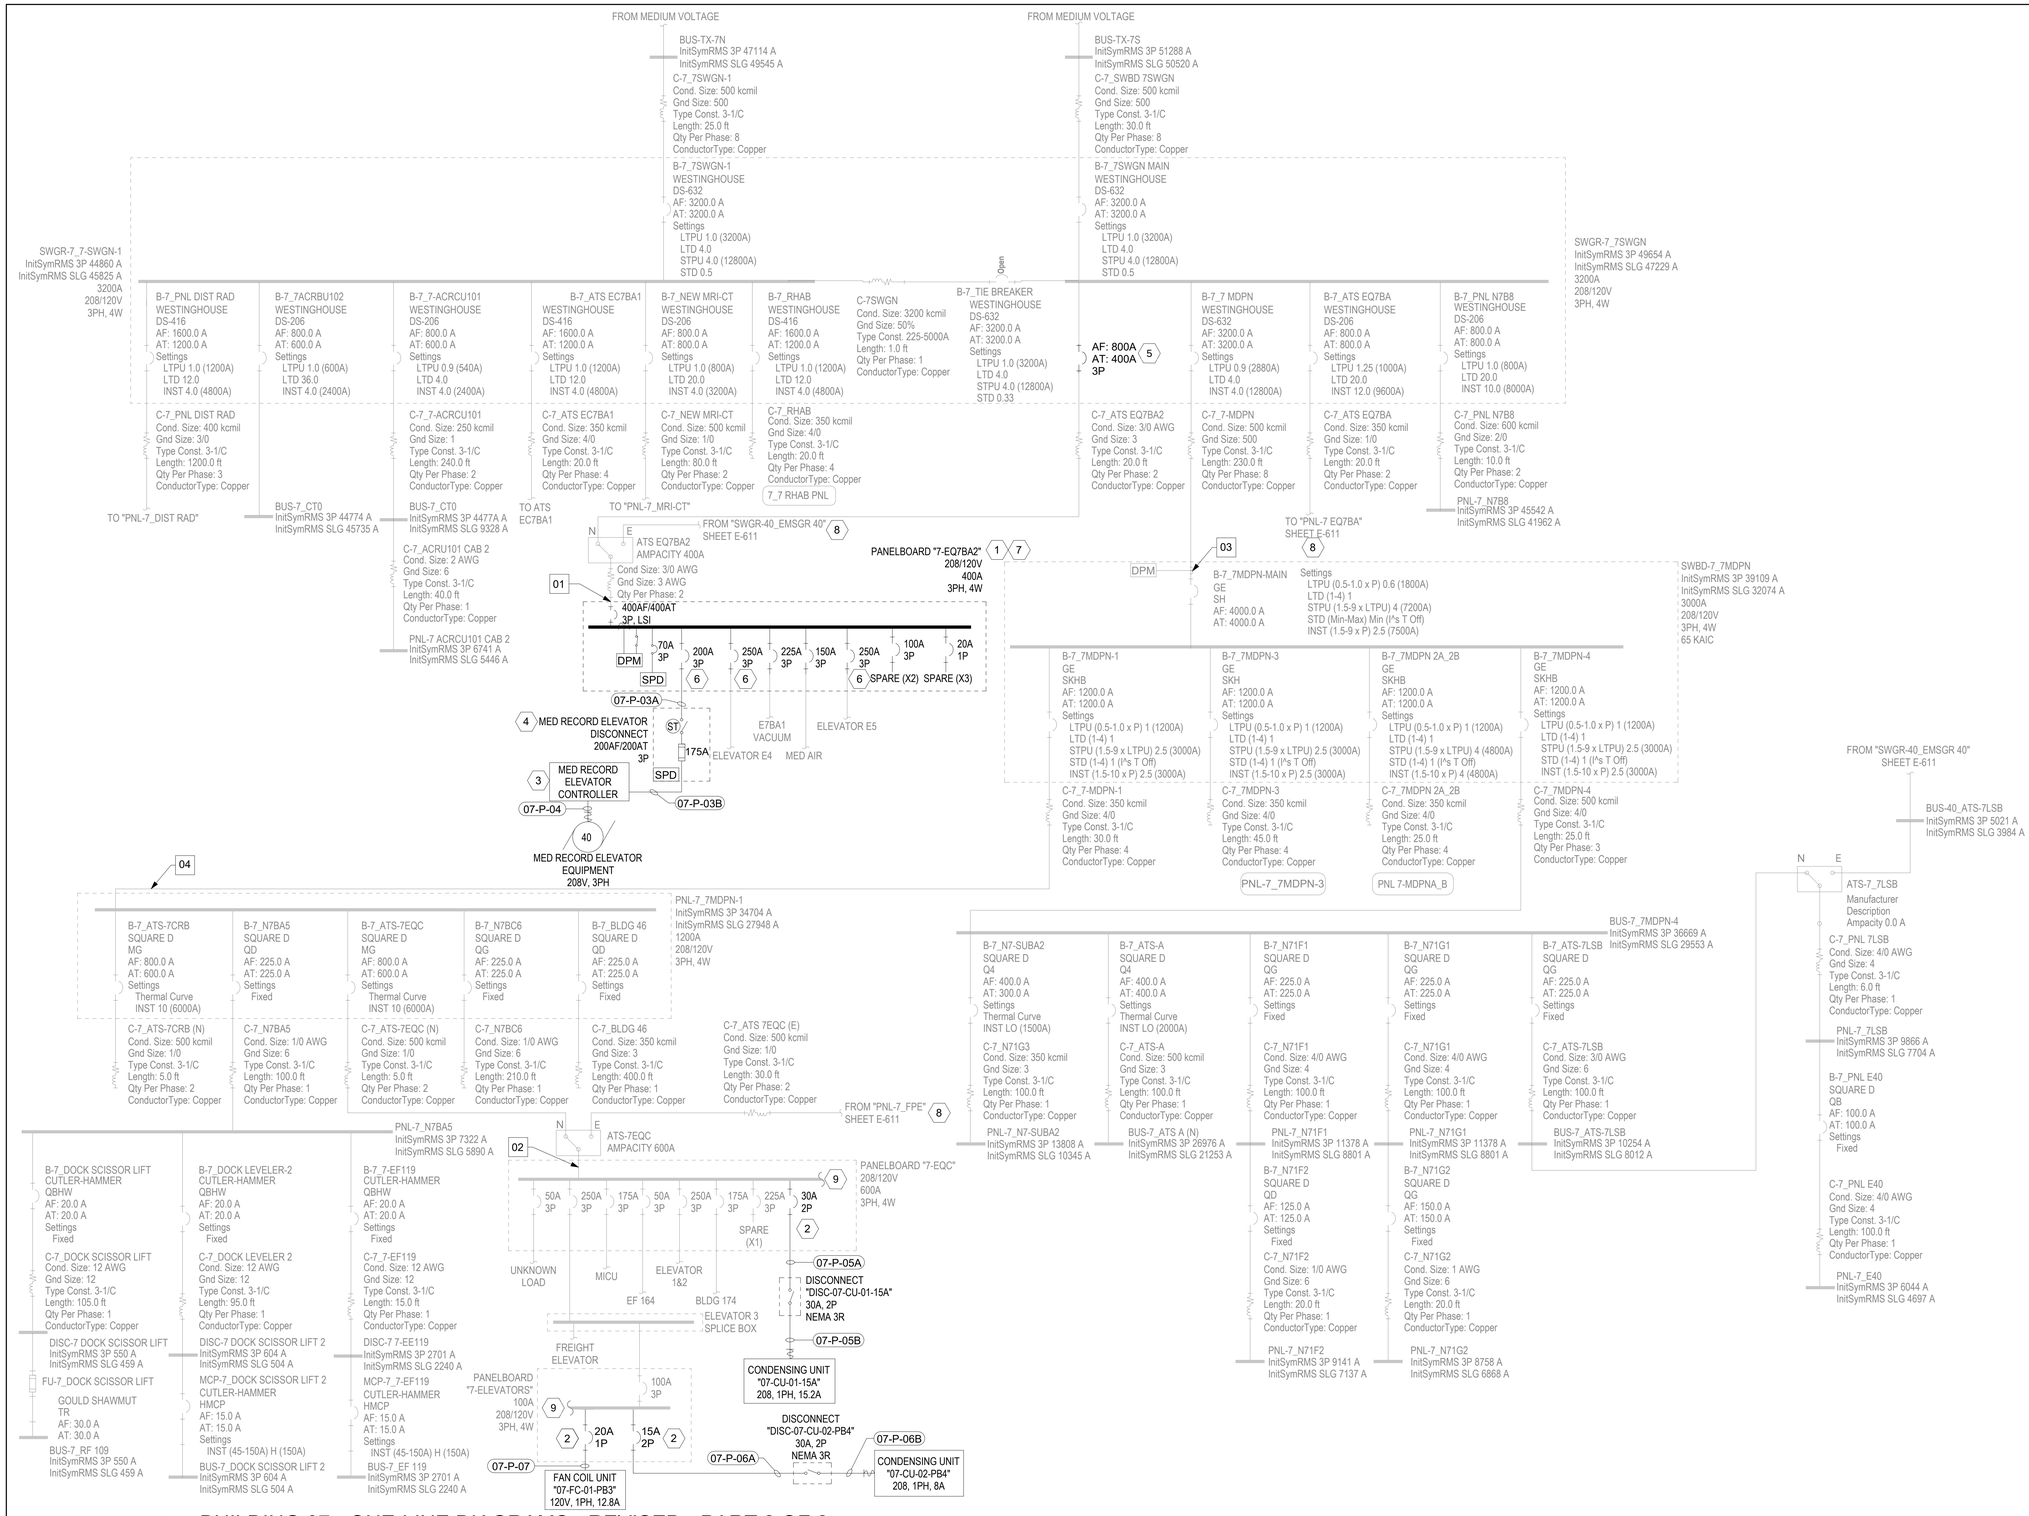

BUILDING 07 - ONE-LINE DIAGRAMS - REVISED - PART 2 OF 2

1 — NTS

GENERAL NOTES

1. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS AS IT PERTAINS TO SUBJECT PROJECT. ANY DISCREPANCIES FOUND SHALL BE REPORTED TO THE ENGINEER.
2. CONTRACTOR SHALL PROVIDE ALL SHUTDOWN PLANS, TEMPORARY POWER PLANS, TEMPORARY POWER, AND PHASING PLANS FOR VA REVIEW AND APPROVAL PRIOR TO COMMENCING WORK. ALL PLANS SHALL BE SUBMITTED FOR REVIEW 30 DAYS PRIOR TO IMPLEMENTATION.
3. SHORT CIRCUIT CALCULATIONS BASED ON VA PROVIDED AS-BUILTS.
4. CONTRACTOR SHALL PROVIDE CIRCUIT BREAKERS WITH AIC RATING EQUAL TO OR GREATER THAN HIGHEST FAULT CURRENT RATING INDICATED ON ASSOCIATED PANELBOARD SCHEDULE AND ONE-LINE DIAGRAM.

KEY NOTES

1. PROVIDE REPLACEMENT PANELBOARD. PROVIDE CONDUIT AND WIRE AS NEEDED TO RE-TERMINATE EXISTING CIRCUITING. REFERENCE ASSOCIATED PANELBOARD SCHEDULE ON SHEET E-702 FOR ADDITIONAL INFORMATION.
2. UTILIZE EXISTING SPACE(S) TO PROVIDE CIRCUIT BREAKER AS INDICATED.
3. PROVIDE (1) 1" CONDUIT FROM CONTROLLER TO UPSTREAM ATS FOR ALL COMMUNICATION / CONTROL CABLING AS REQUIRED.
4. ELEVATOR CONTROL SWITCH SHALL INCLUDE SHUNT TRIP DISCONNECT SWITCH AND SHALL BE INTERFACED WITH EXISTING FIRE ALARM CONTROL SYSTEM TO DE-ENERGIZED CIRCUIT UPON ACTIVATION; PROVIDE CONDUIT AND WIRE ASVREQUIRED. PROVIDE FUSES PER ELEVATOR MANUFACTURER'S REQUIREMENTS. COORDINATE WITH ELEVATOR MANUFACTURER.
5. PROVIDE REPLACEMENT RETRO FIT CIRCUIT BREAKER. COORDINATE WITH MANUFACTURER TO PROVIDE A COMPLETE AND FULLY FUNCTIONAL SYSTEM.
6. CIRCUIT BREAKER SHALL INCLUDE SHUNT TRIP AND SHALL BE INTERFACED WITH EXISTING FIRE ALARM CONTROL SYSTEM TO DE-ENERGIZE CIRCUIT UPON ACTIVATION; PROVIDE CONDUIT AND WIRE AS REQUIRED.
7. PROVIDE ID PLACARD FOR REPLACMENT PANELBOARD TO READ AS FOLLOWS: "EQ7BA2". PRIOR TO PLACARD BEING MADE, CONTRACTOR SHALL CONFIRM WITH VA FOR NAMING CONVENTION.
8. ADDITIONAL LOAD HAS BEEN ADDED TO FEEDER. REFERENCE CONTINUED ONE-LINE DIAGRAM AS INDICATED ON DRAWING AND ASSOCIATED PANEL SCHEDULE FOR ADDITIONAL LOADING INFORMATION.
9. REFERENCE PANEL SCHEDULE FOR ADDITIONAL INFORMATION.

LOAD DATA POINT NOTES

01. LOAD DATA POINT: EXISTING PANELBOARD "7-EQ7BA2" MAIN FEED. REFERENCE 'PANELBOARD "7-EQ7BA2" CALCULATED LOAD INFORMATION SCHEDULE' ON SHEET E-703 FOR ADDITIONAL INFORMATION.
02. LOAD DATA POINT: EXISTING PANELBOARD "7-EQC" MAIN FEED. REFERENCE 'PANELBOARD "7-EQC" CALCULATED LOAD INFORMATION SCHEDULE' ON SHEET E-702 FOR ADDITIONAL INFORMATION.
03. LOAD DATA POINT: EXISTING SWITCHBOARD "7-7MDPN" MAIN FEED HAS BEEN METERED. REFERENCE 'SWITCHBOARD "7-7MDPN" METERING AND LOAD INFORMATION SCHEDULE' ON SHEET E-702 FOR ADDITIONAL INFORMATION.
04. LOAD DATA POINT: EXISTING PANELBOARD "7-7MDPN-1" MAIN FEED. REFERENCE 'PANELBOARD "7-7MDPN-1" METERING AND LOAD INFORMATION SCHEDULE' ON SHEET E-702 FOR ADDITIONAL INFORMATION.

Revisions:	Date:

CONSULTANT/ DISCIPLINE

DISCIPLINE:

ARCHITECT/ ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HIGHWAY S. SUITE 300
KENT, WA 98032
SPEESDESIGNBUILD

STAMP

LOUIS R. LITZAU — STATE OF WASHINGTON — 55681 — 3-24-26 — REGISTERED PROFESSIONAL ENGINEER

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: BUILDING 07 - ONE-LINE DIAGRAMS - REVISED - PART 2 OF 2

Approved:

Phase: 100% CONSTRUCTION DOCUMENTS

FULLY SPRINKLERED

Project Title: REPLACE ELEVATORS IN BLDG 07 & BLDG 09

Location: ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA

Issue Date: 03/24/2026 | **Checked:** DCW/NVP | **Drawn:** JNV/GPB

Project Number: 502-24-102

Building Number: 07

Drawing Number: E-612

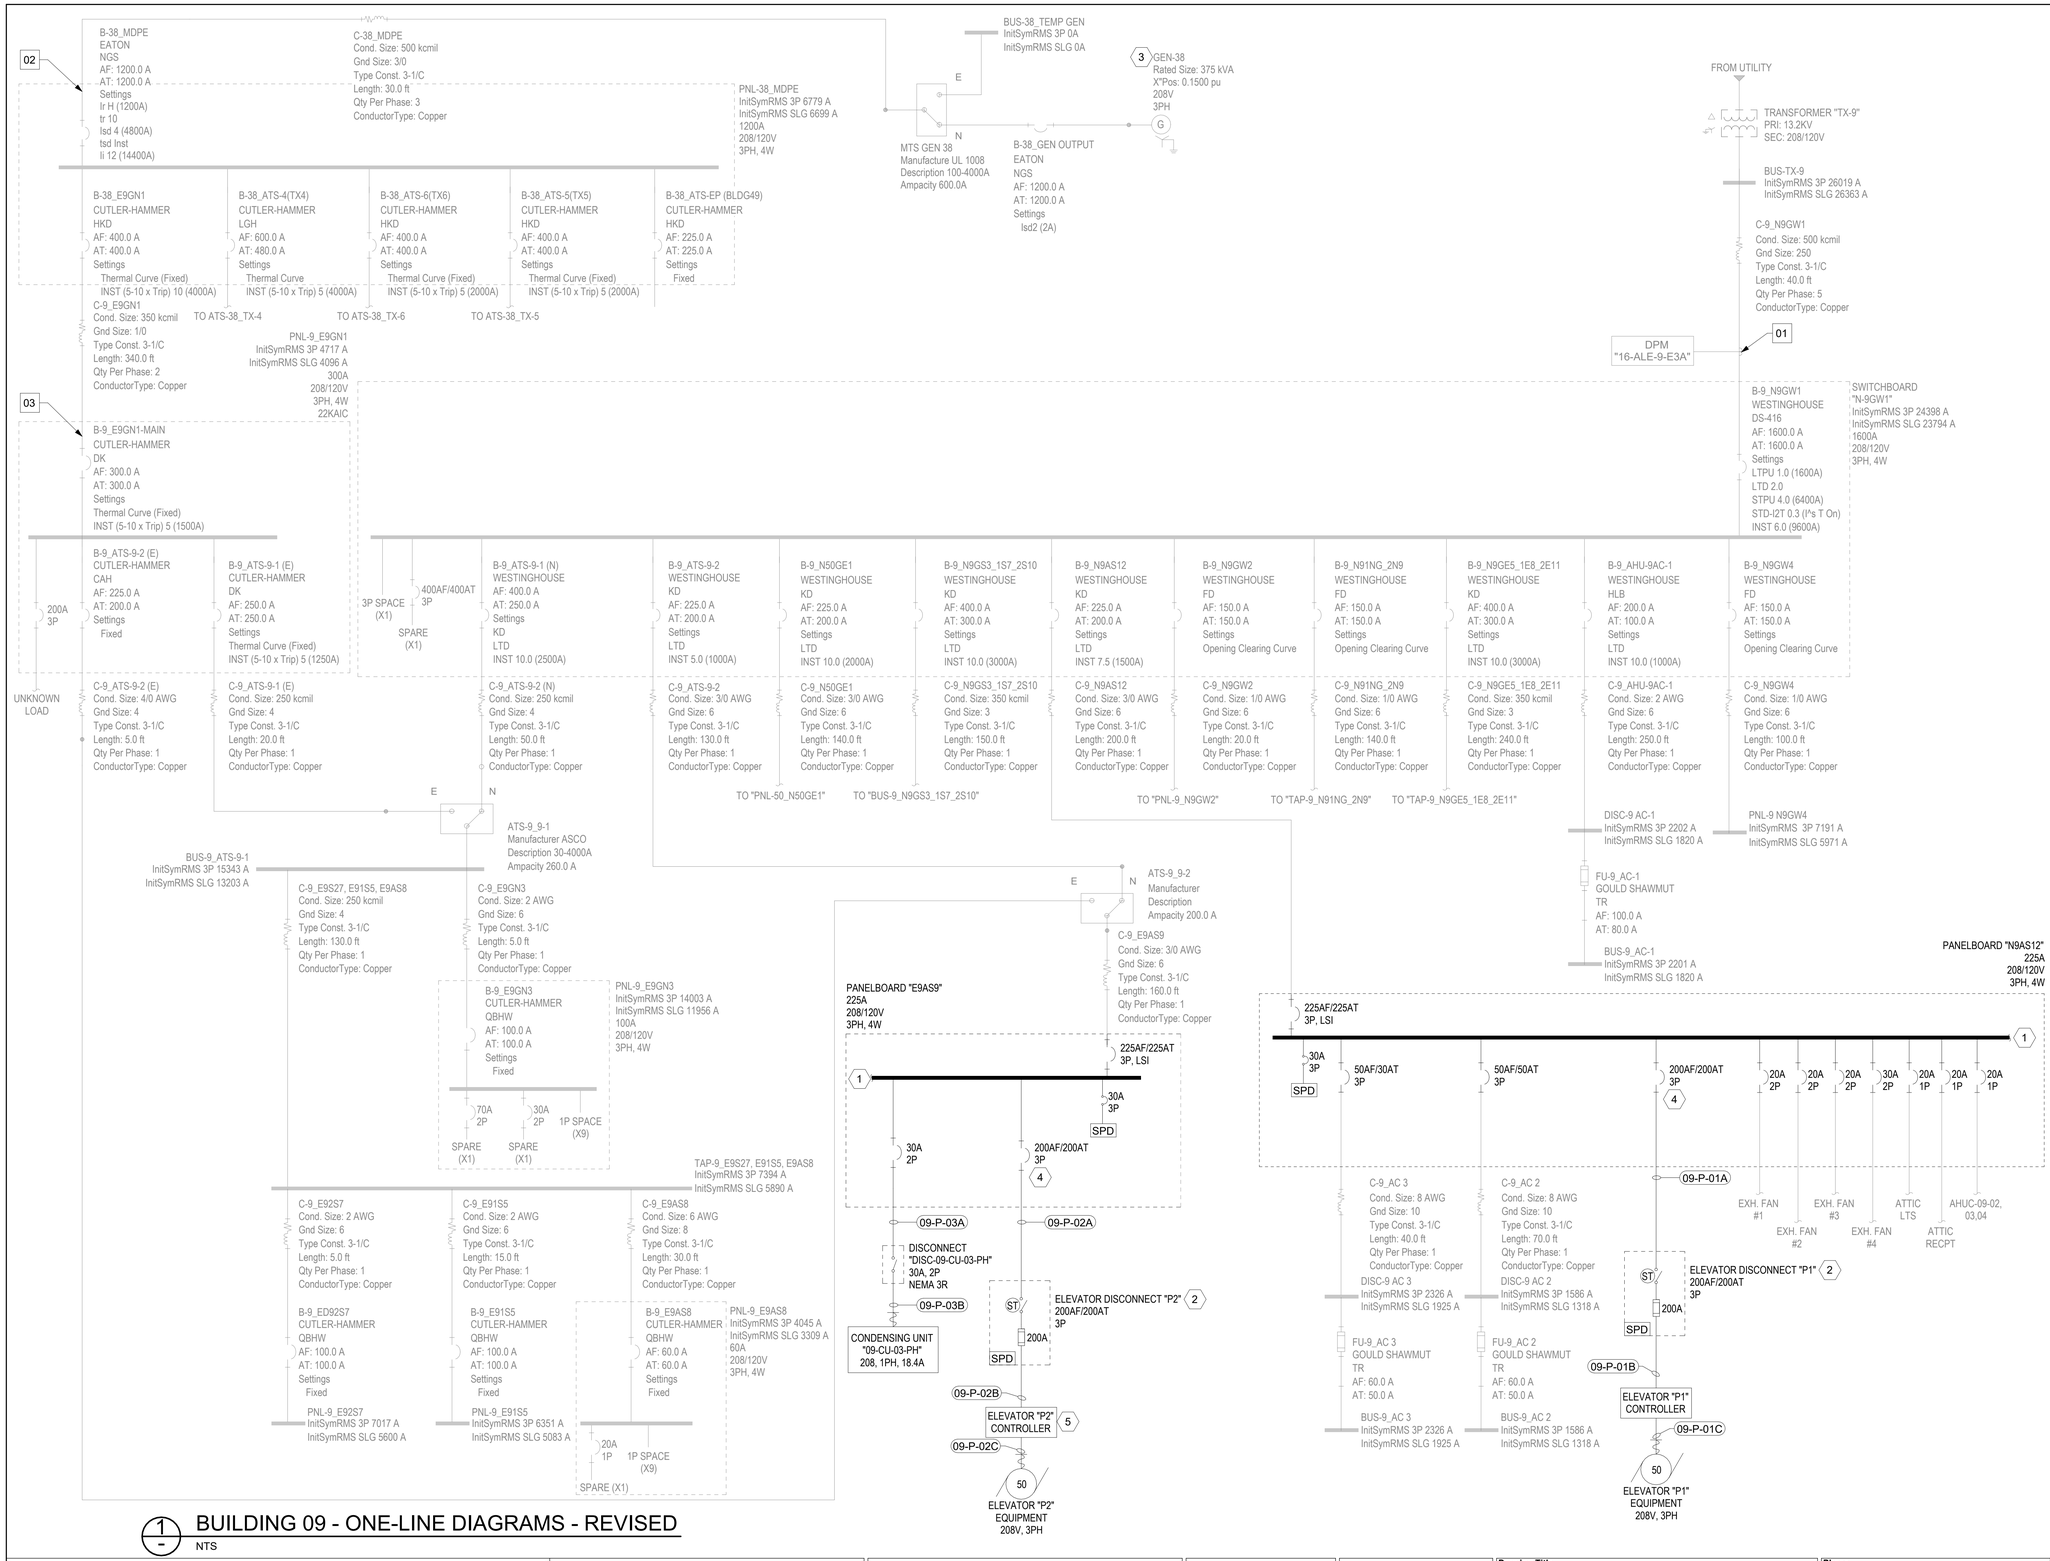

1 BUILDING 09 - ONE-LINE DIAGRAMS - REVISED
NTS

GENERAL NOTES

1. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS AS IT PERTAINS TO SUBJECT PROJECT. ANY DISCREPANCIES FOUND SHALL BE REPORTED TO THE ENGINEER.
2. CONTRACTOR SHALL PROVIDE ALL SHUTDOWN PLANS, TEMPORARY POWER PLANS, AND PHASING PLANS FOR VA REVIEW AND APPROVAL PRIOR TO COMMENCING WORK. ALL PLANS SHALL BE SUBMITTED FOR REVIEW 30 DAYS PRIOR TO IMPLEMENTATION.
3. SHORT CIRCUIT CALCULATIONS BASED ON VA PROVIDED AS-BUILTS.
4. CONTRACTOR SHALL PROVIDE CIRCUIT BREAKERS WITH AIC RATING EQUAL TO OR GREATER THAN HIGHEST FAULT CURRENT RATING INDICATED ON ASSOCIATED PANELBOARD SCHEDULE AND ONE-LINE DIAGRAM.

KEY NOTES

1. PROVIDE REPLACEMENT PANELBOARD. PROVIDE CONDUIT AND WIRE AS REQUIRED TO RE-TERMINATE EXISTING CIRCUITING. REFERENCE ASSOCIATED PANELBOARD SCHEDULES ON SHEET E-703 FOR ADDITIONAL INFORMATION.
2. ELEVATOR CONTROL SWITCH SHALL INCLUDE SHUNT TRIP DISCONNECT SWITCH AND SHALL BE INTERFACED WITH EXISTING FIRE ALARM CONTROL SYSTEM TO DE-ENERGIZE CIRCUIT UPON ACTIVATION OF SPRINKLER SYSTEM; PROVIDE CONDUIT AND WIRE AS REQUIRED. PROVIDE FUSES PER ELEVATOR MANUFACTURER'S REQUIREMENTS. COORDINATE WITH ELEVATOR MANUFACTURER.
3. REFERENCE ASSOCIATED GENERATOR CAPACITY AND LOAD INFORMATION SCHEDULE ON SHEET E-701 FOR ADDITIONAL INFORMATION.
4. CIRCUIT BREAKER SHALL INCLUDE SHUNT TRIP AND SHALL BE INTERFACED WITH EXISTING FIRE ALARM CONTROL SYSTEM TO DE-ENERGIZE CIRCUIT UPON ACTIVATION; PROVIDE CONDUIT AND WIRE AS REQUIRED.
5. PROVIDE (1) 1" CONDUIT FROM CONTROLLER TO UPSTREAM ATS FOR ALL COMMUNICATION / CONTROL CABLING AS REQUIRED.

LOAD DATA POINT NOTES

01 LOAD DATA POINT: EXISTING SWITCHBOARD "N-9GW1" MAIN FEED HAS BEEN METERED. REFERENCE 'SWITCHBOARD "N-9GW1" METERING AND LOAD INFORMATION SCHEDULE' ON SHEET E-703 FOR ADDITIONAL INFORMATION.

02 LOAD DATA POINT: EXISTING PANELBOARD "38_MDPE" MAIN FEED. REFERENCE 'PANELBOARD "38_MDPE" CALCULATED LOAD INFORMATION SCHEDULE' ON SHEET E-703 OR ADDITIONAL INFORMATION.

03 LOAD DATA POINT: EXISTING PANELBOARD "9_E9GN1" MAIN FEED. REFERENCE 'PANELBOARD "9_E9GN1" CALCULATED LOAD INFORMATION SCHEDULE' ON SHEET E-703 FOR ADDITIONAL INFORMATION.

Revisions:	Date:

CONSULTANT/ DISCIPLINE

DISCIPLINE:

ARCHITECT/ ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HIGHWAY S. SUITE 300
KENT, WA 98032

SPEESDESIGNBUILD

STAMP

LEWIS R. LITZAU
STATE OF WASHINGTON
55681
3-24-26
REGISTERED
PROFESSIONAL ENGINEER

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: BUILDING 09 - ONE-LINE DIAGRAMS - REVISED	Phase: 100% CONSTRUCTION DOCUMENTS
Approved:	FULLY SPRINKLERED

Project Title: REPLACE ELEVATORS IN BLDG 07 & BLDG 09	Project Number: 502-24-102
	Building Number: 09
Location: ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA	Drawing Number: E-613
Issue Date: 03/24/2026	Checked: DCW/NVP
	Drawn: JNV/GPB

LUMINAIRE SCHEDULE

TYPE	DESCRIPTION	LUMENS / COLOR TEMP	DRIVER	WATTS	VOLTS	MOUNTING	MFGR	CATALOG #	LENS/DIFFUSER	FINISH	NOTES
L1/L1E	4' STRIP LIGHT	2762 / 4000K	ELECTRONIC, 0-10V	21	120/277V	SUSPENDED	WTZ OR APPROVED EQUAL	WTZ4-3L-U-40-SPFL	SMOOTH POLYCARBONATE FROSTED	WHITE	1, 2, 3
L2	JELLY JAR / VAPORTIGHT LED / WALL OR SURFACE MOUNTED	2520 / 4000K	ELECTRONIC, 0-10V	21	120/277V	WALL	LED LIGHTING SUPPLY OR APPROVED EQUAL	MLLG-LN-LED-VTJJ-21-40	BRUSHED ALUMINUM	WHITE	2, 3
L3/L3E	4' STRIP LIGHT	3708 / 4000K	ELECTRONIC, 0-10V	29	120/277V	SUSPENDED	WTZ OR APPROVED EQUAL	WTZ4-4L-U-40-SPFL	SMOOTH POLYCARBONATE FROSTED	WHITE	1, 2, 3
L4	WALL PACK, WITH INTEGRAL PHOTOCELL	3465 / 4000K	ELECTRONIC	47	120/277V	WALL	PHILLIPS GARDCO, OR APPROVED EQUAL	121-16L-530-NW-G4	FROSTED HIGH-IMPACT DIFFUSER	DARK GRAY	2, 3

GENERAL NOTES:
1. ALL FIXTURES WITH AN "E" SUFFIX, SHALL BE PROVIDED WITH AN EMERGENCY BATTERY PACK. PROVIDE AN UNSWITCHED HOT LEG TO EACH "E" FIXTURE.
2. REFER TO LUMINAIRE FOOT-CANDLE REQUIREMENT SCHEDULE ON THIS SHEET FOR LUMINAIRE MOUNTING INFORMATION.
3. PRIOR TO LUMINAIRE PROCUREMENT, CONTRACTOR SHALL PROVIDE LIGHTING LAYOUT WITH PROPOSED LUMINAIRES AND INDICATE POINT-BY-POINT PHOTOMETRICS FOR ENGINEER REVIEW DURING SUBMITTAL REVIEW PROCESS. REFERENCE LUMINAIRE FOOT-CANDLE REQUIREMENT SCHEDULE FOR FOOT CANDLE REQUIREMENTS.

LUMINAIRE FOOT-CANDLE REQUIREMENT SCHEDULE

ROOM TYPE	BLDG NUMBER	ROOM NUMBER	SHEET NUMBER	MOUNTING HEIGHT	CEILING HEIGHT	FOOT-CANDLE REQUIREMENT	NOTES
ELEVATOR MACHINE ROOM	7	15A	E-404	10' 5"	8' 0"	30 FC	1, 2
ELEVATOR PIT/HOISTWAY		MED RECORD ELEV PIT		-	2' 0"	10 FC	1, 2
		MED RECORD ELEV HOISTWAY		-	(TOP OF CAB)		1, 2
ELEVATOR MACHINE ROOM		PB4	E-401	9' 6"	9' 6"	30 FC	1, 2
ELEVATOR PIT/HOISTWAY		CART LIFT ELEV PIT	E-402	2' 0"	-	10 FC	1, 2
		CART LIFT ELEV HOIST WAY		-	-		1, 2
		ELEV 1&2 PIT	E-406	2' 0"	-		1, 2
		ELEV 1&2 HOISTWAY		-	-		1, 2
		ELEV 4&5 PIT	E-408	2' 0"	-		1, 2
		ELEV 4&5 HOISTWAY		-	-		1, 2
		ELEV 3 PIT	E-407	2' 0"	-		1, 2
		ELEV 3 HOISTWAY		-	-		1, 2
ELEVATOR PIT/HOISTWAY	9	ELEV 1&2 PIT	E-410	2' 0"	-	10 FC	1, 2
		ELEV 1&2 HOISTWAY		-	-		1, 2

NOTE(S):
1. FOOT CANDLE REQUIREMENTS ARE AVERAGE MAINTAINED ILLUMINATION LEVELS AT FINISHED FLOOR THROUGHOUT THE SPACE.
2. PROVIDE ALL HARDWARE AND FASTENING EQUIPMENT AS REQUIRED. REFERENCE LUMINAIRE SCHEDULE FOR ADDITIONAL INFORMATION.

EQUIPMENT SCHEDULE

BUILDING	ROOM NUMBER	DESCRIPTION	TAG	VOLTS	PHASE	VA	HP	AMPS	MOCP (A)	NOTES
07	EXTERIOR	OUTDOOR HEAT PUMP	07-CU-01-15A	208	1	3040	-	15.2	30	1, 2, 3
	15A	INDOOR HEAT PUMP	07-AC-01-15A	208	1	-	-	-	-	1, 2
	EXTERIOR	OUTDOOR HEAT PUMP	07-CU-02-PB4	208	1	1600	-	8.0	15	1, 2, 3
	PB4	INDOOR HEAT PUMP	07-AC-02-PB4	208	1	-	-	-	-	1, 2
	PB3	INDOOR FAN COIL	01-FC-01-PB3	208	1	2560	-	12.8	20	1, 3
	PB4	ELEVATOR EQUIPMENT	SPS CARTLIFT #7	208	3	14549	15	42	60	1
	15A	ELEVATOR EQUIPMENT	MED RECORD ELEV	208	3	36027	40	104	175	1
09	EXTERIOR	OUTDOOR HEAT PUMP	09-CU-03-PH	208	1	3680	-	18.4	30	1, 2, 3
	PENTHOUSE	INDOOR HEAT PUMP	09-AC-03-PH	208	1	-	-	-	-	1, 2
	02	ELEVATOR EQUIPMENT	P1	208	3	45033	50	130	200	1
	02	ELEVATOR EQUIPMENT	P2	208	3	45033	50	130	200	1

NOTES:
1. IF INSTALLED UNITS DEVIATE FROM THE BASIS OF DESIGN, CONTRACTOR IS RESPONSIBLE DETERMINING AND EXECUTING ANY CHANGE TO RACEWAYS, CONDUCTORS, DISCONNECTS, STARTERS, OVERCURRENT PROTECTION, AND ANY OTHER REQUIRED INSTALLATION DEVICES.
2. INDOOR UNIT POWERED BY AIR-COOLED CONDENSING UNIT. PROVIDE CONDUIT AND WIRE FROM CONDENSOR UNIT TO ASSOCIATED AC UNIT AS REQUIRED PER MANUFACTURER'S INSTRUCTIONS. COORDINATE WITH MECHANICAL CONTRACTOR AS REQUIRED.
3. EQUIPMENT SHALL BE FED FROM A HACR BREAKER UNLESS OTHERWISE NOTED BY MANUFACTURER'S REQUIREMENTS.

GENERATOR "40" CAPACITY AND LOAD INFORMATION SCHEDULE

SYSTEM RATINGS: 1000kW, 1250kVA, 208/120V, 3PH

LOAD TYPE	DEMAND AMPS (A)	SYSTEM VOLTAGE	DEMAND VA	NOTES
PEAK DEMAND LOAD	1100	208	396293	1
REMOVED LOAD				
EXISTING FAN COIL UNIT	-	-	-1541	1
MED RECORD ELEVATOR EQUIPMENT (30 HP)	-	-	-31703	
ADDED DEMAND LOAD				
SWITCHGEAR "40_EMSGR 40"				
PANELBOARD "7-EQ7BA2"				
MED RECORD ELEVATOR REPLACEMENT EQUIPMENT (40 HP)	-	-	37468	3
CONDENSING UNIT "07-CU-01-15A"	-	-	3162	3
OUTDOOR SERVICE RECEPTACLE	-	-	180	
PANELBOARD "7-FPE"	-	-	-	
PANELBOARD "7-EQC"	-	-	-	
PANELBOARD "7-ELEVATORS"	-	-	-	
FAN COIL UNIT "07-FC-01-PB3"	-	-	1536	3
CONDENSING UNIT "07-CU-02-PB4"	-	-	1664	3
OUTDOOR SERVICE RECEPTACLE	-	-	180	
TOTAL DEMAND VA			407238	
TOTAL AMPERAGE			1130	
% TOTAL LOAD			33%	2

NOTES:
1. PEAK DEMAND IS CALCULATED FROM EXISTING GENERATOR 40 TEST DATA PROVIDED BY THE VA.
2. TOTAL PERCENT LOADING IS COMPARED TO GENERATOR NAMEPLATE RATING OF 1250kVA.
3. ADDED LOAD CONSISTS OF HVAC AND ELEVATOR DEMAND LOADS. REFERENCE PANEL SCHEDULES FOR ADDITIONAL INFORMATION.

GENERATOR "38" CAPACITY AND LOAD INFORMATION SCHEDULE

SYSTEM RATINGS: 300kW, 375kVA, 208/120V, 3PH

LOAD TYPE	DEMAND AMPS (A)	SYSTEM VOLTAGE	DEMAND VA	NOTES
PEAK DEMAND LOAD	420	208	151312	1
REMOVED LOAD				
ELEVATOR "P2" EQUIPMENT (50 HP)	-	-	-54040	
ADDED DEMAND LOAD				
PANELBOARD "38_MDPE"	-	-	-	
PANELBOARD "9_E9GN1"	-	-	-	
PANELBOARD "9-E9AS9"	-	-	-	
ELEVATOR "P2" REPLACEMENT EQUIPMENT (50 HP)	-	-	54040	3
CONDENSING UNIT "09-CU-03-PH"	-	-	3827	3
OUTDOOR SERVICE RECEPTACLE	-	-	180	
TOTAL DEMAND VA			155319	
TOTAL AMPERAGE			431	
% TOTAL LOAD			41%	2

NOTES:
1. PEAK DEMAND IS CALCULATED FROM EXISTING GENERATOR 38 TEST DATA PROVIDED BY THE VA.
2. TOTAL PERCENT LOADING IS COMPARED TO GENERATOR NAMEPLATE RATING OF 375kVA.
3. ADDED LOAD CONSISTS OF HVAC AND ELEVATOR DEMAND LOADS. REFERENCE PANEL SCHEDULES FOR ADDITIONAL INFORMATION.

BLDG 07 - CONDUIT AND WIRE SCHEDULE - PINEVILLE ELEVATORS

CONDUIT TAG	SERVICE	ROUTING FROM	ROUTING TO	CONDUIT QTY	CONDUIT SIZE	CONDUCTORS (QTY) & SIZE	CONDUCTORS GROUND SIZE	VOLTAGE DROP	FAULT CURRENT (A)	NOTES
07-P-01	SPS CARTLIFT #7 EQUIPMENT	SPS CARTLIFT #7 DISCONNECT	SPS CARTLIFT #7 CONTROLLER	1	1"	(3) 4 AWG	8 AWG	2.97%	2,452	-
07-P-02	SPS CARTLIFT #7 EQUIPMENT	SPS CARTLIFT #7 CONTROLLER	SPS CARTLIFT #7 EQUIPMENT	1	1"	(3) 4 AWG	8 AWG	3.09%	2,317	-
07-P-03A	MED RECORD ELEVATOR EQUIPMENT	PANELBOARD "7-EQ7BA2"	MED RECORD ELEVATOR DISCONNECT	1	2"	(3) 4/0 AWG	4 AWG	3.56%	3,569	-
07-P-03B	MED RECORD ELEVATOR EQUIPMENT	MED RECORD ELEVATOR DISCONNECT	MED RECORD ELEVATOR CONTROLLER	1	2"	(3) 2/0 AWG	6 AWG	3.76%	3,301	-
07-P-04	MED RECORD ELEVATOR EQUIPMENT	MED RECORD ELEVATOR CONTROLLER	MED RECORD ELEVATOR EQUIPMENT	1	2"	(3) 2/0 AWG	6 AWG	3.85%	3,181	-
07-P-05A	CONDENSING UNIT "07-CU-01-15A"	PANELBOARD "7-EQC"	DISCONNECT "DISC-07-CU-01-15A"	1	1"	(2) 6 AWG	8 AWG	2.85%	999	-
07-P-05B	CONDENSING UNIT "07-CU-01-15A"	DISCONNECT "DISC-07-CU-01-15A"	CONDENSING UNIT "07-CU-01-15A"	1	3/4"	(2) 10 AWG	10 AWG	2.96%	929	-
07-P-06A	CONDENSING UNIT "07-CU-02-PB4"	PANELBOARD "7-ELEVATORS"	DISCONNECT "DISC-07-CU-02-PB4"	1	1"	(2) 6 AWG	8 AWG	2.94%	1,479	-
07-P-06B	CONDENSING UNIT "07-CU-02-PB4"	DISCONNECT "DISC-07-CU-02-PB4"	CONDENSING UNIT "07-CU-02-PB4"	1	3/4"	(2) 12 AWG	12 AWG	3.00%	1,334	-
07-P-07	FAN COIL UNIT "07-FC-01-PB3"	PANELBOARD "7-ELEVATORS"	FAN COIL UNIT "07-FC-01-PB3"	1	3/4"	(1) 10 AWG	10 AWG	3.05%	1,531	-
07-C-01	ELEVATOR / ATS STATUS	TYPICAL ELEVATOR CONTROLLER	TYPICAL UPSTREAM ATS	1	1"	MFG CAB	12 AWG	N/A	N/A	1

NOTE(S):
1. PROVIDE ELEVATOR MANUFACTURER REQUIRED CABLING.

BLDG 09 - CONDUIT AND WIRE SCHEDULE - PINEVILLE ELEVATORS

CONDUIT TAG	SERVICE	ROUTING FROM	ROUTING TO	CONDUIT QTY	CONDUIT SIZE	CONDUCTORS (QTY) & SIZE	CONDUCTORS GROUND SIZE	VOLTAGE DROP	FAULT CURRENT (A)	NOTES
09-P-01A	ELEVATOR "P1" EQUIPMENT	PANELBOARD "N9AS12"	ELEVATOR DISCONNECT "P1"	1	2"	(3) 3/0 AWG	6 AWG	3.15%	5,713	-
09-P-01B	ELEVATOR "P1" EQUIPMENT	ELEVATOR DISCONNECT "P1"	ELEVATOR "P1" CONTROLLER	1	2"	(3) 3/0 AWG	6 AWG	3.21%	5,466	-
09-P-01C	ELEVATOR "P1" EQUIPMENT	ELEVATOR "P1" CONTROLLER	ELEVATOR "P1" EQUIPMENT	1	2"	(3) 3/0 AWG	6 AWG	3.24%	5,240	-
09-P-02A	ELEVATOR "P2" EQUIPMENT	PANELBOARD "E9AS9"	ELEVATOR DISCONNECT "P2"	1	2"	(3) 3/0 AWG	6 AWG	2.33%	4,257	-
09-P-02B	ELEVATOR "P2" EQUIPMENT	ELEVATOR DISCONNECT "P2"	ELEVATOR "P2" CONTROLLER	1	2"	(3) 3/0 AWG	6 AWG	2.39%	4,118	-
09-P-02C	ELEVATOR "P2" EQUIPMENT	ELEVATOR "P2" CONTROLLER	ELEVATOR "P2" EQUIPMENT	1	2"	(3) 3/0 AWG	6 AWG	2.41%	3,987	-
09-P-03A	CONDENSING UNIT "09-CU-03-PH"	PANELBOARD "E9AS9"	DISCONNECT "DISC-09-CU-03-PH"	1	1"	(2) 4 AWG	4 AWG	2.59%	2,159	-
09-P-03B	CONDENSING UNIT "09-CU-03-PH"	DISCONNECT "DISC-09-CU-03-PH"	CONDENSING UNIT "09-CU-03-PH"	1	3/4"	(2) 8 AWG	8 AWG	2.62%	2,106	-
09-C-01	ELEVATOR / ATS STATUS	TYPICAL ELEVATOR CONTROLLER	TYPICAL UPSTREAM ATS	1	1"	MFG CAB	12 AWG	N/A	N/A	1

NOTE(S):
1. PROVIDE ELEVATOR MANUFACTURER REQUIRED CABLING.

GENERAL NOTES

1. CONTRACTOR SHALL UPDATE ALL PANEL CIRCUIT DIRECTORIES TO INDICATE IN ANY AND ALL CHANGES; ALL REVISED CIRCUIT DIRECTORIES SHALL BE TYPE WRITTEN.
2. FOR ALL "REVISED" PANEL SCHEDULES REFERENCE ASSOCIATED EQUIPMENT LOAD SCHEDULE FOR OVERALL PANEL LOAD. "REVISED" PANEL SCHEDULES ON THIS SHEET ARE SHOWN FOR ADDED BRANCH CIRCUIT SIZING ONLY.
3. SCHEDULES WITH GREY TEXT INDICATE EXISTING PANELBOARD RATINGS, CIRCUITS, AND LOADS. BLACK TEXT INDICATES REVISED CIRCUITS, PROVIDED EQUIPMENT, AND ADDITIONAL LOAD.

Revisions:	Date:

CONSULTANT/ DISCIPLINE

DISCIPLINE:

ARCHITECT/ ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HIGHWAY S. SUITE 300
KENT, WA 98032

SPEESDESIGNBUILD

STAMP

LOUIS R. LITZAU — STATE OF WASHINGTON — 55681 — 3-24-26 — REGISTERED PROFESSIONAL ENGINEER

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: ELECTRICAL SCHEDULES

Phase: 100% CONSTRUCTION DOCUMENTS

Approved:

FULLY SPRINKLERED

Project Title: REPLACE ELEVATORS IN BLDG 07 & BLDG 09

Project Number: 502-24-102

Building Number: -

Location: ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA

Issue Date: 03/24/2026

Checked: DCW/NVP

Drawn: JNV/GPB

Drawing Number: E-701

BLDG 07 - SWITCHGEAR "40_EMSGR 40" FEEDER CALCULATED LOAD INFORMATION SCHEDULE

SYSTEM RATINGS: 4000A BUS, 4000A MCB, 208/120V, 3PH

LOAD TYPE	DEMAND VA	NOTES
GENERATOR 40 PEAK LOAD	396293	1
25% OF PEAK DEMAND (NEC 220.87)	99073	
REMOVED LOAD		
EXISTING FAN COIL UNIT	-1541	
MED RECORD ELEVATOR EQUIPMENT (30 HP)	-31703	
ADDED DEMAND LOAD		
PANELBOARD "7-EQ7BA2"		
MED RECORD ELEVATOR REPLACEMENT EQUIPMENT (40 HP)	37468	2
CONDENSING UNIT "07-CU-01-15A"	3162	2
OUTDOOR SERVICE RECEPTACLE	180	
PANELBOARD "7-FPE"		
PANELBOARD "7-EQC"		
PANELBOARD "7-ELEVATORS"		
FAN COIL UNIT "07-FC-01-PB3"	1536	2
CONDENSING UNIT "07-CU-02-PB4"	1664	2
OUTDOOR SERVICE RECEPTACLE	180	
TOTAL DEMAND VA	506311	
TOTAL AMPERAGE	1405	
% TOTAL LOAD	35%	3

NOTES:
1. PEAK DEMAND IS CALCULATED FROM EXISTING GENERATOR 40 TEST DATA PROVIDED BY THE VA OF 1100A. BASED ON GENERATOR TOPOLOGY, 100% OF TOTAL LOAD IS APPLIED TO THIS EQUIPMENT.
2. ADDED LOAD CONSISTS OF HVAC AND ELEVATOR DEMAND LOADS. REFERENCE PANEL SCHEDULES FOR ADDITIONAL INFORMATION.
3. TOTAL PERCENT LOADING IS COMPARED TO EQUIPMENT MAIN OVER CURRENT PROTECTIVE DEVICE RATING OF 4000A.

BLDG 07 - PANELBOARD "7-FPE" CALCULATED LOAD INFORMATION SCHEDULE

FEEDER RATINGS: 1200A BUS, MLO, 208/120V, 3PH, 4W

LOAD TYPE	DEMAND VA	NOTES
GENERATOR 40 PEAK LOAD	198147	1
25% OF PEAK DEMAND (NEC 220.87)	49537	
REMOVED LOAD		
EXISTING FAN COIL UNIT	-1541	
ADDED DEMAND LOAD		
PANELBOARD "7-EQC"		
PANELBOARD "7-ELEVATORS"		
FAN COIL UNIT "07-FC-01-PB3"	1536	2
CONDENSING UNIT "07-CU-02-PB4"	1664	2
OUTDOOR SERVICE RECEPTACLE	180	
TOTAL DEMAND VA	249522	
TOTAL AMPERAGE	693	
% TOTAL LOAD	58%	3

NOTES:
1. PEAK DEMAND IS CALCULATED FROM EXISTING GENERATOR 40 TEST DATA PROVIDED BY THE VA OF 1100A (OR 396,293VA). BASED ON GENERATOR TOPOLOGY, A CONSERVATIVE DEMAND FACTOR OF 50% OF TOTAL LOAD IS APPLIED TO THIS EQUIPMENT.
2. ADDED LOAD CONSISTS OF HVAC DEMAND LOADS. REFERENCE PANEL SCHEDULES FOR ADDITIONAL INFORMATION.
3. TOTAL PERCENT LOADING IS COMPARED TO EQUIPMENT SYSTEM RATING OF 1200A.

BLDG 07 - PANELBOARD "7-EQ7BA" CALCULATED LOAD INFORMATION SCHEDULE

SYSTEM RATINGS: 800A BUS, 800A MCB, 208/120V, 3PH

LOAD TYPE	DEMAND VA	NOTES
GENERATOR 40 PEAK LOAD	118888	1
25% OF PEAK DEMAND (NEC 220.87)	29722	
REMOVED LOAD		
7_CART LIFT ELEVATOR EQUIPMENT (15 HP)	-12960	1
ADDED DEMAND LOAD		
7_CART LIFT ELEVATOR REPLACEMENT EQUIPMENT (15 HP)	17401	2
TOTAL DEMAND VA	153051	
TOTAL AMPERAGE	425	
% TOTAL LOAD	53%	3

NOTES:
1. PEAK DEMAND IS CALCULATED FROM EXISTING GENERATOR 40 TEST DATA PROVIDED BY THE VA OF 1100A (OR 396,293VA). BASED ON GENERATOR TOPOLOGY, A CONSERVATIVE DEMAND FACTOR OF 30% OF TOTAL LOAD IS APPLIED TO THIS EQUIPMENT.
2. ADDED LOAD CONSISTS OF ELEVATOR EQUIPMENT DEMAND LOADS.
3. TOTAL PERCENT LOADING IS COMPARED TO EQUIPMENT SYSTEM RATING OF 800A.

GENERAL NOTES

1. CONTRACTOR SHALL UPDATE ALL PANEL CIRCUIT DIRECTORIES TO INDICATE IN ANY AND ALL CHANGES; ALL REVISED CIRCUIT DIRECTORIES SHALL BE TYPE WRITTEN.
2. FOR ALL "REVISED" PANEL SCHEDULES REFERENCE ASSOCIATED EQUIPMENT LOAD SCHEDULE FOR OVERALL PANEL LOAD. "REVISED" PANEL SCHEDULES ON THIS SHEET ARE SHOWN FOR ADDED BRANCH CIRCUIT SIZING ONLY.
3. SCHEDULES WITH GREY TEXT INDICATE EXISTING PANELBOARD RATINGS, CIRCUITS, AND LOADS. BLACK TEXT INDICATES REVISED CIRCUITS, PROVIDED EQUIPMENT, AND ADDITIONAL LOAD.
4. ALL DIGITAL POWER METERS (DPM) AND SURGE PROTECTIVE DEVICES (SPD) ARE INTEGRAL TO ELECTRICAL DISTRIBUTION EQUIPMENT, UNLESS OTHERWISE NOTED.

KEY NOTES

1. UTILIZE EXISTING SPACE(S) TO PROVIDE CIRCUIT BREAKER AS INDICATED.

BLDG 07 - SWITCHBOARD "7-7MDPN" METERING AND LOAD INFORMATION SCHEDULE

SYSTEM RATINGS: 3000A BUS, MLO, 208/120V, 3PH

LOAD TYPE	DEMAND VA	NOTES
PEAK DEMAND LOAD	123000	1
25% OF PEAK DEMAND (NEC 220.87)	30750	
REMOVED LOAD		
EXISTING FAN COIL UNIT	-1541	
ADDED DEMAND LOAD		
PANELBOARD "7-7MDPN-1"		
PANELBOARD "7-EQC"		
CONDENSING UNIT "07-CU-01-15A"	3162	2
OUTDOOR SERVICE RECEPTACLE	180	
PANELBOARD "7-ELEVATORS"		
CONDENSING UNIT "07-CU-02-PB4"	1664	2
OUTDOOR SERVICE RECEPTACLE	180	
FAN COIL UNIT "07-FC-01-PB3"	1536	2
TOTAL DEMAND VA	158931	
TOTAL AMPERAGE	441	
% TOTAL LOAD	15%	3

NOTES:
1. PEAK DEMAND IS PROVIDED FROM INTEGRAL DIGITAL POWER METER OBSERVED ON 10/28/2025.
2. ADDED LOAD CONSISTS OF HVAC DEMAND LOADS. REFERENCE ASSOCIATED PANEL SCHEDULES FOR ADDITIONAL INFORMATION.
3. TOTAL PERCENT LOADING IS COMPARED TO EQUIPMENT BUS RATING OF 3000A.

BLDG 07 - PANELBOARD "7-7MDPN-1" CALCULATED LOAD INFORMATION SCHEDULE

FEEDER RATINGS: 1200A, 208/120V, 3PH, 4W

LOAD TYPE	DEMAND VA	NOTES
PEAK DEMAND LOAD	123000	1
25% OF PEAK DEMAND (NEC 220.87)	30750	
REMOVED LOAD		
EXISTING FAN COIL UNIT	-1541	
ADDED DEMAND LOAD		
PANELBOARD "7-EQC"		
CONDENSING UNIT "07-CU-01-15A"	3162	2
OUTDOOR SERVICE RECEPTACLE	180	
PANELBOARD "7-ELEVATORS"		
CONDENSING UNIT "07-CU-02-PB4"	1664	2
OUTDOOR SERVICE RECEPTACLE	180	
FAN COIL UNIT "07-FC-01-PB3"	1536	2
TOTAL DEMAND VA	158931	
TOTAL AMPERAGE	441	
% TOTAL LOAD	37%	3

NOTES:
1. PEAK DEMAND IS PROVIDED FROM INTEGRAL DIGITAL POWER METER IN SWITCHBOARD "7-7MDPN" OBSERVED ON 10/28/2025.
2. ADDED LOAD CONSISTS OF HVAC DEMAND LOADS. REFERENCE ASSOCIATED PANEL SCHEDULES FOR ADDITIONAL INFORMATION.
3. TOTAL PERCENT LOADING IS COMPARED TO EQUIPMENT SYSTEM RATING OF 1200A.

BLDG 07 - PANELBOARD "7-EQC" CALCULATED LOAD INFORMATION SCHEDULE

SYSTEM RATINGS: 600A BUS, MLO, 208/120V, 3PH

LOAD TYPE	DEMAND VA	NOTES
GENERATOR 40 PEAK LOAD	118888	1
25% OF PEAK DEMAND (NEC 220.87)	29722	
REMOVED LOAD		
EXISTING FAN COIL UNIT	-1541	
ADDED DEMAND LOAD		
CONDENSING UNIT "07-CU-01-15A"	3162	2
OUTDOOR SERVICE RECEPTACLE	180	
PANELBOARD "7-ELEVATORS"		
FAN COIL UNIT "07-FC-01-PB3"	1536	2
CONDENSING UNIT "07-CU-02-PB4"	1664	2
OUTDOOR SERVICE RECEPTACLE	180	
TOTAL DEMAND VA	153791	
TOTAL AMPERAGE	427	
% TOTAL LOAD	71%	3

NOTES:
1. PEAK DEMAND IS CALCULATED FROM EXISTING GENERATOR 40 TEST DATA PROVIDED BY THE VA OF 1100A. BASED ON GENERATOR TOPOLOGY, A CONSERVATIVE DEMAND FACTOR OF 30% OF TOTAL LOAD IS APPLIED TO THIS EQUIPMENT.
2. ADDED LOAD CONSISTS OF HVAC DEMAND LOADS. REFERENCE PANEL SCHEDULES FOR ADDITIONAL INFORMATION.
3. TOTAL PERCENT LOADING IS COMPARED TO EQUIPMENT SYSTEM RATING OF 600A.

PANELBOARD: 7-EQC (REVISED)

Location: BLDG 7 - RM 29 | **Volts:** 120/208 Wye | **A.I.C Rating:** 22k
Supply From: ATS-7EQC | **Phases:** 3 | **Bus Rating:** 600 A
Mounting: Surface | **Wires** 4 | **Main Circuit Breaker:** MLO
Enclosure: Type 1

CKT	CIRCUIT DESCRIPTION	Trip	Poles	VA PER PHASE A	VA PER PHASE B	VA PER PHASE C	Poles	Trip	CIRCUIT DESCRIPTION	CKT
1	UNKNOWN LOAD	50 A	3	0	0		3	50 A	EF 164	2
3	-	-	-		0	0	-	-	-	4
5	-	-	-			0	0	-	-	6
7	SPD	60 A	3	0	**1520**		**2**	**30 A**	**CONDENSING UNIT "07-CU-01-15A"**	**8**
9	-	-	-			**1520**	**"**	**"**	**"**	**10**
11	-	-	-			0	**180**	**1**	**20 A**	**OUTDOOR SERVICE RECEPTACLE**	**12**
13	FREIGHT ELEVATOR/PNL 7-ELEVATORS	250 A	3	0	0		3	250 A	ELEVATORS 1 & 2	14
15	-	-	-			0	0	-	-	-	16
17	-	-	-				0	0	-	-	18
19	BIO-MED UPS ROOM 054	225 A	3	0	0		3	225 A	SPARE	20
21	-	-	-			0	0	-	-	-	22
23	-	-	-				0	0	-	-	24
25	MICU	175 A	3	0	0		3	175 A	BLDG 147	26
27	-	-	-			0	0	-	-	-	28
29	-	-	-				0	0	-	-	30
			Total Load:	1520	1520	180				
			Total Amps:	13	13	1				

LOAD TYPE	Connected Load (VA)	Demand Factor	Estimated Demand (VA)		Panel Totals
Largest Motor	3040	125.00%	3800	Total Conn. Power Load	3220 VA
Other	-5340	100.00%	-5340	Total Est. Power Demand	3980 VA
Receptacle	5520	100.00%	5520	Total Conn. Amperage	9 A
Lighting	0	125.00%	0	Total Est. Amperage Demand	11 A

Notes:
1. PANEL SCHEDULE PROVIDED FOR ADDED EQUIPMENT ONLY. REFERENCE CORRESPONDING EQUIPMENT LOAD SCHEDULE FOR OVERALL LOADING INFORMATION.

PANELBOARD: 7-ELEVATORS (REVISED)

Location: BLDG 7 - RM 45 | **Volts:** 120/208 Wye | **A.I.C Rating:** 22k
Supply From: PANEL "7-EQC" | **Phases:** 3 | **Bus Rating:** 100A
Mounting: Surface | **Wires** 4 | **Main Circuit Breaker:** 100A / 3P
Enclosure: Type 1

CKT	CIRCUIT DESCRIPTION	Trip	Poles	VA PER PHASE A	VA PER PHASE B	VA PER PHASE C	Poles	Trip	CIRCUIT DESCRIPTION	CKT
1	N/A	-	-	0	0		3	100 A	MAIN	2
3	N/A	-	-		0	0	-	-	-	4
5	N/A	-	-			0	0	-	-	6
7	LIGHTS ELEV. 1 &2 SHAFT	20 A	1	500	1352		2	20 A	AHU-2	8
9	RECEPT ELEV. 1 &2 SHAFT	20 A	1			720	1352	-	-	10
11	FIRE ALARM PANEL	20 A	1				500	500	1	20 A	AHU VALVE	12
13	ELEV. MACH. RM. LIGHTS	20 A	1	500	1000				1	20 A	MACH. RM. LIGHTS & RECEPT.	14
15	MACH. RM. ILIGHTS	20 A	1			500	1000		1	20 A	#2 ELEV. LIGHTS AND RECEPT.	16
17	ELEV. MACH. RM. REC	20 A	1				720	1000	1	20 A	#1 ELEV. LIGHTS AND RECEPT.	18
19	ELEV. #3 SHAFT LIGHTS	20 A	1	500	500				1	20 A	#3 ELEV. LIGHTS	20
21	ELEV. #3 SHAFT RECEPT.	20 A	1			720	0		1	20 A	UNKNOWN LOAD	22
23	RADIO CONTROLS ELV 4 & 5	20 A	1				500	720	1	20 A	UNKNOWN LOAD	24
25	RADIO CONTROLS ELV 4 & 5	20 A	1	**500**	2392				2	40 A	RADIO PAGER SYSTEM NORTH WALL	26
27	**CONDENSING UNIT "07-CU-02-PB4"**	**15 A**	**2**			**800**	2392		**"**	**"**	**"**	28
29	**"**	**"**	**"**							
			Total Load:	7244	7484	6456				
			Total Amps:	60	62	54				

LOAD TYPE	Connected Load (VA)	Demand Factor	Estimated Demand (VA)		Panel Totals
Largest Motor	2704	125.00%	3380	Total Conn. Power Load	21184 VA
Other	9604	100.00%	9604	Total Est. Power Demand	22360 VA
Receptacle	6876	100.00%	6876	Total Conn. Amperage	59 A
Lighting	2000	125.00%	2500	Total Est. Amperage Demand	62 A

Notes:
1. AS-BUILT LOAD INFORMATION PROVIDED FROM ON SITE INVESTIGATIONS.

Revisions:	Date:

CONSULTANT/ DISCIPLINE

DISCIPLINE:

ARCHITECT/ ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HIGHWAY S. SUITE 300
KENT, WA 98032

SDB SPEESDESIGNBUILD

STAMP

LOUIS R. LITANO — STATE OF WASHINGTON — 155681 — REGISTERED PROFESSIONAL ENGINEER — 3-24-26

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: ELECTRICAL SCHEDULES
Phase: 100% CONSTRUCTION DOCUMENTS
Approved:
FULLY SPRINKLERED

Project Title: REPLACE ELEVATORS IN BLDG 07 & BLDG 09
Project Number: 502-24-102
Building Number: -
Location: ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA
Issue Date: 03/24/2026
Checked: DCW/NVP
Drawn: JNV/GPB
Drawing Number: E-702

BLDG 07 - PANELBOARD "7-EQ7BA2" CALCULATED LOAD INFORMATION SCHEDULE		
SYSTEM RATINGS: 400A BUS, 400A MCB, 208/120V, 3PH		
LOAD TYPE	**DEMAND VA**	**NOTES**
EXISTING LOAD	86464	1
REMOVED LOAD		
MED RECORD ELEVATOR EQUIPMENT (30 HP)	-31703	
ADDED DEMAND LOAD		
MED RECORD ELEVATOR REPLACEMENT EQUIPMENT (40 HP)	37468	2
TOTAL DEMAND VA	92228	
TOTAL AMPERAGE	256	
% TOTAL LOAD	64%	4

NOTES:
1. EXISTING LOAD CALCULATED FROM FULLY RATING THE EXISTING 300A BREAKER ON SWITCHGEAR "SWGR-7_7SWGN". REFERENCE EXISTING AND REVISED ONE-LINE DIAGRAMS ON SHEETS E-602 AND E-612 FOR ADDITIONAL INFORMATION.
2. ADDED LOAD CONSISTS OF HVAC AND ELEVATOR EQUIPMENT DEMAND LOADS. REFERENCE PANEL SCHEDULES FOR ADDITIONAL INFORMATION.
3. TOTAL PERCENT LOADING IS COMPARED TO EQUIPMENT MAIN OVER CURRENT PROTECTIVE DEVICE RATING OF 400A.

PANELBOARD: 7-EQ7BA2 (REPLACEMENT)

Location: BLDG 7- RM 29 | **Volts:** 120/208 Wye | **A.I.C Rating:** 42k
Supply From: ATS-EQ7BA2 | **Phases:** 3 | **Bus Rating:** 400A
Mounting: Surface | **Wires** 4 | **Main Circuit Breaker:** 400AF / 400AT / 3P / LSI
Enclosure: Type 1

CKT	CIRCUIT DESCRIPTION	Trip	Poles	VA PER PHASE A		VA PER PHASE B		VA PER PHASE C		Poles	Trip	CIRCUIT DESCRIPTION	CKT
1	**MED RECORDS ELEVATOR (NOTE 4)**	**200 A**	**3**	37468	0					**3**	**225 A**	ET7BA1 VACUUM	2
3	"	"	"			37468	0			"	"	"	4
5	"	"	"					37469	0	"	"	"	6
7	ELEVATOR E4 **(NOTE 4)**	**250 A**	**3**	0	0					**3**	**150 A**	MED AIR	8
9	"	"	"			0	0			"	"	"	10
11	"	"	"					0	0	"	"	"	12
13	**SPARE**	**100 A**	**3**	0	0					**3**	**250 A**	ELEVATOR E5 **(NOTE 4)**	14
15	"	"	"			0	0			"	"	"	16
17	"	"	"					0	0	"	"	"	18
19	**SPARE**	**100 A**	**3**	0	100					**3**	**70 A**	**SPD**	20
21	"	"	"			0	100			"	"	"	22
23	"	"	"					0	100	"	"	"	24
25	**SPARE**	**20 A**	**1**	0	100					**3**	**20 A**	**DPM**	26
27	**SPARE**	**20 A**	**1**			0	100			"	"	"	28
29	**SPARE**	**20 A**	**1**					0	100	"	"	"	30
			Total Load:	37468		37468		37468					
			Total Amps:	314		314		314					

LOAD TYPE	Connected Load (VA)	Demand Factor	Estimated Demand (VA)		Panel Totals
Largest Motor	0	125.00%	0	Total Conn. Power Load:	113003 VA
Other	500	100.00%	500	Total Est. Power Demand:	96143 VA
Receptacle	100	100.00%	100	Total Conn. Amperage:	314 A
Lighting	0	125.00%	0	Total Est. Amperage Demand:	267 A
Elevator	112403	NOTE 3	95543		

Notes:
1. PANEL SCHEDULE PROVIDED FOR ADDED EQUIPMENT ONLY. REFERENCE CORRESPONDING EQUIPMENT LOAD SCHEDULE FOR OVERALL LOADING INFORMATION.
2. SURGE PROTECTION DEVICE (SPD) AND DIGITAL POWER METER (DPM) SHALL BE INTEGRAL TO PANEL (FACTORY INSTALLED).
3. ELEVATOR LOAD IS DERATED TO 85% PER NEC 430.22.
4. CIRCUIT BREAKER SHALL INCLUDE SHUNT TRIP AND SHALL BE INTERFACED WITH EXISTING FIRE ALARM CONTROL SYSTEM TO DE-ENERGIZE CIRCUIT UPON ACTIVATION; PROVIDE CONDUIT AND WIRE AS REQUIRED.

BLDG 09 - SWITCHBOARD "N-9GW1" METERING AND LOAD INFORMATION SCHEDULE		
SYSTEM RATINGS: 1600A BUS, 1600A MCB, 208/120V, 3PH		
LOAD TYPE	**DEMAND VA**	**NOTES**
PEAK DEMAND LOAD	120000	1
25% OF PEAK DEMAND (NEC 220.87)	30000	
REMOVED LOAD		
ELEVATOR "P1" EQUIPMENT (50 HP)	-54040	1
ELEVATOR "P2" EQUIPMENT (50 HP)	-54040	1
ADDED DEMAND LOAD		
PANELBOARD "9-E9AS9"		
ELEVATOR "P2" REPLACEMENT EQUIPMENT (50 HP)	54040	2
CONDENSING UNIT "09-CU-03-PH"	3827	3
OUTDOOR SERVICE RECEPTACLE	180	
PANELBOARD "9-N9AS12"		
ELEVATOR "P1" REPLACEMENT EQUIPMENT (50 HP)	54040	2
TOTAL DEMAND VA	154007	
TOTAL AMPERAGE	427	
% TOTAL LOAD	27%	4

NOTES:
1. PEAK DEMAND IS PROVIDED FROM EXTERNAL DIGITAL POWER METER "16-ALE-9-E3A" OBSERVED ON 10/28/2025.
2. ADDED LOAD CONSISTS OF ELEVATOR EQUIPMENT DEMAND LOADS. REFERENCE PANEL SCHEDULES FOR ADDITIONAL INFORMATION.
3. ADDED LOAD CONSISTS OF HVAC DEMAND LOADS. REFERENCE PANEL SCHEDULES FOR ADDITIONAL INFORMATION.
4. TOTAL PERCENT LOADING IS COMPARED TO EQUIPMENT OVERCURRENT PROTECTION DEVICE RATING OF 1600A.

BLDG 09 - PANELBOARD "38_MDPE" CALCULATED LOAD INFORMATION SCHEDULE		
SYSTEM RATINGS: 1200A BUS, 1200A MCB, 208/120V, 3PH		
LOAD TYPE	**DEMAND VA**	**NOTES**
GENERATOR 38 PEAK LOAD	151312	1
25% OF PEAK DEMAND (NEC 220.87)	37828	
REMOVED LOAD		
ELEVATOR "P2" EQUIPMENT (50 HP)	-54040	1
ADDED DEMAND LOAD		
PANELBOARD "9_E9GN1"		
PANELBOARD "9-E9AS9"		
ELEVATOR "P2" REPLACEMENT EQUIPMENT (50 HP)	54040	2
CONDENSING UNIT "09-CU-03-PH"	3827	3
OUTDOOR SERVICE RECEPTACLE	180	
TOTAL DEMAND VA	193147	
TOTAL AMPERAGE	536	
% TOTAL LOAD	45%	4

NOTES:
1. PEAK DEMAND IS CALCULATED FROM EXISTING GENERATOR 38 TEST DATA PROVIDED BY THE VA. BASED ON GENERATOR TOPOLOGY, A CONSERVATIVE DEMAND FACTOR OF 100% OF TOTAL LOAD IS APPLIED TO THIS EQUIPMENT.
2. ADDED LOAD CONSISTS OF ELEVATOR EQUIPMENT DEMAND LOADS. REFERENCE PANEL SCHEDULES FOR ADDITIONAL INFORMATION.
3. ADDED LOAD CONSISTS OF HVAC DEMAND LOADS. REFERENCE PANEL SCHEDULES FOR ADDITIONAL INFORMATION.
4. TOTAL PERCENT LOADING IS COMPARED TO EQUIPMENT OVERCURRENT PROTECTION DEVICE RATING OF 1200A.

BLDG 09 - PANELBOARD "9_E9GN1" CALCULATED LOAD INFORMATION SCHEDULE		
SYSTEM RATINGS: 300A BUS, 300A MCB, 208/120V, 3PH		
LOAD TYPE	**DEMAND VA**	**NOTES**
GENERATOR 38 PEAK LOAD	60525	1
25% OF PEAK DEMAND (NEC 220.87)	15131	
REMOVED LOAD		
ELEVATOR "P2" EQUIPMENT (50 HP)	-54040	1
ADDED DEMAND LOAD		
PANELBOARD "9_E9GN1"		
PANELBOARD "9-E9AS9"		
ELEVATOR "P2" REPLACEMENT EQUIPMENT (50 HP)	54040	2
CONDENSING UNIT "09-CU-03-PH"	3827	3
OUTDOOR SERVICE RECEPTACLE	180	
TOTAL DEMAND VA	79663	
TOTAL AMPERAGE	221	
% TOTAL LOAD	74%	4

NOTES:
1. PEAK DEMAND IS CALCULATED FROM EXISTING GENERATOR 38 TEST DATA PROVIDED BY THE VA OF 420A. BASED ON GENERATOR TOPOLOGY, A CONSERVATIVE DEMAND FACTOR OF 40% OF TOTAL LOAD IS APPLIED TO THIS EQUIPMENT.
2. ADDED LOAD CONSISTS OF ELEVATOR EQUIPMENT DEMAND LOADS. REFERENCE PANEL SCHEDULES FOR ADDITIONAL INFORMATION.
3. ADDED LOAD CONSISTS OF HVAC DEMAND LOADS. REFERENCE PANEL SCHEDULES FOR ADDITIONAL INFORMATION.
4. TOTAL PERCENT LOADING IS COMPARED TO EQUIPMENT OVERCURRENT PROTECTION DEVICE RATING OF 300A.

PANELBOARD: 9-E9AS9 (REPLACEMENT)

Location: BLDG 9 - ATTIC | **Volts:** 120/208 Wye | **A.I.C Rating:** 22k
Supply From: ATS-9_9-2 | **Phases:** 3 | **Bus Rating:** 225A
Mounting: Surface | **Wires** 4 | **Main Circuit Breaker:** 225AF / 225AT / 3P / LSI
Enclosure: Type 1

CKT	CIRCUIT DESCRIPTION	Trip	Poles	VA PER PHASE A		VA PER PHASE B		VA PER PHASE C		Poles	Trip	CIRCUIT DESCRIPTION	CKT
1	**SPARE**	**150 A**	**3**	0	15011					**3**	**200 A**	**ELEVATOR "P2" EQUIPMENT (NOTE 3)**	2
3	"	"	"			0	15011			"	"	"	4
5	"	"	"					0	15011	"	"	"	6
7	**CONDENSING UNIT "09-CU-03-PH"**	**30 A**	**2**	**1840**	100					**1**	**20 A**	**OUTDOOR SERVICE RECEPTACLE**	8
9	"	"	"			**1840**	0			**1**	**20 A**	**SPARE**	10
11	**SPARE**	**20 A**	**1**					0	0	**1**	**20 A**	**SPARE**	12
13	**SPARE**	**20 A**	**1**	0	0					**1**	**20 A**	**SPARE**	14
15	**SPARE**	**20 A**	**1**			0	0			**1**	**20 A**	**SPARE**	16
17	**SPARE**	**20 A**	**1**					0	0	**1**	**20 A**	**SPARE**	18
19	**SPARE**	**20 A**	**1**	0	0					**1**	**20 A**	**SPARE**	20
21	**SPARE**	**20 A**	**1**			0	0			**1**	**20 A**	**SPARE**	22
23	**SPARE**	**20 A**	**1**					0	0	**1**	**20 A**	**SPARE**	24
25	**SPARE**	**20 A**	**1**	0	100					**3**	**30 A**	**SPD**	26
27	**SPARE**	**20 A**	**1**			0	100			"	"	"	28
29	**SPARE**	**20 A**	**1**					0	100	"	"	"	30
			Total Load:	17131		16951		15113					
			Total Amps:	143		141		126					

LOAD TYPE	Connected Load (VA)	Demand Factor	Estimated Demand (VA)		Panel Totals
Largest Motor	3680	125.00%	4600	Total Conn. Power Load:	49193 VA
Other	300	100.00%	300	Total Est. Power Demand:	43358 VA
Receptacle	180	100.00%	180	Total Conn. Amperage:	137 A
Lighting	0	125.00%	0	Total Est. Amperage Demand:	120 A
Elevator	45033	NOTE 1	38278		

Notes:
1. ELEVATOR LOAD IS DERATED TO 85% PER NEC 430.22
2. SURGE PROTECTION DEVISE SHALL BE INTEGRAL TO PANEL (FACTORY INSTALLED).
3. CIRCUIT BREAKER SHALL INCLUDE SHUNT TRIP AND SHALL BE INTERFACED WITH EXISTING FIRE ALARM CONTROL SYSTEM TO DE-ENERGIZE CIRCUIT UPON ACTIVATION; PROVIDE CONDUIT AND WIRE AS REQUIRED.

PANELBOARD: 9-N9AS12 (REPLACEMENT)

Location: BLDG 9 - ATTIC | **Volts:** 120/208 Wye | **A.I.C Rating:** 22k
Supply From: SWBD-9_N9GW1 | **Phases:** 3 | **Bus Rating:** 225A
Mounting: Surface | **Wires** 4 | **Main Circuit Breaker:** 225AF / 225AT / 3P / LSI
Enclosure: Type 1

CKT	CIRCUIT DESCRIPTION	Trip	Poles	VA PER PHASE A		VA PER PHASE B		VA PER PHASE C		Poles	Trip	CIRCUIT DESCRIPTION	CKT
1	ATTIC LTS	**20 A**	**1**	500	1321					**3**	**30 A**	A/C #3 (3 HP)	2
3	ATTIC RECPT	**20 A**	**1**			720	1321			"	"	"	4
5	AHU-C-N-02.03.04	**20 A**	**1**					1920	1321	"	"	"	6
7	**SPARE**	**20 A**	**1**	0	2042					**3**	**50 A**	A/C #2 (5 HP)	8
9	**SPARE**	**20 A**	**1**			0	2042			"	"	"	10
11	EXH. FAN #1 (1 HP)	**20 A**	**2**					832	2042	"	"	"	12
13	"	"	"	832	15011					**3**	**200 A**	**ELEVATOR "P1" EQUIPMENT (NOTE4)**	14
15	EXH. FAN #2 (1.5 HP)	**20 A**	**2**			936	15011			"	"	"	16
17	"	"	"					936	15011	"	"	"	18
19	EXH. FAN #3 (1 HP)	**20 A**	**2**	832	0					**1**	**20 A**	**SPARE**	20
21	"	"	"			832	0			**1**	**20 A**	**SPARE**	22
23	EXH. FAN #4 (2 HP)	**30 A**	**2**					1144	0	**1**	**20 A**	**SPARE**	24
25	"	"	"	1144	100					**3**	**30 A**	**SPD**	26
27	**SPARE**	**20 A**	**1**			0	100			"	"	"	28
29	**SPARE**	**20 A**	**1**					0	100	"	"	"	30
			Total Load:	21782		20962		23306					
			Total Amps:	181		175		194					

LOAD TYPE	Connected Load (VA)	Demand Factor	Estimated Demand (VA)		Panel Totals
Largest Motor	0	125.00%	0	Total Conn. Power Load:	66048.78 VA
Other	21015	100.00%	21015	Total Est. Power Demand:	59294 VA
Receptacle	0	100.00%	0	Total Conn. Amperage:	183 A
Lighting	0	125.00%	0	Total Est. Amperage Demand:	165 A
Elevator	45033	NOTE 2	38278		

Notes:
1. PANEL SCHEDULE PROVIDED FOR ADDED EQUIPMENT ONLY.
2. ELEVATOR LOAD IS DERATED TO 85% PER NEC 430.22
3. SURGE PROTECTION DEVISE SHALL BE INTEGRAL TO PANEL (FACTORY INSTALLED).
4. CIRCUIT BREAKER SHALL INCLUDE SHUNT TRIP AND SHALL BE INTERFACED WITH EXISTING FIRE ALARM CONTROL SYSTEM TO DE-ENERGIZE CIRCUIT UPON ACTIVATION; PROVIDE CONDUIT AND WIRE AS REQUIRED.

GENERAL NOTES

1. CONTRACTOR SHALL UPDATE ALL PANEL CIRCUIT DIRECTORIES TO INDICATE IN ANY AND ALL CHANGES; ALL REVISED CIRCUIT DIRECTORIES SHALL BE TYPE WRITTEN.
2. FOR ALL "REVISED" PANEL SCHEDULES REFERENCE ASSOCIATED EQUIPMENT LOAD SCHEDULE FOR OVERALL PANEL LOAD. "REVISED" PANEL SCHEDULES ON THIS SHEET ARE SHOWN FOR ADDED BRANCH CIRCUIT SIZING ONLY.
3. SCHEDULES WITH GREY TEXT INDICATE EXISTING PANELBOARD RATINGS, CIRCUITS, AND LOADS. BLACK TEXT INDICATES REVISED CIRCUITS, PROVIDED EQUIPMENT, AND ADDITIONAL LOAD.
4. ALL DIGITAL POWER METERS (DPM) AND SURGE PROTECTIVE DEVICES (SPD) ARE INTEGRAL TO ELECTRICAL DISTRIBUTION EQUIPMENT, UNLESS OTHERWISE NOTED.

KEY NOTES

Revisions:	Date:

CONSULTANT/ DISCIPLINE

DISCIPLINE:

ARCHITECT/ ENGINEER OF RECORD

A/E:
SPEES DESIGN BUILD
23830 PACIFIC HIGHWAY S. SUITE 300
KENT, WA 98032

SPEESDESIGNBUILD

STAMP

LOUIS R. LITZKA — STATE OF WASHINGTON — 15688 — REGISTERED PROFESSIONAL ENGINEER — 3-24-26

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: ELECTRICAL SCHEDULES
Approved:
Phase: 100% CONSTRUCTION DOCUMENTS
FULLY SPRINKLERED
Project Title: REPLACE ELEVATORS IN BLDG 07 & BLDG 09
Location: ALEXANDRIA VA MEDICAL CENTER, ALEXANDRIA - LA
Issue Date: 03/24/2026
Checked: DCW/NVP
Drawn: JNV/GPB
Project Number: 502-24-102
Building Number: -
Drawing Number: E-703