CORPS OF ENGINEERS

U. S. ARMY

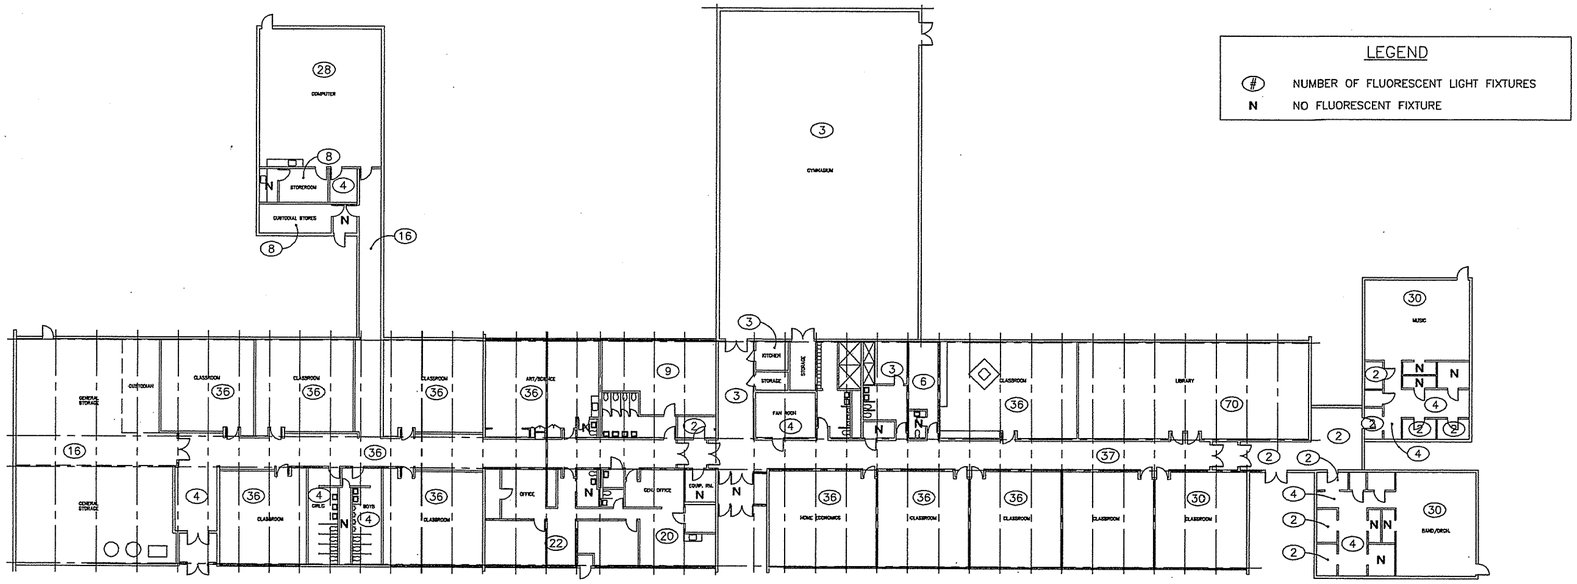

LEGEND

(#)	NUMBER OF FLUORESCENT LIGHT FIXTURES
N	NO FLUORESCENT FIXTURE

N

2 PB1 PB1 **FLOOR PLAN**

SCALE: 1/16"=1'-0"

GENERAL NOTES:

1. EXTERIOR ROOF PLUMBING VENT LEAD FLASHING ARE LEAD CONTAMINATED.
2. YELLOW PAINT MARKINGS ON ASPHALT IN COURT YARD AND PARKING LOT.
3. ALL COPPER PIPING SOLDER JOINTS FOR DRAIN, WASTE, VENT, HOT WATER, COLD WATER AND HOT WATER RECIRCULATION PIPING.
4. DRAIN PIPING HUB AND SPIGOT JOINTS FITTINGS.

LEGEND

1	EXTERIOR OPERABLE AND FIXED WINDOWS – FACTORY APPLIED PRIMER UNDER FINISHED IS LEAD CONTAMINATED. INCLUDES TRIM, FRAME AND SILL.
2	EXTERIOR WINDOWS REPLACES BY TACKBORAD – FACTORY APPLIED PRIMER UNDER FINISHED AND INCLUDES TRIM, FRAME AND SILL.
3	EXTERIOR WOOD DOOR FRAMES – PRIMER UNDER FINISH.
4	EXTERIOR SOFFIT PRIMER UNDER WHITE PAINT NEAR ROOF OF SCHOOL.
5	EXTERIOR FACIAL PRIMER UNDER WHITE PAINT NEAR ROOF OF SCHOOL.
6	EXTERIOR YELLOW PAINT OVER RED, YELLOW PAINT OVER BROWN OR YELLOW PAINT UNDER BEIGE PAINT.
7	GENERAL STORAGE AREA – YELLOW PAINT ON FLOOR IDENTIFYING THE FOOT PRINT OF THE HOT WATER HEATING EQUIPMENT.
8	MECHANICALLY FASTEN CHALKBOARDS IN CLASSROOMS AND TEACHERS LOUNGE.
9	WHITE PAINT ON TOP AND BOTTOM OF TWO STORAGE TANKS – 6"ø AND 4"ø.
10	MECHANICALLY FASTEN LADDER IN COMPUTER ROOM – PRIMER UNDER BLUE FINISHED PAINT IN COMPUTER ROOM.
11	4" DIAMETER PIPE NEXT TO COMPUTER ROOM – PRIMER UNDER YELLOW FINISH PAINT.
12	MECHANICALLY FASTEN TACKBOARDS IN CORRIDOR.
13	TEACHERS MEN'S AND WOMEN'S RESTROOM CERAMIC TILE BASE YELLOW AND BEIGE.
14	CORRIDOR MECHANICALLY FASTEN FIRE ALARM BOXES.

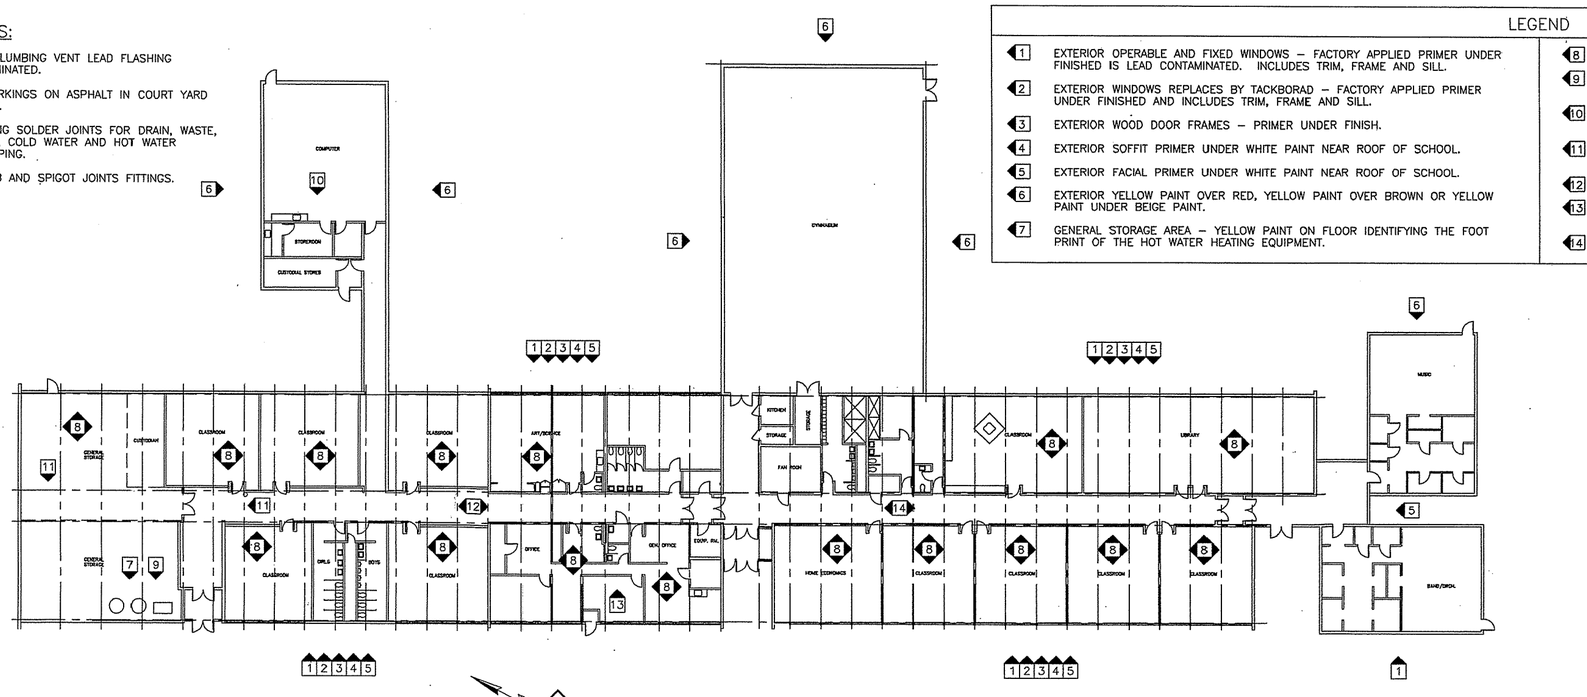

N

1 PB1 PB1 **FLOOR PLAN**

SCALE: 1/16"=1'-0"

REFERENCE NO. PB1

REV.	DATE	C.O.	ACTION	DESCRIPTION	BY	APP'D.

CONTRACTOR _____ CONTRACT NO. _____

CITY _____ STATE _____

RECOMMENDED: _____ PRIME CONTRACTOR

APPROVED: _____ RESIDENT ENGINEER

DATE:

USKH — A quarter century of design for Alaskans

ALASKA DISTRICT
CORPS OF ENGINEERS
ANCHORAGE, ALASKA

DESIGNED: RJW
DRAWN: LDS/EFH
TRACED:
CHECKED: SVB
SUBMITTED:
SR. SECT.

BEN EIELSON JR./SR. HIGH SCHOOL – PHASE 3
EIELSON AIR FORCE BASE, ALASKA
LEAD ABATMENT & PCB

TAYLOR ELEMENTARY
ABATEMENT

RECOMMENDED: _____ CHIEF, MILITARY TECHNICAL ENGINEERING BRANCH

APPROVED: _____ CHIEF ENGINEERING DIVISION

DATE:

SCALE: AS SHOWN

SPEC. NO.

DRAWING NUMBER
29-02-38

SHEET OF

507202PB1.DWG (1=1)