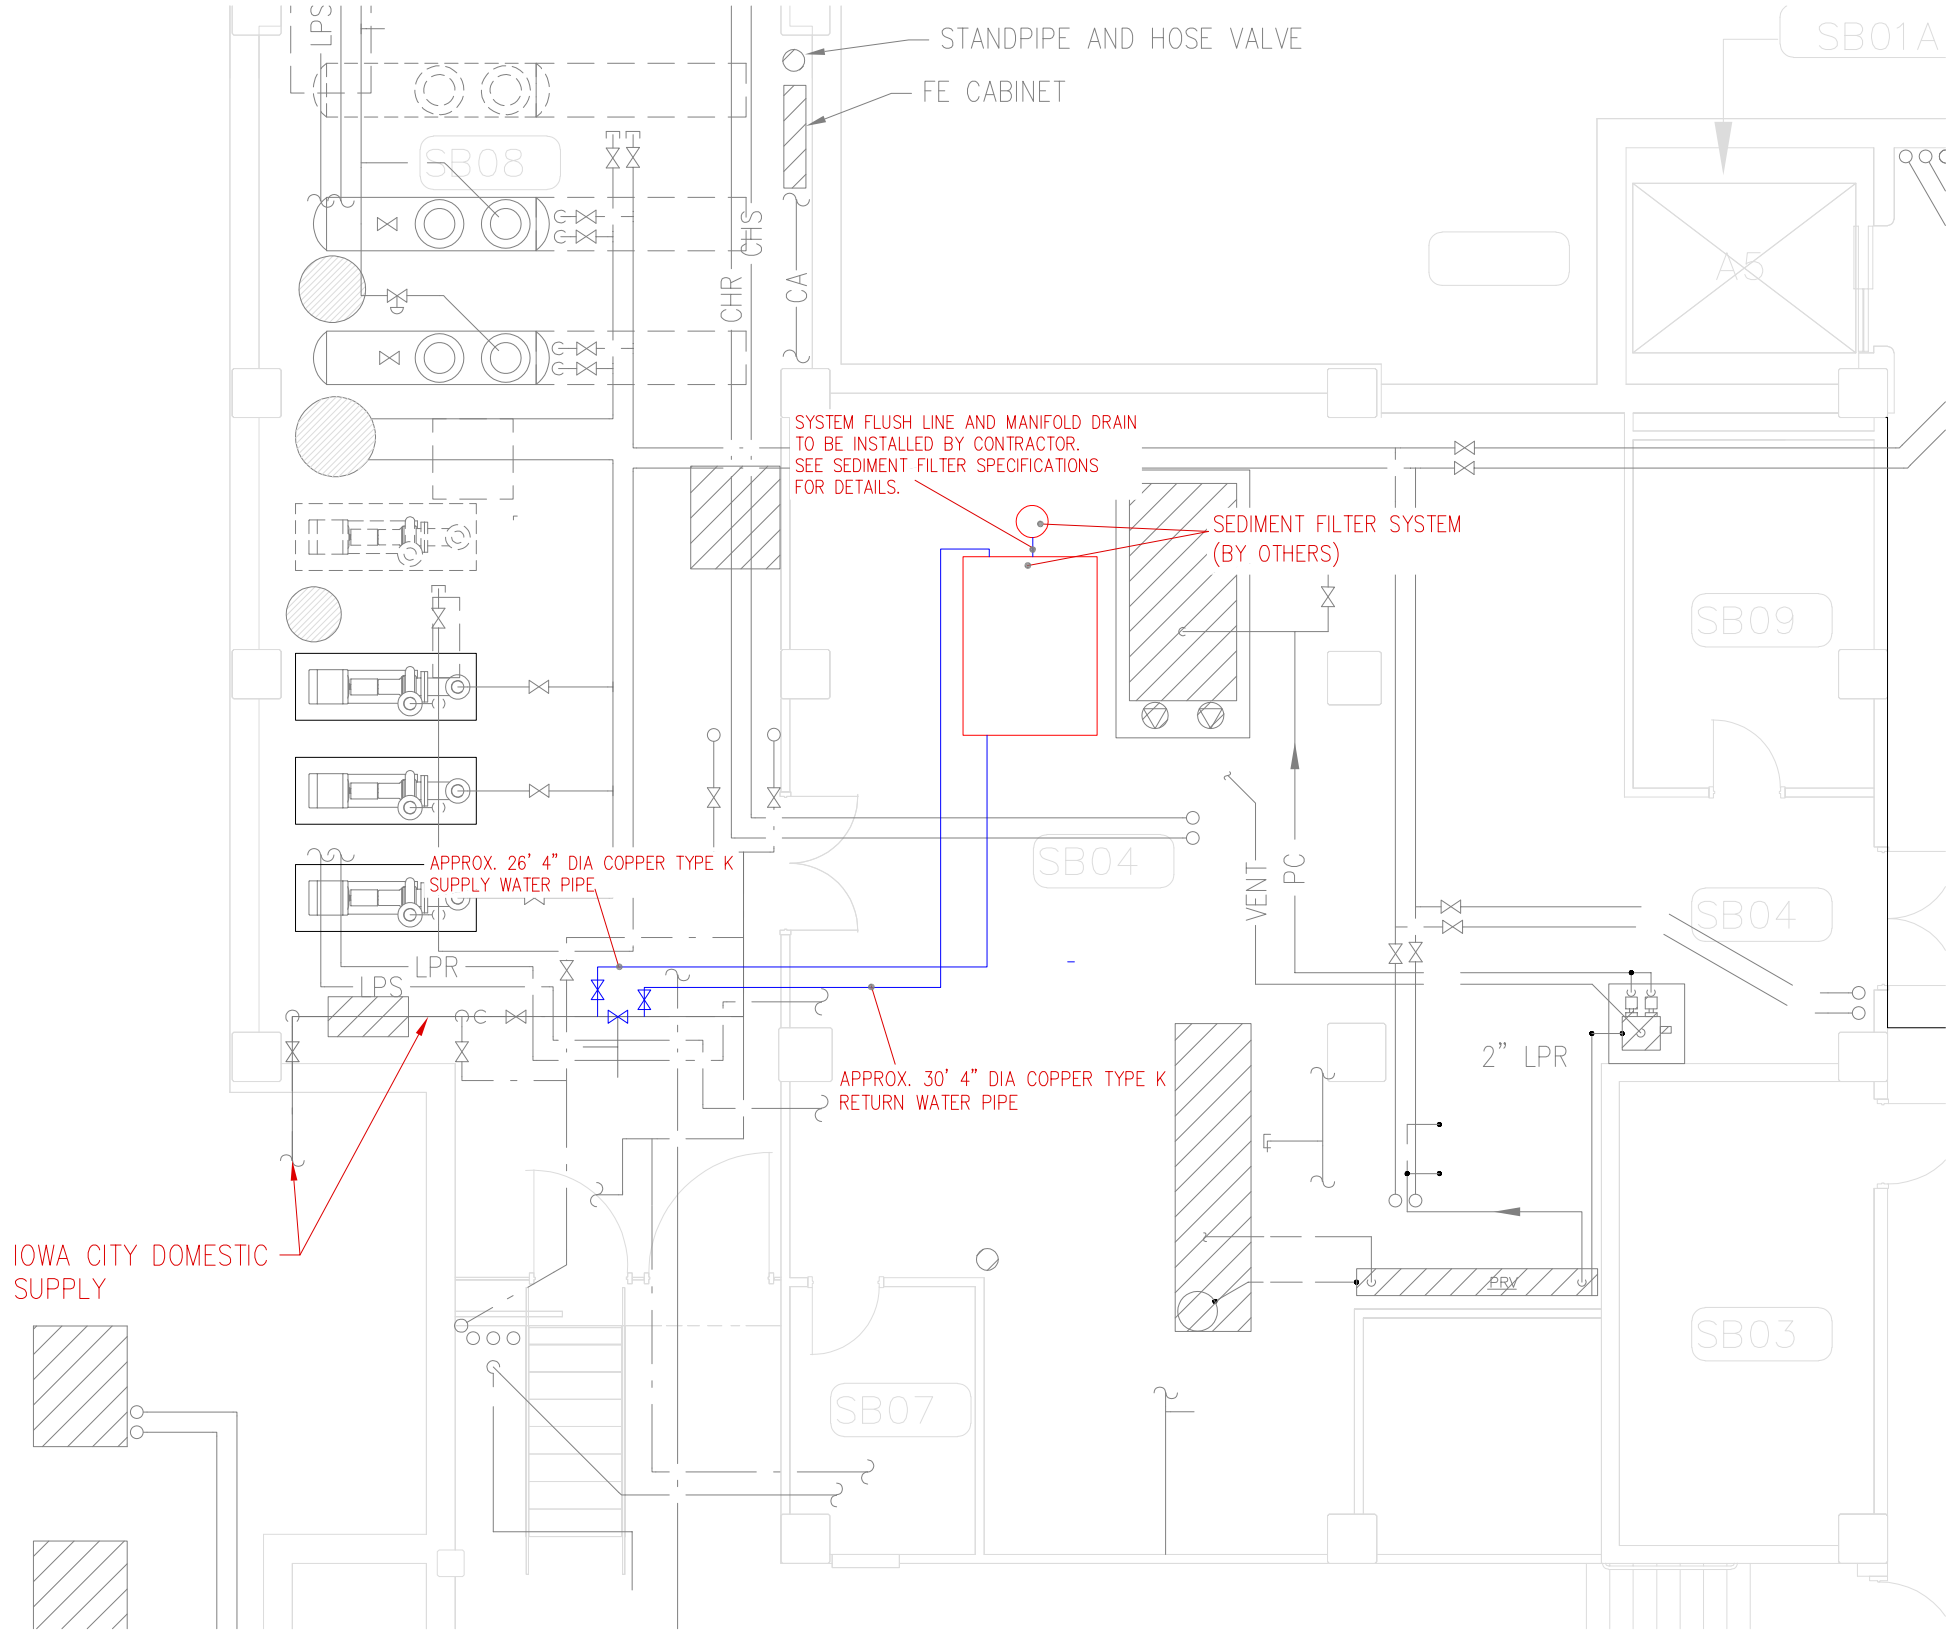


SUB-BASEMENT FLOOR PLAN

SCALE: 3/8"=1'-0"

PLAN NORTH

## GENERAL NOTES

1. PIPE LENGTHS SHOWN ON PLANS ARE APPROXIMATE ONLY. CONTRACTOR SHALL FIELD VERIFY ALL DISTANCES.

2. CONTRACTOR TO FIELD VERIFY ALL SITE CONDITIONS, INCLUDING UTILITIES, FIXTURES, AND APPURTENANCES.

3. PROPOSED PIPE BENDS, ELBOWS, AND OTHER PIPE FITTINGS ARE NOT SHOWN ON PLANS. ENGINEER ESTIMATES SIX (6) 90° AND TWELVE (12) 45° ELBOWS ARE NEEDED. THIS QUANTITY SHALL BE VERIFIED BY CONTRACTOR BEFORE CONSTRUCTION.

4. ENGINEER ESTIMATES SIX (6) GATE VALVES AND THREE BALL VALVES ARE NEEDED. THIS QUANTITY SHALL BE VERIFIED BY CONTRACTOR BEFORE CONSTRUCTION.

5. PENETRATION LOCATIONS THROUGH INTERIOR WALLS SHALL BE COORDINATED WITH ENGINEER. MATERIALS FOR INSTALLATION OF PIPE THROUGH PENETRATION SHALL BE FIELD VERIFIED.

| Revisions: | Date |
|---|---|

CONSULTANTS:

ARCHITECT/ENGINEERS:

Drawing Title: SUB-BASEMENT FLOOR MECHANICAL PIPING PLAN

Approved: Project Director: SEAN FARMER

Project Title: INSTALL SEDIMENT FILTER SYSTEM

Location: BUILDING NO. 1, VAMC IOWA CITY, IA

Date | Checked | Drawn

Project Number: 636A8-26-0001

Building Number: NO. 1

Drawing Number: 1

Dwg. of

Office of Construction and Facilities Management

Department of Veterans Affairs

VA FORM 08-6231