1. SHIELDING AS REQUIRED BASED ON ARCHITECTURAL AND STRUCTURAL DRAWINGS.
2. STAINLESS STEEL BAND CLAMP.
3. TRANSITION TO CPVC AS REQUIRED.
4. EXTEND SHIELDING UP A MINIMUM OF 6" ABOVE FINISHED FLOOR - COORDINATE WITH SHIELDING CONTRACTOR.
5. EXTEND SHIELDING DOWN A MINIMUM OF 3" BELOW THE BOTTOM OF THE SLAB - COORDINATE WITH SHIELDING CONTRACTOR.
6. BOND SHIELDING AROUND DRAIN BODY.
7. OVERLAP DRAIN AS REQUIRED - SECURE TO DRAIN AS REQUIRED (TYPICAL).
8. FINISH FLOOR - SEE DETAIL F1/A-505.

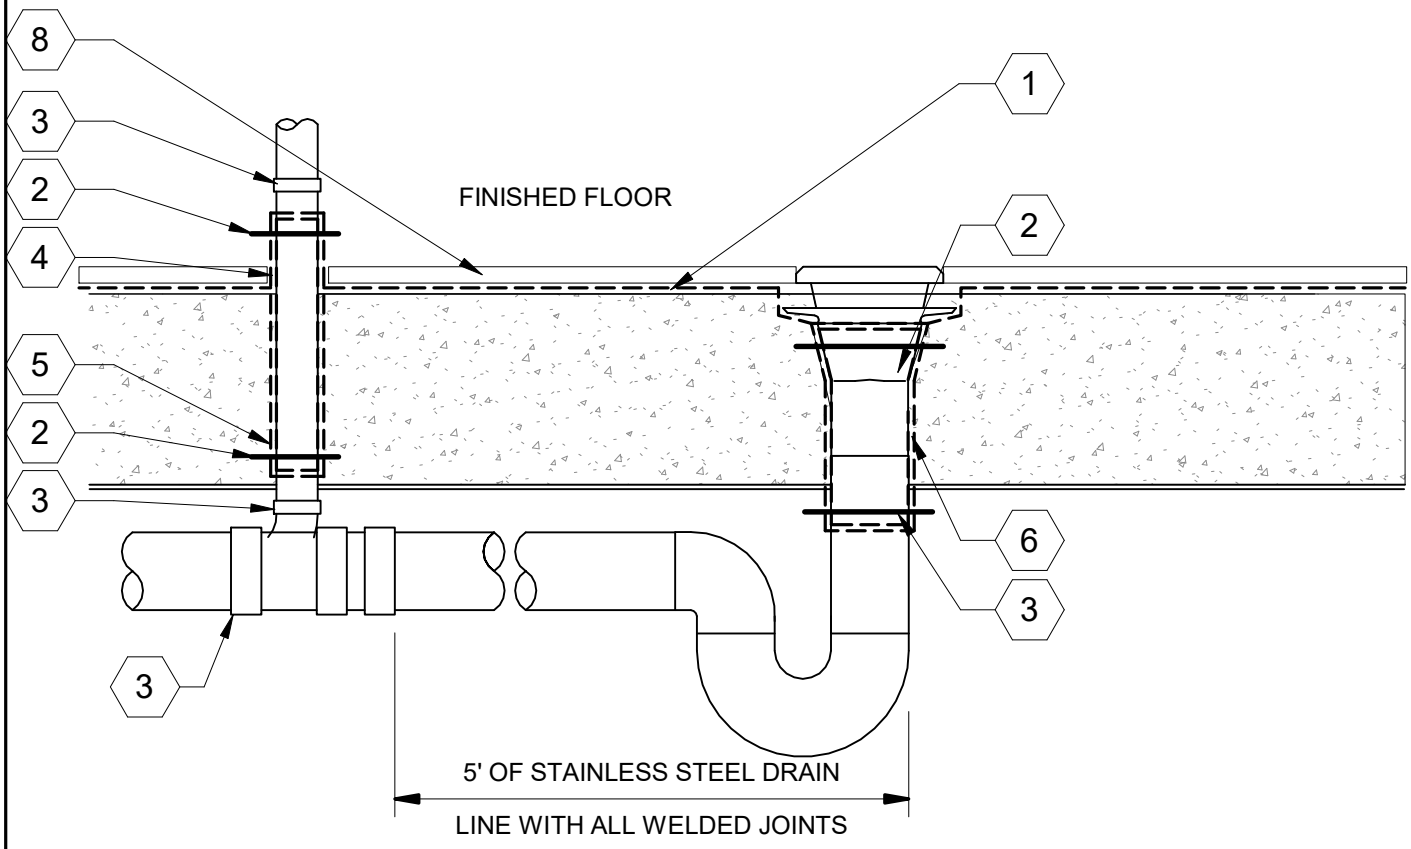

NOTE: DETAIL/DIAGRAM IS INTENDED TO SHOW OPTIONS FOR DRAIN AND VENT PIPING IN THE SECURED AREA.

1 FLOOR DRAINS AT SECURE BOUNDARY

SCALE NTS

MANSFIELD LAHM AIR NATIONAL GUARD BASE, OH
REPAIR B403 FOR CYBER
FA877006

FLOOR DRAINS AT SECURE BOUNDARY

JACOBS GOVERNMENT SERVICES
2600 MICHELSON SR, STE 500
IRVINE, CA 92612

DESIGNED BY: Designer	ISSUE DATE:
DRAWN BY: Author	ANG PROJECT NO.: PBXP222050
CHECKED BY: Checker	
SUBMITTED BY:	
SHEET ID:	**RFI 03, Q.7.**