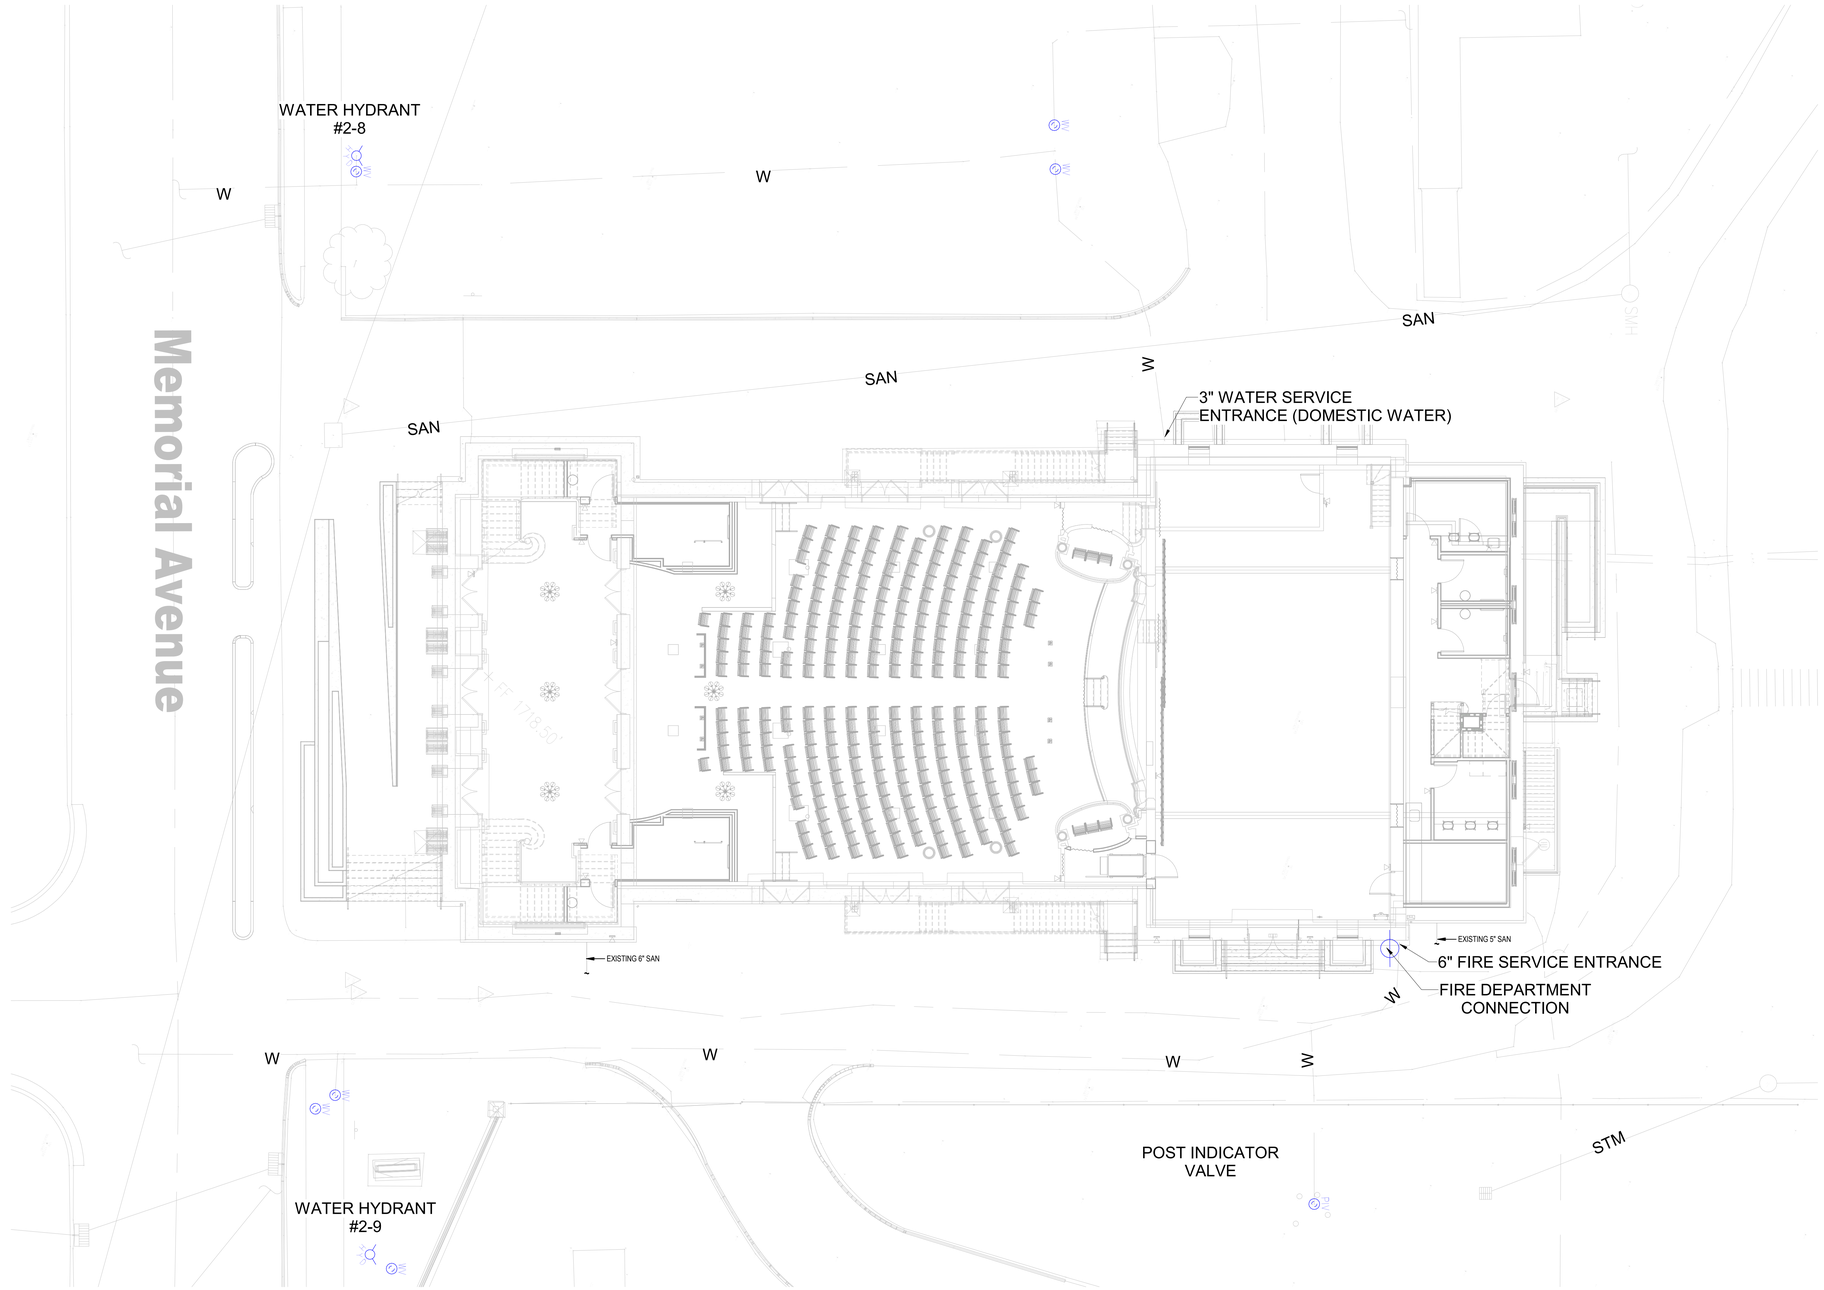

1 **SITE PLAN**
SCALE: 1/8" = 1'-0"

GENERAL NOTES

A. REFER TO SHEET F001 FOR ABBREVIATIONS, LEGEND & DESIGN NOTES.

B. UTILIZE EXISTING SPRINKLER LOCATIONS WHERE POSSIBLE IN AUDITORIUM AND LOBBY CEILINGS.

C. FOLLOW EXISTING EXPOSED BRANCH AND MAIN PIPE ROUTING IN AUDITORIUM AND LOBBY.

D. EXPOSED PIPING SHALL MATCH ADJACENT PAINTED SURFACES.

E. SPRINKLER PIPING TO BE ROUTED IN CEILING WHERE CEILING SPACE ALLOWS. (ROOMS 110, 110A, 111, 111A,104, 105, 106, 108 & 109.)

F. UTILIZE EXISTING TEST LOCATIONS AND DRAIN ROUTING.

PLAN NORTH

No.	Revisions:	Date:
	100% CONSTRUCTION DOCUMENTS	05/30/2025
	95% CONSTRUCTION DOCUMENTS	03/31/2024
	75% DESIGN DEVELOPMENT	01/29/2025
	25% SCHEMATIC DESIGN	10/31/2024

CONSULTANT

ARCHITECT/ENGINEER OF RECORD

FFE | HEAPY

PROJECT NO. 2024-05141

STAMP

NOT FOR CONSTRUCTION

JAMES H. QUILLEN VA MEDICAL CENTER

VA U.S. Department of Veterans Affairs

Drawing Title: SITE PLAN

Approved: VAMC

Phase: 100% CONSTRUCTION DOCUMENTS

FULLY SPRINKLERED

Project Title: RESTORATION OF BUILDING 35 HISTORIC THEATER

Location: MT. HOME, TENNESSEE

Issue Date: 05/30/2025

Checked: EWL

Drawn: RLC

Project Number: 621-24-103

Building Number: 35

Drawing Number: FS100

Autodesk Docs://Mt Home VA - Restoration of B35 Theater/2024-05141-MEP-Central.rvt

5/29/2025 4:06:27 PM

VA FORM 08 - 6231