EXHIBIT G– Range Limit Marker Drawings.

GENERAL NOTES:
1) CONTRACTOR SHALL PROVIDE AND INSTALL ONE ALUMINUM OUTER RANGE LIMIT MARKER.
2) THERE SHALL BE NO HOLES DRILLED IN THE ALUMINUM MARKERS UNTIL THEY ARRIVE ONSITE.
3) INSTALL BITUMINOUS COATING FOR SUBTERRANEOUS PORTIONS OF THE POLE PLUS 6 INCHES ABOVE GROUND.
4) ONSITE CONTRACTOR SHALL INSTALL 3 RED LIGHTS, ON/OFF SWITCH AND ELECTRICAL WIRING.
5) ONSITE CONTRACTOR SHALL PROVIDE AND INSTALL CONCRETE COUNTER BALANCE.

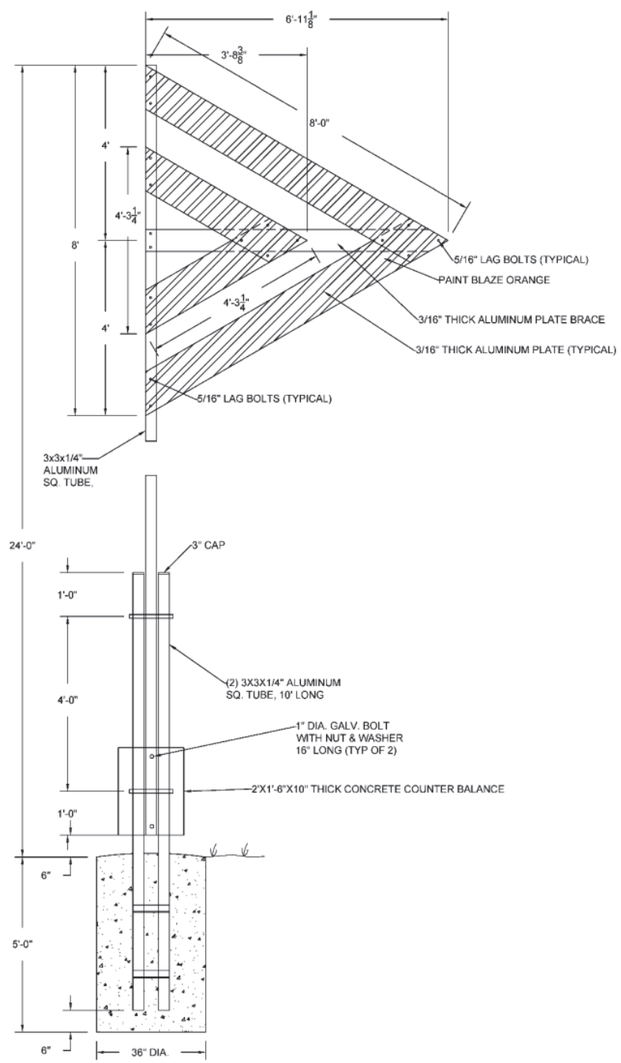

FRONT VIEW

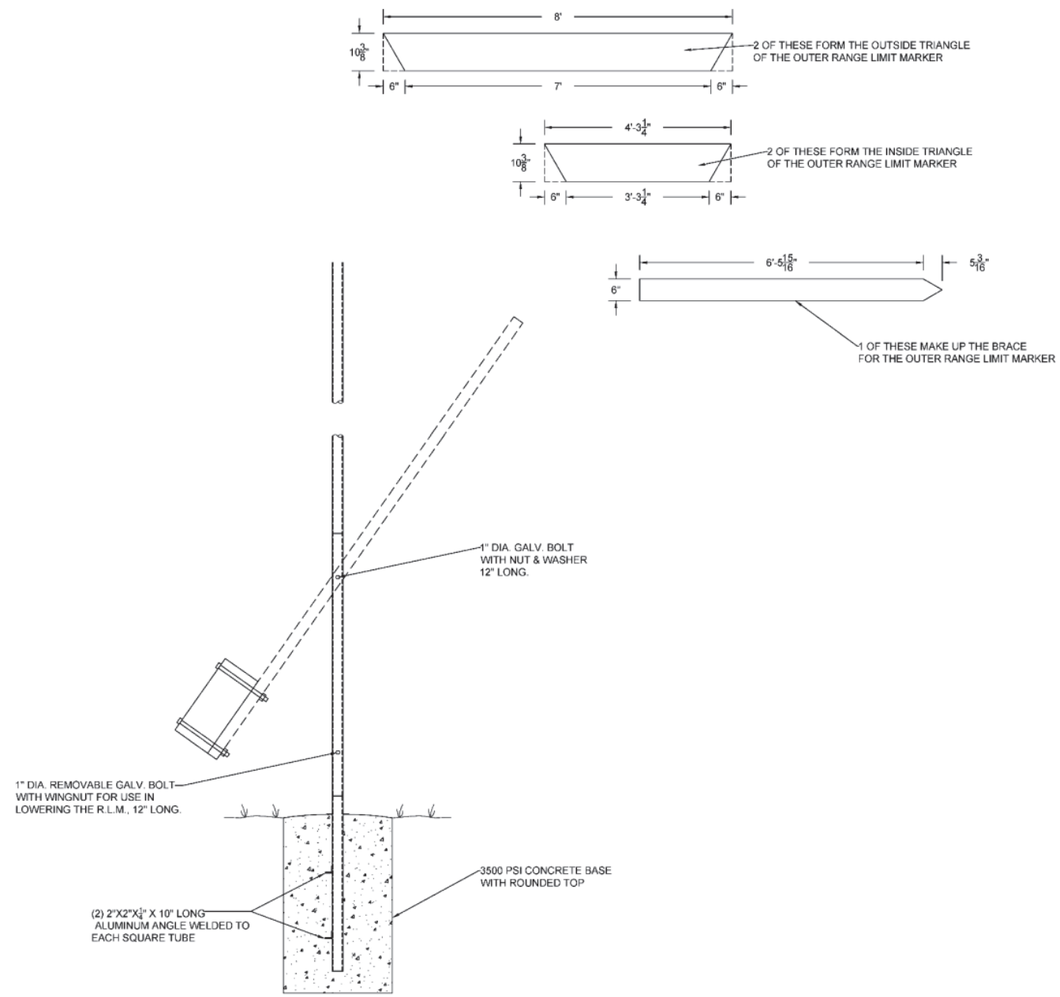

SIDE VIEW

24' TALL ALUMINUM RANGE LIMIT MARKER
SCALE:N.T.S.

REVISIONS
SYMBOL | DESCRIPTION | DATE | APPR.

DESIGNED BY:
DRAWN BY:
CHECKED BY: KC
DATE: 07/18/2023
SCALE: NONE
DRAWING CODE:
PROJECT ENGINEER/ARCHITECT
DATE

24' TALL RANGE LIMIT MARKER

SHEET REFERENCE NUMBER:
S-103
SHEET ____ OF ____

EXHIBIT G – Range Limit Marker Drawings.

GENERAL NOTES:
1) CONTRACTOR SHALL PROVIDE AND INSTALL FIVE 16' TALL ALUMINUM OUTER RANGE LIMIT MARKERS ON THE CMPRC.
2) CONTRACTOR SHALL PROVIDE AND INSTALL FOUR 16' TALL ALUMINUM OUTER RANGE LIMIT MARKERS ON THE BCMU.
3) CONTRACTOR SHALL PROVIDE AND INSTALL FOUR 16' TALL ALUMINUM OUTER RANGE LIMIT MARKERS ON THE CCMU.
4) INSTALL BITUMINOUS COATING FOR SUBTERRANEOUS PORTIONS OF THE POLE PLUS 6 INCHES ABOVE GROUND.
5) THERE SHALL BE NO HOLES DRILLED IN THE ALUMINUM MARKERS UNTIL THEY ARRIVE ONSITE.
6) ONSITE CONTRACTOR SHALL INSTALL 3 RED LIGHTS, ON/OFF SWITCH AND ELECTRICAL WIRING.
7) ONSITE CONTRACTOR SHALL PROVIDE AND INSTALL CONCRETE COUNTER BALANCE.

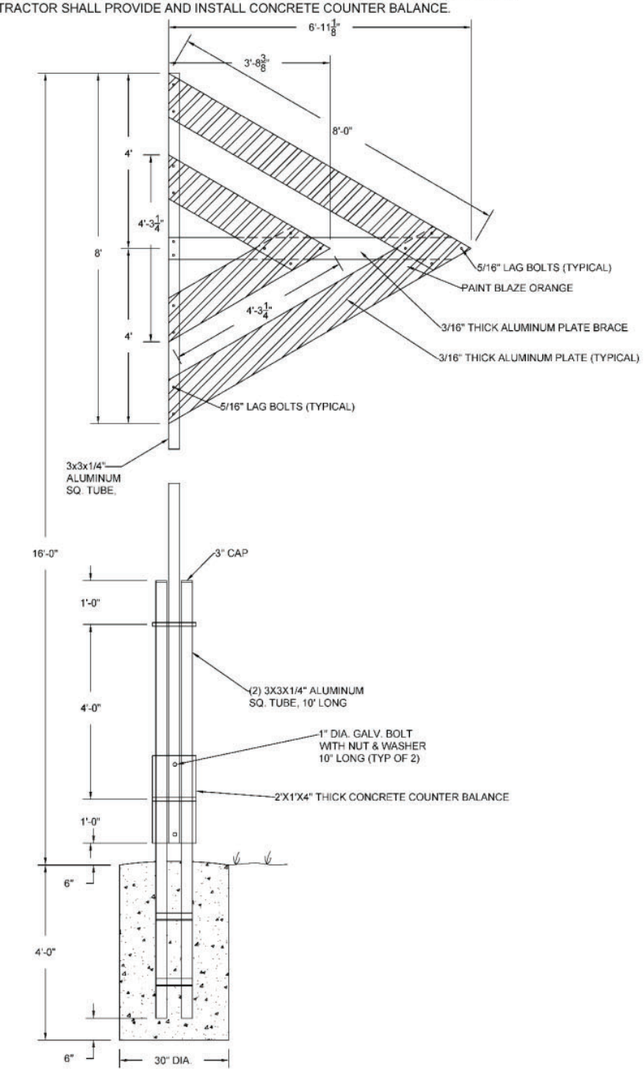

FRONT VIEW

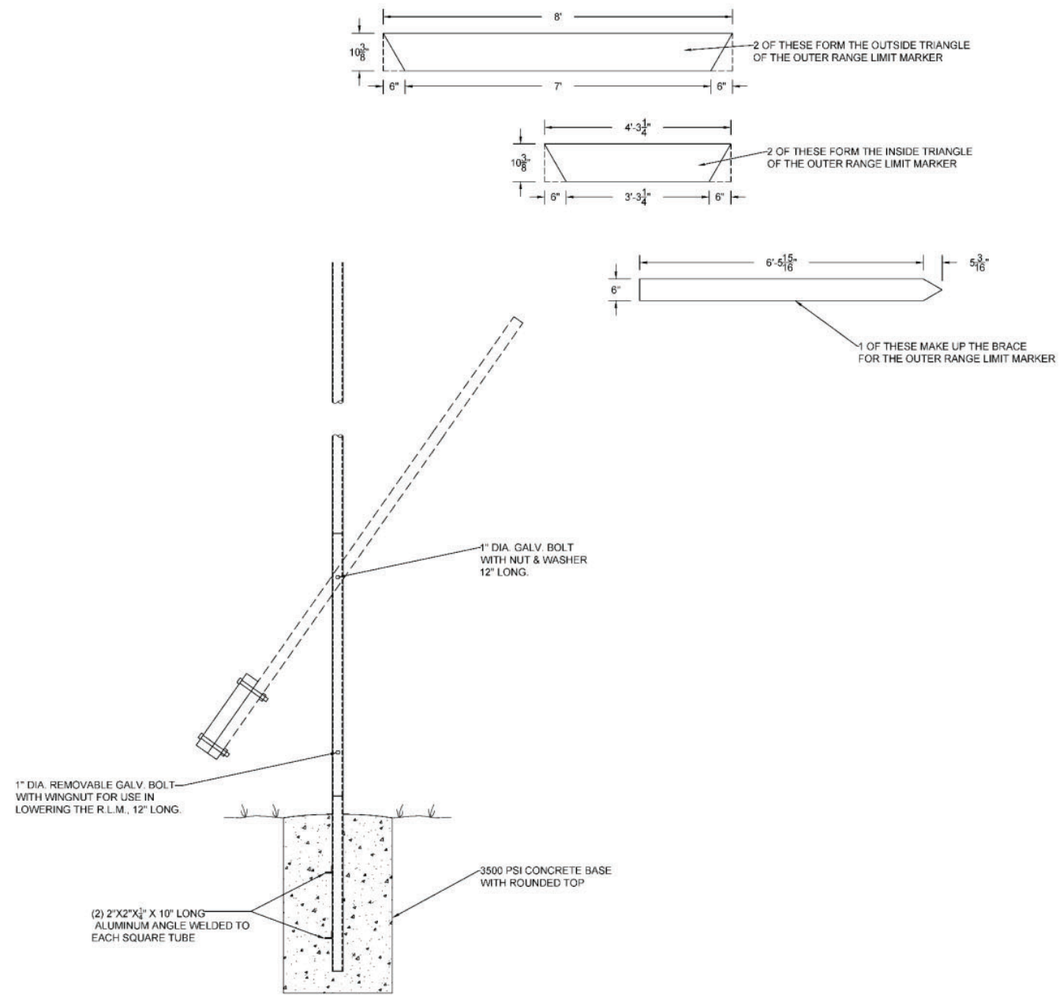

SIDE VIEW

16' TALL ALUMINUM RANGE LIMIT MARKER
SCALE:N.T.S.

SYMBOL	REVISIONS DESCRIPTION	DATE	APPR.

DESIGNED BY:
DRAWN BY:
CHECKED BY: KC
DATE: 07/19/2023
SCALE: NONE
DRAWING CODE:
PROJECT ENGINEER/ARCHITECT
DATE

SHEET REFERENCE NUMBER:
S-104
SHEET ____ OF ____