WALL TO BE UPGRADED TO A FIRE RATED WALL - ELECTRICAL WORK BOTH SIDES.

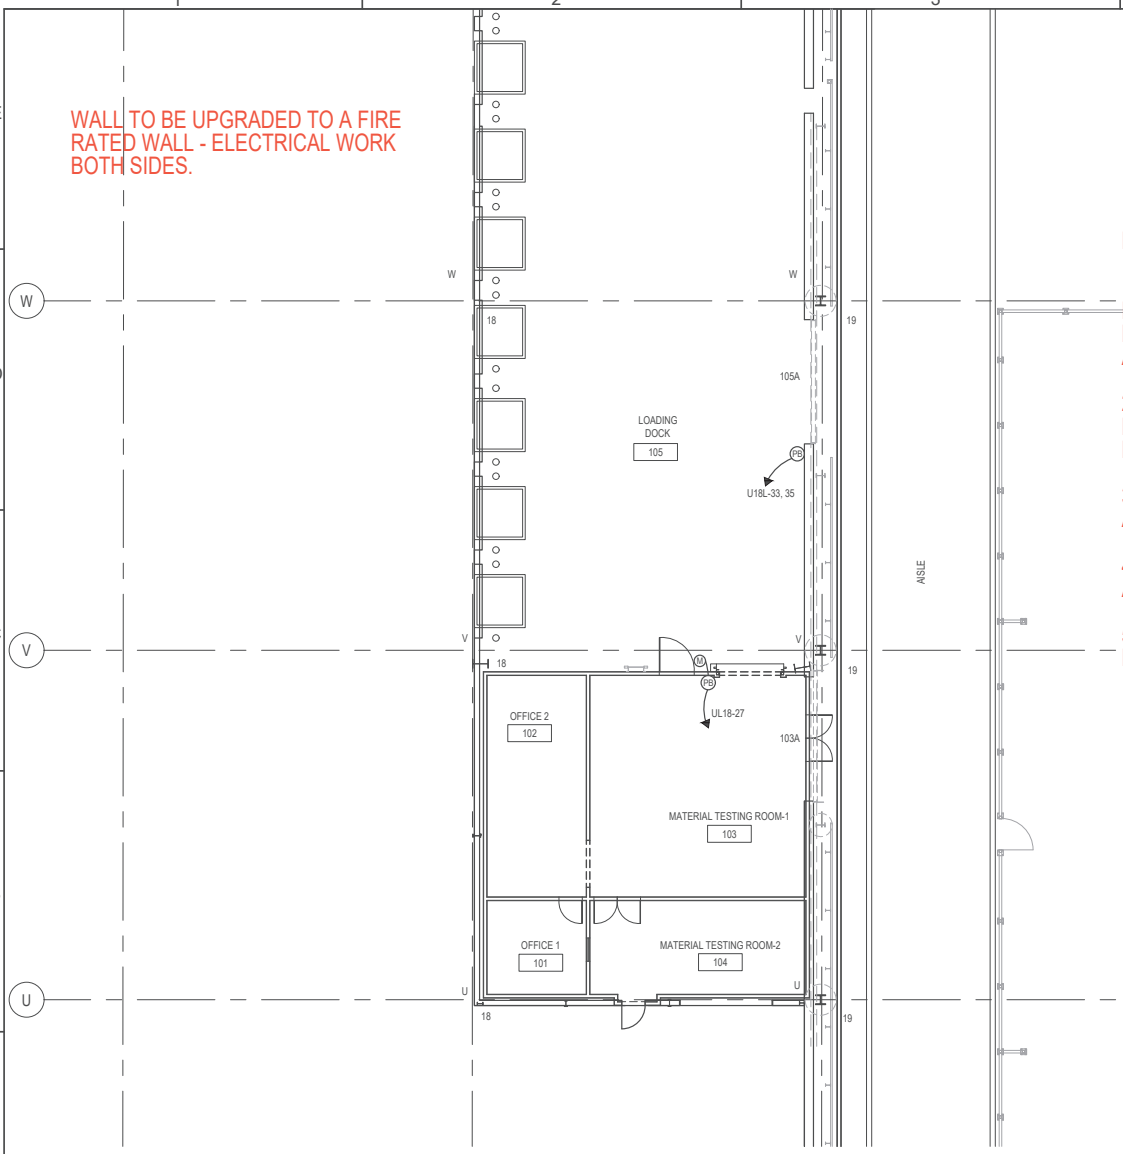

1 E-104 OVERHEAD DOOR ELECTRICAL SPECIFICATIONS

SCALE: 1/8" = 1'-0"

OVERHEAD DOOR - ELECTRICAL SPECIFICATIONS				
DOOR NO.	POWER	CONTROL STATION	CONTROL STATION MOUNTING	NOTES
103A	115 VAC - SINGLE PHASE	24V, 3 BUTTON, OPEN, CLOSE, STOP (STD)	NEMA 1 FLUSH INTERIOR	1. COORDINATE CONTROL STATION INSTALLATION WITH CONSTRUCTION OF RATED WALL ASSEMBLIES
105A	230 VAC - SINGLE PHASE	24V, 3 BUTTON, OPEN, CLOSE, STOP (STD)	NEMA 1 FLUSH INTERIOR	1. COORDINATE CONTROL STATION INSTALLATION WITH CONSTRUCTION OF RATED WALL ASSEMBLIES

ELECTRICAL SCOPE FOR FIRE-RATED WALL UPGRADES

1. CONTRACTOR SHALL REMOVE, PRESERVE, AND RE-INSTALL ALL EXISTING ELECTRICAL COMPONENTS LOCATED ON OR WITHIN WALLS DESIGNATED FOR UPGRADE TO A FIRE-RATED ASSEMBLY. COORDINATE ALL WORK WITH THE GENERAL CONTRACTOR.

2. AFFECTED COMPONENTS INCLUDE BUT ARE NOT LIMITED TO: POWER/LIGHTING PANELS, JUNCTION BOXES, CONDUITS, WIRING DEVICES, FIRE ALARM DEVICES, AND LOW-VOLTAGE CABLING/OUTLETS.

3. PRIOR TO REMOVAL, SAFELY DE-ENERGIZE AND LOTO ALL AFFECTED SYSTEMS.

4. UPON COMPLETION OF RE-INSTALLATION, RE-ENERGIZE AND TEST ALL SYSTEMS TO ENSURE FULL FUNCTIONALITY.

5. ALL WORK SHALL COMPLY WITH THE CURRENT NEC AND ALL RELEVANT LIFE SAFETY STANDARDS.

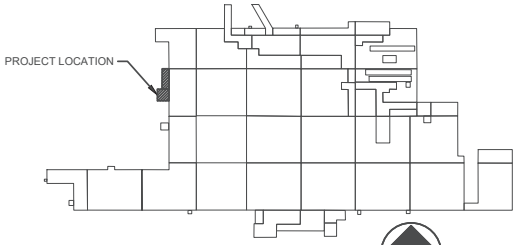

B9001 KEY PLAN

AFMC
AIR FORCE MATERIEL COMMAND
72 ABW CIVIL ENGINEER DIRECTORATE
TINKER AFB, OK

35% DESIGN

PROJECT INFORMATION
WWYK250063
INSTALL REACT VII FACILITY
B9001, V19
TINKER AIR FORCE BASE, OKLAHOMA

REVISIONS
MARK | DATE | DESCRIPTION

MANAGEMENT INFORMATION
ISSUE DATE: 7 OCT 25
DESIGN GROUP: TEPA-CSAG
DESIGNED BY: D PERRY
DRAWN BY: T KISER
CHECKED BY: C HIXON
DESIGN FILE LOCATION: Engr\Design\2020s\2025\202500630_Support\0_3_Drawings\Model

SHEET TITLE
OVERHEAD DOOR ELECTRICAL SPECIFICATIONS

SHEET NUMBER
E-104

SHEET 46 OF