Attachment: A

Site Map

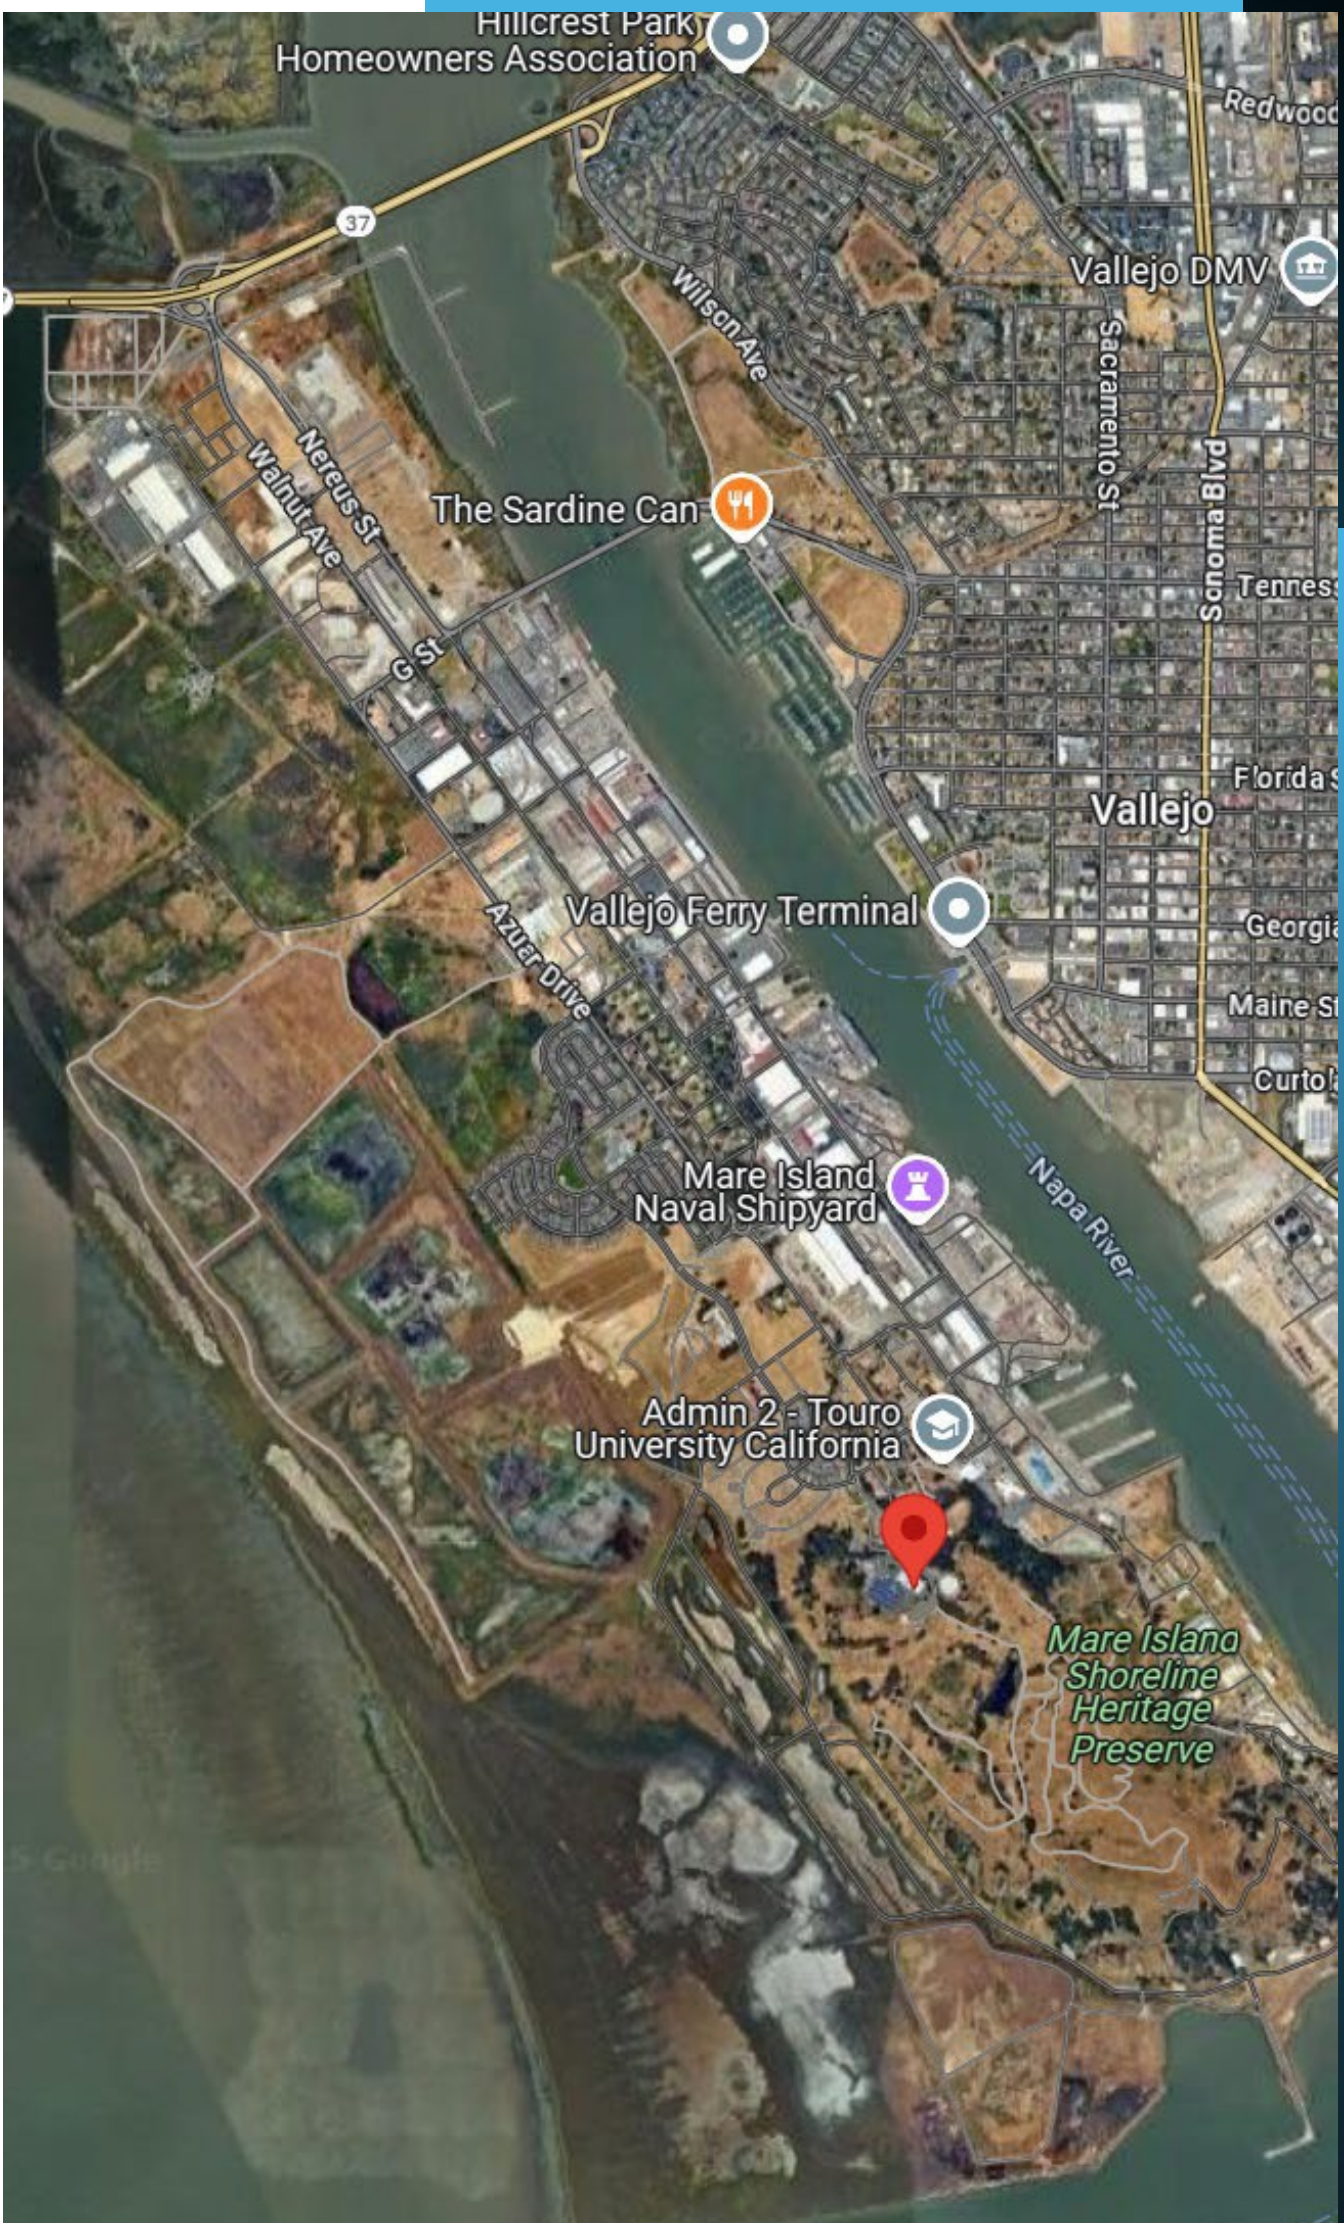

a

Touro Universi
California - Far
Howard Feinberg
Club Dr
Perry Rd
Club Dr
Club Dr
Mesa Rd

Main Facilities and FFEB Equipment

Annex (Storage Facility) – Sprinkler System Inside

Facility FFEB Systems Locations – 2ea (two) Admin Bldgs., 8flrs, 122,300sqft.

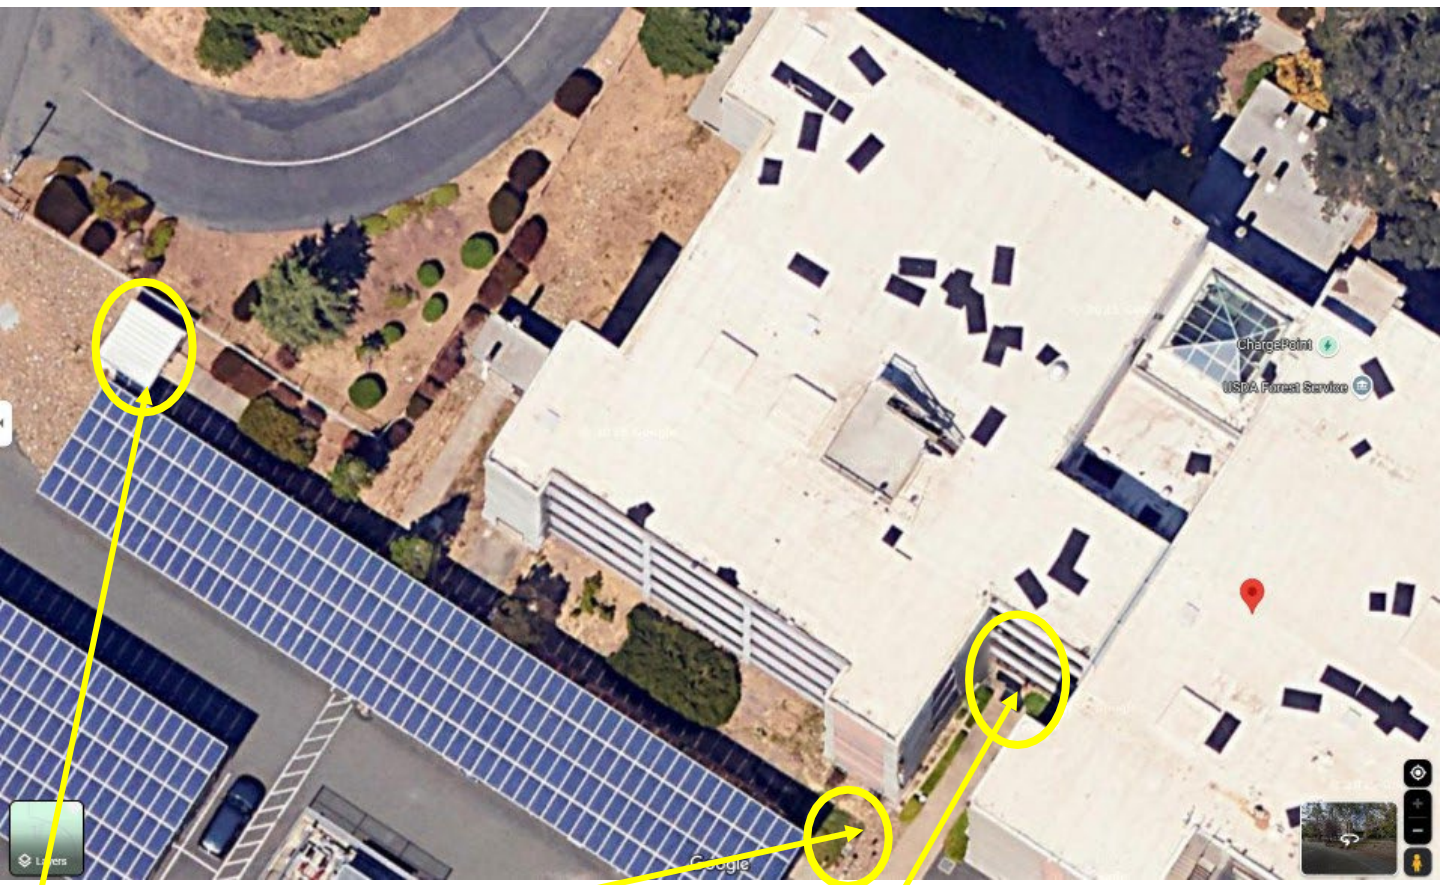

Fire Pump House Backflow Preventer Alarm Panel/Alarm Valves

Facility FFEB Systems Locations – 2ea (two) Admin Bldgs., 8flrs, 122,300sqft.

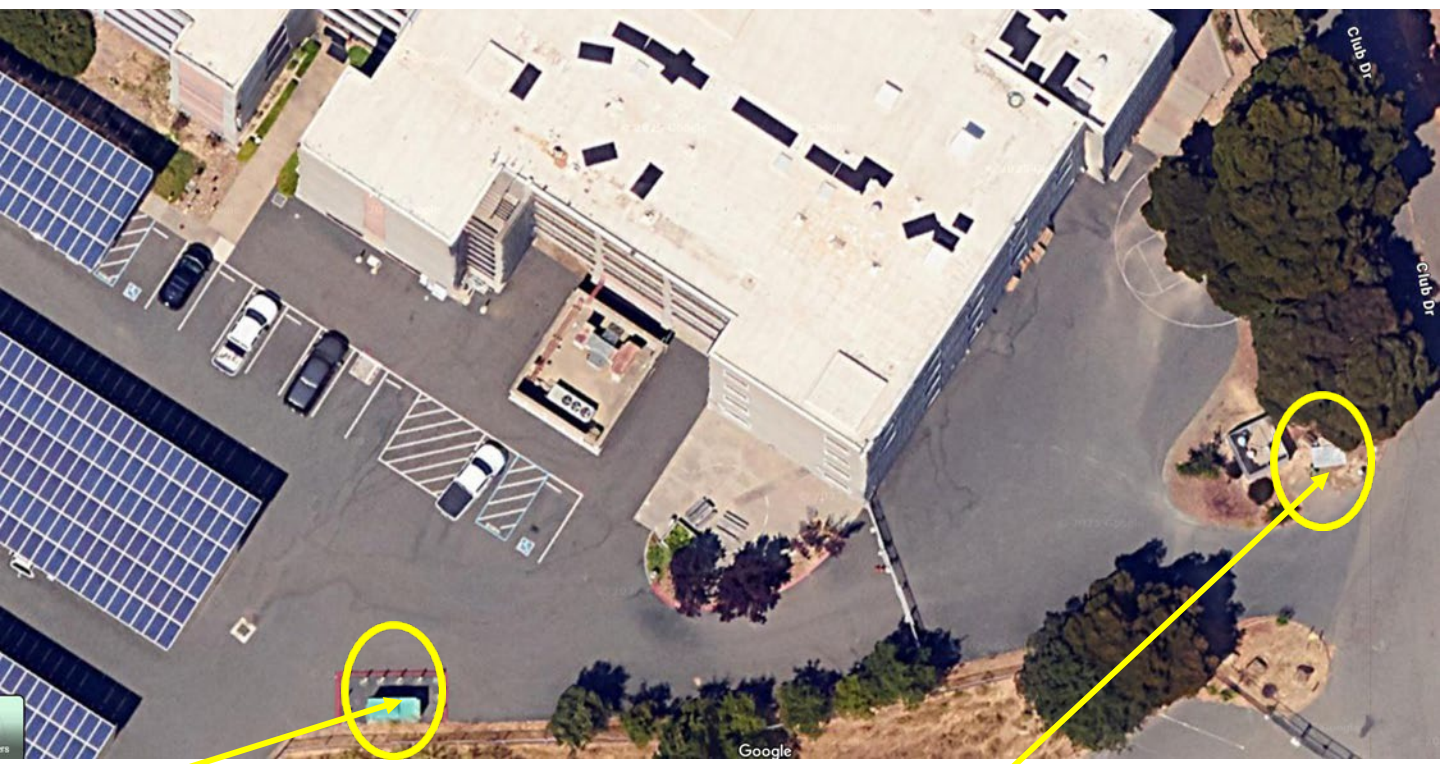

Emergency Generator

Backflow/Valves from water source.