Docusign Envelope ID: 1F1A1E81-2E6F-444A-966C-7E85F75DEEA5

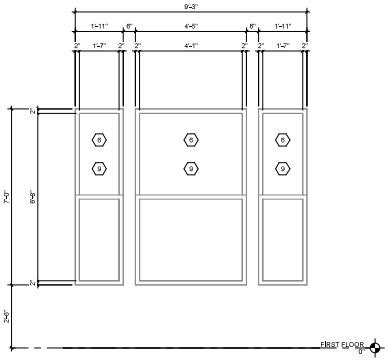

FIRST FLOOR TR ELEVATION
Scale: 1/2" = 1'-0"



FIRST FLOOR REFLECTED CEILING DEMOLITION PLAN
Scale: 1/4" = 1'-0"



FIRST FLOOR DEMOLITION FLOOR PLAN
Scale: 1/4" = 1'-0"



FIRST FLOOR REFLECTED CEILING PLAN
Scale: 1/4" = 1'-0"



FIRST FLOOR PLAN
Scale: 1/4" = 1'-0"

SHEET NOTES:

A. ALL EXISTING CONDITIONS ARE BASED ON BEST AVAILABLE INFORMATION AT THE TIME OF SURVEY AND VISUAL INSPECTION. CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS.

B. ELEMENTS SHOWN WITH LIGHT, GRAY LINES ARE EXISTING TO REMAIN. ELEMENTS SHOWN WITH DARK DASHED LINES ARE EXISTING TO BE DEMOLISHED. DEMOLITION SHALL INCLUDE, BUT NOT BE LIMITED TO, THOSE ELEMENTS SHOWN.

C. ALL WORK SHALL BE COORDINATED BETWEEN TRADES.

D. ALL WORK SHALL BE COORDINATED WITH THE COR TO MINIMIZE DISRUPTION OF AREAS OUTSIDE OF THE PROJECT LIMITS OF WORK.

E. ALL CEILING DEMOLITION WORK TO BE COORDINATED WITH CHANGE OF EXISTING PENDANT SPRINKLER HEADS WITH NEW UPRIGHT SPRINKLERS SUCH THAT THERE IS NO EXTENDED LOSS OF SPRINKLER PROTECTION IN THE CONSTRUCTION AREA.

F. FOR FINISHES IN ALL NEW TR ROOMS– SEE ROOM FINISH SCHEDULE SHEET A-005.

G. ALL NEW TR ROOMS TO HAVE CARBON DIOXIDE EXTINGUISHER WITHIN 75' OF ROOM. SEE OVERALL OR ENLARGED PLANS FOR LOCATIONS

H. PATCH AND FILL ALL PENETRATIONSHOLES IN WALLS OF TR ROOMS TO MAINTAIN WALL RATINGS.

KEY NOTES:

1 REMOVE EXISTING FLOOR FINISH AND BASE.
2 DEMOLISH EXISTING DOOR AND FRAME IN METAL STUD AND GYP BD WALL.
3 DEMOLISH BLINDS. CLEAN AND PREP WINDOWS FOR FILM INSTALLATION.
4 REMOVE EXISTING ACT CEILING, INCLUDING ELEC AND MECH FIXTURES.
5 REMOVE EXISTING SIGNAGE AND TURN OVER TO THE VA.

@ KEY NOTES:

1 ROOM TO RECEIVE NEW FINISHES WALLS AND FLOORS. SEE ROOM FINISH SCHEDULE ON SHEET A-005.
2 NEW FIRE EXTINGUISHER SIGNAGE ABOVE FIRE EXTINGUISHER CABINET. REF TO A-005 FOR REQUIREMENTS.
3 NEW CARD READER. REFER TO TECHNOLOGY DRAWINGS.
4 INSTALL SEMI RECESSED FIRE EXTINGUISHER CABINET.
5 PROVIDE 4'X8'X3/4" FIRE RETARDANT TREATED AC GRADE PLYWOOD BACK BOARDS IN TELECOM ROOMS. PLYWOOD SHALL BE MOUNTED WITH A-SIDE OUT AND PAINTED WITH (3 COATS TOTAL) OF FIRE RESISTANT PAINT ON ALL SIDES PRIOR TO MOUNTING, AND SHALL MATCH P-2 COLOR. MASK OVER FIRE RETARDANT SEAL ON PLYWOOD BEFORE PAINTING TO ALLOW INSPECTION OF FIRE RATING SEAL. ALL DRYWALL SURROUNDING WALLS TO BE PAINTED WITH STANDARD PAINT P-1 TO MATCH PLYWOOD COLOR.
6 INSTALL WINDOW FILM TO INTERIOR FACE OF WINDOW GLAZING - SEE A-205 AND INTERIOR ELEVATION THIS SHEET FOR WINDOW SIZES.
7 EXTEND EXISTING WALL TO UNDERSIDE OF DECK ABOVE (APPROX. 2'-0") WITH WALL TYPE Maa3 SEE SHEET A-202. SEAL ALL PENETRATIONS AND EXISTING VOIDS.
8 EXPOSED CEILING.
9 CLEAN WINDOW. INSTALL NEW WINDOW LOCK. BASIS OF DESIGN: PRIME-LINE WINDOW LOCK #J8628 OR EQUAL.
10 AT NEW DOOR, EXTEND STATIC DISSIPATIVE TILE FROM ROOM INTO CORRIDOR TO EXISTING FLOORING.
11 NEW ROOM SIGNAGE, REF TO A-005 FOR REQUIREMENTS.
12 INSTALL NEW FIRE EXTINGUISHER.

KEY PLAN

SCALE: NO SCALE

AREA OF WORK

100% CONSTRUCTION DOCUMENTS

#	Revisions	Date

CONSULTANTS:

5/23/2026

PROJECT MANAGER
ACG Project Number: 20-398

APOGEE Engineers | Architects
Headquarters:
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420
© COPYRIGHT Apogee Consulting Group, P.A.

Office of Construction and Facilities Management
VA U.S. Department of Veterans Affairs

Drawing Title: ENLARGED PLANS, BUILDING 5, FIRST FLOOR, TELECOM ROOM 110A

Location: ALEXANDRIA VA HEALTH CARE SYSTEM
2495 SHREVEPORT HWY, 71N
PINEVILLE, LA 71360

Project Title: ELECTRONIC HEALTH RECORD MODERNIZATION (EHRM)

VA PROJECT NUMBER: 502-21-222
Building Number: # 5

Approved
Date: MARCH 24, 2026
Checked: WVS
Drawn: MEL

Drawing Number: 005.A-401
Dwg. 16 of 51

C:\Users\mel\Documents\R_20r26_VA Alexandria EHRM_BRe_05_mel4FCF.rbt.rvt
3/5/2026 1:43:26 PM
VA FORM 08-6231

Docusign Envelope ID: 1F1A1E81-2E6F-444A-966C-7B5FF75DEEA5

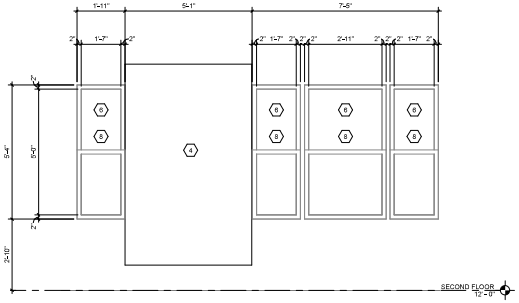

SECOND FLOOR TR ELEVATION
Scale: 1/2" = 1'-0"



SECOND FLOOR REFLECTED CEILING DEMOLITION PLAN
Scale: 1/4" = 1'-0"



SECOND FLOOR DEMOLITION PLAN
Scale: 1/4" = 1'-0"



SECOND FLOOR REFLECTED CEILING PLAN
Scale: 1/4" = 1'-0"

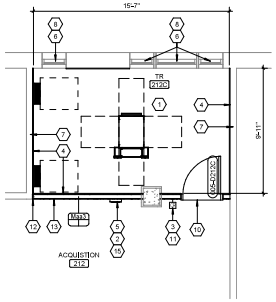

SECOND FLOOR PLAN
Scale: 1/4" = 1'-0"

SHEET NOTES:

A. ALL EXISTING CONDITIONS ARE BASED ON BEST AVAILABLE INFORMATION AT THE TIME OF SURVEY AND VISUAL INSPECTION. CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS.

B. ELEMENTS SHOWN WITH LIGHT, GRAY LINES ARE EXISTING TO REMAIN. ELEMENTS SHOWN WITH DARK DASHED LINES ARE EXISTING TO BE DEMOLISHED. DEMOLITION SHALL INCLUDE, BUT NOT BE LIMITED TO, THOSE ELEMENTS SHOWN.

C. ALL WORK SHALL BE COORDINATED BETWEEN TRADES.

D. ALL WORK SHALL BE COORDINATED WITH THE COR TO MINIMIZE DISRUPTION OF AREAS OUTSIDE OF THE PROJECT LIMITS OF WORK.

E. ALL CEILING DEMOLITION WORK TO BE COORDINATED WITH CHANGE OF EXISTING PENDANT SPRINKLER HEADS WITH NEW UPRIGHT SPRINKLERS SUCH THAT THERE IS NO EXTENDED LOSS OF SPRINKLER PROTECTION IN THE CONSTRUCTION AREA.

F. FOR FINISHES IN ALL NEW TR ROOMS - SEE ROOM FINISH SCHEDULE SHEET A-005.

G. ALL NEW TR ROOMS TO HAVE CARBON DIOXIDE EXTINGUISHER WITHIN 75' OF ROOM. SEE OVERALL OR ENLARGED PLANS FOR LOCATIONS

H. PATCH AND FILL ALL PENETRATIONSHOLES IN WALLS OF TR ROOMS TO MAINTAIN WALL RATINGS.

KEY NOTES:

1 REMOVE EXISTING FLOOR FINISH AND BASE.
2 REMOVE EXISTING RADIATOR.
3 REMOVE EXISTING ACT CEILING, INCLUDING ELEC AND MECH FIXTURES.
4 FLOOR FINISH CUT LINE. PREP AREA TO RECEIVE NEW FLOORING.
5 EXISTING FLOOR FINISH TO REMAIN.
6 DEMOLISH BLINDS. CLEAN AND PREP WINDOWS FOR FILM INSTALLATION.

@ KEY NOTES:

1 ROOM TO RECEIVE NEW FINISHES WALLS AND FLOORS. SEE ROOM FINISH SCHEDULE ON SHEET A-005.
2 NEW FIRE EXTINGUISHER SIGNAGE ABOVE FIRE EXTINGUISHER CABINET. REF TO A-005 FOR REQUIREMENTS.
3 NEW CARD READER. REFER TO TECHNOLOGY DRAWINGS.
4 PROVIDE 4'X8'X3/4" FIRE RETARDANT TREATED AC GRADE PLYWOOD BACK BOARDS IN TELECOM ROOMS. PLYWOOD SHALL BE MOUNTED WITH A SIDE CUT AND PAINTED WITH (3 COATS TOTAL) OF FIRE RESISTANT PAINT ON ALL SIDES PRIOR TO MOUNTING, AND SHALL MATCH P-2 COLOR. MASK OVER FIRE RETARDANT SEAL ON PLYWOOD BEFORE PAINTING TO ALLOW INSPECTION OF FIRE RATING SEAL. ALL DRYWALL SURROUNDING WALLS TO BE PAINTED WITH STANDARD PAINT P-1 TO MATCH PLYWOOD COLOR.
5 INSTALL SEMI RECESSED FIRE EXTINGUISHER CABINET.
6 INSTALL WINDOW FILM TO INTERIOR FACE OF WINDOW GLAZING - SEE A-005 AND SEE INTERIOR ELEVATION THIS SHEET FOR WINDOW SIZES.
7 EXTEND EXISTING WALL TO UNDERSIDE OF DECK ABOVE (APPROX. 2'-0") WITH WALL TYPE Mas3 SEE SHEET A-002. SEAL ALL PENETRATIONS AND EXISTING VOIDS.
8 CLEAN WINDOW. INSTALL NEW WINDOW LOCK. BASIS OF DESIGN: PRIME-LINE WINDOW LOCK #J9928 OR EQUAL.
9 EXPOSED CEILING.
10 AT NEW DOOR, EXTEND STATIC DISSIPATIVE TILE FROM ROOM INTO CORRIDOR TO EXISTING FLOORING.
11 NEW ROOM SIGNAGE. REF TO A-005 FOR REQUIREMENTS.
12 ALIGN WALLS.
13 PAINT ENTIRE WALL, 2 COATS. INSTALL R8-1 COLOR TO MATCH ADJACENT BASE.
14 INSTALL NEW CEILING GRID ANGLE AT NEW WALL AND CONNECT EXISTING GRID.
15 INSTALL NEW FIRE EXTINGUISHER.

KEY PLAN

SCALE: NO SCALE
AREA OF WORK

100% CONSTRUCTION DOCUMENTS

#	Revisions	Date

CONSULTANTS:

5/23/2026

PROJECT MANAGER
ACG Project Number: 20-398

APOGEE Engineers | Architects
Headquarters:
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420
© COPYRIGHT Apogee Consulting Group, P.A.

Office of Construction and Facilities Management
VA U.S. Department of Veterans Affairs

Drawing Title: ENLARGED PLANS, BUILDING 5, SECOND FLOOR, TELECOM ROOM 212C

Location: ALEXANDRIA VA HEALTH CARE SYSTEM
2495 SHREVEPORT HWY, 71N
PINEVILLE, LA 71360

Project Title: ELECTRONIC HEALTH RECORD MODERNIZATION (EHRM)

VA PROJECT NUMBER: 502-21-222
Building Number: # 5

Approved
Date: MARCH 24, 2026
Checked: WVS
Drawn: MEL

Drawing Number: 005.A-402
Dwg. 17 of 51

C:\Users\mel\Documents\A_20-398_VA Alexandria EHRM_BRe_05_mel4FCF.rvt
3/5/2026 1:43:26 PM
VA FORM 08-6231

Docusign Envelope ID: 1F1A1E71-2E6F-44 40-966C-7E85F75DEEA5



BASEMENT REFLECTED DEMOLITION CEILING PLAN
Scale: 1/4" = 1'-0"



BASEMENT DEMOLITION FLOOR PLAN
Scale: 1/4" = 1'-0"



BASEMENT REFLECTED CEILING PLAN
Scale: 1/4" = 1'-0"

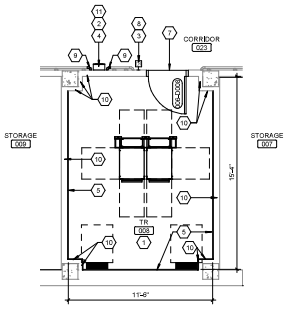

BASEMENT PLAN
Scale: 1/4" = 1'-0"

SHEET NOTES:

A. ALL EXISTING CONDITIONS ARE BASED ON BEST AVAILABLE INFORMATION AT THE TIME OF SURVEY AND VISUAL INSPECTION. CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS.

B. ELEMENTS SHOWN WITH LIGHT, GRAY LINES ARE EXISTING TO REMAIN. ELEMENTS SHOWN WITH DARK, DASHED LINES ARE EXISTING TO BE DEMOLISHED. DEMOLITION SHALL INCLUDE, BUT NOT BE LIMITED TO, THOSE ELEMENTS SHOWN.

C. ALL WORK SHALL BE COORDINATED BETWEEN TRADES.

D. ALL WORK SHALL BE COORDINATED WITH THE COR TO MINIMIZE DISRUPTION OF AREAS OUTSIDE OF THE PROJECT LIMITS OF WORK.

E. ALL CEILING DEMOLITION WORK TO BE COORDINATED WITH CHANGE OF EXISTING PENDANT SPRINKLER HEADS WITH NEW UPRIGHT SPRINKLERS SUCH THAT THERE IS NO EXTENDED LOSS OF SPRINKLER PROTECTION IN THE CONSTRUCTION AREA.

F. FOR FINISHES IN ALL NEW TR ROOMS – SEE ROOM FINISH SCHEDULE SHEET A-005.

G. ALL NEW TR ROOMS TO HAVE CARBON DIOXIDE EXTINGUISHER WITHIN 75' OF ROOM. SEE OVERALL OR ENLARGED PLANS FOR LOCATIONS

H. PATCH AND FILL ALL PENETRATIONS/HOLES IN WALLS OF TR ROOMS TO MAINTAIN WALL RATINGS.

KEY NOTES:

1 REMOVE EXISTING FLOOR FINISH AND BASE.
2 EXISTING EXPOSED STRUCTURE CEILINGS. DEMOLISH ALL EXISTING MECHANICAL AND ELECTRICAL DEVICES.
3 DEMOLISH EXISTING HANDRAIL ONLY FOR NEW SURFACE MOUNT FIRE EXTINGUISHER CABINET.
4 DEMOLISH EXISTING DOOR AND FRAME IN MASONRY WALL.
5 REMOVE EXISTING SIGNAGE AND TURN OVER TO VA.
6 SEE MECHANICAL DRAWINGS FOR ABOVE CEILING WORK. FOLLOW ICRA MEASURES ON SHEET G-004.

KEY NOTES:

1 ROOM TO RECEIVE NEW FINISHES WALLS AND FLOORS. SEE ROOM FINISH SCHEDULE ON SHEET A-005.
2 NEW FIRE EXTINGUISHER SIGNAGE ABOVE FIRE EXTINGUISHER CABINET. REF TO A-005 FOR REQUIREMENTS.
3 NEW CARD READER. REFER TO TECHNOLOGY DRAWINGS.
4 INSTALL NEW SURFACE MOUNT FIRE EXTINGUISHER CABINET.
5 PROVIDE 4'X8'X3/4" FIRE RETARDANT TREATED AC GRADE PLYWOOD BACK BOARDS IN TELECOM ROOMS. PLYWOOD SHALL BE MOUNTED WITH A-SIDE OUT AND PAINTED WITH (2 COATS TOTAL) OF FIRE RESISTANT PAINT ON ALL SIDES PRIOR TO MOUNTING, AND SHALL MATCH PW COLOR, MASK OVER FIRE RETARDANT SEAL ON PLYWOOD BEFORE PAINTING TO ALLOW INSPECTION OF FIRE RATING SEAL. ALL DRYWALL SURROUNDING WALLS TO BE PAINTED WITH STANDARD PAINT P-1 TO MATCH PLYWOOD COLOR.
6 EXPOSED CEILING.
7 AT NEW DOOR, EXTEND STATIC DISSIPATIVE TILE FROM ROOM INTO CORRIDOR TO EXISTING FLOORING.
8 NEW ROOM SIGNAGE. REF TO A-005 FOR REQUIREMENTS.
9 INSTALL NEW HANDRAIL RETURNS. COLOR TO MATCH.
10 EXTEND EXISTING WALL (+10'-0") TO UNDERSIDE OF DECK ABOVE (APPROX. 2'-0") WITH WALL TYPE Mas3. SEE SHEET A-002. SEAL ALL PENETRATIONS AND EXISTING VOIDS.
11 INSTALL NEW FIRE EXTINGUISHER.

KEY PLAN

SCALE: NO SCALE
AREA OF WORK

FULLY SPRINKLERED
100% CONSTRUCTION DOCUMENTS

#	Revisions	Date

CONSULTANTS:

3/23/2026

PROJECT MANAGER
ACG Project Number 20-398

APOGEE Engineers | Architects
Headquarters:
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420
© COPYRIGHT Apogee Consulting Group, P.A.

Office of Construction and Facilities Management
VA U.S. Department of Veterans Affairs

Drawing Title: ENLARGED PLANS, BUILDING 6, BASEMENT, TELECOM ROOM 008
Location: ALEXANDRIA VA HEALTH CARE SYSTEM 2495 SHREVEPORT HWY, 71N PINEVILLE, LA 71360
Project Title: ELECTRONIC HEALTH RECORD MODERNIZATION (EHRM)
VA PROJECT NUMBER: 502-21-222
Building Number: # 6
Approved
Date: MARCH 24, 2026 | Checked: WVS | Drawn: MEL
Drawing Number: 006.A-400
Dwg. 18 of 51

C:\Users\mel\Documents\A_2k26_VA_Alexandria EHRM_BAtg_05_mlaFCF.rbt.rvt
3/5/2026 1:51:22 PM
VA FORM 08-6231

Docusign Envelope ID: 1F1A1E81-2B1B-44 40-966C-7B5F75DEEA3



FIRST FLOOR REFLECTED CEILING DEMOLITION PLAN
Scale: 1/4" = 1'-0"



FIRST FLOOR DEMOLITION FLOOR PLAN
Scale: 1/4" = 1'-0"



FIRST FLOOR REFLECTED CEILING PLAN
Scale: 1/4" = 1'-0"



FIRST FLOOR PLAN
Scale: 1/4" = 1'-0"

SHEET NOTES:

A. ALL EXISTING CONDITIONS ARE BASED ON BEST AVAILABLE INFORMATION AT THE TIME OF SURVEY AND VISUAL INSPECTION. CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS.

B. ELEMENTS SHOWN WITH LIGHT, GRAY LINES ARE EXISTING TO REMAIN. ELEMENTS SHOWN WITH DARK DASHED LINES ARE EXISTING TO BE DEMOLISHED. DEMOLITION SHALL INCLUDE, BUT NOT BE LIMITED TO, THOSE ELEMENTS SHOWN.

C. ALL WORK SHALL BE COORDINATED BETWEEN TRADES.

D. ALL WORK SHALL BE COORDINATED WITH THE COR TO MINIMIZE DISRUPTION OF AREAS OUTSIDE OF THE PROJECT LIMITS OF WORK.

E. ALL CEILING DEMOLITION WORK TO BE COORDINATED WITH CHANGE OF EXISTING PENDANT SPRINKLER HEADS WITH NEW UPRIGHT SPRINKLERS SUCH THAT THERE IS NO EXTENDED LOSS OF SPRINKLER PROTECTION IN THE CONSTRUCTION AREA.

F. FOR FINISHES IN ALL NEW TR ROOMS - SEE ROOM FINISH SCHEDULE SHEET A-005.

G. ALL NEW TR ROOMS TO HAVE CARBON DIOXIDE EXTINGUISHER WITHIN 75' OF ROOM. SEE OVERALL OR ENLARGED PLANS FOR LOCATIONS

H. PATCH AND FILL ALL PENETRATIONS/HOLES IN WALLS OF TR ROOMS TO MAINTAIN WALL RATINGS.

KEY NOTES:

1 REMOVE EXISTING FLOOR FINISH AND BASE.
2 REMOVE EXISTING ACT CEILING, INCLUDING ELEC AND MECH FIXTURES.
3 FINISH FLOOR CUT LINE. PREP AREA TO RECEIVE NEW FLOORING.
4 EXISTING FLOOR FINISH TO REMAIN.
5 REMOVE EXISTING SIGNAGE AND TURN OVER TO VA.
6 REMOVE PORTION OF EXISTING ACT TILE. COORDINATE WITH NEW.

KEY NOTES:

1 ROOM TO RECEIVE NEW FINISHES WALLS AND FLOORS. SEE ROOM FINISH SCHEDULE ON SHEET A-005.
2 NEW FIRE EXTINGUISHER SIGNAGE ABOVE FIRE EXTINGUISHER CABINET. REF TO A-005 FOR REQUIREMENTS.
3 NEW CARD READER. REFER TO TECHNOLOGY DRAWINGS.
4 PROVIDE 4'0"X3/4" FIRE RETARDANT TREATED AC GRADE PLYWOOD BACK BOARDS IN TELECOM ROOMS. PLYWOOD SHALL BE MOUNTED WITH A-SIDE OUT AND PAINTED WITH (2 COATS TOTAL) OF FIRE RESISTANT PAINT ON ALL SIDES PRIOR TO MOUNTING, AND SHALL MATCH P-2 COLOR. MASK OVER FIRE RETARDANT SEAL ON PLYWOOD BEFORE PAINTING TO ALLOW INSPECTION OF FIRE RATING SEAL. ALL DRYWALL SURROUNDING WALLS TO BE PAINTED WITH STANDARD PAINT P-1 TO MATCH PLYWOOD COLOR.
5 INSTALL NEW SEMI RECESSED FIRE EXTINGUISHER CABINET.
6 INSTALL WINDOW FILM TO INTERIOR FACE OF 40" X 65" WINDOW GLAZING - SEE A-005.
7 CLEAN WINDOW. INSTALL NEW WINDOW LOCK. BASIS OF DESIGN: PRIME-LINE WINDOW LOCK #U9928 OR EQUAL.
8 EXPOSED CEILING.
9 EXTEND EXISTING WALL TO UNDERSIDE OF DECK ABOVE (APPROX. 2-0") WITH WALL TYPE Mate2. SEE SHEET A-002. SEAL ALL PENETRATIONS AT0 EXISTING VOIDS.
10 AT NEW DOOR, EXTEND STATIC DISSIPATIVE TILE FROM ROOM INTO CORRIDOR TO EXISTING FLOORING.
11 NEW ROOM SIGNAGE. REF TO A-005 FOR REQUIREMENTS.
12 NEW CEILING TRACK WALL ANGLE. CUT EXISTING TILE TO FIT NEW LENGTH AND REINSTALL.
13 ALIGN WALLS.
14 PAINT ENTIRE WALL, 2 COATS, AND INSTALL RB TO MATCH EXISTING MATERIALS ON ADJACENT WALLS.
15 INSTALL NEW FIRE EXTINGUISHER.

KEY PLAN

SCALE: NO SCALE

AREA OF WORK

FULLY SPRINKLERED

100% CONSTRUCTION DOCUMENTS

#	Revisions	Date

CONSULTANTS:

3/23/2026

PROJECT MANAGER

APOGEE Engineers | Architects

Headquarters
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420

© COPYRIGHT Apogee Consulting Group, P.A.

ACG Project Number: 20-398

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: ENLARGED PLANS, BUILDING 6, FIRST FLOOR, TELECOM ROOM 101

Location: ALEXANDRIA VA HEALTH CARE SYSTEM
2495 SHREVEPORT HWY, 71N
PINEVILLE, LA 71360

Project Title: ELECTRONIC HEALTH RECORD MODERNIZATION (EHRM)

VA PROJECT NUMBER: 502-21-222

Building Number: # 6

Approved

Date: MARCH 24, 2026 | Checked: WVS | Drawn: MEL

Drawing Number: 006.A-401

Dwg. 19 of 51

C:\Submitting\Documents\A_20-398_VA_Alexandria EHRM_BAtg_06_wMEP.rvt
3/5/2026 1:51:22 PM
VA FORM 08-6231

Docusign Envelope ID: 1F1A1E81-2B6F-444A-B66C-7B5FF7D2EEA3



SECOND FLOOR
REFLECTED CEILING
DEMOLITION PLAN
Scale: 1/4" = 1'-0"



SECOND FLOOR
DEMOLITION PLAN
Scale: 1/4" = 1'-0"



SECOND FLOOR
REFLECTED CEILING PLAN
Scale: 1/4" = 1'-0"

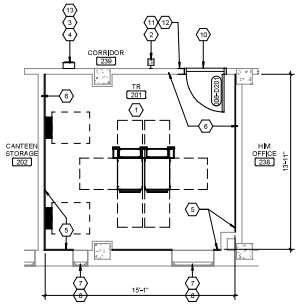

SECOND FLOOR PLAN
Scale: 1/4" = 1'-0"

SHEET NOTES:

A. ALL EXISTING CONDITIONS ARE BASED ON BEST AVAILABLE INFORMATION AT THE TIME OF SURVEY AND VISUAL INSPECTION. CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS.

B. ELEMENTS SHOWN WITH LIGHT, GRAY LINES ARE EXISTING TO REMAIN. ELEMENTS SHOWN WITH DARK, DASHED LINES ARE EXISTING TO BE DEMOLISHED. DEMOLITION SHALL INCLUDE, BUT NOT BE LIMITED TO, THOSE ELEMENTS SHOWN.

C. ALL WORK SHALL BE COORDINATED BETWEEN TRADES.

D. ALL WORK SHALL BE COORDINATED WITH THE COR TO MINIMIZE DISRUPTION OF AREAS OUTSIDE OF THE PROJECT LIMITS OF WORK.

E. ALL CEILING DEMOLITION WORK TO BE COORDINATED WITH CHANGE OF EXISTING PENDANT SPRINKLER HEADS WITH NEW UPRIGHT SPRINKLERS SUCH THAT THERE IS NO EXTENDED LOSS OF SPRINKLER PROTECTION IN THE CONSTRUCTION AREA.

F. FOR FINISHES IN ALL NEW TR ROOMS – SEE ROOM FINISH SCHEDULE SHEET A-005.

G. ALL NEW TR ROOMS TO HAVE CARBON DIOXIDE EXTINGUISHER WITHIN 75' OF ROOM. SEE OVERALL OR ENLARGED PLANS FOR LOCATIONS

H. PATCH AND FILL ALL PENETRATIONS/HOLES IN WALLS OF TR ROOMS TO MAINTAIN WALL RATINGS.

KEY NOTES:

1 REMOVE EXISTING FLOOR FINISH AND BASE.
2 DEMOLISH EXISTING DOOR AND FRAME IN MASONRY WALL.
3 REMOVE EXISTING ACT CEILING, INCLUDING ELEC AND MECH FIXTURES.
4 REMOVE EXISTING SIGNAGE AND TURN OVER TO VA.
5 SEE MECHANICAL DRAWINGS FOR ABOVE CEILING WORK. FOLLOW ICRA MEASURES ON SHEET G-004.

ⓦ KEY NOTES:

1 ROOM TO RECEIVE NEW FINISHES WALLS AND FLOORS. SEE ROOM FINISH SCHEDULE ON SHEET A-005.
2 NEW CARD READER. REFER TO TECHNOLOGY DRAWINGS.
3 NEW FIRE EXTINGUISHER SIGNAGE ABOVE FIRE EXTINGUISHER CABINET. REF TO A-005 FOR REQUIREMENTS.
4 INSTALL NEW SURFACE MOUNT FIRE EXTINGUISHER CABINET.
5 PROVIDE 4'X8'X3/4" FIRE RETARDANT TREATED AC GRADE PLYWOOD BACK BOARDS IN TELECOM ROOMS. PLYWOOD SHALL BE MOUNTED WITH A-SIDE OUT AND PAINTED WITH (3 COATS TOTAL) OF FIRE RESISTANT PAINT ON ALL SIDES PRIOR TO MOUNTING, AND SHALL MATCH P-2 COLOR. MASK OVER FIRE RETARDANT SEAL ON PLYWOOD BEFORE PAINTING TO ALLOW INSPECTION OF FIRE RATING SEAL. ALL DRYWALL SURROUNDING WALLS TO BE PAINTED WITH STANDARD PAINT P-1 TO MATCH PLYWOOD COLOR.
6 EXTEND EXISTING WALL (+10'-0") TO UNDERSIDE OF DECK ABOVE (APPROX. 2'-0") WITH WALL TYPE Mark3. SEE SHEET A-002. SEAL ALL PENETRATIONS AND EXISTING VOIDS.
7 INSTALL WINDOW FILM TO INTERIOR FACE OF 14 X 72 AND 40 X 72 WINDOW GLAZING – SEE A-005.
8 CLEAN WINDOW. INSTALL NEW WINDOW LOCK. BASIS OF DESIGN: PRIME-LINE WINDOW LOCK #U9928 OR EQUAL.
9 EXPOSED CEILING.
10 AT NEW DOOR, EXTEND STATIC DISSIPATIVE TILE FROM ROOM INTO CORRIDOR TO EXISTING FLOORING.
11 NEW ROOM SIGNAGE. REF TO A-005 FOR REQUIREMENTS.
12 INFILL EXISTING DOOR OPENING. PROVIDE NEW METAL STUD TO MATCH THE PROPER STUD THICKNESS WITH THE REMAINING WALL SO THAT THE ADJOINING WALL SURFACES ARE FLUSH ON BOTH SIDES. GYPSUM BOARD EACH SIDE.
13 INSTALL NEW FIRE EXTINGUISHER.

KEY PLAN

SCALE: NO SCALE

AREA OF WORK

FULLY SPRINKLERED

100% CONSTRUCTION DOCUMENTS

#	Revisions	Date

CONSULTANTS:

3/23/2026

PROJECT MANAGER

ACG Project Number 20-398

APOGEE Engineers | Architects

Headquarters:
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420

© COPYRIGHT Apogee Consulting Group, P.A.

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: ENLARGED PLANS, BUILDING 6, SECOND FLOOR, TELECOM ROOM 201

Project Title: ELECTRONIC HEALTH RECORD MODERNIZATION (EHRM)

VA PROJECT NUMBER: 502-21-222

Building Number: # 6

Location: ALEXANDRIA VA HEALTH CARE SYSTEM
2495 SHREVEPORT HWY, 71N
PINEVILLE, LA 71360

Approved

Date: MARCH 24, 2026 | Checked: WVS | Drawn: MEL

Drawing Number: 006.A-402

Dwg. 20 of 51

C:\Users\mel\Documents\A_2K26_VA_Alexandria EHRM_BRe_06_mel4FC.RVT

3/5/2026 1:51:23 PM

VA FORM 08-6231

Docusign Envelope ID: 1F1A1E81-2B6F-444A-966C-7B5FF75DEEA5



THIRD FLOOR REFLECTED CEILING DEMOLITION PLAN
Scale: 1/4" = 1'-0"



THIRD FLOOR DEMOLITION PLAN
Scale: 1/4" = 1'-0"



THIRD FLOOR REFLECTED CEILING PLAN
Scale: 1/4" = 1'-0"

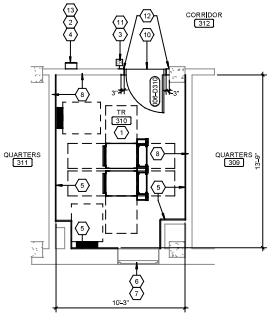

THIRD FLOOR PLAN
Scale: 1/4" = 1'-0"

SHEET NOTES:

A. ALL EXISTING CONDITIONS ARE BASED ON BEST AVAILABLE INFORMATION AT THE TIME OF SURVEY AND VISUAL INSPECTION. CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS.

B. ELEMENTS SHOWN WITH LIGHT, GRAY LINES ARE EXISTING TO REMAIN. ELEMENTS SHOWN WITH DARK, DASHED LINES ARE EXISTING TO BE DEMOLISHED. DEMOLITION SHALL INCLUDE, BUT NOT BE LIMITED TO, THOSE ELEMENTS SHOWN.

C. ALL WORK SHALL BE COORDINATED BETWEEN TRADES.

D. ALL WORK SHALL BE COORDINATED WITH THE COR TO MINIMIZE DISRUPTION OF AREAS OUTSIDE OF THE PROJECT LIMITS OF WORK.

E. ALL CEILING DEMOLITION WORK TO BE COORDINATED WITH CHANGE OF EXISTING PENDANT SPRINKLER HEADS WITH NEW UPRIGHT SPRINKLERS SUCH THAT THERE IS NO EXTENDED LOSS OF SPRINKLER PROTECTION IN THE CONSTRUCTION AREA.

F. FOR FINISHES IN ALL NEW TR ROOMS – SEE ROOM FINISH SCHEDULE SHEET A-005.

G. ALL NEW TR ROOMS TO HAVE CARBON DIOXIDE EXTINGUISHER WITHIN 75' OF ROOM. SEE OVERALL OR ENLARGED PLANS FOR LOCATIONS

H. PATCH AND FILL ALL PENETRATIONS/HOLES IN WALLS OF TR ROOMS TO MAINTAIN WALL RATINGS.

KEY NOTES:

1 REMOVE EXISTING FLOOR FINISH AND BASE.
2 DEMOLISH EXISTING DOOR AND FRAME IN MASONRY WALL.
3 REMOVE EXISTING ACT CEILING, INCLUDING ELEC AND MECH FIXTURES.
4 REMOVE EXISTING SIGNAGE AND TURN OVER TO VA.

KEY NOTES:

1 ROOM TO RECEIVE NEW FINISHES WALLS AND FLOORS. SEE ROOM FINISH SCHEDULE ON SHEET A-005.
2 NEW FIRE EXTINGUISHER SIGNAGE ABOVE FIRE EXTINGUISHER CABINET. REF TO A-005 FOR REQUIREMENTS.
3 NEW CARD READER. REFER TO TECHNOLOGY DRAWINGS.
4 INSTALL NEW SURFACE MOUNT FIRE EXTINGUISHER CABINET.
5 PROVIDE 4'X8'X3/4" FIRE RETARDANT TREATED AC GRADE PLYWOOD BACK BOARDS IN TELECOM ROOMS. PLYWOOD SHALL BE MOUNTED WITH A-SIDE OUT AND PAINTED WITH (3 COATS TOTAL) OF FIRE RESISTANT PAINT ON ALL SIDES PRIOR TO MOUNTING, AND SHALL MATCH P-2 COLOR. MASK OVER FIRE RETARDANT SEAL ON PLYWOOD BEFORE PAINTING TO ALLOW INSPECTION OF FIRE RATING SEAL. ALL DRYWALL SURROUNDING WALLS TO BE PAINTED WITH STANDARD PAINT P-1 TO MATCH PLYWOOD COLOR.
6 INSTALL WINDOW FILM TO INTERIOR FACE OF 40 X 72 WINDOW GLAZING – SEE A-005.
7 CLEAN WINDOW. INSTALL NEW WINDOW LOCK. BASIS OF DESIGN: PRIME-LINE WINDOW LOCK #U9928 OR EQUAL.
8 EXTEND EXISTING WALL (+10+5") TO UNDERSIDE OF DECK ABOVE (APPROX. 2-0") WITH WALL TYPE Mas1, SEE SHEET A-002. SEAL ALL PENETRATIONS AND EXISTING VOIDS.
9 EXPOSED CEILING.
10 AT NEW DOOR, EXTEND STATIC DISSIPATIVE TILE FROM ROOM INTO CORRIDOR TO EXISTING FLOORING.
11 NEW ROOM SIGNAGE. REF TO A-005 FOR REQUIREMENTS.
12 INFILL EXISTING DOOR OPENING. PROVIDE NEW METAL STUD TO MATCH THE PROPER STUD THICKNESS WITH THE REMAINING WALL SO THAT THE ADJOINING WALL SURFACES ARE FLUSH ON BOTH SIDES. GYPSUM BOARD EACH SIDE.
13 INSTALL NEW FIRE EXTINGUISHER.

KEY PLAN

SCALE: NO SCALE
AREA OF WORK

FULLY SPRINKLERED

100% CONSTRUCTION DOCUMENTS

#	Revisions:	Date

CONSULTANTS:

3/23/2026

PROJECT MANAGER | ACG Project Number 20-398

APOGEE Engineers | Architects

Headquarters:
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420

© COPYRIGHT Apogee Consulting Group, P.A.

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: ENLARGED PLANS, BUILDING 6, THIRD FLOOR, TELECOM ROOM 310

Project Title: ELECTRONIC HEALTH RECORD MODERNIZATION (EHRM)

VA PROJECT NUMBER: 502-21-222

Building Number: # 6

Location: ALEXANDRIA VA HEALTH CARE SYSTEM
2495 SHREVEPORT HWY, 71N
PINEVILLE, LA 71360

Approved

Date: MARCH 24, 2026 | Checked: WVS | Drawn: MEL

Drawing Number: 006.A-403

Dwg. 21 of 51

3/5/2026 1:51:23 PM C:\Submitted\Documents\A_20-398_VA_Alexandria EHRM_BAtg_06_wMEP.rvt

Docusign Envelope ID: 1F1A1E71-2E6F-44 40-966C-7E6F F5DEEA5

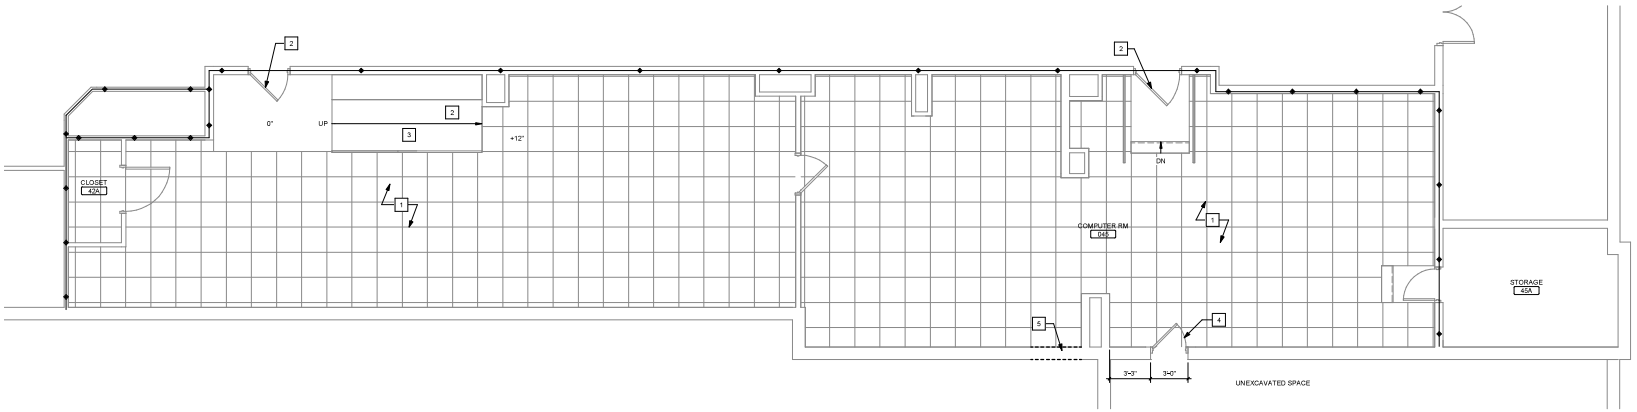

1 MCR DEMOLITION BASEMENT FLOOR PLAN
Scale: 1/4" = 1'-0"

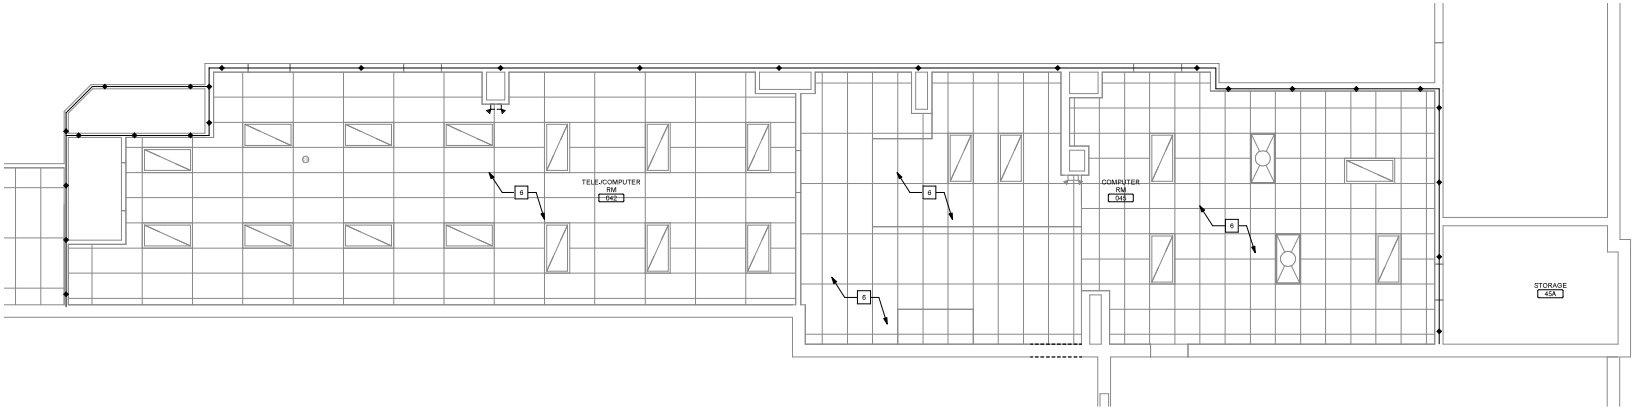

2 MCR EXISTING BASEMENT REFLECTED CEILING PLAN
Scale: 1/4" = 1'-0"

SHEET NOTES:

A. ALL EXISTING CONDITIONS ARE BASED ON BEST AVAILABLE INFORMATION AT THE TIME OF SURVEY AND VISUAL INSPECTION. CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS.

B. ELEMENTS SHOWN WITH LIGHT, GRAY LINES ARE EXISTING TO REMAIN. ELEMENTS SHOWN WITH DARK DASHED LINES ARE EXISTING TO BE DEMOLISHED. DEMOLITION SHALL INCLUDE, BUT NOT BE LIMITED TO, THOSE ELEMENTS SHOWN.

C. ALL WORK SHALL BE COORDINATED BETWEEN TRADES.

D. ALL WORK SHALL BE COORDINATED WITH THE COR TO MINIMIZE DISRUPTION OF AREAS OUTSIDE OF THE PROJECT LIMITS OF WORK.

E. ALL CEILING DEMOLITION WORK TO BE COORDINATED WITH CHANGE OF EXISTING PENDANT SPRINKLER HEADS WITH NEW UPRIGHT SPRINKLERS SUCH THAT THERE IS NO EXTENDED LOSS OF SPRINKLER PROTECTION IN THE CONSTRUCTION AREA.

F. PATCH AND FILL ALL PENETRATIONS/HOLES IN WALLS OF MCR ROOM TO MAINTAIN WALL RATINGS.

G. CONTRACTOR TO INCLUDE REPLACEMENT OF 100 SKD RAISED FLOOR ACCESS TILE. ALL NEW TILES TO BE SOLID. ALL EXISTING PERFORATED TO BE REPLACED WITH NEW SOLID.

H. SEE ET SHEETS FOR SEQUENCE OF CONSTRUCTION.

I. FOR ANY DEMOLITION MEASURE THAT CREATES DUST, EXISTING EQUIPMENT LIST BE PROTECTED AND COVERED TO MAINTAIN OPERATION AS NEEDED FOR SEQUENCE OF CONSTRUCTION FOR THE DURATION OF SUCH DEMOLITION. SEE DETAIL 3/007.A-402 ENCLOSURE. NO DEMOLITION SHALL TAKE PLACE WITHOUT ALL EXISTING EQUIPMENT BEING PROTECTED AND COVERED.

J. CONTRACTOR TO REPLACE FIVE ACCESS FLOORING TILES AT ALL NEW RACK LOCATIONS, AND ALL NEW CRAC UNIT LOCATIONS.

KEY NOTES:

1 EXISTING RAISED ACCESS FLOORING TO REMAIN. REMOVE PERFORATED VENTED TILES (60) AND REPLACE WITH NEW SOLID. EXISTING ACCESS SUPPORT SYSTEM IN GOOD CONDITION AND REMAING IN PLACE.
2 EXISTING DOOR TO REMAIN.
3 EXISTING RAMP TO REMAIN.
4 EXISTING TRAP DOOR TO REMAIN.
5 APPROX. LOCATION FOR WALL PENETRATION FOR (6) 4" CONDUIT FOR FIBER. CONTRACTOR TO REPAIR MASONRY WALL AFTER CONDUIT INSTALLATION. ALL PATCHING AND REPAIR WORK TO BE MASONRY FOR FULL WIDTH OF WALL. FILL ALL VOIDS, FIRESTOP AROUND ALL CONDUIT PENETRATIONS.
6 EXISTING ACT CEILING, ELEC. AND MECH FIXTURES TO REMAIN.

KEY PLAN

SCALE: NO SCALE

AREA OF WORK



FULLY SPRINKLERED

100% CONSTRUCTION DOCUMENTS

#	Revisions	Date

CONSULTANTS:

3/23/2026

PROJECT MANAGER

ACG Project Number 20-398

APOGEE Engineers | Architects

Headquarters:
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420

© COPYRIGHT Apogee Consulting Group, P.A.

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: ENLARGED PLANS, BUILDING 7, BASEMENT, COMPUTER ROOM 45B

Location: ALEXANDRIA VA HEALTH CARE SYSTEM, 2495 SHREVEPORT HWY, 71N, PINEVILLE, LA 71360

Project Title: ELECTRONIC HEALTH RECORD MODERNIZATION (EHRM)

VA PROJECT NUMBER: 502-21-222

Building Number: # 7

Approved

Date: MARCH 24, 2026 | Checked: WVS | Drawn: MEL

Drawing Number: 007.A-401

Dwg. 22 of 51

C:\Users\mel\Documents\A_2K26_VA Alexandria EHRM_BMg_07_mel4FCF.rbt.rvt
3/5/2026 1:59:56 PM
VA FORM 08-6231

Docusign Envelope ID: 1F1A1E81-2B1F-44 40-966C-7B5FF75DEEA5

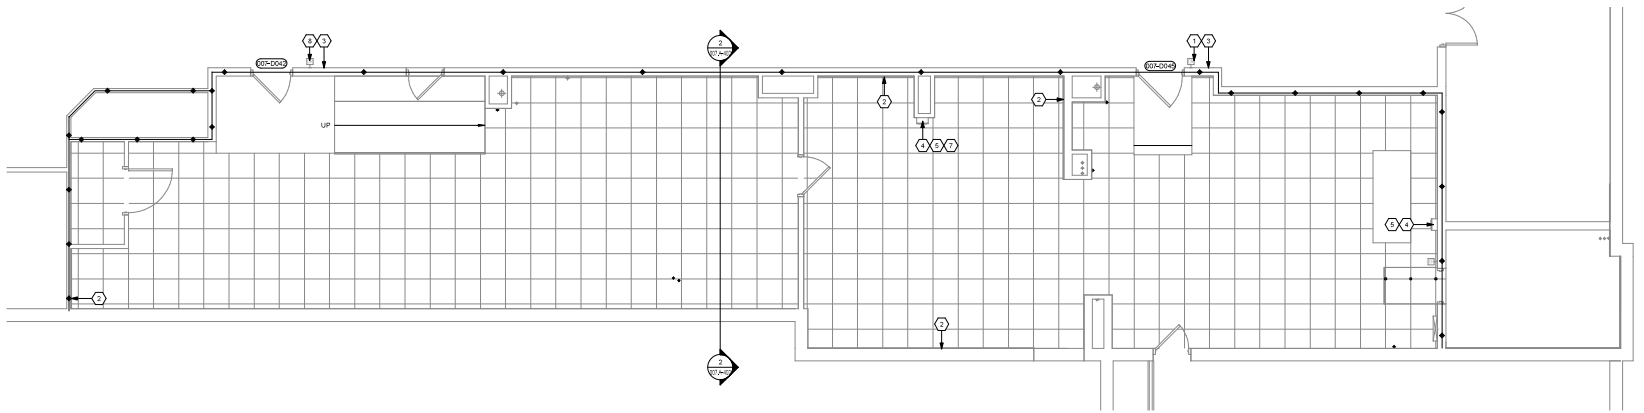

1 MCR BASEMENT FLOOR PLAN
Scale: 1/4" = 1'-0"



3 SEISMIC BRACING DETAIL
Scale: 1/2" = 1'-0"

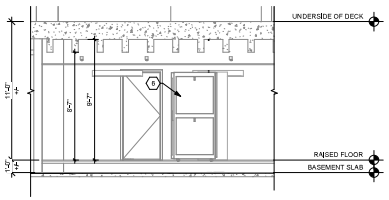

2 MCR SCHEMATIC SECTION
Scale: 1/4" = 1'-0"

SHEET NOTES:

A. ALL EXISTING CONDITIONS ARE BASED ON BEST AVAILABLE INFORMATION AT THE TIME OF SURVEY AND VISUAL INSPECTION. CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS.

B. ELEMENTS SHOWN WITH LIGHT, GRAY LINES ARE EXISTING TO REMAIN. ELEMENTS SHOWN WITH DARK DASHED LINES ARE EXISTING TO BE DEMOLISHED. DEMOLITION SHALL INCLUDE, BUT NOT BE LIMITED TO, THOSE ELEMENTS SHOWN.

C. ALL WORK SHALL BE COORDINATED BETWEEN TRADES.

D. ALL WORK SHALL BE COORDINATED WITH THE COR TO MINIMIZE DISRUPTION OF AREAS OUTSIDE OF THE PROJECT LIMITS OF WORK.

E. ALL CEILING DEMOLITION WORK TO BE COORDINATED WITH CHANGE OF EXISTING PENDANT SPRINKLER HEADS WITH NEW UPRIGHT SPRINKLERS SUCH THAT THERE IS NO EXTENDED LOSS OF SPRINKLER PROTECTION IN THE CONSTRUCTION AREA.

F. PATCH AND FILL ALL PENETRATIONS/HOLES IN WALLS OF MCR ROOM TO MAINTAIN WALL RATINGS.

G. CONTRACTOR TO INCLUDE REPLACEMENT OF 100 (30) RAISED FLOOR ACCESS TILE. ALL NEW TILES TO BE SOLID. ALL EXISTING PERFORATED TO BE REPLACED WITH NEW SOLID.

H. SEE ET SHEETS FOR SEQUENCE OF CONSTRUCTION.

I. FOR ANY DEMOLITION MEASURE THAT CREATES DUST, EXISTING EQUIPMENT LIST BE PROTECTED AND COVERED TO MAINTAIN OPERATION AS NEEDED FOR SEQUENCE OF CONSTRUCTION FOR THE DURATION OF SUCH DEMOLITION. SEE DETAIL 3/007.A-402 ENCLOSURE. NO DEMOLITION SHALL TAKE PLACE WITHOUT ALL EXISTING EQUIPMENT BEING PROTECTED AND COVERED.

J. CONTRACTOR TO REPLACE FIVE ACCESS FLOORING TILES AT ALL NEW RACK LOCATIONS, AND ALL NEW CRAC UNIT LOCATIONS.

KEY NOTES:

1 NEW DUAL AUTHENTICATION CARD READER. REFER TO TECHNOLOGY DRAWINGS.
2 PROVIDE 4'X8'X3/4" FIRE RETARDANT TREATED AC GRADE PLYWOOD BACK BOARDS IN TELECOM ROOMS. PLYWOOD SHALL BE MOUNTED WITH A-SIDE OUT AND PAINTED WITH (3 COATS TOTAL) OF FIRE RESISTANT PAINT ON ALL SIDES PRIOR TO MOUNTING, AND SHALL MATCH P-2 COLOR, MASK OVER FIRE RETARDANT SEAL ON PLYWOOD BEFORE PAINTING TO ALLOW INSPECTION OF FIRE RATING SEAL. ALL DRYWALL SURROUNDING WALLS TO BE PAINTED WITH STANDARD PAINT P-1 TO MATCH PLYWOOD COLOR.
3 NEW ROOM SIGNAGE. REF TO A-005 FOR REQUIREMENTS.
4 INSTALL NEW SURFACE MOUNT FIRE EXTINGUISHER CABINET.
5 NEW FIRE EXTINGUISHER SIGNAGE ABOVE FIRE EXTINGUISHER CABINET. REF TO A-005 FOR REQUIREMENTS.
6 TR RACK. SEE TECHNOLOGY DRAWINGS.
7 INSTALL NEW FIRE EXTINGUISHER.
8 EXISTING CARD READER TO REMAIN.

KEY PLAN
SCALE: NO SCALE
AREA OF WORK

REFERENCE PHOTOS

FULLY SPRINKLERED

100% CONSTRUCTION DOCUMENTS

#	Revisions:	Date

CONSULTANTS:

3/23/2026

PROJECT MANAGER | ACG Project Number 20-398

APOGEE Engineers | Architects
Headquarters
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420

© COPYRIGHT Apogee Consulting Group, P.A.

Office of Construction and Facilities Management
VA U.S. Department of Veterans Affairs

Drawing Title: ENLARGED PLANS, BUILDING 7, BASEMENT, COMPUTER ROOM 45B

Project Title: ELECTRONIC HEALTH RECORD MODERNIZATION (EHRM)

VA PROJECT NUMBER: 502-21-222

Building Number: # 7

Location: ALEXANDRIA VA HEALTH CARE SYSTEM, 2495 SHREVEPORT HWY, 71N, PINEVILLE, LA 71360

Approved

Date: MARCH 24, 2026 | Checked: WVS | Drawn: MEL

Drawing Number: 007.A-402

Dwg. 23 of 51

C:\Users\mel\Documents\A_20-398_VA Alexandria EHRM_BRG_07_mel4PC-R20.rvt
3/23/2026 1:59:57 PM
VA FORM 08-6231

Docusign Envelope ID: 1F41697F-2597-444A-966C-7695FF50EEA5

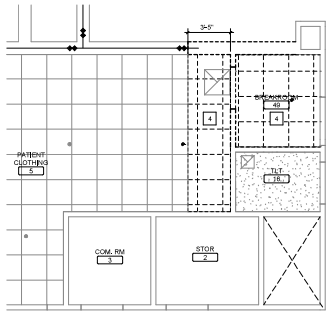

BASEMENT DEMOLITION REFLECTED CEILING PLAN
Scale: 1/4" = 1'-0"

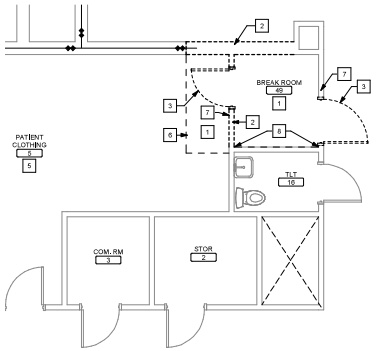

BASEMENT DEMOLITION FLOOR PLAN
Scale: 1/4" = 1'-0"

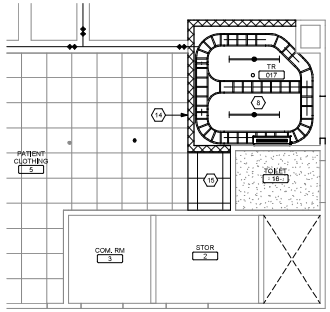

BASEMENT REFLECTED CEILING PLAN
Scale: 1/4" = 1'-0"

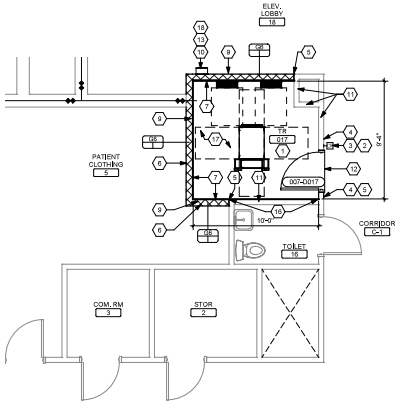

BASEMENT FLOOR PLAN
Scale: 1/4" = 1'-0"

SHEET NOTES:

A. ALL EXISTING CONDITIONS ARE BASED ON BEST AVAILABLE INFORMATION AT THE TIME OF SURVEY AND VISUAL INSPECTION. CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS.

B. ELEMENTS SHOWN WITH LIGHT, GRAY LINES ARE EXISTING TO REMAIN. ELEMENTS SHOWN WITH DARK DASHED LINES ARE EXISTING TO BE DEMOLISHED. DEMOLITION SHALL INCLUDE, BUT NOT BE LIMITED TO, THOSE ELEMENTS SHOWN.

C. ALL WORK SHALL BE COORDINATED BETWEEN TRADES.

D. ALL WORK SHALL BE COORDINATED WITH THE COR TO MINIMIZE DISRUPTION OF AREAS OUTSIDE OF THE PROJECT LIMITS OF WORK.

E. ALL CEILING DEMOLITION WORK TO BE COORDINATED WITH CHANGE OF EXISTING PENDANT SPRINKLER HEADS WITH NEW UPRIGHT SPRINKLERS SUCH THAT THERE IS NO EXTENDED LOSS OF SPRINKLER PROTECTION IN THE CONSTRUCTION AREA.

F. FOR FINISHES IN ALL NEW TR ROOMS - SEE ROOM FINISH SCHEDULE SHEET A-005.

G. ALL NEW TR ROOMS TO HAVE CARBON DIOXIDE EXTINGUISHER WITHIN 75' OF ROOM. SEE OVERALL OR ENLARGED PLANS FOR LOCATIONS.

H. PATCH AND FILL ALL PENETRATIONS/HOLES IN WALLS OF TR ROOMS TO MAINTAIN WALL RATINGS.

KEY NOTES:

1 REMOVE EXISTING FLOOR FINISH AND BASE.
2 DEMOLISH EXISTING MASONRY WALL TO UNDERSIDE OF DECK.
3 DEMOLISH EXISTING DOOR AND FRAME IN MASONRY WALL.
4 REMOVE EXISTING ACT CEILING, INCLUDING ELEC AND MECH FIXTURES STORE FOR RE-USE.
5 EXISTING FLOOR FINISH AND BASE TO REMAIN.
6 FINISH FLOORING CUT LINE, PREP AREA TO RECEIVE NEW FLOORING.
7 REMOVE EXISTING SIGNAGE AND TURN OVER TO VA.
8 REMOVE GYPSUM BOARD TR SIDE IN PREPARATION FOR WATERSHIELD MEMBRANE.

KEY NOTES:

1 ROOM TO RECEIVE NEW FINISHES WALLS AND FLOORS. SEE ROOM FINISH SCHEDULE ON SHEET A-005.
2 NEW ROOM SIGNAGE, REF TO A-005 FOR REQUIREMENTS.
3 NEW CARD READER, REFER TO TECHNOLOGY DRAWINGS.
4 PAINT AND RUBBER BASE TO MATCH ON CORRIDOR SIDE.
5 ALIGN WALLS.
6 NEW FINISHES TO MATCH EXISTING - PAINT AND RUBBER BASE, MODIFY FLOORING AS NECESSARY.
7 PROVIDE 4'X8'X3/4" FIRE RETARDANT TREATED AC GRADE PLYWOOD BACK BOARDS IN TELECOM ROOMS. PLYWOOD SHALL BE MOUNTED WITH A-SIDE OUT AND PAINTED WITH (3 COATS TOTAL) OF FIRE RESISTANT PAINT ON ALL SIDES PRIOR TO MOUNTING, AND SHALL MATCH PMS COLOR, MASK OVER FIRE RETARDANT SEAL ON PLYWOOD BEFORE PAINTING TO ALLOW INSPECTION OF FIRE RATING SEAL. ALL DRYWALL SURROUNDING WALLS TO BE PAINTED WITH STANDARD PAINT PMS TO MATCH PLYWOOD COLOR.
8 EXPOSED CEILING.
9 6" CMU WALL TO UNDERSIDE OF DECK. PAINT TO MATCH ADJACENT CMU WALLS.
10 INSTALL NEW SURFACE MOUNT FIRE EXTINGUISHER CABINET.
11 EXTEND EXISTING WALL TO UNDERSIDE OF DECK ABOVE (APPROX. 6'-0" TO 10'-4") WITH WALL TYPE Mas3, SEE SHEET A-002. SEAL ALL PENETRATIONS AND EXISTING VOIDS.
12 AT NEW DOOR, EXTEND STATIC DISSIPATIVE TILE FROM ROOM INTO CORRIDOR TO EXISTING FLOORING.
13 NEW FIRE EXTINGUISHER SIGNAGE ABOVE FIRE EXTINGUISHER CABINET, REF TO A-005 FOR REQUIREMENTS.
14 TERMINATE CEILING WITH PROPER EDGE TRIM TO NEW WALL.
15 PROVIDE NEW TILE TO COORDINATE WITH EXISTING LAYOUT AND GRID. INSTALL NEW GRID.
16 PROVIDE GRACE ICE AND WATERSHIELD SELF ADHERING, MEMBRANE 45 MIL THICK OR EQUAL, ENTIRE WALL ABOVE FLOOR FINISH, BOTTOM OF MEMBRANE TO SEAL 1/4" TO FLOOR AND TURN UP. ADHERE TO METAL TRACK RUNNER AND METAL STUDS, INSIDE FACE, TR ROOM SIDE. REPLACE REMOVED GYPSUM BOARD.
17 NEW WATER LEAK SENSORS ON FLOOR.
18 INSTALL NEW FIRE EXTINGUISHER.

KEY PLAN

SCALE: NO SCALE

AREA OF WORK



WALL RATING LEGEND

1 HR - FIRE SEPARATION
2 HR - FIRE SEPARATION
SMOKE RESISTIVE HAZARDOUS AREA

FULLY SPRINKLERED

100% CONSTRUCTION DOCUMENTS

#	Revisions	Date

CONSULTANTS:

5/23/2026

PROJECT MANAGER | ACG Project Number 20-398

APOGEE Engineers | Architects
Headquarters:
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420

© COPYRIGHT Apogee Consulting Group, P.A.

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: ENLARGED PLANS, BUILDING 7, BASEMENT, TELECOM ROOM 17

Location: ALEXANDRIA VA HEALTH CARE SYSTEM
2495 SHREVEPORT HWY, 71N
PINEVILLE, LA 71360

Project Title: ELECTRONIC HEALTH RECORD MODERNIZATION (EHRM)

VA PROJECT NUMBER: 502-21-222

Building Number: # 7

Approved

Date: MARCH 24, 2026 | Checked: WVS | Drawn: MEL

Drawing Number: 007.A-403

Dwg. 24 of 51

C:\Users\mel\Documents\A_20-398_VA Alexandria EHRM_BRG_07_mel.RVT
3/5/2026 1:58:57 PM
VA FORM 08-6231

Docusign Envelope ID: 1F1A1E81-2B6F-444A-966C-7B5FF75DEEA5

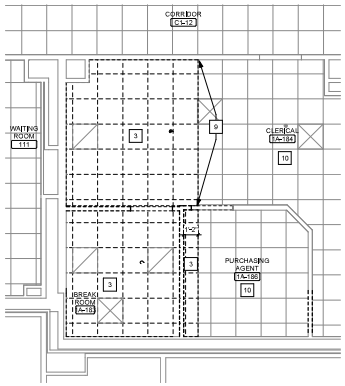

FIRST FLOOR REFLECTED CEILING DEMOLITION PLAN
Scale: 1/4" = 1'-0"

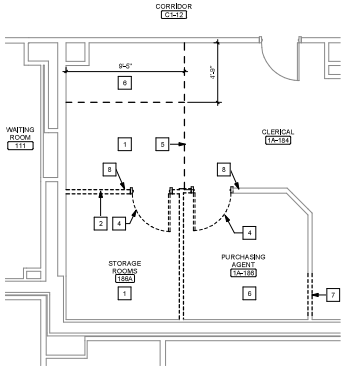

FIRST FLOOR DEMOLITION FLOOR PLAN
Scale: 1/4" = 1'-0"

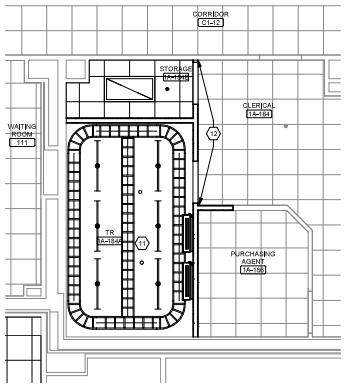

FIRST FLOOR REFLECTED CEILING PLAN
Scale: 1/4" = 1'-0"

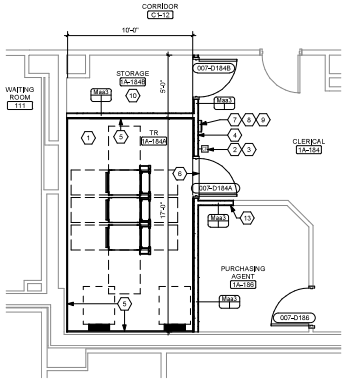

FIRST FLOOR PLAN
Scale: 1/4" = 1'-0"

SHEET NOTES:

A. ALL EXISTING CONDITIONS ARE BASED ON BEST AVAILABLE INFORMATION AT THE TIME OF SURVEY AND VISUAL INSPECTION. CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS.

B. ELEMENTS SHOWN WITH LIGHT, GRAY LINES ARE EXISTING TO REMAIN. ELEMENTS SHOWN WITH DARK DASHED LINES ARE EXISTING TO BE DEMOLISHED. DEMOLITION SHALL INCLUDE, BUT NOT BE LIMITED TO, THOSE ELEMENTS SHOWN.

C. ALL WORK SHALL BE COORDINATED BETWEEN TRADES.

D. ALL WORK SHALL BE COORDINATED WITH THE COR TO MINIMIZE DISRUPTION OF AREAS OUTSIDE OF THE PROJECT LIMITS OF WORK.

E. ALL CEILING DEMOLITION WORK TO BE COORDINATED WITH CHANGE OF EXISTING PENDANT SPRINKLER HEADS WITH NEW UPRIGHT SPRINKLERS SUCH THAT THERE IS NO EXTENDED LOSS OF SPRINKLER PROTECTION IN THE CONSTRUCTION AREA.

F. FOR FINISHES IN ALL NEW TR ROOMS - SEE ROOM FINISH SCHEDULE SHEET A-005.

G. ALL NEW TR ROOMS TO HAVE CARBON DIOXIDE EXTINGUISHER WITHIN 75' OF ROOM. SEE OVERALL OR ENLARGED PLANS FOR LOCATIONS.

H. PATCH AND FILL ALL PENETRATIONS/HOLES IN WALLS OF TR ROOMS TO MAINTAIN WALL RATINGS.

KEY NOTES:

1 REMOVE EXISTING FLOOR FINISH AND BASE.
2 DEMOLISH EXISTING METAL STUD AND GYP BD WALL.
3 REMOVE EXISTING ACT CEILING, INCLUDING ELEC AND MECH FIXTURES.
4 DEMOLISH EXISTING DOOR AND FRAME METAL STUD AND GYP BD WALL.
5 FINISH FLOORING CUT LINE. PREP AREA TO RECEIVE NEW FLOORING.
6 EXISTING FLOOR FINISH AND BASE TO REMAIN.
7 CREATE ROUGH OPENING FOR NEW DOOR.
8 REMOVE EXISTING SIGNAGE AND TURN OVER TO VA.
9 REMOVE PORTION OF EXISTING ACT TILE. COORDINATE WITH NEW.
10 SEE MECHANICAL DRAWINGS FOR ABOVE CEILING WORK, FOLLOW ICRA MEASURES ON SHEET G-004.

KEY NOTES:

1 ROOM TO RECEIVE NEW FINISHES WALLS AND FLOORS. SEE ROOM FINISH SCHEDULE ON SHEET A-005.
2 NEW CARD READER. REFER TO TECHNOLOGY DRAWINGS.
3 NEW ROOM SIGNAGE. REF TO A-005 FOR REQUIREMENTS.
4 NEW FINISHES TO MATCH EXISTING - PAINT AND RUBBER BASE. MODIFY FLOORING AS NECESSARY.
5 PROVIDE 4'X8'X3/4" FIRE RETARDANT TREATED AC GRADE PLYWOOD BACK BOARDS IN TELECOM ROOMS. PLYWOOD SHALL BE MOUNTED WITH A-SIDE OUT AND PAINTED WITH (3 COATS TOTAL) OF FIRE RESISTANT PAINT ON ALL SIDES PRIOR TO MOUNTING, AND SHALL MATCH PJ COLOR. MASK OVER FIRE RETARDANT SEAL ON PLYWOOD BEFORE PAINTING TO ALLOW INSPECTION OF FIRE RATING SEAL. ALL DRYWALL SURROUNDING WALLS TO BE PAINTED WITH STANDARD PAINT P-1 TO MATCH PLYWOOD COLOR.
6 AT NEW DOOR, EXTEND STATIC DISSIPATIVE TILE FROM ROOM INTO CORRIDOR TO EXISTING FLOORING.
7 INSTALL NEW FIRE EXTINGUISHER.
8 INSTALL NEW SEMI RECESSED FIRE EXTINGUISHER CABINET.
9 NEW FIRE EXTINGUISHER SIGNAGE ABOVE FIRE EXTINGUISHER CABINET, REF TO A-005 FOR REQUIREMENTS.
10 ROOM TO RECEIVE NEW FINISHES FOR ALL WALLS, BASE, AND CEILING. REFERENCE ROOM FINISH SCHEDULE A-005.
11 EXPOSED CEILING.
12 NEW CEILING TRACK WALL ANGLE, CUT EXISTING TILE TO FIT NEW LENGTH AND REINSTALL.
13 ALIGN WALLS.

KEY PLAN

SCALE: NO SCALE

AREA OF WORK



FULLY SPRINKLERED

100% CONSTRUCTION DOCUMENTS

#	Revisions	Date

CONSULTANTS:

3/23/2026

PROJECT MANAGER

ACG Project Number: 20-398

APOGEE Engineers | Architects

© COPYRIGHT Apogee Consulting Group, P.A.

Headquarters:
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: ENLARGED PLANS, BUILDING 7, FIRST FLOOR, TELECOM ROOM 1A-184A

Location: ALEXANDRIA VA HEALTH CARE SYSTEM
2495 SHREVEPORT HWY, 71N
PINEVILLE, LA 71360

Project Title: ELECTRONIC HEALTH RECORD MODERNIZATION (EHRM)

VA PROJECT NUMBER: 502-21-222

Building Number: # 7

Approved

Date: MARCH 24, 2026 | Checked: WVS | Drawn: MEL

Drawing Number: 007.A-404

Dwg. 25 of 51

C:\Users\mel\Documents\A_20-398_VA Alexandria EHRM_BRG_07_mel.RVT
3/5/2026 1:58:58 PM
VA FORM 08-6231

Docusign Envelope ID: 1F1A1E71-2E6F-44 40-966C-7B5FF7D2EEA3

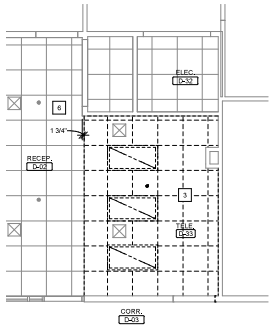

FIRST FLOOR REFLECTED CEILING DEMOLITION PLAN
Scale: 1/4" = 1'-0"

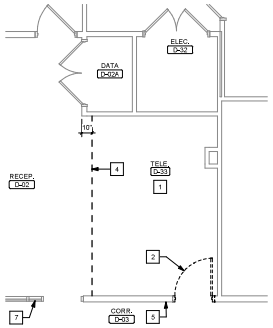

FIRST FLOOR DEMOLITION FLOOR PLAN
Scale: 1/4" = 1'-0"

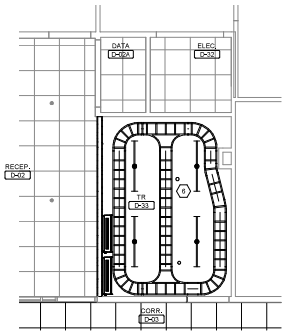

FIRST FLOOR REFLECTED CEILING PLAN
Scale: 1/4" = 1'-0"

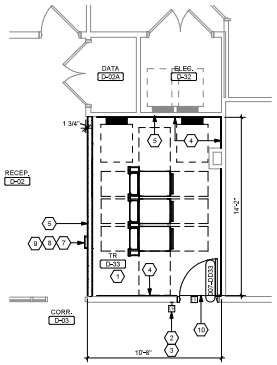

FIRST FLOOR PLAN
Scale: 1/4" = 1'-0"

SHEET NOTES:

A. ALL EXISTING CONDITIONS ARE BASED ON BEST AVAILABLE INFORMATION AT THE TIME OF SURVEY AND VISUAL INSPECTION. CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS.

B. ELEMENTS SHOWN WITH LIGHT, GRAY LINES ARE EXISTING TO REMAIN. ELEMENTS SHOWN WITH DARK DASHED LINES ARE EXISTING TO BE DEMOLISHED. DEMOLITION SHALL INCLUDE, BUT NOT BE LIMITED TO, THOSE ELEMENTS SHOWN.

C. ALL WORK SHALL BE COORDINATED BETWEEN TRADES.

D. ALL WORK SHALL BE COORDINATED WITH THE COR TO MINIMIZE DISRUPTION OF AREAS OUTSIDE OF THE PROJECT LIMITS OF WORK.

E. ALL CEILING DEMOLITION WORK TO BE COORDINATED WITH CHANGE OF EXISTING PENDANT SPRINKLER HEADS WITH NEW UPRIGHT SPRINKLERS SUCH THAT THERE IS NO EXTENDED LOSS OF SPRINKLER PROTECTION IN THE CONSTRUCTION AREA.

F. FOR FINISHES IN ALL NEW TR ROOMS - SEE ROOM FINISH SCHEDULE SHEET A-005.

G. ALL NEW TR ROOMS TO HAVE CARBON DIOXIDE EXTINGUISHER WITHIN 75' OF ROOM. SEE OVERALL OR ENLARGED PLANS FOR LOCATIONS.

H. PATCH AND FILL ALL PENETRATIONS/HOLES IN WALLS OF TR ROOMS TO MAINTAIN WALL RATINGS.

KEY NOTES:

1 REMOVE EXISTING FLOOR FINISH AND BASE.
2 DEMOLISH EXISTING DOOR AND FRAME METAL STUD AND GYP BD WALL.
3 REMOVE EXISTING ACT CEILING, INCLUDING ELEC AND MECH FIXTURES.
4 FINISH FLOORING CUT LINE, PREP AREA TO RECEIVE NEW FLOORING.
5 REMOVE EXISTING SIGNAGE AND TURN OVER TO VA.
6 SEE MECHANICAL DRAWINGS FOR ABOVE CEILING WORK. FOLLOW ICRA MEASURES ON SHEET G-004.
7 EXISTING STOREFRONT TO REMAIN.

(#) KEY NOTES:

1 ROOM TO RECEIVE NEW FINISHES WALLS AND FLOORS. SEE ROOM FINISH SCHEDULE ON SHEET A-005.
2 NEW CARD READER. REFER TO TECHNOLOGY DRAWINGS.
3 NEW ROOM SIGNAGE. REF TO A-005 FOR REQUIREMENTS.
4 PROVIDE 4'-8"X3'-4" FIRE RETARDANT TREATED AC GRADE PLYWOOD BACK BOARDS IN TELECOM ROOMS. PLYWOOD SHALL BE MOUNTED WITH A=SIDE OUT AND PAINTED WITH (3 COATS TOTAL) OF FIRE RESISTANT PAINT ON ALL SIDES PRIOR TO MOUNTING, AND SHALL MATCH P-2 COLOR. MASK OVER FIRE RETARDANT SEAL ON PLYWOOD BEFORE PAINTING TO ALLOW INSPECTION OF FIRE RATING SEAL. ALL DRYWALL SURROUNDING WALLS TO BE PAINTED WITH STANDARD PAINT P-1 TO MATCH PLYWOOD COLOR.
5 EXTEND EXISTING WALL TO UNDERSIDE OF DECK ABOVE (APPROX. 8'-2" TO 11'-2") WITH WALL TYPE Mas3. SEE SHEET A-002. SEAL ALL PENETRATIONS AND EXISTING VOIDS.
6 EXPOSED CEILING.
7 INSTALL NEW SEMI RECESSED FIRE EXTINGUISHER CABINET.
8 INSTALL NEW FIRE EXTINGUISHER.
9 NEW FIRE EXTINGUISHER SIGNAGE ABOVE FIRE EXTINGUISHER CABINET. REF TO A-005 FOR REQUIREMENTS.
10 AT NEW DOOR, EXTEND STATIC DISSIPATIVE TILE FROM ROOM INTO CORRIDOR TO EXISTING FLOORING.

KEY PLAN

SCALE: NO SCALE

AREA OF WORK



FULLY SPRINKLERED

100% CONSTRUCTION DOCUMENTS

#	Revisions	Date

CONSULTANTS:

3/23/2026

PROJECT MANAGER

ACG Project Number 20-398

APOGEE Engineers | Architects

Headquarters
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420

© COPYRIGHT Apogee Consulting Group, P.A.

Office of Construction and Facilities Management

U.S. Department of Veterans Affairs

Drawing Title: ENLARGED PLANS, BUILDING 7, FIRST FLOOR, TELECOM ROOM D-33

Location: ALEXANDRIA VA HEALTH CARE SYSTEM, 2495 SHREVEPORT HWY, 71N, PINEVILLE, LA 71360

Project Title: ELECTRONIC HEALTH RECORD MODERNIZATION (EHRM)

VA PROJECT NUMBER: 502-21-222

Building Number: # 7

Approved

Date: MARCH 24, 2026 | Checked: WVS | Drawn: MEL

Drawing Number: 007.A-405

Dwg. 26 of 51

C:\Users\mel\Documents\A_20-398_VA Alexandria EHRM_BRG_07_mel.RVT
3/5/2026 1:58:58 PM
VA FORM 08-6231

DocuSign Envelope ID: 7F41697F-2597-44 40-966C-7695F75DEEA5



REFERENCE PHOTOS

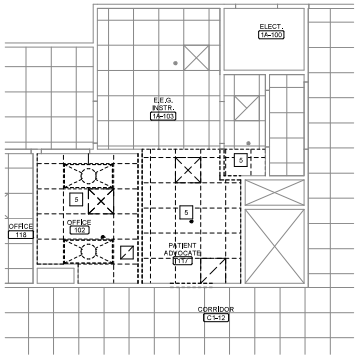

FIRST FLOOR REFLECTED CEILING DEMOLITION PLAN
Scale: 1/4" = 1'-0"

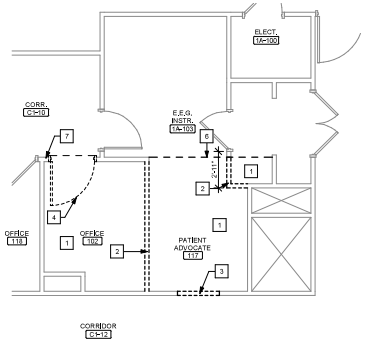

FIRST FLOOR DEMOLITION FLOOR PLAN
Scale: 1/4" = 1'-0"

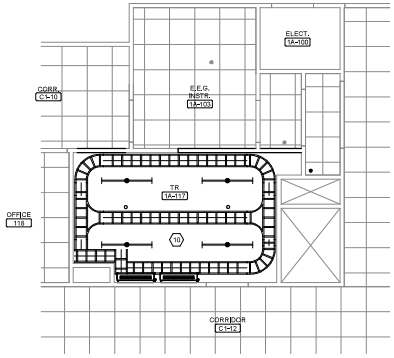

FIRST FLOOR REFLECTED CEILING PLAN
Scale: 1/4" = 1'-0"

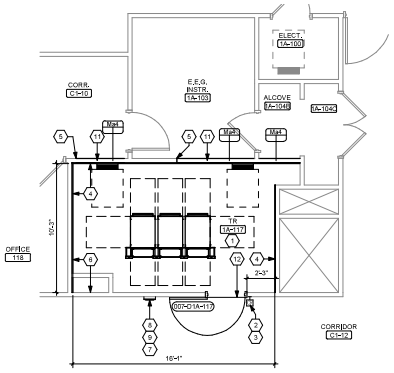

FIRST FLOOR PLAN
Scale: 1/4" = 1'-0"

SHEET NOTES:

A. ALL EXISTING CONDITIONS ARE BASED ON BEST AVAILABLE INFORMATION AT THE TIME OF SURVEY AND VISUAL INSPECTION. CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS.

B. ELEMENTS SHOWN WITH LIGHT, GRAY LINES ARE EXISTING TO REMAIN. ELEMENTS SHOWN WITH DARK DASHED LINES ARE EXISTING TO BE DEMOLISHED. DEMOLITION SHALL INCLUDE, BUT NOT BE LIMITED TO, THOSE ELEMENTS SHOWN.

C. ALL WORK SHALL BE COORDINATED BETWEEN TRADES.

D. ALL WORK SHALL BE COORDINATED WITH THE COR TO MINIMIZE DISRUPTION OF AREAS OUTSIDE OF THE PROJECT LIMITS OF WORK.

E. ALL CEILING DEMOLITION WORK TO BE COORDINATED WITH CHANGE OF EXISTING PENDANT SPRINKLER HEADS WITH NEW UPRIGHT SPRINKLERS SUCH THAT THERE IS NO EXTENDED LOSS OF SPRINKLER PROTECTION IN THE CONSTRUCTION AREA.

F. FOR FINISHES IN ALL NEW TR ROOMS - SEE ROOM FINISH SCHEDULE SHEET A-005.

G. ALL NEW TR ROOMS TO HAVE CARBON DIOXIDE EXTINGUISHER WITHIN 75' OF ROOM. SEE OVERALL OR ENLARGED PLANS FOR LOCATIONS.

H. PATCH AND FILL ALL PENETRATIONS/HOLES IN WALLS OF TR ROOMS TO MAINTAIN WALL RATINGS.

KEY NOTES:

1 REMOVE EXISTING FLOOR FINISH AND BASE.
2 DEMOLISH EXISTING METAL STUD AND GYP BD WALL.
3 CREATE ROUGH OPENING FOR NEW DOOR.
4 DEMOLISH EXISTING DOOR AND FRAME METAL STUD AND GYP BD WALL.
5 REMOVE EXISTING ACT CEILING, INCLUDING ELEC AND MECH FIXTURES.
6 FINISH FLOORING CUT LINE. PREP AREA TO RECEIVE NEW FLOORING.
7 REMOVE EXISTING SIGNAGE AND TURN OVER TO VA.

KEY NOTES:

1 ROOM TO RECEIVE NEW FINISHES WALLS AND FLOORS, SEE ROOM FINISH SCHEDULE ON SHEET A-005.
2 NEW ROOM SIGNAGE. REF TO A-005 FOR REQUIREMENTS.
3 NEW CARD READER, REFER TO TECHNOLOGY DRAWINGS.
4 PROVIDE 4'-0"X3'-0" FIRE RETARDANT TREATED AC GRADE PLYWOOD BACK BOARDS IN TELECOM ROOMS. PLYWOOD SHALL BE MOUNTED WITH A-SIDE OUT AND PAINTED WITH (3 COATS TOTAL) OF FIRE RESISTANT PAINT ON ALL SIDES PRIOR TO MOUNTING, AND SHALL MATCH P-2 COLOR. MASK OVER FIRE RETARDANT SEAL ON PLYWOOD BEFORE PAINTING TO ALLOW INSPECTION OF FIRE RATING SEAL. ALL DRYWALL SURROUNDING WALLS TO BE PAINTED WITH STANDARD PAINT P-1 TO MATCH PLYWOOD COLOR.
5 ALIGN WALLS.
6 EXTEND EXISTING WALL TO UNDERSIDE OF DECK ABOVE (APPROX. 9'-0" TO 11'-0") WITH WALL TYPE Mtw3 - SEE SHEET A-002. SEAL ALL PENETRATIONS AND EXISTING VOIDS.
7 INSTALL NEW FIRE EXTINGUISHER.
8 INSTALL NEW SEMI RECESSED FIRE EXTINGUISHER CABINET.
9 NEW FIRE EXTINGUISHER SIGNAGE ABOVE FIRE EXTINGUISHER CABINET. REF TO A-005 FOR REQUIREMENTS.
10 EXPOSED CEILING.
11 PROVIDE NEW WALL, METAL STUD TO MATCH THE PROPER STUD THICKNESS WITH THE REMAINING WALL SO THAT ADJOINING WALL SURFACES ARE FLUSH ON BOTH SIDES. GYPSUM BOARD ON EACH SIDE.
12 AT NEW DOOR, EXTEND STATIC DISSIPATIVE TILE FROM ROOM INTO CORRIDOR TO EXISTING FLOORING.

KEY PLAN

SCALE: NO SCALE

AREA OF WORK



FULLY SPRINKLERED

100% CONSTRUCTION DOCUMENTS

#	Revisions	Date

CONSULTANTS:

3/23/2026

PROJECT MANAGER

ACG Project Number 20-398

APOGEE Engineers | Architects

Headquarters
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420

© COPYRIGHT Apogee Consulting Group, P.A.

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: ENLARGED PLANS, BUILDING 7, FIRST FLOOR, TELECOM ROOM 1A-117

Location: ALEXANDRIA VA HEALTH CARE SYSTEM
2495 SHREVEPORT HWY, 71N
PINEVILLE, LA 71360

Project Title: ELECTRONIC HEALTH RECORD MODERNIZATION (EHRM)

VA PROJECT NUMBER: 502-21-222

Building Number: # 7

Approved

Date: MARCH 24, 2026 | Checked: WVS | Drawn: MEL

Drawing Number: 007.A-406

Dwg. 27 of 51

C:\Users\mel\Documents\A_20-398_VA Alexandria EHRM_BRG_07_mel4CP_R20.rvt
3/23/2026 1:59:59 PM
VA FORM 08-6231

Docusign Envelope ID: 1F1A1E71-2E6F-644-A0A-966C-7B5FF75DEEA5

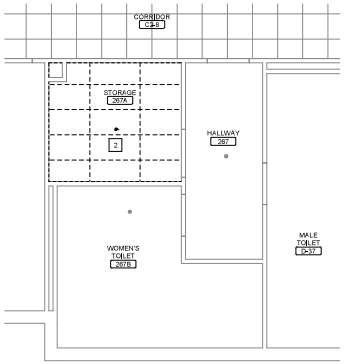

SECOND FLOOR REFLECTED CEILING DEMOLITION PLAN
Scale: 1/4" = 1'-0"

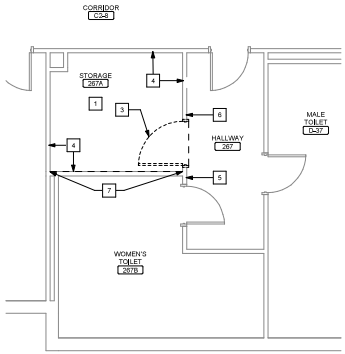

SECOND FLOOR DEMOLITION PLAN
Scale: 1/4" = 1'-0"

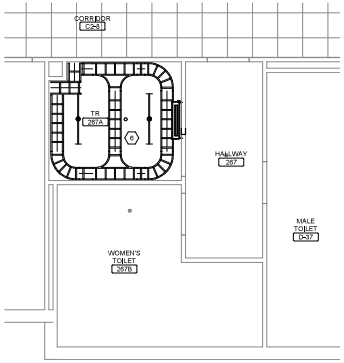

SECOND FLOOR REFLECTED CEILING PLAN
Scale: 1/4" = 1'-0"

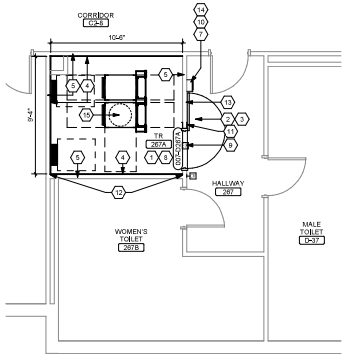

SECOND FLOOR PLAN
Scale: 1/4" = 1'-0"

SHEET NOTES:

A. ALL EXISTING CONDITIONS ARE BASED ON BEST AVAILABLE INFORMATION AT THE TIME OF SURVEY AND VISUAL INSPECTION. CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS.

B. ELEMENTS SHOWN WITH LIGHT, GRAY LINES ARE EXISTING TO REMAIN. ELEMENTS SHOWN WITH DARK DASHED LINES ARE EXISTING TO BE DEMOLISHED. DEMOLITION SHALL INCLUDE, BUT NOT BE LIMITED TO, THOSE ELEMENTS SHOWN.

C. ALL WORK SHALL BE COORDINATED BETWEEN TRADES.

D. ALL WORK SHALL BE COORDINATED WITH THE COR TO MINIMIZE DISRUPTION OF AREAS OUTSIDE OF THE PROJECT LIMITS OF WORK.

E. ALL CEILING DEMOLITION WORK TO BE COORDINATED WITH CHANGE OF EXISTING PENDANT SPRINKLER HEADS WITH NEW UPRIGHT SPRINKLERS SUCH THAT THERE IS NO EXTENDED LOSS OF SPRINKLER PROTECTION IN THE CONSTRUCTION AREA.

F. FOR FINISHES IN ALL NEW TR ROOMS - SEE ROOM FINISH SCHEDULE SHEET A-005.

G. ALL NEW TR ROOMS TO HAVE CARBON DIOXIDE EXTINGUISHER WITHIN 75' OF ROOM, SEE OVERALL OR ENLARGED PLANS FOR LOCATIONS.

H. PATCH AND FILL ALL PENETRATIONSHOLES IN WALLS OF TR ROOMS TO MAINTAIN WALL RATINGS.

KEY NOTES:

1 DEMOLISH 1X1 FLOOR TILE AND SETTING BED.
2 REMOVE EXISTING ACT CEILING, INCLUDING ELEC AND MECH FIXTURES.
3 DEMOLISH EXISTING DOOR AND FRAME METAL STUD AND GYP BD WALL.
4 DEMOLISH 4X4 WALL TILE FROM FLOOR TO CEILING.
5 SAVE INTACT 4X4 WALL TILE FROM ROOM 267A WALL, USE RECLAIMED TILE TO PATCH IN WALL TILE IN CORRIDOR DAMAGED FROM NEW DOOR INSTALLATION.
6 REMOVE EXISTING SIGNAGE AND TURN OVER TO VA.
7 REMOVE GYPSUM BOARD TR SIDE IN PREPARATION FOR WATERSHIELD MEMBRANE.

KEY NOTES:

1 ROOM TO RECEIVE NEW FINISHES WALLS AND FLOORS, SEE ROOM FINISH SCHEDULE ON SHEET A-005.
2 NEW ROOM SIGNAGE, REF TO A-005 FOR REQUIREMENTS.
3 NEW CARD READER, REFER TO TECHNOLOGY DRAWINGS.
4 PROVIDE 4'X8'X3/4" FIRE RETARDANT TREATED AC GRADE PLYWOOD BACK BOARDS IN TELECOM ROOMS. PLYWOOD SHALL BE MOUNTED WITH A-SIDE OUT AND PAINTED WITH (3 COATS TOTAL) OF FIRE RESISTANT PAINT ON ALL SIDES PRIOR TO MOUNTING, AND SHALL MATCH P-2 COLOR. MASK OVER FIRE RETARDANT SEAL ON PLYWOOD BEFORE PAINTING TO ALLOW INSPECTION OF FIRE RATING SEAL. ALL DRYWALL SURROUNDING WALLS TO BE PAINTED WITH STANDARD PAINT P-1 TO MATCH PLYWOOD COLOR.
5 EXTEND EXISTING WALL TO UNDERSIDE OF DECK ABOVE (APPROX. 2'-0") WITH WALL TYPE Mxx, SEE SHEET A-002. SEAL ALL PENETRATIONS AND EXISTING VOIDS.
6 EXPOSED CEILING.
7 INSTALL NEW SEMI RECESSED FIRE EXTINGUISHER CABINET.
8 INSTALL SELF LEVELING CEMENT UNDERLAYMENT TO LEVEL THE FLOOR PRIOR TO INSTALLATION OF FLOOR FINISH.
9 AT NEW DOOR, EXTEND STATIC DISSIPATIVE TILE FROM ROOM INTO CORRIDOR TO EXISTING FLOORING.
10 NEW FIRE EXTINGUISHER SIGNAGE ABOVE FIRE EXTINGUISHER CABINET, REF TO A-005 FOR REQUIREMENTS.
11 INFILL EXISTING DOOR OPENING, PROVIDE NEW METAL STUD TO MATCH THE PROPER STUD THICKNESS WITH THE REMAINING WALL SO THAT ADJOINING WALL SURFACES ARE FLUSH ON BOTH SIDES. GYPSUM BOARD EACH SIDE, PAINT AND WALL BASE TO MATCH ADJACENT EXISTING WALL TILE. SALVAGE TILE FROM TR ROOM DEMOLITION AND REUSE.
12 PROVIDE GRACE, ICE AND WATERSHIELD, SELF ADHERING, MEMBRANE 45 MIL THICK OR EQUAL, ENTIRE WALL ABOVE FLOOR FINISH, BOTTOM OF MEMBRANE TO SEAL 1/4" TO FLOOR AND TURN UP, ADHERE TO METAL TRACK RUNNER AND METAL STUDS. INSIDE FACE, TR ROOM SIDE.
13 ADD WALL TILE TO MATCH SURROUNDING WALLS.
14 INSTALL NEW FIRE EXTINGUISHER.
15 PATCH REMOVED FLOOR DRAIN HOLE IN DECK AND ANY OTHER FLOOR PENETRATIONS WITH CONCRETE, APPLY LIQUIFED RUBBER MEMBRANE (REDGUARD OR EQUAL) TO 12" PAST THE PATCH, ALL AROUND.

KEY PLAN

SCALE: NO SCALE

AREA OF WORK



FULLY SPRINKLERED

100% CONSTRUCTION DOCUMENTS

#	Revisions	Date

CONSULTANTS:

3/23/2026

PROJECT MANAGER

ACG Project Number 20-398

APOGEE Engineers | Architects

Headquarters
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420

© COPYRIGHT Apogee Consulting Group, P.A.

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: ENLARGED PLANS, BUILDING 7, SECOND FLOOR, TELECOM ROOM 267A

Project Title: ELECTRONIC HEALTH RECORD MODERNIZATION (EHRM)

VA PROJECT NUMBER: 502-21-222

Building Number: # 7

Location: ALEXANDRIA VA HEALTH CARE SYSTEM, 2495 SHREVEPORT HWY, 71N, PINEVILLE, LA 71360

Approved

Date: MARCH 24, 2026 | Checked: WVS | Drawn: MEL

Drawing Number: 007.A-407

Dwg. 28 of 51

C:\Users\mel\Documents\A_20-398_VA Alexandria EHRM_BRG_07_mel.RVT 3/5/2026 1:58:59 PM

VA FORM 08-6231

Docusign Envelope ID: 1F1A1E81-2E6F-444A-966C-7B5FF75DEEA5

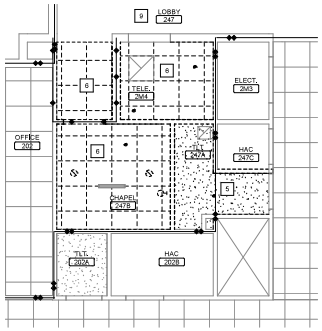

SECOND FLOOR REFLECTED CEILING DEMOLITION PLAN
Scale: 1/4" = 1'-0"

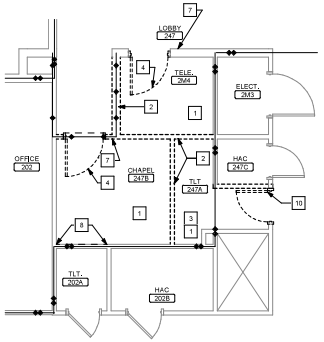

SECOND FLOOR DEMOLITION PLAN
Scale: 1/4" = 1'-0"

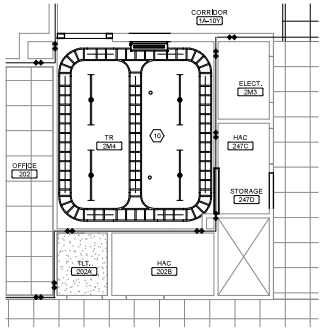

SECOND FLOOR REFLECTED CEILING PLAN
Scale: 1/4" = 1'-0"

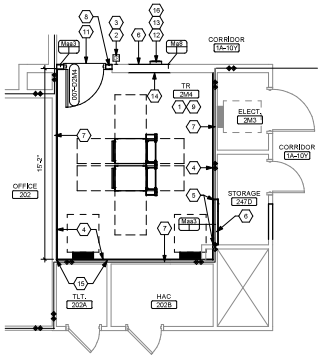

SECOND FLOOR PLAN
Scale: 1/4" = 1'-0"

SHEET NOTES:

A. ALL EXISTING CONDITIONS ARE BASED ON BEST AVAILABLE INFORMATION AT THE TIME OF SURVEY AND VISUAL INSPECTION. CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS.

B. ELEMENTS SHOWN WITH LIGHT, GRAY LINES ARE EXISTING TO REMAIN. ELEMENTS SHOWN WITH DARK DASHED LINES ARE EXISTING TO BE DEMOLISHED. DEMOLITION SHALL INCLUDE, BUT NOT BE LIMITED TO, THOSE ELEMENTS SHOWN.

C. ALL WORK SHALL BE COORDINATED BETWEEN TRADES.

D. ALL WORK SHALL BE COORDINATED WITH THE COR TO MINIMIZE DISRUPTION OF AREAS OUTSIDE OF THE PROJECT LIMITS OF WORK.

E. ALL CEILING DEMOLITION WORK TO BE COORDINATED WITH CHANGE OF EXISTING PENDANT SPRINKLER HEADS WITH NEW UPRIGHT SPRINKLERS SUCH THAT THERE IS NO EXTENDED LOSS OF SPRINKLER PROTECTION IN THE CONSTRUCTION AREA.

F. FOR FINISHES IN ALL NEW TR ROOMS - SEE ROOM FINISH SCHEDULE SHEET A-005.

G. ALL NEW TR ROOMS TO HAVE CARBON DIOXIDE EXTINGUISHER WITHIN 75' OF ROOM. SEE OVERALL OR ENLARGED PLANS FOR LOCATIONS.

H. PATCH AND FILL ALL PENETRATIONS/HOLES IN WALLS OF TR ROOMS TO MAINTAIN WALL RATINGS.

KEY NOTES:

1 REMOVE EXISTING FLOOR FINISH AND BASE.
2 DEMOLISH EXISTING WALL.
3 REMOVE EXISTING CERAMIC TILE FLOOR, TILE WALLS, AND BASE.
4 DEMOLISH EXISTING DOOR AND FRAME METAL STUD AND GYP BD WALL.
5 DEMOLISH EXISTING HARD CEILING.
6 REMOVE EXISTING ACT CEILING, INCLUDING ELEC AND MECH FIXTURES.
7 REMOVE EXISTING SIGNAGE AND TURN OVER TO VA.
8 REMOVE GYPSUM BOARD TR SIDE IN PREPARATION FOR WATERSHIELD MEMBRANE.
9 SEE MECHANICAL DRAWINGS FOR ABOVE CEILING WORK, FOLLOW JCRA MEASURES ON SHEET G-004.
10 EXISTING DOOR WITH GROUTED IN FRAME IN PLASTER WALL TO BE REMOVED.

⟨#⟩ KEY NOTES:

1 ROOM TO RECEIVE NEW FINISHES WALLS AND FLOORS. SEE ROOM FINISH SCHEDULE ON SHEET A-005.
2 NEW ROOM SIGNAGE. REF TO A-005 FOR REQUIREMENTS.
3 NEW CARD READER. REFER TO TECHNOLOGY DRAWINGS.
4 PROVIDE 4'X8'X3/4" FIRE RETARDANT TREATED AC GRADE PLYWOOD BACK BOARDS IN TELECOM ROOMS. PLYWOOD SHALL BE MOUNTED WITH A-SIDE OUT AND PAINTED WITH (2 COATS TOTAL) OF FIRE RESISTANT PAINT ON ALL SIDES PRIOR TO MOUNTING. AND SHALL MATCH P-C COLOR. MASK OVER FIRE RETARDANT SEAL ON PLYWOOD BEFORE PAINTING TO ALLOW INSPECTION OF FIRE RATING SEAL. ALL DRYWALL SURROUNDING WALLS TO BE PAINTED WITH STANDARD PAINT P-1 TO MATCH PLYWOOD COLOR.
5 ALIGN WALLS.
6 NEW WALL.
7 EXTEND EXISTING WALL TO UNDERSIDE OF DECK ABOVE (APPROX. 8'-0" TO 11'-0") WITH WALL TYPE Maa1. SEE SHEET A-002. SEAL ALL PENETRATIONS AND EXISTING VOIDS.
8 FILL IN OPENING WITH METAL STUD AND GYP BD. TO MATCH PAINT.
9 INSTALL SELF LEVELING CEMENT UNDERLAYMENT TO LEVEL THE FLOOR PRIOR TO INSTALLATION OF FLOOR FINISH.
10 EXPOSED CEILING.
11 AT NEW DOOR, EXTEND STATIC DISSIPATIVE TILE FROM ROOM INTO CORRIDOR TO EXISTING FLOORING.
12 INSTALL NEW SURFACE MOUNT FIRE EXTINGUISHER CABINET.
13 NEW FIRE EXTINGUISHER SIGNAGE ABOVE FIRE EXTINGUISHER CABINET. REF TO A-005 FOR REQUIREMENTS.
14 INFILL EXISTING DOOR OPENING. PROVIDE NEW METAL STUD TO MATCH THE PROPER STUD THICKNESS WITH THE REMAINING WALL SO THAT ADJOINING WALL SURFACES ARE FLUSH ON BOTH SIDES. GYPSUM BOARD EACH SIDE, PAINT AND WALL BASE TO MATCH ADJACENT EXISTING FINISHES TO REMAIN.
15 PROVIDE GRACE ICE AND WATERSHIELD, SELF ADHERING, MEMBRANE 45 MIL THICK OR EQUAL, ENTIRE WALL ABOVE FLOOR FINISH. BOTTOM OF MEMBRANE TO SEAL 1/4" TO FLOOR AND TURN UP. ADHERE TO METAL TRACK RUNNER AND METAL STUDS, INSIDE FACE, TR ROOM SIDE. REPLACE REMOVED GYPSUM BOARD.
16 INSTALL NEW FIRE EXTINGUISHER.

KEY PLAN

SCALE: NO SCALE

AREA OF WORK



WALL RATING LEGEND

1 HR - FIRE SEPARATION
2 HR - FIRE SEPARATION
SMOKE RESISTIVE HAZARDOUS AREA

FULLY SPRINKLERED

100% CONSTRUCTION DOCUMENTS

#	Revisions	Date

CONSULTANTS:

3/23/2026

PROJECT MANAGER

ACG Project Number: 20-398

APOGEE Engineers | Architects

Headquarters:
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420

© COPYRIGHT Apogee Consulting Group, P.A.

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: ENLARGED PLANS, BUILDING 7, SECOND FLOOR, TELECOM ROOM 2M4

Project Title: ELECTRONIC HEALTH RECORD MODERNIZATION (EHRM)

VA PROJECT NUMBER: 502-21-222

Building Number: # 7

Location: ALEXANDRIA VA HEALTH CARE SYSTEM
2495 SHREVEPORT HWY, 71N
PINEVILLE, LA 71360

Approved

Date: MARCH 24, 2026 | Checked: WVS | Drawn: MEL

Drawing Number: 007.A-408

Dwg. 29 of 51

C:\Users\mel\Documents\A_20-398_VA Alexandria EHRM_BRG_07_mel.RVT 3/5/2026 2:00:00 PM

VA FORM 08-6231

Docusign Envelope ID: 1F1A1E71-2E6F-444A-966C-7B5FF7D2EEA5

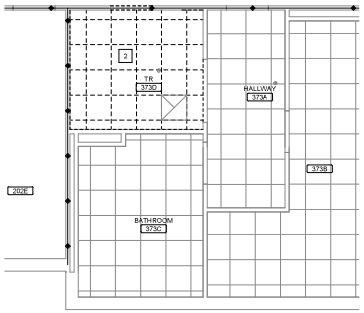

THIRD FLOOR REFLECTED CEILING DEMOLITION PLAN
Scale: 1/4" = 1'-0"

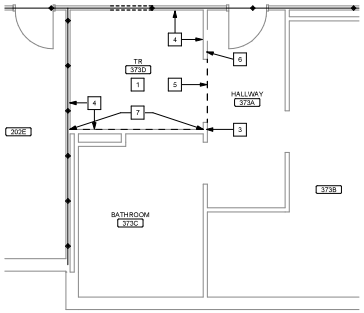

THIRD FLOOR DEMOLITION PLAN
Scale: 1/4" = 1'-0"

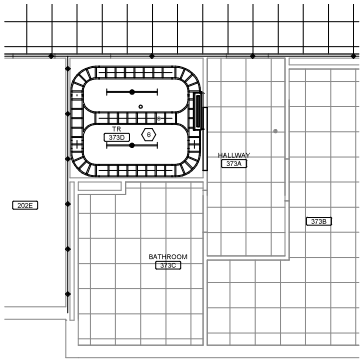

THIRD FLOOR REFLECTED CEILING PLAN
Scale: 1/4" = 1'-0"

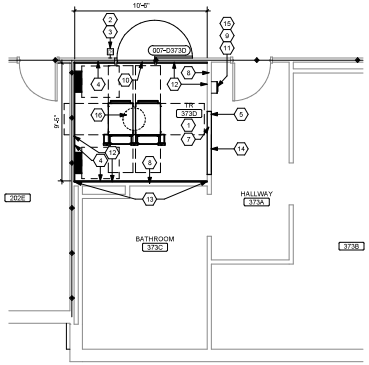

THIRD FLOOR PLAN
Scale: 1/4" = 1'-0"

SHEET NOTES:

A. ALL EXISTING CONDITIONS ARE BASED ON BEST AVAILABLE INFORMATION AT THE TIME OF SURVEY AND VISUAL INSPECTION. CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS.

B. ELEMENTS SHOWN WITH LIGHT, GRAY LINES ARE EXISTING TO REMAIN. ELEMENTS SHOWN WITH DARK DASHED LINES ARE EXISTING TO BE DEMOLISHED. DEMOLITION SHALL INCLUDE, BUT NOT BE LIMITED TO, THOSE ELEMENTS SHOWN.

C. ALL WORK SHALL BE COORDINATED BETWEEN TRADES.

D. ALL WORK SHALL BE COORDINATED WITH THE COR TO MINIMIZE DISRUPTION OF AREAS OUTSIDE OF THE PROJECT LIMITS OF WORK.

E. ALL CEILING DEMOLITION WORK TO BE COORDINATED WITH CHANGE OF EXISTING PENDANT SPRINKLER HEADS WITH NEW UPRIGHT SPRINKLERS SUCH THAT THERE IS NO EXTENDED LOSS OF SPRINKLER PROTECTION IN THE CONSTRUCTION AREA.

F. FOR FINISHES IN ALL NEW TR ROOMS - SEE ROOM FINISH SCHEDULE SHEET A-005.

G. ALL NEW TR ROOMS TO HAVE CARBON DIOXIDE EXTINGUISHER WITHIN 75' OF ROOM. SEE OVERALL OR ENLARGED PLANS FOR LOCATIONS.

H. PATCH AND FILL ALL PENETRATIONS/HOLES IN WALLS OF TR ROOMS TO MAINTAIN WALL RATINGS.

KEY NOTES:

1 DEMOLISH 1X1 FLOOR TILE AND SETTING BED.
2 REMOVE EXISTING ACT CEILING, INCLUDING ELEC AND MECH FIXTURES.
3 SAVE MINIMUM 15 SF INTACT 4X4 WALL TILE FROM ROOM 373D WALL. USE RECLAIMED TILE TO PATCH IN WALL TILE IN CORRIDOR DAMAGED FROM NEW DOOR INSTALLATION.
4 DEMOLISH 4X4 WALL TILE FROM FLOOR TO CEILING.
5 FINISH FLOORING CUT LINE. PREP AREA TO RECEIVE NEW FLOORING.
6 REMOVE EXISTING SIGNAGE AND TURN OVER TO VA.
7 REMOVE GYPSUM BOARD TR SIDE IN PREPARATION FOR WATERSHIELD MEMBRANE.

KEY NOTES:

1 ROOM TO RECEIVE NEW FINISHES WALLS AND FLOORS, SEE ROOM FINISH SCHEDULE ON SHEET A-005.
2 NEW ROOM SIGNAGE, REF TO A-005 FOR REQUIREMENTS.
3 NEW CARD READER, REFER TO TECHNOLOGY DRAWINGS.
4 PROVIDE 4'X8'X3/4" FIRE RETARDANT TREATED AC GRADE PLYWOOD BACK BOARDS IN TELECOM ROOMS. PLYWOOD SHALL BE MOUNTED WITH A-SIDE OUT AND PAINTED WITH (3 COATS TOTAL) OF FIRE RESISTANT PAINT ON ALL SIDES PRIOR TO MOUNTING, AND SHALL MATCH P-2 COLOR. MASK OVER FIRE RETARDANT SEAL ON PLYWOOD BEFORE PAINTING TO ALLOW INSPECTION OF FIRE RATING SEAL. ALL DRYWALL SURROUNDING WALLS TO BE PAINTED WITH STANDARD PAINT P-1 TO MATCH PLYWOOD COLOR.
5 NEW FINISHES TO MATCH EXISTING. INSTALL COVED TILE BASE AT FLOOR/WALL INTERSECTION.
6 EXPOSED CEILING.
7 INFILL EXISTING DOOR OPENING. PROVIDE NEW METAL STUD TO MATCH THE PROPER STUD THICKNESS WITH THE REMAINING WALL SO THAT ADJOINING WALL SURFACES ARE FLUSH ON BOTH SIDES. GYPSUM BOARD EACH SIDE, PAINT AND WALL BASE TO MATCH ADJACENT EXISTING FINISHES TO REMAIN.
8 EXTEND EXISTING WALL TO UNDERSIDE OF DECK ABOVE (APPROX. 8'-2" TO 11'-0") WITH WALL TYPE Maa3_, SEE SHEET A-002. SEAL ALL PENETRATIONS AND EXISTING VOIDS.
9 NEW FIRE EXTINGUISHER SIGNAGE ABOVE FIRE EXTINGUISHER CABINET, REF TO A-005 FOR REQUIREMENTS.
10 AT NEW DOOR, EXTEND STATIC DISSIPATIVE TILE FROM ROOM INTO CORRIDOR TO EXISTING FLOORING.
11 INSTALL NEW SURFACE MOUNT FIRE EXTINGUISHER CABINET.
12 REPAIR OR REPLACE WALL SHEATHING DAMAGED BY TILE REMOVAL.
13 PROVIDE GRACE ICE AND WATERSHIELD, SELF ADHERING, MEMBRANE 45 MIL THICK OR EQUAL, ENTIRE WALL ABOVE FLOOR FINISH, BOTTOM OF MEMBRANE TO SEAL 1/4" TO FLOOR AND TURN UP. ADHERE TO METAL TRACK RUNNER AND METAL STUDS, INSIDE FACE, TR ROOM SIDE. REPLACE REMOVED GYPSUM BOARD.
14 SALVAGE EXISTING TILE FROM TR DEMOLITION AND REUSE FOR WALL FINISH, THIS SIDE ONLY.
15 INSTALL NEW FIRE EXTINGUISHER.
16 PATCH REMOVED FLOOR DRAIN HOLE IN DECK AND ANY OTHER FLOOR PENETRATIONS WITH CONCRETE, APPLY LIQUIFIED RUBBER MEMBRANE (REDGUARD OR EQUAL) TO 12" PAST THE PATCH, ALL AROUND.

KEY PLAN

SCALE: NO SCALE

AREA OF WORK



WALL RATING LEGEND

1 HR - FIRE SEPARATION
2 HR - FIRE SEPARATION
SMOKE RESISTIVE HAZARDOUS AREA

FULLY SPRINKLERED

100% CONSTRUCTION DOCUMENTS

#	Revisions	Date

CONSULTANTS:

5/23/2026

PROJECT MANAGER

ACG Project Number 20-398

APOGEE Engineers | Architects

Headquarters
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420

© COPYRIGHT Apogee Consulting Group, P.A.

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: ENLARGED PLANS, BUILDING 7, THIRD FLOOR, TELECOM ROOM 373D

Project Title: ELECTRONIC HEALTH RECORD MODERNIZATION (EHRM)

VA PROJECT NUMBER: 502-21-222

Building Number: # 7

Location: ALEXANDRIA VA HEALTH CARE SYSTEM
2495 SHREVEPORT HWY, 71N
PINEVILLE, LA 71360

Approved

Date: MARCH 24, 2026 | Checked: WVS | Drawn: MEL

Drawing Number: 007.A-409

Dwg. 30 of 51

C:\Users\mel\Documents\A_20-398_VA Alexandria EHRM_BRG_07_mel.RVT 3/5/2026 2:00:00 PM

VA FORM 08-6231

Docusign Envelope ID: 1F1A1E71-2E6F-44 40-966C-7B5FF7D2EEA3

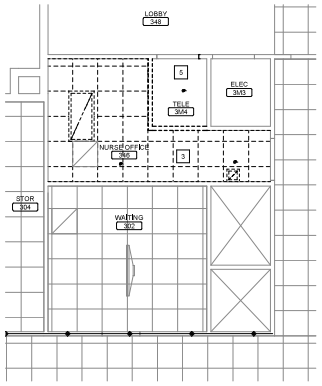

THIRD FLOOR REFLECTED CEILING DEMOLITION PLAN
Scale: 1/4" = 1'-0"

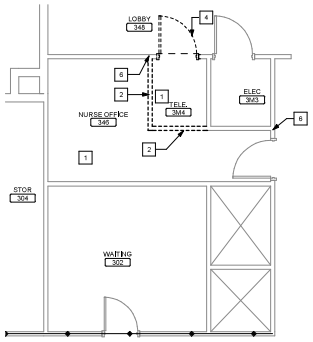

THIRD FLOOR DEMOLITION PLAN
Scale: 1/4" = 1'-0"

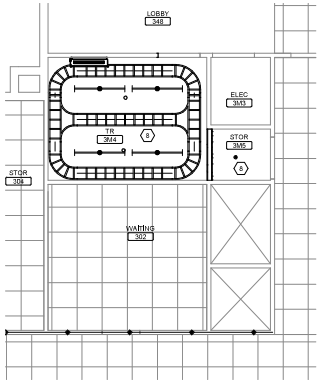

THIRD FLOOR REFLECTED CEILING PLAN
Scale: 1/4" = 1'-0"

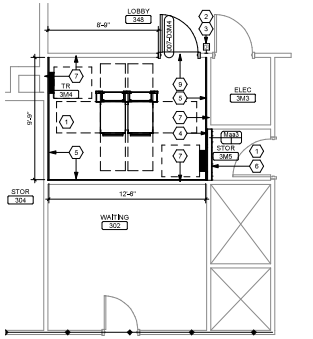

THIRD FLOOR PLAN
Scale: 1/4" = 1'-0"

SHEET NOTES:

A. ALL EXISTING CONDITIONS ARE BASED ON BEST AVAILABLE INFORMATION AT THE TIME OF SURVEY AND VISUAL INSPECTION. CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS.

B. ELEMENTS SHOWN WITH LIGHT, GRAY LINES ARE EXISTING TO REMAIN. ELEMENTS SHOWN WITH DARK DASHED LINES ARE EXISTING TO BE DEMOLISHED. DEMOLITION SHALL INCLUDE, BUT NOT BE LIMITED TO, THOSE ELEMENTS SHOWN.

C. ALL WORK SHALL BE COORDINATED BETWEEN TRADES.

D. ALL WORK SHALL BE COORDINATED WITH THE COR TO MINIMIZE DISRUPTION OF AREAS OUTSIDE OF THE PROJECT LIMITS OF WORK.

E. ALL CEILING DEMOLITION WORK TO BE COORDINATED WITH CHANGE OF EXISTING PENDANT SPRINKLER HEADS WITH NEW UPRIGHT SPRINKLERS SUCH THAT THERE IS NO EXTENDED LOSS OF SPRINKLER PROTECTION IN THE CONSTRUCTION AREA.

F. FOR FINISHES IN ALL NEW TR ROOMS - SEE ROOM FINISH SCHEDULE SHEET A-005.

G. ALL NEW TR ROOMS TO HAVE CARBON DIOXIDE EXTINGUISHER WITHIN 75' OF ROOM. SEE OVERALL OR ENLARGED PLANS FOR LOCATIONS.

H. PATCH AND FILL ALL PENETRATIONS/HOLES IN WALLS OF TR ROOMS TO MAINTAIN WALL RATINGS.

KEY NOTES:

1 REMOVE EXISTING FLOOR FINISH AND BASE.
2 DEMOLISH EXISTING METAL STUD AND GYP BD WALL.
3 REMOVE EXISTING ACT CEILING, INCLUDING ELEC AND MECH FIXTURES.
4 DEMOLISH EXISTING DOOR AND FRAME METAL STUD AND GYP BD WALL.
5 EXISTING EXPOSED CEILING.
6 REMOVE EXISTING SIGNAGE AND TURN OVER TO VA.

KEY NOTES:

1 ROOM TO RECEIVE NEW FINISHES WALLS AND FLOORS, SEE ROOM FINISH SCHEDULE ON SHEET A-005.
2 NEW ROOM SIGNAGE, REF TO A-005 FOR REQUIREMENTS.
3 NEW CARD READER, REFER TO TECHNOLOGY DRAWINGS.
4 ALIGN WALLS.
5 PROVIDE 4'X8'X3/4" FIRE RETARDANT TREATED AC GRADE PLYWOOD BACK BOARDS IN TELECOM ROOMS. PLYWOOD SHALL BE MOUNTED WITH A-SIDE OUT AND PAINTED WITH (3 COATS TOTAL) OF FIRE RESISTANT PAINT ON ALL SIDES PRIOR TO MOUNTING, AND SHALL MATCH PJ COLOR. MASK OVER FIRE RETARDANT SEAL ON PLYWOOD BEFORE PAINTING TO ALLOW INSPECTION OF FIRE RATING SEAL. ALL DRYWALL SURROUNDING WALLS TO BE PAINTED WITH STANDARD PAINT P-1 TO MATCH PLYWOOD COLOR.
6 NEW FINISHES TO MATCH EXISTING - PAINT AND RUBBER BASE. MODIFY FLOORING AS NECESSARY.
7 EXTEND EXISTING WALL TO UNDERSIDE OF DECK ABOVE (APPROX. 8'-0" TO 11'-0") WITH WALL TYPE Mas1, SEE SHEET A-002. SEAL ALL PENETRATIONS AND EXISTING VOIDS.
8 EXPOSED CEILING.
9 AT NEW DOOR, EXTEND STATIC DISSIPATIVE TILE FROM ROOM INTO CORRIDOR TO EXISTING FLOORING.

KEY PLAN

SCALE: NO SCALE

AREA OF WORK



WALL RATING LEGEND

1 HR - FIRE SEPARATION
2 HR - FIRE SEPARATION
SMOKE RESISTIVE HAZARDOUS AREA

FULLY SPRINKLERED

100% CONSTRUCTION DOCUMENTS

#	Revisions	Date

CONSULTANTS:

5/23/2026

PROJECT MANAGER
ACG Project Number 20-398

APOGEE Engineers | Architects
© COPYRIGHT Apogee Consulting Group, P.A.

Headquarters
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420

Office of Construction and Facilities Management
VA U.S. Department of Veterans Affairs

Drawing Title: ENLARGED PLANS, BUILDING 7, THIRD FLOOR, TELECOM ROOM 3M4

Project Title: ELECTRONIC HEALTH RECORD MODERNIZATION (EHRM)

VA PROJECT NUMBER: 502-21-222

Building Number: # 7

Location: ALEXANDRIA VA HEALTH CARE SYSTEM
2495 SHREVEPORT HWY, 71N
PINEVILLE, LA 71360

Approved

Date: MARCH 24, 2026 | Checked: WVS | Drawn: MEL

Drawing Number: 007.A-410

Dwg. 31 of 51

C:\Users\mel\Documents\A_20-398_VA Alexandria EHRM_BRG_07_mel.RVT 3/5/2026 2:03:01 PM

VA FORM 08-6231

Docusign Envelope ID: 1F1A1E81-2E6F-644-A0A-966C-7B5FF75DEEA5

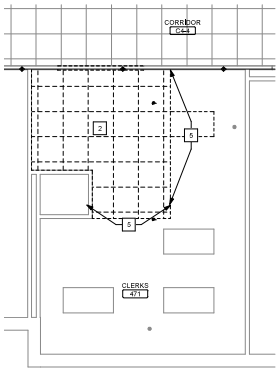

FOURTH FLOOR REFLECTED CEILING DEMOLITION PLAN
Scale: 1/4" = 1'-0"

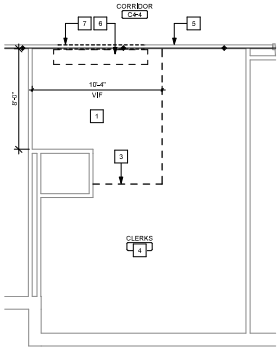

FOURTH FLOOR DEMOLITION PLAN
Scale: 1/4" = 1'-0"

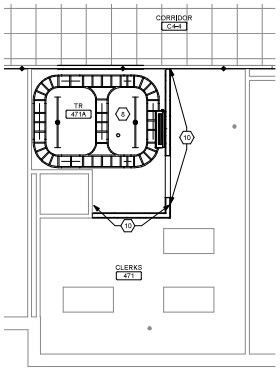

FOURTH FLOOR CEILING PLAN
Scale: 1/4" = 1'-0"

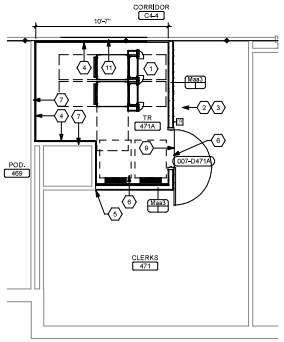

FOURTH FLOOR PLAN
Scale: 1/4" = 1'-0"

SHEET NOTES:

A. ALL EXISTING CONDITIONS ARE BASED ON BEST AVAILABLE INFORMATION AT THE TIME OF SURVEY AND VISUAL INSPECTION. CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS.

B. ELEMENTS SHOWN WITH LIGHT, GRAY LINES ARE EXISTING TO REMAIN. ELEMENTS SHOWN WITH DARK DASHED LINES ARE EXISTING TO BE DEMOLISHED. DEMOLITION SHALL INCLUDE, BUT NOT BE LIMITED TO, THOSE ELEMENTS SHOWN.

C. ALL WORK SHALL BE COORDINATED BETWEEN TRADES.

D. ALL WORK SHALL BE COORDINATED WITH THE COR TO MINIMIZE DISRUPTION OF AREAS OUTSIDE OF THE PROJECT LIMITS OF WORK.

E. ALL CEILING DEMOLITION WORK TO BE COORDINATED WITH CHANGE OF EXISTING PENDANT SPRINKLER HEADS WITH NEW UPRIGHT SPRINKLERS SUCH THAT THERE IS NO EXTENDED LOSS OF SPRINKLER PROTECTION IN THE CONSTRUCTION AREA.

F. FOR FINISHES IN ALL NEW TR ROOMS - SEE ROOM FINISH SCHEDULE SHEET A-005.

G. ALL NEW TR ROOMS TO HAVE CARBON DIOXIDE EXTINGUISHER WITHIN 75' OF ROOM. SEE OVERALL OR ENLARGED PLANS FOR LOCATIONS.

H. PATCH AND FILL ALL PENETRATIONS/HOLES IN WALLS OF TR ROOMS TO MAINTAIN WALL RATINGS.

KEY NOTES:

1 REMOVE EXISTING FLOOR FINISH AND BASE.
2 REMOVE EXISTING ACT CEILING, INCLUDING ELEC AND MECH FIXTURES.
3 FINISH FLOORING CUT LINE. PREP AREA TO RECEIVE NEW FLOORING.
4 EXISTING FLOOR FINISH TO REMAIN.
5 REMOVE PORTION OF EXISTING ACT TILE. COORDINATE WITH NEW.
6 DEMOLISH EXISTING FIRE DOOR ALONG WITH ALL ASSOCIATED CONTROLS.
7 DEMOLISH ALL WOOD TRIM AND CONSTRUCTION IN THE 6'-8" WIDE X 3'-10" OPENING.

KEY NOTES:

1 ROOM TO RECEIVE NEW FINISHES WALLS AND FLOORS. SEE ROOM FINISH SCHEDULE ON SHEET A-005.
2 NEW CARD READER. REFER TO TECHNOLOGY DRAWINGS.
3 NEW ROOM SIGNAGE. REF TO A-005 FOR REQUIREMENTS.
4 PROVIDE 4'X8'X3/4" FIRE RETARDANT TREATED AC GRADE PLYWOOD BACK BOARDS IN TELECOM ROOMS. PLYWOOD SHALL BE MOUNTED WITH A+B/E CUT AND PAINTED WITH (3 COATS TOTAL) OF FIRE RESISTANT PAINT ON ALL SIDES PRIOR TO MOUNTING, AND SHALL MATCH P-2 COLOR. MASK OVER FIRE RETARDANT SEAL ON PLYWOOD BEFORE PAINTING TO ALLOW INSPECTION OF FIRE RATING SEAL. ALL DRYWALL SURROUNDING WALLS TO BE PAINTED WITH STANDARD PAINT P-1 TO MATCH PLYWOOD COLOR.
5 ALIGN WALLS.
6 NEW FINISHES TO MATCH EXISTING - PAINT AND RUBBER BASE. MODIFY FLOORING AS NECESSARY.
7 EXTEND EXISTING WALL TO UNDERSIDE OF DECK ABOVE (APPROX. 8'-0" TO 11'-0") WITH WALL TYPE Mas3_ SEE SHEET A-002. SEAL ALL PENETRATIONS AND EXISTING VOIDS.
8 EXPOSED CEILING.
9 AT NEW DOOR, EXTEND STATIC DISSIPATIVE TILE FROM ROOM INTO CORRIDOR TO EXISTING FLOORING.
10 NEW CEILING TRACK WALL ANGLE. CUT EXISTING TILE TO FIT NEW LENGTH AND REINSTALL.
11 INFILL OPENING WITH PARTITION TYPE Mas3.

KEY PLAN

SCALE: NO SCALE

AREA OF WORK



WALL RATING LEGEND

1 HR - FIRE SEPARATION
2 HR - FIRE SEPARATION
SMOKE RESISTIVE HAZARDOUS AREA

FULLY SPRINKLERED

100% CONSTRUCTION DOCUMENTS

#	Revisions	Date

CONSULTANTS:

3/23/2026

PROJECT MANAGER

ACG Project Number: 20-398

APOGEE
Engineers | Architects
Headquarters:
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420

© COPYRIGHT Apogee Consulting Group, P.A.

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: ENLARGED PLANS, BUILDING 7, FOURTH FLOOR, TELECOM ROOM 471A

Project Title: ELECTRONIC HEALTH RECORD MODERNIZATION (EHRM)

VA PROJECT NUMBER: 502-21-222

Building Number: # 7

Location: ALEXANDRIA VA HEALTH CARE SYSTEM
2495 SHREVEPORT HWY, 71N
PINEVILLE, LA 71360

Approved

Date: MARCH 24, 2026 | Checked: WVS | Drawn: MEL

Drawing Number: 007.A-411

Dwg. 32 of 51

C:\Users\mel\Documents\R_20-398_VA Alexandria EHRM_BRG_07_mel.RVT 3/19/2026 2:03:01 PM

VA FORM 08-6231

Docusign Envelope ID: 1F1A1E71-2E6F-444A-966C-7B5FF75DEEA5

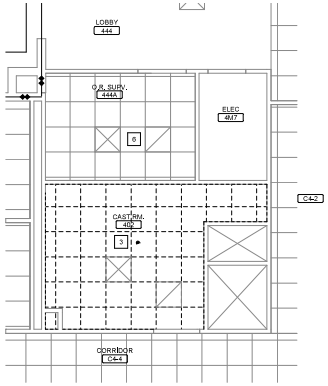

FOURTH FLOOR REFLECTED CEILING DEMOLITION PLAN
Scale: 1/4" = 1'-0"

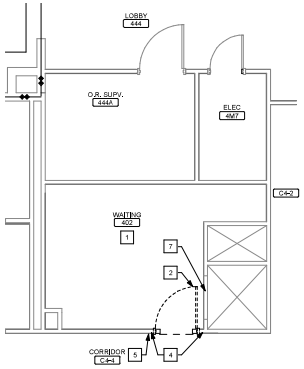

DEMOLITON FLOOR PLAN
Scale: 1/4" = 1'-0"

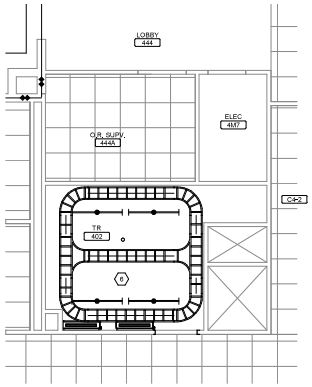

FOURTH FLOOR CEILING PLAN
Scale: 1/4" = 1'-0"

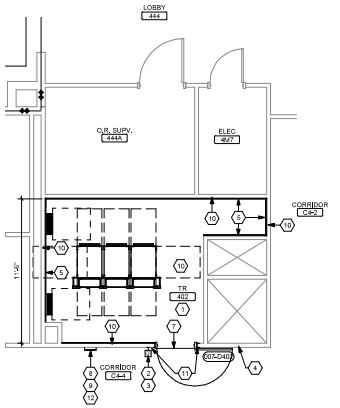

FOURTH FLOOR PLAN
Scale: 1/4" = 1'-0"

SHEET NOTES:

A. ALL EXISTING CONDITIONS ARE BASED ON BEST AVAILABLE INFORMATION AT THE TIME OF SURVEY AND VISUAL INSPECTION. CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS.

B. ELEMENTS SHOWN WITH LIGHT, GRAY LINES ARE EXISTING TO REMAIN. ELEMENTS SHOWN WITH DARK DASHED LINES ARE EXISTING TO BE DEMOLISHED. DEMOLITION SHALL INCLUDE, BUT NOT BE LIMITED TO, THOSE ELEMENTS SHOWN.

C. ALL WORK SHALL BE COORDINATED BETWEEN TRADES.

D. ALL WORK SHALL BE COORDINATED WITH THE COR TO MINIMIZE DISRUPTION OF AREAS OUTSIDE OF THE PROJECT LIMITS OF WORK.

E. ALL CEILING DEMOLITION WORK TO BE COORDINATED WITH CHANGE OF EXISTING PENDANT SPRINKLER HEADS WITH NEW UPRIGHT SPRINKLERS SUCH THAT THERE IS NO EXTENDED LOSS OF SPRINKLER PROTECTION IN THE CONSTRUCTION AREA.

F. FOR FINISHES IN ALL NEW TR ROOMS - SEE ROOM FINISH SCHEDULE SHEET A-005.

G. ALL NEW TR ROOMS TO HAVE CARBON DIOXIDE EXTINGUISHER WITHIN 75' OF ROOM. SEE OVERALL OR ENLARGED PLANS FOR LOCATIONS.

H. PATCH AND FILL ALL PENETRATIONS/HOLES IN WALLS OF TR ROOMS TO MAINTAIN WALL RATINGS.

KEY NOTES:

1. REMOVE EXISTING FLOOR FINISH AND BASE.
2. DEMOLISH EXISTING DOOR AND FRAME METAL STUD AND GYP BD WALL.
3. REMOVE EXISTING ACT CEILING, INCLUDING ELEC AND MECH FIXTURES.
4. CUT BACK EXISTING BUMPER RAIL, HANDRAIL, AND WALL PROTECTION 12" AWAY FRO EDGE OF EXISTING DOOR FRAME AND REINSTALL EDGE AND GUARD RETURNS.
5. REMOVE EXISTING SIGNAGE AND TURN OVER TO VA.
6. SEE MECHANICAL DRAWINGS FOR ABOVE CEILING WORK. FOLLOW ICRA MEASURES ON SHEET G-004.
7. EXISTING ACCESS PANEL TO REMAIN.

KEY NOTES:

1. ROOM TO RECEIVE NEW FINISHES WALLS AND FLOORS. SEE ROOM FINISH SCHEDULE ON SHEET A-005.
2. NEW ROOM SIGNAGE. REF TO A-005 FOR REQUIREMENTS.
3. NEW CARD READER, REFER TO TECHNOLOGY DRAWINGS.
4. NEW FINISHES TO MATCH EXISTING - PAINT AND RUBBER BASE, MODIFY FLOORING AS NECESSARY.
5. PROVIDE 4'X8'X3/4" FIRE RETARDANT TREATED AC GRADE PLYWOOD BACK BOARDS IN TELECOM ROOMS. PLYWOOD SHALL BE MOUNTED WITH A-SIDE OUT AND PAINTED WITH (3 COATS TOTAL) OF FIRE RESISTANT PAINT ON ALL SIDES PRIOR TO MOUNTING, AND SHALL MATCH P-2 COLOR. MASK OVER FIRE RETARDANT SEAL ON PLYWOOD BEFORE PAINTING TO ALLOW INSPECTION OF FIRE RATING SEAL. ALL DRYWALL SURROUNDING WALLS TO BE PAINTED WITH STANDARD PAINT P-1 TO MATCH PLYWOOD COLOR.
6. EXPOSED CEILING.
7. AT NEW DOOR, EXTEND STATIC DISSIPATIVE TILE FROM ROOM INTO CORRIDOR TO EXISTING FLOORING.
8. INSTALL NEW SEMI RECESSED FIRE EXTINGUISHER CABINET.
9. NEW FIRE EXTINGUISHER SIGNAGE ABOVE FIRE EXTINGUISHER CABINET, REF TO A-005 FOR REQUIREMENTS.
10. EXTEND EXISTING WALL TO UNDERSIDE OF DECK ABOVE (APPROX. 6'-0" TO 11'-0") WITH WALL TYPE Mak3, SEE SHEET A-002. SEAL ALL PENETRATIONS AND EXISTING VOIDS.
11. INSTALL NEW HANDRAIL/RETURNS. COLOR TO MATCH EXISTING.
12. INSTALL NEW FIRE EXTINGUISHER.

KEY PLAN

SCALE: NO SCALE

AREA OF WORK



WALL RATING LEGEND

1 HR - FIRE SEPARATION

2 HR - FIRE SEPARATION

SMOKE RESISTIVE HAZARDOUS AREA

FULLY SPRINKLERED

100% CONSTRUCTION DOCUMENTS

#	Revisions:	Date

CONSULTANTS:

5/23/2026

PROJECT MANAGER

APOGEE Engineers | Architects

© COPYRIGHT Apogee Consulting Group, P.A.

Headquarters:
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420

ACG Project Number: 20-398

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: ENLARGED PLANS, BUILDING 7, FOURTH FLOOR, TELECOM ROOM 402

Location: ALEXANDRIA VA HEALTH CARE SYSTEM, 2495 SHREVEPORT HWY, 71N, PINEVILLE, LA 71360

Project Title: ELECTRONIC HEALTH RECORD MODERNIZATION (EHRM)

VA PROJECT NUMBER: 502-21-222

Building Number: # 7

Approved

Date: MARCH 24, 2026 | Checked: WVS | Drawn: MEL

Drawing Number: 007.A-412

Dwg. 33 of 51

C:\Users\mel\Documents\A_20-398_VA Alexandria EHRM_BRG_07_mel4PC-BB.rvt
3/5/2026 2:00:01 PM
VA FORM 08-6231