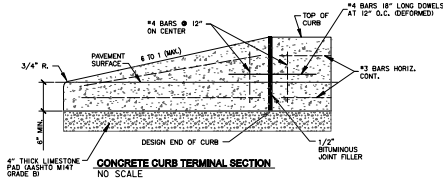

CONCRETE CURB TERMINAL SECTION
NO SCALE



CONCRETE VERTICAL CURB

NOTES:

1. ALL CONCRETE CURBS AND TRANSITIONS, SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 4000 PSI.
2. MAXIMUM SPACING ON SCORED JOINTS SHALL BE 15'.
3. 1/2" THICK EXPANSION JOINTS SHALL BE LOCATED AT TANGENT POINTS IN CURB RETURNS, TRANSITIONS, AND AT A MAXIMUM OF 60' INTERVALS. EXPANSION MATERIAL SHALL ALSO BE PLACED BETWEEN CURBS AND ADJACENT STRUCTURES, SIDEWALKS, DRIVEWAYS AND CURB ACCESS RAMPS. THE 1/2" JOINT FILLER SHALL EXTEND THE FULL DEPTH OF THE CONCRETE.
4. CONCRETE SHALL BE FINISHED WITH A STEEL TROWEL FOLLOWED BY BRUSHING WITH A FINE BRUSH ALONG THE LENGTH OF THE CURB OR CURB AND GUTTER.
5. SINGLE CURB MAY BE CONSTRUCTED BY THE USE OF FORMS OR MAY BE SLIP FORMED.
6. ALL EXPOSED EDGES AND HAND TOOLED JOINTS SHALL BE FINISHED WITH A TOOL HAVING A 1/4" RADIUS UNLESS A LARGER RADIUS IS INDICATED BY THE APPLICABLE STANDARD DETAIL OR PROJECT PLANS.
7. FOR REVEALS OF 6" TO LESS THAN 8".
8. FOR REVEALS OF 8" TO 10".

CONCRETE CURB AND TERMINAL SECTION
NO SCALE

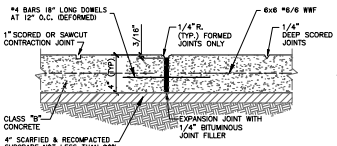

EXPANSION AND SCORED JOINT DETAIL
NO SCALE



TYPICAL SECTION
NO SCALE

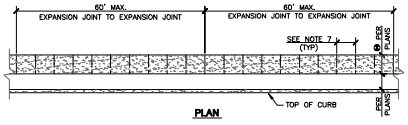

PLAN

NOTES:

1. EXPANSION JOINTS SHALL BE LOCATED WHERE SIDEWALK ABUTS CONCRETE DRIVEWAYS, CURB OR OTHER ADJACENT STRUCTURES.
2. ONE-HALF INCH BITUMINOUS JOINT FILLER SHALL BE INSTALLED AT EXPANSION JOINT LOCATIONS AND SHALL EXTEND THE FULL DEPTH OF THE CONCRETE.
3. 1" DEEP CONTRACTION JOINTS SHALL BE PLACED AT INTERVALS OF APPROXIMATELY 15' OR AT A SPACING THAT MATCHES THE ADJACENT CURB.
4. FORMED CONTRACTION JOINTS SHALL BE FINISHED WITH A TOOL HAVING A 1/4" RADIUS.
5. SCORED JOINTS SHALL BE 1/4" DEEP AND PLACED AT THE SPACING INDICATED FOR THE WIDTH OF SIDEWALK OR MATCH SCORED JOINTS OF ADJACENT CURB.
6. CONCRETE SHALL BE FINISHED BY MEANS OF A FLOAT, STEEL TROWELLED AND BROOMED WITH A FINE BRUSH IN A TRANSVERSE DIRECTION.
7. 1/4" DEEP SCORED JOINTS (TYP) SPACED AT 6' OR EQUAL TO SIDEWALK WIDTH.

CONCRETE SIDEWALK
NO SCALE

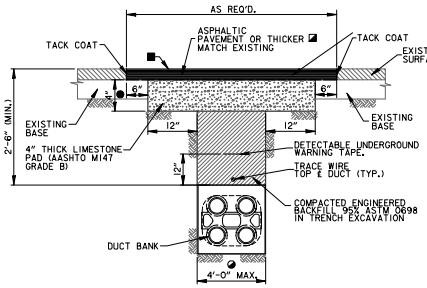

ASPHALT DRIVE OR ASPHALT ROAD REPAIR DETAIL
NO SCALE

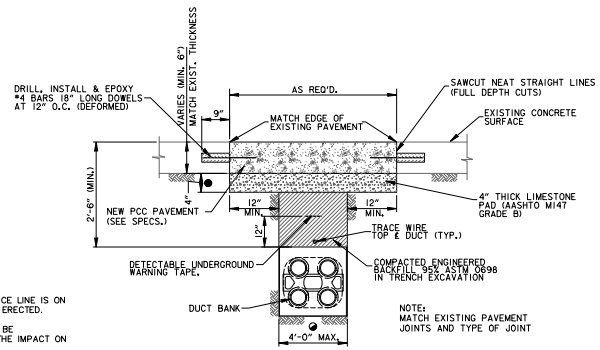

CONCRETE DRIVE OR CONCRETE ROAD REPAIR DETAIL
NO SCALE

◐ FOR TRENCH WIDTHS EXCEEDING 4' REFER TO VA STANDARD DETAIL 32 12 16-02 "TYPE 2 UTILITY TRENCH PATCH". FOR TRENCH WHERE PORTLAND CEMENT CONCRETE (PCC) PAVEMENT EXISTS, REFER TO 32 12 16-03 "TYPE 3 UTILITY TRENCH PATCH".

◪ 2" MINIMUM OR THICKNESS OF EXISTING PAVEMENT WHICHEVER IS GREATER.

■ BITUMINOUS SURFACE TREATMENT (CHIPSEAL) REQUIRED ONLY FOR LONGITUDINAL TRENCHES WITH WIDTHS GREATER THAN 6'.

● 4" MINIMUM ABC OR THICKNESS OF EXISTING GRANULAR BASE COURSE MATERIALS (E.G. ABC & SELECT MATERIAL) WHICHEVER IS GREATER.

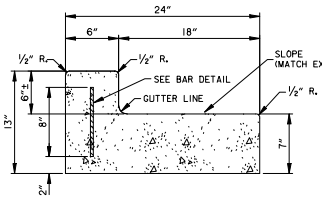

6" MONOLITHIC BARRIER TYPE CURB and GUTTER DETAIL
NO SCALE



BAR DETAILS
NO SCALE

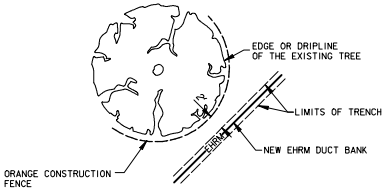

PLAN VIEW - TREE PROTECTION DETAIL
NO SCALE

NOTES:

1. INSTALL NEW TREE CONSTRUCTION FENCE ON THE OUTSIDE LIMITS OF THE TREES CANOPY OR DRIPLINE WHEN THE NEW EHRM DUCT BANK IS WITHIN 2' OF THE TREES DRIPLINE.
2. EXISTING PINE TREES DO NOT NEED TO BE PROTECTED WITH CONSTRUCTION FENCING. IF EXISTING PINE TREES ARE DAMANGED BY THE CONTRACTOR, THE CONTRACTOR WILL REMOVE THE TREE AT NO ADDITIONAL COST TO THE OWNER.
3. IN AREAS WHERE THE NEW DUCTBANK IS BEING INSTALLED UNDER TREE CANOPYS, THE CONSTRUCTION FENCE SHALL BE PLACED 2' FROM THE THE OUTSIDE EDGE OF THE DUCTBANK TRENCH.

TREE PRESERVATION NOTES

1. ROOT PRUNING IS SUBSIDIARY TO OTHER BID ITEMS.
2. ROOT PRUNING SHOULD BE COORDINATED WITH THE TREE PROTECTION FENCING. IN SOME CASES, THAT FENCE LINE IS ON THE ROOT CUT, AND PROVISIONS FOR ROOT PRUNING MAY NEED TO BE ACCOMMODATED BEFORE FENCE IS ERECTED.
3. CAREFULLY EXPOSE ROOTS WITHIN THE LIMITS OF CONSTRUCTION AND MARK FOR PRUNING. THE VA SHALL BE CONTACTED TO REVIEW PROPOSED ROOTS PRIOR TO TRENCHING, EXCAVATION, OR CUTTING TO DETERMINE THE IMPACT ON ANY STRUCTURAL CRITICAL ROOTS AND THE CLOSEST POINT TO TREES THAT SOIL MAY BE DISTURBED.
4. ROOT PRUNING CAN BE ACCOMPLISHED WITH CIRCULAR SAWS OF VARYING TYPES AND/OR A ROTARY TYPE STUMP GRINDER TO A DEPTH OF 18" OR TO THE MAXIMUM DEPTH OF THE REQUIRED GRADING CUT, WHICHEVER IS LESS. SAW BLADE AND GRINDER TEETH MUST BE SHARPENED AND CLEANED PRIOR TO USE. TRENCHING MACHINES ARE NOT ALLOWED IN ROOT PRUNING OPERATIONS.
5. ROOTS OVER 1 INCH IN DIAMETER MUST BE CLEANLY AND SHARPLY CUT WITH A HAND SAW.
6. PRUNING CUTS SHALL BE FLUSH WITH THE SIDE OF THE TRENCH CLOSEST TO THE TREE.
7. THE VA SHALL BE CALLED TO REVIEW ANY ROOTS OVER 2 INCHES IN DIAMETER ENCOUNTERED DURING EXCAVATION AND/OR CONSTRUCTION ACTIVITIES TO DETERMINE STRUCTURAL STABILITY OF THE TREE.

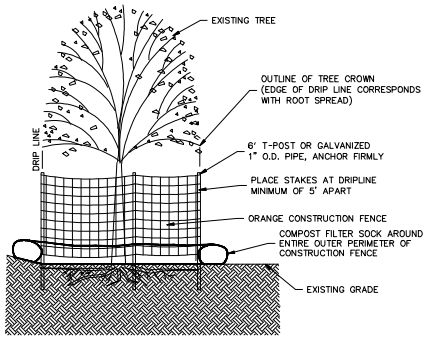

TREE PRESERVATION NOTES

1. GRADING AROUND TREES TO BE LIMITED TO OUTSIDE THE DRIPLINE UNLESS OTHERWISE NOTED ON THESE PLANS.
2. THERE SHALL BE NO GRADING OR FILLING WITHIN THE PROTECTED CRITICAL ROOT ZONES OF PROTECTED TREES UNLESS OTHERWISE NOTED ON THESE PLANS.
3. NO VEHICLES OR EQUIPMENT SHALL BE DRIVEN OR PARKED UNDER THE DRIPLINE OF PROTECTED TREES. NO MATERIALS SHALL BE STORED UNDER THE DRIPLINE OF PROTECTED TREES.
4. TREE FENCE AND SILT FENCE FOR ALL PROTECTED TREES MUST BE PROPERLY MAINTAINED THROUGHOUT CONSTRUCTION.
5. ALL REQUIRED TREE, SILT FENCING, AND COMPOST FILTER SOCK SHALL REMAIN IN PLACE UNTIL ALL GRADING AND LANDSCAPING ACTIVITIES HAVE CEASED AND SHALL ONLY BE REMOVED UPON THE REVIEW AND APPROVAL BY THE ENGINEER OR LANDSCAPE ARCHITECT.
6. ATTACHMENTS (WIRES, FENCES, ETC.) OTHER THAN THOSE APPROVED FOR GUYING, BRACING, OR WRAPPING MUST NOT BE ATTACHED TO PROTECTED TREES.

TREE PROTECTION DETAIL
NO SCALE

SHEET NOTES:

1. CONTRACTOR SHALL COORDINATE ALL WORK WITH THE VA HOSPITAL ENGINEERING OFFICE.
2. ALL ASPHALT ROADWAYS AND PARKING AREAS SHALL BE OPEN CUT AND RESTORED TO ORIGINAL CONDITIONS.
3. ALL CONCRETE SIDEWALKS AND SURFACES SHALL BE OPEN CUT AND RESTORED TO ORIGINAL CONDITIONS.

KEY PLAN
SCALE: NO SCALE

NORTH

SHEET LAYOUT
AREA OF WORK



THE LOCATION OF EXISTING UNDERGROUND UTILITIES ARE SHOWN ARE APPROX. THE CONTRACTOR SHALL DETERMINE THE EXACT LOCATION OF ALL EXIST. UNDERGROUND UTILITIES BEFORE COMMENCING WORK. THE CONTRACTOR WILL BE FULLY RESPONSIBLE FOR ANY AND ALL DAMAGES WHICH MIGHT OCCASIONED DUE TO HIS FAILURE TO EXACTLY LOCATE AND PRESERVE ANY AND ALL UNDERGROUND UTILITIES.

CALL LOUISIANA ONE CALL - JUST DIAL 811

FULLY SPRINKLERED

100% CONSTRUCTION DOCUMENTS

#	Revisions:	Date

CONSULTANTS:

Ballard CLC, Inc.
Architects • Engineers • Surveyors
1009 Bayou Place
Alexandria, LA 71303
Tel. (318) 445-4271 Fax. (318) 448-0257

STATE OF LOUISIANA
A. BRYAN BUTLER
REG. NO. 27015
REGISTERED PROFESSIONAL ENGINEER
CIVIL ENGINEERING
03-24-2026

PROJECT MANAGER
ACS Project Number: 20-398

APOGEE
Engineers | Architects
© COPYRIGHT Apogee Consulting Group, P.A.

Headquarters:
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420

Office of Construction and Facilities Management
VA U.S. Department of Veterans Affairs

Drawing Title: MISC. SITE DETAILS	Project Title: ELECTRONIC HEALTH RECORD MODERNIZATION (EHRM)		VA PROJECT NUMBER: 502-21-222
			Building Number: #
Location: VA ALEXANDRIA HEALTH CARE SYSTEM, 2495 SHREVEPORT HWY, 71N, PINEVILLE, LA, 71360	Approved		Drawing Number: C-501
	Date: MARCH 24, 2026	Checked: BCLC	Drawn: BCLC

Dwg. 17 of 18

File Path

4/10/2026 9:26:03 AM

VA FORM 08-6231

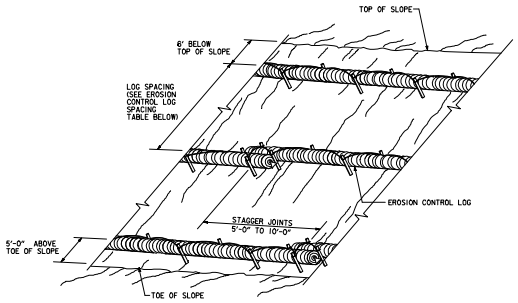

EROSION CONTROL LOGS ON SLOPES
STAKE AND LASHING ANCHORING
NO SCALE

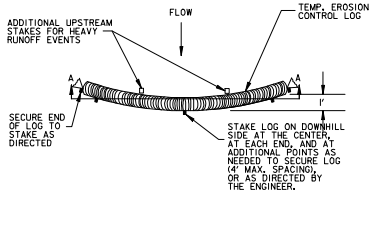

PLAN VIEW

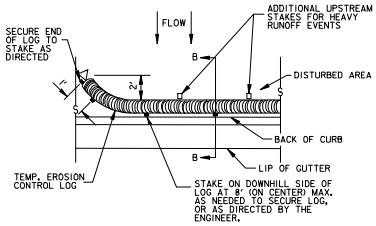

PLAN VIEW

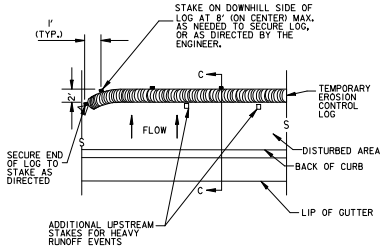

PLAN VIEW

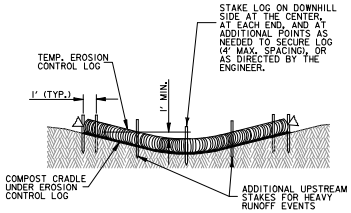

SECTION A-A
EROSION CONTROL LOG AT DAM
NO SCALE



SECTION B-B
EROSION CONTROL LOG AT BACK OF CURB
NO SCALE

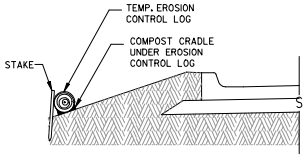

SECTION C-C
EROSION CONTROL LOG AT AWAY FROM CURB
NO SCALE

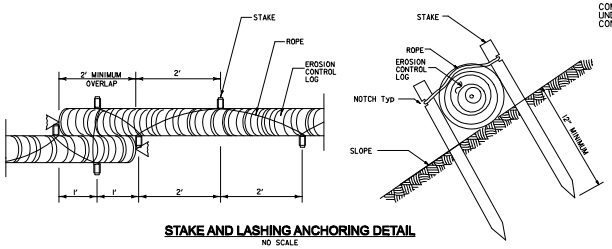

STAKE AND LASHING ANCHORING DETAIL
NO SCALE

EROSION CONTROL LOG SPACING TABLE				
SLOPE	LOG DIAMETER			
	6"	8"	12"	18"
1:1 OR STEEPER	5'	10'	15'	20'
2:1	10'	20'	30'	40'
3:1	15'	30'	45'	60'
4:1 OR FLATTER	20'	40'	60'	80'

* ADJUSTMENTS CAN BE MADE FOR SOIL TYPE; SOFT, LOAMY SOILS-ADJUST ROWS CLOSER TOGETHER; HARD, ROCKY SOILS- ADJUST ROWS FARTHER APART

GENERAL NOTES:

1. EROSION CONTROL LOGS SHALL BE INSTALLED IN ACCORDANCE WITH MANFACTURER'S RECOMMENDATIONS, OR AS DIRECTED BY THE ENGINEER.
2. LENGTHS OF EROSION CONTROL LOGS SHALL BE IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS AND AS REQUIRED FOR THE PURPOSE INTENDED.
3. UNLESS OTHERWISE DIRECTED, USE BIODEGRADABLE OR PHOTODEGRADABLE CONTAINMENT MESH ONLY WHERE LOG WILL REMAIN IN PLACE AS PART OF A VEGETATIVE SYSTEM. FOR TEMPORARY INSTALLATIONS, USE RECYCLABLE CONTAINMENT MESH.
4. FILL LOGS WITH SUFFICIENT FILTER MATERIAL TO ACHIEVE THE MINIMUM COMPACTED DIAMETER SPECIFIED IN THE PLANS WITHOUT EXCESSIVE DEFORMATION.
5. STAKES SHALL BE 2" X 2" WOOD OR #3 REBAR, 2'-4' LONG, EMBEDDED SUCH THAT 2" PROTRUDES ABOVE LOG, OR AS DIRECTED BY THE ENGINEER.
6. DO NOT PLACE STAKES THROUGH CONTAINMENT MESH.
7. EROSION CONTROL MEASURES ARE INCIDENTAL & WILL NOT BE PAID FOR SEPARATELY.
8. SANDBAGS USED AS ANCHORS SHALL BE PLACED ON TOP OF LOGS & SHALL BE OF SUFFICIENT SIZE TO HOLD LOGS IN PLACE.
9. TURN THE ENDS OF EACH ROW OF LOGS UPSLOPE TO PREVENT RUNOFF FROM FLOWING AROUND THE LOG.
10. FOR HEAVY RUNOFF EVENTS, ADDITIONAL UPSTREAM STAKES MAY BE NECESSARY TO KEEP LOG FROM FOLDING IN ON ITSELF.

SHEET NOTES:

1. CONTRACTOR SHALL COORDINATE ALL WORK WITH THE VA HOSPITAL ENGINEERING OFFICE.
2. ALL ASPHALT ROADWAYS AND PARKING AREAS SHALL BE OPEN CUT AND RESTORED TO ORIGINAL CONDITIONS.
3. ALL CONCRETE SIDEWALKS AND SURFACES SHALL BE OPEN CUT AND RESTORED TO ORIGINAL CONDITIONS.

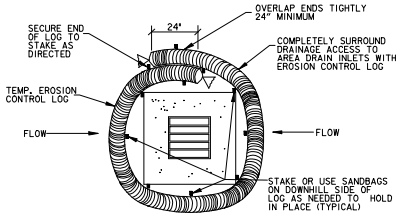

EROSION CONTROL LOG AT DROP INLET
NO SCALE

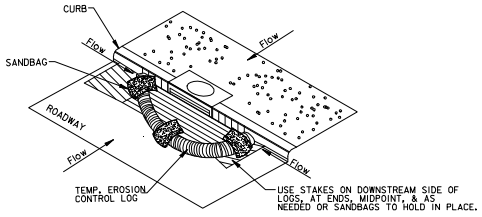

EROSION CONTROL LOG AT CURB INLET
NO SCALE

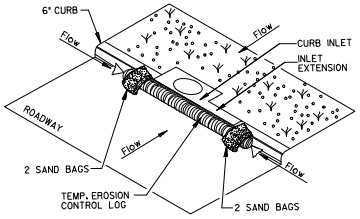

EROSION CONTROL LOG AT CURB INLET
NO SCALE

NOTE:
EROSION CONTROL LOGS USED AT CURB INLETS SHOULD ONLY BE USED IF THEY WILL NOT IMPEDE TRAFFIC OR FLOOD THE ROADWAY OR WHEN THE STORM SEWER SYSTEM IS NOT FULLY FUNCTIONAL.

FULLY SPRINKLERED

100% CONSTRUCTION DOCUMENTS

#	Revisions:	Date

CONSULTANTS:

Ballard CLC, Inc.
Architects • Engineers • Surveyors
1009 Bayou Place
Alexandria, LA 71303
Tel. (318) 445-6271 Fax. (318) 448-0257

STATE OF LOUISIANA
A. BRYAN BUTLER
REG. NO. 27015
REGISTERED PROFESSIONAL ENGINEER
CIVIL ENGINEERING
03-24-2026

PROJECT MANAGER
ACS Project Number 20-398

APOGEE
Engineers | Architects
© COPYRIGHT Apogee Consulting Group, P.A.

Headquarters:
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420

Office of Construction and Facilities Management
VA U.S. Department of Veterans Affairs

Drawing Title: EROSION CONTROL DETAILS

Project Title: ELECTRONIC HEALTH RECORD MODERNIZATION (EHRM)

VA PROJECT NUMBER: 502-21-222

Building Number: #

Location: VA ALEXANDRIA HEALTH CARE SYSTEM
2495 SHREVEPORT HWY, 71N
PINEVILLE, LA, 71360

Approved

Date: MARCH 24, 2026 | Checked: BCLC | Drawn: BCLC

Drawing Number: C-502

Dwg. 18 of 18

File Path
4/13/2026 9:26:03 AM
VA FORM 08-6231

Docusign Envelope ID: 1F A1697-2B6F-44-A0-980C-7B95F750EEA5

ARCHITECTURAL SYMBOL LEGEND

- TYPICAL KEYNOTE
- DEMOLITION KEYNOTE
- DOOR NUMBER
- CEILING/ SOFFIT HEIGHT (MATL 1-0)
- WINDOW TYPE

ABBREVIATIONS

AFF	ABOVE FINISHED FLOOR	FD	FLOOR DRAIN	PEB	PRE-ENGINEERED BUILDING
ACP/APC	ACOUSTIC CEILING PANEL/ ACOUSTIC PANEL CEILING	FE	FIRE EXTINGUISHER	PJF	PREFORMED JOINT FILLER
		FFE	FINISH FLOOR ELEVATION	PT	PRESSURE TREATED
ACT	ACOUSTICAL/ TILE	FV	FIELD VERIFY	PERIM	PERIMETER
ADJ	ADJUSTABLE	FEC	FIRE EXTINGUISHER CABINET	PL	PLATE
ADT'L	ADDITIONAL	FDN	FOUNDATION	PLAM	PLASTIC LAMINATE
AGG	AGGREGATE	FIN	FINISH	PLBG	PLUMBING
ALT	ALTERNATE	FLSHG	FLASHING	PLYWD	PLYWOOD
AL	ALUMINUM	FLR	FLOOR	PNT	PAINT
APPROX	APPROXIMATE(LY)	FRMG	FRAMING	PR	PAIR
ASPH	ASPHALT	FT	FOOT/FEET	PTD	PAINTED
AUTO	AUTOMATIC	FTG	FOOTING	PWR	POWER
B/O	BOTTOM OF	GC	GENERAL CONTRACTOR	RB	RUBBER BASE
BD	BOARD	GA	GAUGE	RD	ROOF DRAIN
BLDG	BUILDING	GALV	GALVANIZED	RO	ROUGH OPENING
BLKG	BLOCKING	GEN	GENERAL	RAD	RADIUS
BOT	BOTTOM	GYP	GYPSUM	REC	RECESSED
BRG	BEARING			REINF	REINFORCED
		HM	HOLLOW METAL	REQ'D	REQUIRED
℄	CENTERLINE	HDWR	HARDWARE	REV	REVISED (REVISION)
C/C	CENTER TO CENTER	HOL	HOLLOW	RM	ROOM
CJ	CONTROL JOINT	HOR	HORIZONTAL		
CLL	CONTRACT LIMIT LINE	HT	HEIGHT	S	SOUTH
CEM	CEMENT(ITIOUS)	HVAC	HEATING/VENTILATION/AIR CONDITIONING	SB	SPLASH BLOCK
CMU	CONCRETE MASONRY UNIT			SF	SQUARE FEET
CLG	CEILING			SS	STAINLESS STEEL
CLR	CLEAR	ID	INSIDE DIAMETER	SIM	SIMILAR
COL	COLUMN	IN	INCH	SPEC	SPECIFICATIONS
CONC	CONCRETE	INCL	INCLUDING	SQ	SQUARE
CONST	CONSTRUCTION	INSUL	INSULATION	STD	STANDARD
CONT	CONTINUOUS	INT	INTERIOR	STL	STEEL
CPT	CARPET			STOR	STORAGE
CT	CERAMIC TILE	JAN	JANITOR	STRUCT	STRUCTURAL
CTR	CENTER(ED)	JT	JOINT	SUSP	SUSPENDED
DF	DRINKING FOUNTAIN	LAV	LAVATORY		
DS	DOWNSPOUT	LB(S)	POUND(S)	T&G	TONGUE AND GROOVE
DBL	DOUBLE	LS	LANDSCAPE	T/O	TOP OF
DEG	DEGREE	LT	LIGHT	TELE	TELEPHONE
DEMO	DEMOLITION			TRTD	TREATED
DET/DTL	DETAIL	MO	MASONRY OPENING	TS	TUBE STEEL
DIA	DIAMETER	MAS	MASONRY	TYP	TYPICAL
DIM	DIMENSION	MATL	MATERIAL		
DN	DOWN	MAX	MAXIMUM	UNFIN	UNFINISHED
DWG(S)	DRAWING(S)	MECH	MECHANICAL	UNO	UNLESS NOTED OTHERWISE
		MFR	MANUFACTURER		
E	EAST	MIN	MINIMUM	VCT	VINYL COMPOSITION TILE
EC	ELECTRICAL CONTRACTOR	MISC	MISCELLANEOUS	VIF	VERIFY IN FIELD
EHO	ELECTRICAL HOLD OPEN	MTD	MOUNTED	VERT	VERTICAL
EJ	EXPANSION JOINT	MTL	METAL		
EW	EACH WAY	N	NORTH	W	WEST
EA	EACH	NIC	NOT IN CONTRACT	W/	WITH
EIFS	EXTERIOR INSULATION FINISH SYSTEM	NTS	NOT TO SCALE	W/O	WITHOUT
		NOM	NOMINAL	WC	WATER CLOSET
EL	ELEVATION			WWF	WELDED WIRE FABRIC
ELEC	ELECTRICAL/	OC	ON CENTER	WD	WOOD
ELEV	ELEVATOR	OD	OUTSIDE DIAMETER	WH	WATER HEATER
EMER	EMERGENCY	O TO O	OUT TO OUT	WT	WEIGHT
EQ	EQUAL	OPNG	OPENING		
EQUIP	EQUIPMENT	OPP	OPPOSITE		
EXIST	EXISTING	OVHD	OVERHEAD		
EXT	EXTERIOR				
EWC	ELECTRIC WATER COOLER				

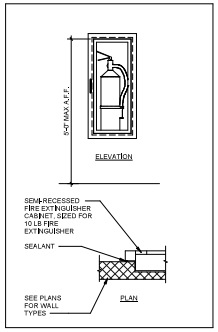

GENERAL NOTES

1. INDICATIONS OF PROJECT LIMITS OR LINES OF DEMARCATION ARE SHOWN FOR GENERAL SCOPE DEFINITION AND REFLECT THE UNDERSTANDING OF THE DESIGNER AS TO THE LIMITATIONS OF THE WORK AREA IN AN OCCUPIED AREA; ACTUAL CONTRACT LIMITS ARE TO BE DETERMINED BY AGREEMENT BETWEEN THE COR AND CONTRACTOR BEFORE THE START OF THE WORK.
2. DRAWINGS ARE PREPARED USING PRODUCT DIMENSIONS AND DETAILS FROM BASIS OF DESIGN PRODUCT. PRODUCTS MAY CHANGE IN DIMENSION AND DETAIL. BEFORE THEY ARE INCORPORATED INTO WORK, PRODUCTS FROM OTHER MANUFACTURERS ARE ALSO ACCEPTABLE. DIMENSIONS AND DETAILS FOR ALTERNATE PRODUCTS MAY VARY FROM BASIS OF DESIGN. CONTRACTOR SHALL VERIFY INSTALLATION REQUIREMENTS FOR ALL PRODUCTS TO BE INCORPORATED INTO WORK (INCLUDING THICKNESS FOR RECESSED OR SEMI-RECESSED PRODUCTS) AND IS RESPONSIBLE FOR ACCOMMODATING AND COORDINATING CHANGES TO OTHER MATERIALS OR PRODUCTS THAT ARE NECESSARY BECAUSE OF THESE DIFFERENCES.
3. THE DRAWINGS AND SPECIFICATIONS ARE SEPARATED INTO DISCIPLINES FOR CONVENIENCE. THE SEPARATIONS ARE USED ONLY FOR THE PURPOSES OF CONVENIENCE AND REFERENCE AND IN NO WAY DO THEY DEFINE OR LIMIT THE SCOPE OR INTENT OF ANY PART OF THE DRAWINGS AND SPECIFICATIONS AS A WHOLE. THE FACT THAT THE DRAWINGS ARE SEPARATED IN NO WAY SUGGESTS THAT THE WORK IS NOT TO BE CONSTRUCTED AS A COMPLETE, INTEGRATED AND UNIFIED WHOLE.
4. THE DRAWINGS AND SPECIFICATIONS, INCLUDING DRAWINGS PREPARED BY SPECIFIC ENGINEERING DISCIPLINES ARE COMPLEMENTARY. ITEMS SHOWN IN ANY ONE LOCATION IN THE DRAWINGS SHALL BE CONSIDERED TO BE REQUIREMENTS OF THE CONTRACT FOR CONSTRUCTION. IN THE EVENT OF AN INCONSISTENCY BETWEEN THE DRAWINGS AND SPECIFICATIONS, OR WITHIN EITHER DOCUMENT, THE CONTRACTOR SHALL SEEK CLARIFICATION OR INTERPRETATION FROM THE COR PRIOR TO BIDDING. WHERE INCONSISTENCIES ARE NOT CLARIFIED PRIOR TO BIDDING, AND WHERE THE ACTUAL SOLUTION OR INTENT CANNOT BE REASONABLY INFERRED, THE CONTRACTOR SHALL PROVIDE THE BETTER QUALITY OR GREATER QUANTITY OF WORK.
5. THE CONTRACTOR SHALL NOTIFY THE COR IMMEDIATELY SHOULD DISCREPANCIES BE FOUND IN THE DRAWINGS AND SPECIFICATIONS.
6. THE CONTRACTOR IS RESPONSIBLE FOR CHECKING ALL FIELD CONDITIONS AND DIMENSIONS AS THEY RELATE TO THIS PROJECT, FOR EACH PHASE. SHOULD DISCREPANCIES EXIST BETWEEN THE WORK INDICATED AND ACTUAL FIELD CONDITIONS, NOTIFY THE COR PRIOR TO PROCEEDING WITH THE WORK.
7. DO NOT SCALE THE DRAWINGS. DRAWING SCALES AS INDICATED ARE FOR REFERENCE ONLY AND ARE NOT INTENDED TO ACCURATELY DEPICT ACTUAL OR DESIGNATED CONDITIONS. WRITTEN DIMENSIONS SHALL GOVERN.
8. PROVIDE SEALANT AT ALL INTERSECTIONS BETWEEN DIFFERENT MATERIALS.
9. COORDINATE WORK OF ALL TRADES PRIOR TO STARTING CONSTRUCTION.
10. REFER TO ALL OTHER TRADE DRAWINGS AND SPECIFICATIONS FOR ADDITIONAL INFORMATION ON THIS PROJECT.
11. PROVIDE BACKING AT PARTITIONS AS REQUIRED FOR MOUNTING OF WALL-MOUNTED ITEMS; PROVIDE SUPPLEMENTAL FRAMING AT WALL OPENINGS INCLUDING KING STUDS, JACK STUDS, AND CRIPPLE STUDS, AS REQUIRED FOR COMPLETION OF THE WORK.
12. DIMENSIONS SHOWN ARE TO FACE OF STUD FRAMING, FACE OF CONCRETE/MASONRY WALLS, OR FINISHED FACE OF EXISTING WALL SURFACE.
13. ALL WOOD IN CONTACT WITH CONCRETE SHALL BE PRESSURE TREATED.
14. GENERAL PARKING IS NOTED ON G-003, FOR LIMITED PARKING NEAR EACH BUILDING COORDINATE WITH COR.
15. REFER TO MP SHEETS FOR NEW SPRINKLER WORK.

DEMOLITION NOTES

1. KEY NOTES AND DRAWINGS ARE INTENDED TO GRAPHICALLY REPRESENT GENERAL WORK AND DO NOT PORTRAY FULL SCOPE OF THE PROJECT. SEE SPECIFICATIONS FOR DETAILED REQUIREMENTS.
2. REMOVE EXISTING CONSTRUCTION AS DESIGNATED HEREIN AND CLEAR AREA OF DEBRIS PRIOR TO PROCEEDING WITH NEW CONSTRUCTION.
3. EXISTING EQUIPMENT REMOVED SHALL BE PROPERLY DISPOSED OF, OFF PROJECT GROUNDS. COORDINATE WITH COR.
4. AT AREAS INDICATED TO BE PATCHED AND REPAIRED, FOR ADDITION AND RENOVATION PROJECTS: THE CONSTRUCTION AND ASSEMBLY OF THE PATCH OR REPAIR SHALL MATCH THE ASSEMBLY AND INTEGRITY OF THE ADJACENT EXISTING CONSTRUCTION, FOR FIRE RATING, MATERIALS, FINISH, THICKNESS, AND QUALITY.
5. COORDINATE WORKING HOURS ALLOWED FOR DEMOLITION AND WASTE REMOVAL WITH COR.
6. NOTIFY COR OF ANY DEMOLITION REQUIRED AND NOT INDICATED FOR INSTALLATION OF ELECTRICAL OR DATA ITEMS. AFTER SUCH DEMOLITION AND INSTALLATION, PATCH OR REPLACE MATERIALS AND FINISHES TO MATCH EXISTING.
7. CONTRACTOR SHALL PROTECT AREA ADJACENT TO THE DEMOLITION AND NEW CONSTRUCTION WORK TO PREVENT DAMAGES. (IF DAMAGED REPAIR, RE-PATCH, SAND SMOOTH AND REFINISH TO MATCH EXISTING.) REPAIR OR REPLACE ITEMS DAMAGED DURING CONSTRUCTION ACTIVITIES AT NO ADDITIONAL COST.
8. THE INFORMATION CONTAINED IN THESE DEMOLITION DOCUMENTS DEFINES GENERAL SCOPE ONLY AND DOES NOT RELIEVE THE CONTRACTOR OF THE RESPONSIBILITY OF PROVIDING ALL DEMOLITION REQUIRED FOR THE COMPLETION OF THE PROJECT.
9. DO NOT ENCROACH ON ADJACENT OCCUPIED AREAS NOT IDENTIFIED WITHIN THE SCOPE OF WORK.
10. REFER TO THE ELECTRICAL DRAWINGS FOR FURTHER INFORMATION REGARDING DEMOLITION OF ELECTRICAL SYSTEMS.
11. BEFORE THE START OF WORK, IDENTIFY ANY REQUIRED DEMOLITION BEYOND THE IDENTIFIED PROJECT SCOPE WHETHER ABOVE, BELOW, OR OUTSIDE THE PROJECT AREA. NOTIFY AND COORDINATE WITH THE COR. PROVIDE DEMOLITION OF THESE AREAS AND PATCH THE SAME AS A PART OF THE SCOPE OF THE PROJECT.
12. ALL DEMOLITION WORK SHALL BE PERFORMED WITH DUE CARE AND DILIGENCE IN ORDER TO PREVENT ARBITRARY DAMAGE OR INTERRUPTION OF SERVICE OR CONCEALED UTILITIES INTENDED TO REMAIN IN SERVICE. DISCOVERY OF UTILITIES OR CONDITIONS LOCATED DIFFERING FROM THOSE INDICATED OR THAT ARE NOT IDENTIFIED, SHALL BE REPORTED TO THE COR.
13. AFTER REMOVAL OF EXISTING SOLID CONCRETE MASONRY WALL, FILL FLOOR VOIDS UP TO FINISH CONCRETE LEVEL AND PERFORM FLOOR LEVELING FOR ENTIRE AREA OF RENOVATION.
14. VERIFY ALL EXISTING CONDITIONS PRIOR TO BEGINNING WORK. NOTIFY COR AND ARCHITECT OF ANY CONFLICTS PRIOR TO PROCEEDING WITH DEMOLITION.
15. ALL ITEMS BEING SALVAGED OR REMOVED SHALL REMAIN THE PROPERTY OF THE VA UNTIL CONFIRMATION HAS BEEN MADE AS TO WHETHER THE VA WILL RETAIN SUCH ITEMS. ALL ITEMS NOT BEING RETAINED BY THE VA OR DESIGNATED ON THE DRAWINGS, ARE TO BE RELOCATED OR REINSTALLED FROM THE SITE BY CONTRACTOR IN APPROVED MANNER.
16. CONTRACTOR SHALL NOTIFY COR OF ANY AREA REQUIRING DEMOLITION OTHER THAN SHOWN IN THESE DRAWINGS DUE TO UNFORESEEN CONDITIONS, TO ACCOMMODATE INSTALLATION OF ALL OTHER TRADES (INCLUDING ROOF PENETRATIONS), AFTER SUCH DEMOLITION AND INSTALLATION, PATCH OR REPLACE MATERIALS AND FINISHES TO MATCH EXISTING.
17. COORDINATE WITH COR FOR CONSTRUCTION ACCESS ROUTE AND LOCATIONS OF DUMPSTER AREA. COORDINATE WITH COR FOR SCHEDULE OF USE OF ACCESS ROUTE FOR WASTE REMOVAL AND CONTRACTOR USE OF FREIGHT ELEVATOR (AS REQUIRED).
18. REFER TO MP FOR SHEETS FOR DEMO SPRINKLER WORK.

FULLY SPRINKLERED

100% CONSTRUCTION DOCUMENTS

#	Revisions	Date

CONSULTANTS:

3/23/2026

PROJECT MANAGER

ACG Project Number 20-398

APOGEE Engineers | Architects
Headquarters:
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420

© COPYRIGHT Apogee Consulting Group, P.A.

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: ARCHITECTURAL SYMBOLS, ABBREVIATIONS AND NOTES

Location: ALEXANDRIA VA HEALTH CARE SYSTEM, 2495 SHREVEPORT HWY, 71N, PINEVILLE, LA 71360

Project Title: ELECTRONIC HEALTH RECORD MODERNIZATION (EHRM)

VA PROJECT NUMBER: 502-21-222

Building Number: #

Approved:

Date: MARCH 24, 2026 | Checked: WVS | Drawn: MEL

Drawing Number: A-001

Dwg. 1 of 51

C:\Users\mel\Documents\MS_20-398_EHRM_UHAPCF.rbt.v4
3/18/2026 4:38:34 PM
VA FORM 08-6231

Docusign Envelope ID: 1F A1697-2B8F6-44-A0-980C-7B95F750DEA5

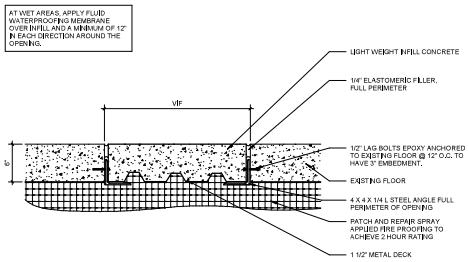

12 TYPICAL INFILL DETAIL
Scale: 1 1/2" = 1'-0"

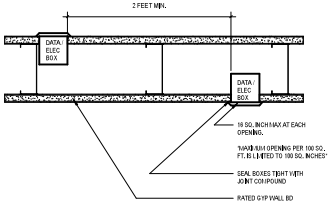

13 ADJACENT ELECTRICAL BOXES- RATED WALLS
Scale: 3" = 1'-0"

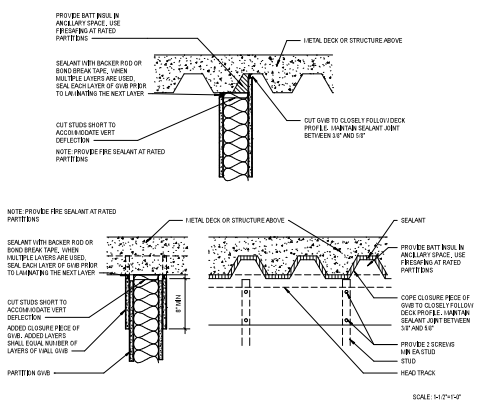

14 TOP OF PARTITION DETAIL
Scale: 1 1/2" = 1'-0"



TAG	STUD SIZE	OVERALL THICK	UL ASSEMB	STC*
Mab1	1-1/2"	3-3/4"	—	—
Mab2	2-1/2"	4-3/4"	—	—
Mab3	3-5/8"	5-7/8"	—	—
Mab4	4"	6-1/4"	—	—
Mab6	6"	8-1/4"	—	—
Mab8	8"	10-1/4"	—	—

9 PARTITION TYPE - Mab_SHAFT
Scale: 1" = 1'-0"

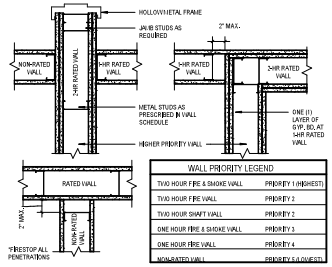

WALL PRIORITY LEGEND	
TWO HOUR FIRE & SMOKE WALL	PRIORITY 1 (HIGHEST)
TWO HOUR FIRE WALL	PRIORITY 2
TWO HOUR SHAFT WALL	PRIORITY 2
ONE HOUR FIRE & SMOKE WALL	PRIORITY 3
ONE HOUR FIRE WALL	PRIORITY 4
NON-RATED WALL	PRIORITY 5 (LOWEST)

10 WALL PRIORITY PLAN & LEGEND
Scale: 1 1/2" = 1'-0"



11 DEFLECTION TRACK DETAIL1
Scale: 1 1/2" = 1'-0"



5 PARTITION TYPE - a
Scale: No Scale



TAG	STUD SIZE	OVERALL THICK	UL ASSEMB	STC*
Maa1	1-5/8"	2-7/8"	UL-U419	—
Maa2	2-1/2"	3-3/4"	UL-U419	—
Maa3	3-5/8"	4-7/8"	UL-U419	—
Maa4	4"	5-1/4"	UL-U419	—
Maa6	6"	7-1/4"	UL-U419	—
Maa8	8"	9-1/4"	UL-U419	—

6 PARTITION TYPE - Maa RATED
Scale: 1" = 1'-0"



TAG	STUD SIZE	OVERALL THICK	UL ASSEMB	STC*
aa_	0"	5/8"	—	—

7 PARTITION TYPE - aa
Scale: 1" = 1'-0"



TAG	BLOCK SIZE	OVERALL THICK	UL ASSEMB	STC*
G4	3-5/8"	3-5/8"	—	—
G6	5-5/8"	5-5/8"	—	—
G8	7-5/8"	7-5/8"	—	—
G10	9-5/8"	9-5/8"	—	—
G12	11-5/8"	11-5/8"	—	—
			—	—
			—	—

REFER TO PARTITION TAG FOR FIRE RATING

8 PARTITION TYPE - G_
Scale: 1" = 1'-0"



TAG	STUD SIZE	OVERALL THICK	UL ASSEMB	STC*
Ma0	7/8"	1-1/2"	—	—
Ma1	1-5/8"	2-1/4"	—	—
Ma2	2-1/2"	3-1/8"	—	—
Ma3	3-5/8"	4-1/4"	—	—
Ma4	4"	4-5/8"	—	—
Ma6	6"	6-5/8"	—	—
Ma8	8"	8-5/8"	—	—

1 PARTITION TYPE - Ma_
Scale: 1" = 1'-0"



TAG	STUD SIZE	OVERALL THICK	UL ASSEMB	STC*
Maa1	1-5/8"	2-7/8"	—	—
Maa2	2-1/2"	3-3/4"	—	—
Maa3	3-5/8"	4-7/8"	—	—
Maa4	4"	5-1/4"	—	—
Maa6	6"	7-1/4"	—	—
Maa8	8"	9-1/4"	—	—

3 PARTITION TYPE - Mab
Scale: 1" = 1'-0"



TAG	STUD SIZE	OVERALL THICK	UL ASSEMB	STC*
Mab1	1-5/8"	3-1/2"	—	—
Mab2	2-1/2"	4-3/8"	—	—
Mab3	3-5/8"	5-1/2"	—	—
Mab4	4"	5-7/8"	—	—
Mab6	6"	7-7/8"	—	—
Mab8	8"	9-7/8"	—	—

4 PARTITION TYPE - Mb_
Scale: 1" = 1'-0"



TAG	STUD SIZE	OVERALL THICK	UL ASSEMB	STC*
Mb0	7/8"	2-1/8"	—	—
Mb1	1-5/8"	2-7/8"	—	—
Mb2	2-1/2"	3-3/4"	—	—
Mb3	3-5/8"	4-7/8"	—	—
Mb4	4"	5-1/4"	—	—
Mb6	6"	7-1/4"	—	—
Mb8	8"	9-1/4"	—	—

SHEET NOTES:

A. ALL RATED GYPSUM PARTITION TYPES TO BE UL DESIGN NO. U419. SUBMITTAL REQUIRED.

B. ALL PARTITION TYPES UTILIZING TWO LAYERS OF GYPSUM TO BE UL DESIGN NO. V497. SUBMITTAL REQUIRED.

PARTITION TYPE KEY1

CORE TYPES

C. CAST IN PLACE CONCRETE

G. CONCRETE MASONRY UNIT (GROUTED SOLID)

H. CONCRETE MASONRY UNIT (HOLLOW)

M. METAL STUD FRAMING / METAL FURRING

MM. METAL STUD FRAMING (2 ROWS, PARALLEL WITH PRESCRIBED AIR GAP BETWEEN

S. METAL SHAFT WALL CH STUD

T. TILT-UP CONCRETE PANEL

W. WOOD STUD FRAMING / FURRING

INSULATION TYPES

A. ACOUSTIC INSULATION

T. THERMAL INSULATION

FULLY SPRINKLERED

100% CONSTRUCTION DOCUMENTS

#	Revisions	Date

CONSULTANTS:

3/23/2026

PROJECT MANAGER

ACG Project Number 20-398

APOGEE Engineers | Architects
Headquarters:
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420

© COPYRIGHT Apogee Consulting Group, P.A.

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: PARTITION TYPES AND DETAILS

Location: ALEXANDRIA VA HEALTH CARE SYSTEM, 2495 SHREVEPORT HWY, 71N, PINEVILLE, LA 71360

Project Title: ELECTRONIC HEALTH RECORD MODERNIZATION (EHRM)

VA PROJECT NUMBER: 502-21-222

Building Number: #

Approved

Date: MARCH 24, 2026 | Checked: WVS | Drawn: MEL

Drawing Number: A-002

Dwg. 2 of 51

3/13/2026 4:38:34 PM C:\Users\mel\Documents\MS_20-398_EHRM_UHM-CFS8.rvt

VA FORM 08-6231

Docusign Envelope ID: 1F A1697-2B6F6-44 A0-B6C-7B95F F50EEA5



5 DEMOLITION ELEVATION - DOOR IN MASONRY WALL
Scale: 1/2" = 1'-0"

MORTAR:
A) MORTAR FOR NEW WORK:
1) MORTAR FOR CLAY TILE:
a. PROPORTION BY VOLUME: ONE PART WHITE PORTLAND CEMENT, TWO PARTS OF GRADED WHITE SAND PASSING NUMBER 50 SIEVE, AND 1/8 PART HYDRATED LIME.
B) MORTAR FOR NEW WORK:
1) ADMIXTURES:
a. DO NOT USE MORTAR ADMIXTURES, AND COLOR ADMIXTURES UNLESS APPROVED BY COR.
b. DO NOT USE ANTIFREEZE COMPOUNDS.
C) TYPE N MORTAR, ASTM C270, 750 PSI



6 NEW ELEVATION - DOOR IN MASONRY WALL
Scale: 1/2" = 1'-0"

DOOR SCHEDULE

NO.	DOOR WIDTH	DOOR HEIGHT	DOOR THICK	DOOR MAT'L	DOOR FINISH	ELEV	DOOR FRAME MAT'L	DOOR FRAME FINISH	ELEV	HEAD DETAIL NO.	JAMB DETAIL NO.	Door Fire Rating Minutes	HDWR SET	REMARKS
00-D103	3'-0"	7'-0"	1 3/4"	SCW	PNT-1	A	HM	PNT-2	1	MAS	MAS	45 MIN	1.0	180 DEGREE SWING
00-D202	3'-0"	7'-0"	1 3/4"	SCW	PNT-1	A	HM	PNT-2	1	MAS	MAS	45 MIN	1.0	NOTE 1
002-D133	3'-0"	7'-0"	1 3/4"	SCW	PF	A	HM	PNT-2	1	MTLS/GYP	MTLS/GYP	45 MIN	1.0	NOTE 1
002-D296	3'-0"	7'-0"	1 3/4"	SCW	PNT-1	A	HM	PNT-2	1	MAS	MAS	45 MIN	1.0	NOTE 1
002-D339	3'-0"	7'-0"	1 3/4"	SCW	PNT-1	A	HM	PNT-2	1	MAS	MAS	45 MIN	1.0	NOTE 1
002-D424	3'-0"	7'-0"	1 3/4"	SCW	PF	A	HM	PNT-2	1	MTLS/GYP	MTLS/GYP	45 MIN	1.0	NOTE 1
003-D105	3'-0"	7'-0"	1 3/4"	SCW	PF	A	HM	PNT-2	1	MAS	MAS	45 MIN	1.0	NOTE 1
003-D205	3'-0"	7'-0"	1 3/4"	SCW	PF	A	HM	PNT-2	1	MAS	MAS	45 MIN	1.0	8" + JAMB
003-D305	3'-0"	7'-0"	1 3/4"	SCW	PNT-1	A	HM	PNT-2	1	MAS	MAS	45 MIN	1.0	8" + JAMB
004-D102E	3'-0"	7'-0"	1 3/4"	SCW	PF	A	HM	PNT-2	1	MTLS/GYP	MTLS/GYP	45 MIN	1.0	-
005-D110A	3'-0"	7'-0"	1 3/4"	SCW	PNT-1	A	HM	PNT-2	1	MTLS/GYP	MTLS/GYP	45 MIN	1.0	NOTE 1
005-D212C	3'-0"	7'-0"	1 3/4"	SCW	PNT-1	A	HM	PNT-2	1	MTLS/GYP	MTLS/GYP	45 MIN	1.0	NOTE 1
005-D306A	3'-0"	7'-0"	1 3/4"	HM	PNT-1	A	HM	PNT-2	1	MTLS/GYP	MTLS/GYP	45 MIN	1.0	NOTE 1
006-D008	3'-0"	7'-0"	1 3/4"	HM	PNT-1	A	HM	PNT-2	1	MAS	MAS	45 MIN	1.0	NOTE 1
006-D101	3'-0"	7'-0"	1 3/4"	SCW	PNT-1	A	HM	PNT-2	1	MTLS/GYP	MTLS/GYP	45 MIN	1.0	NOTE 1
006-D201	3'-0"	7'-0"	1 3/4"	SCW	PNT-1	A	HM	PNT-2	1	MAS	MAS	45 MIN	1.0	NOTE 1
006-D310	3'-0"	7'-0"	1 3/4"	SCW	PNT-1	A	HM	PNT-2	1	MAS	MAS	45 MIN	1.0	NOTE 1
007-D1A-117	3'-0"	7'-0"	1 3/4"	SCW	PF	A	HM	PNT-2	1	MTLS/GYP	MTLS/GYP	45 MIN	3.0	180 DEGREE SWING
007-D3M4	3'-0"	7'-0"	1 3/4"	SCW	PF	A	HM	PNT-2	1	MTLS/GYP	MTLS/GYP	45 MIN	1.0	-
007-D3M4	3'-0"	7'-0"	1 3/4"	SCW	PF	A	HM	PNT-2	1	MTLS/GYP	MTLS/GYP	45 MIN	1.0	-
007-D017	3'-0"	7'-0"	1 3/4"	SCW	PNT-1	A	HM	PNT-2	1	MAS	MAS	45 MIN	3.0	-
007-D045	3'-0"	7'-0"	1 3/4"	ETR	ETR	ETR	ETR	ETR	ETR	ETR	ETR	ETR	ETR	NEW DUAL AUTHENTICATION CARD READER
007-D184A	3'-0"	7'-0"	1 3/4"	SCW	PF	A	HM	PNT-2	1	MTLS/GYP	MTLS/GYP	45 MIN	1.0	-
007-D184B	3'-0"	7'-0"	1 3/4"	SCW	PF	A	HM	PNT-2	1	MTLS/GYP	MTLS/GYP	-	1.0	-
007-D186	3'-0"	7'-0"	1 3/4"	SCW	PF	A	HM	PNT-2	1	MTLS/GYP	MTLS/GYP	45 MIN	1.0	-
007-D287A	3'-0"	7'-0"	1 3/4"	SCW	PF	A	HM	PNT-2	1	MTLS/GYP	MTLS/GYP	45 MIN	3.0	-
007-D373D	3'-0"	7'-0"	1 3/4"	SCW	PF	A	HM	PNT-2	1	MTLS/GYP	MTLS/GYP	45 MIN	3.0	-
007-D462	3'-0"	7'-0"	1 3/4"	SCW	PF	A	HM	PNT-2	1	MTLS/GYP	MTLS/GYP	45 MIN	1.0	180 DEGREE SWING
007-D471A	3'-0"	7'-0"	1 3/4"	SCW	PF	A	HM	PNT-2	1	MTLS/GYP	MTLS/GYP	45 MIN	1.0	180 DEGREE SWING
007-D033	3'-0"	7'-0"	1 3/4"	SCW	PF	A	HM	PNT-2	1	MTLS/GYP	MTLS/GYP	45 MIN	1.0	-
008-D105C	3'-0"	7'-0"	1 3/4"	SCW	PF	A	HM	PNT-2	1	MTLS/GYP	MTLS/GYP	45 MIN	4.0	-
008-D135	3'-0"	7'-0"	1 3/4"	SCW	PF	A	HM	PNT-2	1	MTLS/GYP	MTLS/GYP	45 MIN	4.0	-
008-D218	3'-0"	7'-0"	1 3/4"	SCW	PF	A	HM	PNT-2	1	MTLS/GYP	MTLS/GYP	45 MIN	1.0	-
008-D315	3'-0"	7'-0"	1 3/4"	SCW	PF	A	HM	PNT-2	1	MTLS/GYP	MTLS/GYP	45 MIN	2.0	DOOR IN MENTAL HEALTH WARD
013-D6	3'-0"	7'-0"	1 3/4"	SCW	PNT-1	A	HM	PNT-2	1	MTLS/GYP	MTLS/GYP	45 MIN	1.0	-
01-D1A107	3'-0"	7'-0"	1 3/4"	ETR	ETR	ETR	ETR	ETR	ETR	ETR	ETR	ETR	1.0	ETR, UPGRADE CARD READER
015-D7F	3'-0"	7'-0"	1 3/4"	SCW	PNT-1	A	HM	PNT-2	1	MTLS/GYP	MTLS/GYP	45 MIN	3.0	-
016-D110B	3'-0"	7'-0"	1 3/4"	ETR	ETR	ETR	ETR	ETR	ETR	ETR	ETR	ETR	1.0	ETR, UPGRADE CARD READER
045-D170	3'-0"	7'-0"	1 3/4"	SCW	PF	A	HM	PNT-2	1	MTLS/GYP	MTLS/GYP	45 MIN	1.0	DOOR IN MENTAL HEALTH WARD
045-D173	3'-0"	7'-0"	1 3/4"	SCW	PF	A	HM	PNT-2	1	MTLS/GYP	MTLS/GYP	45 MIN	1.0	DOOR IN MENTAL HEALTH WARD
045-D270	3'-0"	7'-0"	1 3/4"	SCW	PF	A	HM	PNT-2	1	MTLS/GYP	MTLS/GYP	45 MIN	4.0	DOOR IN MENTAL HEALTH WARD
045-D272	3'-0"	7'-0"	1 3/4"	SCW	PF	A	HM	PNT-2	1	MTLS/GYP	MTLS/GYP	45 MIN	1.0	DOOR IN MENTAL HEALTH WARD
046-D302	3'-0"	7'-0"	1 3/4"	SCW	PNT-1	A	HM	PNT-2	1	MTLS/GYP	-	-	3.0	-
048-D186	3'-0"	7'-0"	1 3/4"	SCW	PF	A	HM	PNT-2	1	MTLS/GYP	MTLS/GYP	45 MIN	1.0	180 DEGREE SWING
139-D32	3'-0"	7'-0"	1 3/4"	HM	PNT-2	A	HM	PNT-2	1	MTLS/GYP	MTLS/GYP	45 MIN	1.0	-
143-D13	3'-0"	7'-0"	1 3/4"	SCW	PF	A	HM	PNT-2	1	MTLS/GYP	MTLS/GYP	45 MIN	1.0	-
143-D102	3'-0"	7'-0"	1 3/4"	HM	PNT-1	A	HM	PNT-2	1	MTLS/GYP	MTLS/GYP	45 MIN	3.0	-
17-D108	3'-0"	7'-0"	1 3/4"	SCW	PNT-1	A	HM	PNT-2	1	MTLS/GYP	MTLS/GYP	45 MIN	3.0	-

NOTE 1: JAMB WIDTH TO EQUAL EXISTING WALL WIDTH + 1/4" RETURNS, EACH SIDE.

EXIST= EXISTING
HM= HOLLOW METAL
PNT= PAINT
SCW= SOLID CORE WOOD



DOOR ELEVATIONS



FRAME ELEVATIONS



7 HEAD DETAIL @ MASONRY FOR FRAMES WITH NOTE 1
Scale: 1 1/2" = 1'-0"



3 HEAD DETAIL @ MASONRY
Scale: 1 1/2" = 1'-0"



1 HEAD DETAIL @ METAL STUD
Scale: 1 1/2" = 1'-0"



4 JAMB DETAIL @ MASONRY
Scale: 1 1/2" = 1'-0"



2 METAL STUD 4 - JAMB
Scale: 1 1/2" = 1'-0"

FULLY SPRINKLERED
100% CONSTRUCTION DOCUMENTS

#	Revisions	Date

CONSULTANTS:

3/23/2026

PROJECT MANAGER
ACG Project Number 20-398

APOGEE
Engineers | Architects
Headquarters:
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420
© COPYRIGHT Apogee Consulting Group, P.A.

Office of Construction and Facilities Management
VA U.S. Department of Veterans Affairs

Drawing Title: DOOR SCHEDULE
Location: ALEXANDRIA VA HEALTH CARE SYSTEM, 2495 SHREVEPORT HWY, 71N, PINEVILLE, LA 71360
Project Title: ELECTRONIC HEALTH RECORD MODERNIZATION (EHRM)
VA PROJECT NUMBER: 502-21-222
Building Number: #
Approved
Date: MARCH 24, 2026
Checked: WVS
Drawn: MEL
Drawing Number: A-004
Dwg. 3 of 51

3/23/2026 4:38:35 PM C:\Users\mel\Documents\MS_20-398_EHRN_mel-PC-R5.rvt
VA FORM 08-6231

Docusign Envelope ID: 7F41697F-2B7F-44-A0B6-7B95F75DEEA5

ROOM FINISH SCHEDULE

ROOM NO.	NAME	FLOOR	BASE	WALLS EAST	WALLS NORTH	WALLS SOUTH	WALLS WEST	CEILING FINISH	REMARKS
BUILDING 1									
101	LOBBY	-	-	-	-	-	-	-	
102	CORRIDOR	EXISTING	RB/ETR	P	-	-	-	EXISTING	
103	TR	SDT-1	RB-1	P-1,3/WF	P-1,2	P-1,2	P-1	EXPOSED STRUCTURE	P-2 AT PLYWOOD ALL SIX SIDES UNCOVERING ONE STAMP
104	PMS	-	-	-	-	-	-	-	
201	CONFERENCE ROOM	-	-	-	-	-	-	-	
202	TR	SDT-1	RB-1	P-1,3/WF	P-1,2	P-1,2	P-1	EXPOSED STRUCTURE	P-2 AT PLYWOOD ALL SIX SIDES UNCOVERING ONE STAMP
203	NURSE EXEC. OFFICE	ETR	ETR/RB	ETR	P	ETR	ETR	ETR	MATCH EXISTING WALL PAINT AND BASE FOR NEW WALL
204	CORRIDOR	ETR	ETR/RB	P	ETR	ETR	ETR	ETR	PROVIDE FINISHES TO MATCH EXISTING TO PATCH PAINT AND BASE.
BUILDING 2									
102	CORRIDOR	ETR	RB	PWP-1	ETR	ETR	ETR	ETR	MATCH STAINED WOOD/PVC HANDRAIL AND MATCHING MAPLE CRASH RAIL.
133	TR	SDT-1	RB-1	P-1,3/WF	P-1,2	P-1,2	P-1,2	EXPOSED STRUCTURE	P-2 AT PLYWOOD ALL SIX SIDES UNCOVERING ONE STAMP
134	EDUC.	ETR	ETR/RB-1	P	-	-	-	ETR	PATCH WALL BASE AND PAINT FOR DOOR INFILL
202	CORRIDOR	ETR	RB	P	ETR	ETR	ETR	ETR	PATCH WALL BASE AND PAINT
256	TR	SDT-1	RB-1	P-1,3/WF	P-1,2	P-1,2	P-1	EXPOSED STRUCTURE	P-2 AT PLYWOOD ALL SIX SIDES UNCOVERING ONE STAMP
303	CORRIDOR	ETR	RB	P	ETR	ETR	ETR	ETR	PATCH WALL BASE AND PAINT
359	TR	SDT-1	RB-1	P-1,3/WF	P-1,2	P-1,2	P-1	EXPOSED STRUCTURE	P-2 AT PLYWOOD ALL SIX SIDES UNCOVERING ONE STAMP
361	TOILET	ETR	ETR/MATCH EXISTING	ETR	ETR	ETR/MAT CH EXISTING	ETR	ETR	INFILL WALL BASE AND FINISH TO MATCH EXISTING TOILET
402	CORRIDOR	ETR	RB/ETR	PWP-2	ETR	ETR	ETR	ETR	MATCH DARK STAINED WOOD/PVC HANDRAIL AND MATCHING BEIGE CRASH RAIL.
424	TR	SDT-1	RB-1	P-1,2	P-1,2	P-1,2	P-1	EXPOSED STRUCTURE	P-2 AT PLYWOOD ALL SIX SIDES UNCOVERING ONE STAMP
426	BMGT. STORAGE	ETR	ETR/RB	ETR	P	ETR	ETR	ETR	PATCH WALL BASE AND PAINT FOR DOOR INFILL
BUILDING 3									
105	TR	SDT-1	RB-1	P-1,3/WF	P-1,2	P-1,2	P-1	EXPOSED STRUCTURE	P-2 AT PLYWOOD ALL SIX SIDES UNCOVERING ONE STAMP
107	CORRIDOR	-	RB	PWP-3	-	-	-	-	
205	TR	SDT-1	RB-1	P-1,3/WF	P-1,2	P-1,2	P-1	EXPOSED STRUCTURE	P-2 AT PLYWOOD ALL SIX SIDES UNCOVERING ONE STAMP
206	OFFICE STAFF	ETR	ETR/RB	ETR	P	ETR	ETR	ETR/ACT-1	MATCH WALL PAINT AND BASE FINISHES ON NEW WALL
224	CORRIDOR	ETR	ETR/RB	P	ETR	ETR	ETR	ETR	PATCH EXISTING WALL PAINT AND BASE AROUND NEW FRAME.
305	TR	SDT-1	RB-1	P-1,3/WF	P-1,2	P-1,2	P-1	EXPOSED STRUCTURE	P-2 AT PLYWOOD ALL SIX SIDES UNCOVERING ONE STAMP
306	DOCTORS OFFICE	ETR	ETR/RB	ETR	P	ETR	ETR	ETR/ACT	MATCH WALL PAINT AND BASE FINISHES ON NEW WALL
313	CORRIDOR	ETR	ETR/RB	P	ETR	ETR	ETR	ETR	PATCH EXISTING WALL PAINT AND BASE AROUND NEW FRAME.
BUILDING 4									
102	WAITING	ETR	ETR/ RB	ETR	ETR	ETR	P	ETR	
102E	TR	SDT-1	RB-1	P-1,2	P-1	P-1,2	P-1,2	EXPOSED STRUCTURE	P-2 AT PLYWOOD ALL SIX SIDES UNCOVERING ONE STAMP
BUILDING 5									
110	ADMIN. OFFICE	ETR	ETR/RB	ETR	ETR	ETR	P	ETR/ACT-1	PATCH EXISTING BASE AND PAINT TO MATCH EXISTING
110A	TR	SDT-1	RB-1	P-1,2	P-1,2	P-1,2	P-1/WF	EXPOSED STRUCTURE	P-2 AT PLYWOOD ALL SIX SIDES UNCOVERING ONE STAMP
212	ACQUISITION	PATCH AS NECESSARY	RB	-	P	-	-	PATCH AS NECESSARY	MATCH EXISTING BASE AND PAINT FOR NEW WALLS ONLY
212C	TR	SDT-1	RB-1	P-1,2	P-1,2	P-1,2	P-1/WF	EXPOSED STRUCTURE	P-2 AT PLYWOOD ALL SIX SIDES UNCOVERING ONE STAMP
G08	ELECTRICAL STORAGE	ETR	ETR/RB	-	-	-	P	ETR/ACT-1	MATCH EXISTING BASE AND PAINT FOR NEW WALLS ONLY
G08A	TR	SDT-1	RB-1	P-1	P-1,2	P-1,2	P-1,3/WF	EXPOSED STRUCTURE	P-2 AT PLYWOOD ALL SIX SIDES UNCOVERING ONE STAMP
G23	CORRIDOR	ETR	ETR/RB	ETR	P	ETR	ETR	ETR	PATCH WALL BASE AND PAINT FOR INFILL
BUILDING 6									
008	TR	SDT-1	RB-1	P-1,2	P-1	P-1,2	P-1,2	EXPOSED STRUCTURE	P-2 AT PLYWOOD ALL SIX SIDES UNCOVERING ONE STAMP
023	CORRIDOR	-	RB	-	-	P	-	-	
101	TR	SDT-1	RB-1	P-1,2	P-1,2	P-1/WF	P-1,2	EXPOSED STRUCTURE	P-2 AT PLYWOOD ALL SIX SIDES UNCOVERING ONE STAMP
101A	OFFICE	ETR	ETR/RB	P	ETR	ETR	ETR	ETR/ACT-1	PATCH EXISTING FINISHES AS NECESSARY FOR NEW WALL
201	TR	SDT-1	RB-1	P-1,2	P-1	P-1,2/WF	P-1,2	EXPOSED STRUCTURE	P-2 AT PLYWOOD ALL SIX SIDES UNCOVERING ONE STAMP
238	CORRIDOR	-	RB	-	-	P	-	-	
310	TR	SDT-1	RB-1	P-1,2	P-1	P-1,3/WF	P-1,2	EXPOSED STRUCTURE	P-2 AT PLYWOOD ALL SIX SIDES UNCOVERING ONE STAMP
312	CORRIDOR	-	RB	-	-	P	-	-	
BUILDING 7									
1A-101	CORRIDOR	ETR	ETR/RB	-	-	P	P	ETR/ACT-1	PATCH WALL PAINT, CEILING, AND BASE TO MATCH EXISTING.
1A-103	E.E.G. INSTR.	EXISTING	RB	-	-	P	-	PATCH AS NECESSARY	PATCH WALL PAINT AND BASE
1A-104B	ALCOVE	ETR	RB/ETR	P	-	-	-	-	PATCH WALL PAINT, CEILING, AND BASE TO MATCH EXISTING.
1A-117	TR	SDT-1	RB-1	P-1,2	P-1,2	P-1,2	P-1,2	EXPOSED STRUCTURE	P-2 AT PLYWOOD ALL SIX SIDES UNCOVERING ONE STAMP
1A-184	CLERICAL	ETR	RB	P	ETR	P	ETR	ETR/ACT-1	PATCH WALL PAINT, CEILING, AND BASE TO MATCH EXISTING.
1A-184A	TR	SDT-1	RB-1	P-1,2	P-1,2	P-1,2	P-1,2	EXPOSED STRUCTURE	P-2 AT PLYWOOD ALL SIX SIDES UNCOVERING ONE STAMP
1A-184B	STORAGE	ETR	ETR/RB-1	P-1	P-1	ETR	ETR	ACT-1	PATCH WALL PAINT, CEILING, AND BASE ON NEW WALLS TO MATCH EXISTING.
1A-186	PURCHASING AGENT	ETR	RB-1/ETR	-	-	P	P	ETR/ACT-1	PATCH WALL PAINT, CEILING, AND BASE TO MATCH EXISTING.
3M4	TR	SDT-1	RB-1	P-1,2	P-1,2	P-1,2	P-1,2	EXPOSED STRUCTURE	P-2 AT PLYWOOD ALL SIX SIDES UNCOVERING ONE STAMP
3M4	TR	SDT-1	RB-1	P-1,2	P-1,2	P-1,2	P-1,2	EXPOSED STRUCTURE	P-2 AT PLYWOOD ALL SIX SIDES UNCOVERING ONE STAMP
3M5	STOR	PATCH AS NECESSARY	RB	-	-	-	P	PATCH AS NECESSARY	PATCH WALL PAINT AND BASE ON NEW WALLS ONLY
5	PATIENT CLOTHING	ETR	ETR/RB	P	P	ETR	ETR	ETR/ACT-1	PATCH WALL PAINT AND BASE ON NEW WALLS ONLY
5B	STORAGE	PATCH AS NECESSARY	RB	-	P	-	P	PATCH AS NECESSARY	PATCH WALL PAINT AND BASE ON NEW WALLS ONLY
G17	TR	SDT-1	RB-1	P-1,2	P-1	P-1,2	P-1,2	EXPOSED STRUCTURE	P-2 AT PLYWOOD ALL SIX SIDES UNCOVERING ONE STAMP
18	ELEV. LOBBY	ETR	ETR/RB	ETR	ETR	P	ETR	ETR/ACT-1	PATCH WALL PAINT, CEILING, AND BASE TO MATCH EXISTING.
042	TELE/COMPUTER RM	AF/ETR	RB-1	P-1,2	P-1,2	P-1,2	P-1,2	EXPOSED STRUCTURE	P-2 AT PLYWOOD ALL SIX SIDES UNCOVERING ONE STAMP. REPLACE VENTED ACCESS FLOORING TILES WITH SOLID ACCESS FLOORING TILES TO MATCH
42A	CLOSET	AF-1/ETR	-	P-1,2	P-1,2	P-1,2	P-1,2	EXPOSED STRUCTURE	P-2 AT PLYWOOD ALL SIX SIDES UNCOVERING ONE STAMP
045	COMPUTER RM	AF-1/ETR	-	P-1,2	P-1,2	P-1,2	P-1,2	EXPOSED STRUCTURE	P-2 AT PLYWOOD ALL SIX SIDES UNCOVERING ONE STAMP. VENTED ACCESS FLOORING TILES TO BE REPLACED WITH MATCHING SOLID ACCESS TILES
45A	STORAGE	AF-1	RB-1	P-1,2	P-1,2	P-1	P-1,2	EXPOSED STRUCTURE	P-2 AT PLYWOOD ALL SIX SIDES UNCOVERING ONE STAMP. NEW ACCESS FLOORING TO TRANSITION AND TIE INTO EXISTING GRID.
47	STOR.	ETR	ETR/RB	P	ETR	ETR	ETR	ETR/ACT-1PATCH AS NECESSARY	PATCH WALL PAINT AND BASE ON NEW WALLS ONLY
247D	STORAGE	ETR	ETR/RB	ETR	ETR	P	ETR	ETR/ACT-1	PATCH WALL PAINT, CEILING, AND BASE TO MATCH EXISTING.
267	HALLWAY	ETR	ETR/RB	-	-	-	P	PATCH AS NECESSARY	PATCH WALL PAINT AND BASE FOR NEW DOOR
267A	TR	SDT-1	RB-1	P-1,2	P-1,2	P-1,2	P-1,2	EXPOSED STRUCTURE	P-2 AT PLYWOOD ALL SIX SIDES UNCOVERING ONE STAMP
348	LOBBY	EXISTING	RB	-	-	P	-	PATCH AS NECESSARY	PATCH WALL PAINT AND BASE
373A	HALLWAY	ETR	ETR/RB	ETR	ETR	ETR	P	ETR/ACT-1PATCH AS NECESSARY	PATCH WALL PAINT, CEILING, AND BASE TO MATCH EXISTING.
373D	TR	SDT-1	RB-1	P-1,2	P-1,2	P-1,2	P-1,2	EXPOSED STRUCTURE	P-2 AT PLYWOOD ALL SIX SIDES UNCOVERING ONE STAMP
402	TR	SDT-1	RB-1	P-1,2	P-1,2	P-1,2	P-1,2	EXPOSED STRUCTURE	P-2 AT PLYWOOD ALL SIX SIDES UNCOVERING ONE STAMP
471	CLERKS	ETR	ETR/RB	ETR	ETR	P	P	ETR/ACT-1	PATCH WALL PAINT, CEILING, AND BASE TO MATCH EXISTING.
471A	TR	SDT-1	RB-1	P-1,2	P-1,2	P-1,2	P-1,2	EXPOSED STRUCTURE	P-2 AT PLYWOOD ALL SIX SIDES UNCOVERING ONE STAMP
C1-10	CORR.	ETR	RB	P	-	-	-	ETR	
C1-12	CORRIDOR	ETR	ETR/RB	ETR	P	ETR	ETR	ETR/ACT-1	PATCH WALL PAINT, CEILING, AND BASE TO MATCH EXISTING.

ROOM FINISH SCHEDULE

ROOM NO.	NAME	FLOOR	BASE	WALLS EAST	WALLS NORTH	WALLS SOUTH	WALLS WEST	CEILING FINISH	REMARKS
C-4-4	CORRIDOR	ETR	ETR/RB	-	-	-	PWP-4	ETR	PATCH WALL PAINT, CEILING, AND BASE TO MATCH EXISTING.
D-1	CORRIDOR	ETR	ETR/RB	ETR	ETR	P	ETR	ETR	PATCH WALL PAINT AND BASE
D-02	RECEP.	ETR	ETR/RB	P	P	-	-	ETR/ACT-1	PATCH WALL PAINT, CEILING, AND BASE TO MATCH EXISTING.
D-03	CORR.	ETR	ETR/RB	-	-	-	P	ETR/ACT-1	PATCH WALL PAINT, CEILING, AND BASE ON NEW WALLS ONLY
D-33	TR	SDT-1	RB-1	P-1,2	P-1,2	P-1,2	P-1,2	EXPOSED STRUCTURE	P-2 AT PLYWOOD ALL SIX SIDES UNCOVERING ONE STAMP
BUILDING 8									
105	CONCESSIONAIRE VENDING	ETR	ETR/RB	ETR	ETR	P	ETR/P	ETR/ACT-1 PATCH AS NECESSARY	MATCH EXISTING WALL PAINT AND BASE ON NEW WALL AND AROUND NEW EXTINGUISHER CABINET
105C	TR	SDT-1	RB-1	P-1,2	P-1	P-1,2	P-1,2	EXPOSED STRUCTURE	P-2 AT PLYWOOD ALL SIX SIDES UNCOVERING ONE STAMP
BUILDING 9									
100C	CORRIDOR	ETR	ETR/RB	ETR	ETR	P	ETR	ETR/ACT-1, PATCH AS NECESSARY	PATCH WALL PAINT AND BASE
135	TR	SDT-1	RB-1	P-1	P-1	P-1	P-1	EXPOSED STRUCTURE	
200	LOBBY	ETR	ETR/RB	P	ETR	P	ETR	ETR/ACT-1, PATCH AS NECESSARY	PATCH WALL PAINT AND BASE AT NEW WALLS ,
218	TR	SDT-1	RB-1	P-1,2	P-1,2	P-1,2	P-1,2	EXPOSED STRUCTURE	P-2 AT PLYWOOD ALL SIX SIDES UNCOVERING ONE STAMP
300	ELEVATOR LOBBY	ETR	ETR/RB	P/ETR	ETR	P/ETR	ETR	ETR/ACT-1, PATCH AS NECESSARY	PATCH WALL PAINT, CEILING, AND BASE AT NEW WALLS
315	TR	SDT-1	RB-1	P-1,2	P-1,2	P-1,2	P-1,2	EXPOSED STRUCTURE	P-2 AT PLYWOOD ALL SIX SIDES UNCOVERING ONE STAMP
BUILDING 13									
1	MACHINE SHOP	ETR	ETR/RB	ETR	ETR	ETR	P	ETR	PATCH PAINT AND BASE AS NECESSARY TO MATCH EXISTING.
6	TE	SDT-1	RB-1	P-1,2	P-1,2	P-1,2	P-1,2	EXPOSED STRUCTURE	P-2 AT ALL PLYWOOD ALL SIX SIDES UNCOVERING ONE STAMP
BUILDING 14									
1A101	CORRIDOR	ETR	RB/ETR	ETR	ETR	ETR/P	ETR	ETR	PATCH PAINT AND BASE TO MATCH EXISTING
1A107	TE ROOM	EXISTING TO REMAIN	EXISTING TO REMAIN	P-1,2	P-1	P-1,2	P-1,2	EXPOSED STRUCTURE	P-2 AT PLYWOOD, ALL SIX SIDES UNCOVERING ONE STAMP
BUILDING 15									
7	GROUNDS MAINT	ETR	RB/ETR	P/ETR	P/ETR	P/ETR	P/ETR	PATCH AS NECESSARY	PROVIDE PAINT AND BASE TO NEW WALLS FOR TR TO MATCH EXISTING FINISHES
7F	TR	SDT-1	RB-1	P-1,2	P-1,2	P-1,2	P-1,2	EXPOSED STRUCTURE	P-2 AT PLYWOOD ALL SIX SIDES UNCOVERING ONE STAMP
BUILDING 16									
110	LAUNDRY SUPPORT SPACE	ETR	ETR/RB	ETR	P	ETR	ETR	ETR	PATCH PAINT AND BASE TO MATCH EXISTING
110B	TE	SDT-1	RB-1	P-1,2	P-1,2	P-1,2	P-1,2	EXPOSED STRUCTURE	P-2 AT PLYWOOD ALL SIX SIDES UNCOVERING ONE STAMP
BUILDING 45									
170	TR	SDT-1	RB-1	P-1,2	P-1,2	P-1,2	P-1,2	EXPOSED STRUCTURE	P-2 AT PLYWOOD ALL SIX SIDES UNCOVERING ONE STAMP
173	TR	SDT-1	RB-1	P-1,2	P-1,2	P-1,2	P-1,2	EXPOSED STRUCTURE	P-2 AT PLYWOOD ALL SIX SIDES UNCOVERING ONE STAMP
175	CORRIDOR	ETR	ETR/RB	ETTR	ETR	ETR/P	ETR	ETR	PATCH PAINT AND BASE TO MATCH EXISTING
176	CORRIDOR	ETR/ETR	ETR	ETR	ETR	ETR	ETR/P	ETR	PATCH PAINT AROUND NEW EXTINGUISHER CABINET
246	CORRIDOR	-	RB	-	-	P/ETR	-	-	
268	TR	SDT-1	RB-1	P-1,2	P-1,2	P-1,2	P-1,2	EXPOSED STRUCTURE	P-2 AT PLYWOOD ALL SIX SIDES UNCOVERING ONE STAMP
272	TR	SDT-1	RB-1	P-1,2	P-1,2	P-1,2	P-1,2	EXPOSED STRUCTURE	P-2 AT PLYWOOD ALL SIX SIDES UNCOVERING ONE STAMP
287	LOBBY	ETR	ETR/RB	ETR	ETR	ETR/P	ETR	ETR	PATCH PAINT AND BASE TO MATCH EXISTING
C1-1	LOBBY	ETR	ETR/RB	-	-	P/ETR	-	ETR	PATCH PAINT AROUND NEW INSTALLATIONS ON WALL
BUILDING 46									
301	STORAGE	ETR	ETR/RB	ETR	ETR	ETR	P	ETR	PATCH WALL PAINT AND BASE AS NECESSARY TO MATCH EXISTING
302	TE	SDT-1	RB-1	P-1,2	P-1,2	P-1,2	P-1,2	EXPOSED STRUCTURE	P-2 AT PLYWOOD ALL SIX SIDES, UNCOVERING ONE STAMP
BUILDING 49									
133	CORR.	ETR	ETR/RB	ETR	ETR	ETR/P	ETR	ETR/ACT-1 PATCH AS NECESSARY	PATCH WALL PAINT AND BASE
165	CORR.	ETR	ETR/RB	ETR/P WP-5	ETR	ETR	ETR/WWP-5	ETR/ACT-1, PATCH AS NECESSARY	PATCH WALL AND BASE FINISHES TO MATCH EXISTING
166	TR	SDT-1	RB-1	P-1,2	P-1,2	P-1,2	P-1,2	EXPOSED STRUCTURE	P-2 AT PLYWOOD ALL SIX SIDES UNCOVERING ONE STAMP
BUILDING 136									
32	TR	SDT-1	RB-1	P-1,2	P-1,2	P-1,2	P-1,2	EXPOSED STRUCTURE	P-2 AT PLYWOOD ALL SIX SIDES UNCOVERING ONE STAMP
118	BIN	ETR	RB/ETR	ETR	P	ETR	P	ETR/ACT-1 PATCH AS NECESSARY	PROVIDE PAINT AND BASE AT WALLS
BUILDING 147									
101	CHILLER PLANT	ETR	ETR/RB	ETR	ETR/P	ETR	ETR	ETR	PATCH PAINT AND BASE AS NECESSARY
102	TE	SDT-1	RB-1	P-1,2	P-1,2	P-1,2	P-1,2	EXPOSED STRUCTURE	P-2 AT PLYWOOD ALL SIX SIDES UNCOVERING ONE STAMP
BUILDING 171									
107	OFFICE	ETR-REVISE EXISTING	RB/ETR	ETR	ETR	ETR/P	ETR/P	ETR/ACT-1 PATCH	PROVIDE PAINT AND BASE TO MATCH SURROUND OFFICE MATERIALS. PATCH AND ADJUST CEILING TO NEW WALLS.
108	TE	SDT-1	RB-1	P-1,2	P-1,2	P-1,2	P-1,2	EXPOSED STRUCTURE	P-2 AT PLYWOOD ALL SIX SIDES UNCOVERING ONE STAMP
109	CORR.	ETR	ETR/RB	ETR/P	ETR	ETR	ETR	ETR	PATCH PAINT AND BASE TO MATCH EXISTING FINISHES.

FINISH KEY

MATERIAL GROUP	CODE	MATERIAL	MANUFACTURER	STYLE/COLOR	SIZE	NUMBER	REMARKS
CEILINGS							
CEILINGS	ACT-1	ACOUSTICAL CEILING TILE	ARMSTRONG	WHITE	BY LOCATION	VA TO CONFIRM	SIMILAR TO ARMSTRONG, CORTEGA #816
FLOORING							
FLOORING	AF-1	ACCESS FLOORING	COMPUTER ENVIRONMENTS, INC	STEEL CLAD RESIN FIBER CORE PANELS COVERED WITH HIGH PRESSURE LAMINATE-1250 LBS DESIGN LOAD	24" X 24"	FORMICA 70103 CHEYENNE GRAY	GR112 PANEL SOLID WITH PVC EDGE TRIM AND HPL. 10 AND 40 SERIES UNDERSTRUCTURE
FLOORING	SDT-1	STATIC DISSIPATIVE TILE	AMERICAN BILTRITE	MISSION WHITE	24" X 24"	SDT-147	
MISC.							
MISC.	DOORS	VARIES BY LOCATION	VT INDUSTRIES	RIFT CUT RED OAK, STAIN BY LOCATIONS	-	-	CONTRACTOR TO FIELD VERIFY AND MATCH PER LOCATION IN ACCORDANCE WITH SPECIFICATION 01 33 23 1.13 EHRM SURVEYING
MISC.	W	CORNER GUARD	CS CONSTRUCTION SPECIALTIES	SM-20	-	-	CONTRACTOR TO FIELD VERIFY AND MATCH PER LOCATION IN ACCORDANCE WITH SPECIFICATION 01 33 23 1.13 EHRM SURVEYING
MISC.	WF-1	WINDOW FILM 1	3M SCOTCHSHIELD	ULTRA NIGHT VISION S25	-	-	ON ALL EXPOSED AND UNEXPOSED WINDOWS IN TELECOM ROOMS
MISC.	WF-2	WINDOW FILM 2	3M SCOTCHSHIELD	S-80 SSECURITY	-	-	1 LAYER ON EXISTING WINDOWS ONLY
MISC.	WF-1	PETG HAND RAIL	CS CONSTRUCTION SPECIALTIES	HRB-4C	-	-	CONTRACTOR TO FIELD VERIFY AND MATCH PER LOCATION IN ACCORDANCE WITH SPECIFICATION 01 33 23 1.13 EHRM SURVEYING
MISC.	WR-3	SINGLE LINE WOOD RAIL	CS CONSTRUCTION SPECIALTIES	R-OWR-RW	-	-	VA INTERIOR DESIGNER TO SELECT, PER LOCATION
MISC.	WP-3	WOOD HAND RAIL	CS CONSTRUCTION SPECIALTIES	HRW-10C	-	-	VA INTERIOR DESIGNER TO SELECT, PER LOCATION
MISC.	WR-4	PETG HAND RAIL	CS CONSTRUCTION SPECIALTIES	HRB-4C	-	-	CONTRACTOR TO FIELD VERIFY AND MATCH PER LOCATION IN ACCORDANCE WITH SPECIFICATION 01 33 23 1.13 EHRM SURVEYING
MISC.	WP-5	CRASH RAIL	CS CONSTRUCTION SPECIALTIES	SCR/BCR/ECR-10	-	-	CONTRACTOR TO FIELD VERIFY AND MATCH PER LOCATION IN ACCORDANCE WITH SPECIFICATION 01 33 23 1.13 EHRM SURVEYING
WALLS							ONE STAMP
WALLS	P	PAINT	SHERWIN WILLIAMS	NEUTRAL	-	-	CONTRACTOR TO FIELD VERIFY AND MATCH PER LOCATION IN ACCORDANCE WITH SPECIFICATION 01 33 23 1.13 EHRM SURVEYING
WALLS	P-1	PAINT	SHERWIN WILLIAMS	HIGH REFLECTIVE WHITE	-	SW7757	
WALLS	P-2	FIRE RETARDANT PAINT	FLAME CONTROL COATINGS	FLAME CONTROL NO.1 20-20A-INTUMESCENT FIRE RETARDANT PAINT	-	-	1 COAT ON ALL PLYWOOD IN TELECOM ROOMS, ALL SIDES AND KEEP ONE EXPOSED IN TELECOM ROOMS. COLOR TO MATCH P-1.
WALLS	P-2	FIRE RETARDANT PAINT	FLAME CONTROL COATINGS	FLAME CONTROL NO. 400	-	-	2 COATS SEMI-GLOSS OVERCOAT OVER 20-20A PAINT. ALL SIDES AND KEEP SAME STAMP EXPOSED
WALLS	P-3	DOORFRAME PAINT	SHERWIN WILLIAMS	SEMI-GLOSS	-	SIMILAR TO BURNT UMBER	CONTRACTOR TO FIELD VERIFY AND MATCH PER LOCATION IN ACCORDANCE WITH SPECIFICATION 01 33 23 1.13 EHRM SURVEYING
WALLS	RB	RUBBER BASE	ROPPE	STANDARD TO MATCH EXISTING SIMILAR TO BURNT UMBER	6"	-	CONTRACTOR TO FIELD VERIFY AND MATCH PER LOCATION IN ACCORDANCE WITH SPECIFICATION 01 33 23 1.13 EHRM SURVEYING
WALLS	RB-1	RUBBER BASE	ROPPE	PIG	4"	125	

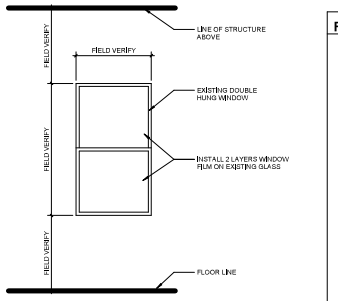

PHYSICAL SECURITY INTERIOR ELEVATION AT EXTERIOR WINDOWS

1 Scale: 3/4" = 1'-0"

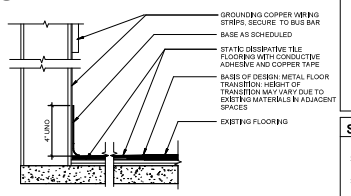

STATIC DISSIPATIVE TILE TO EXISTING FLOORING

2 Scale: 3" = 1'-0"

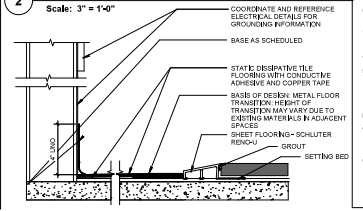

STATIC DISSIPATIVE TILE TO PORCELAIN FLOORING

3 Scale: 3" = 1'-0"

FINISH GENERAL NOTES

1. REFERENCE ROOM FINISH SCHEDULE AND FINISH MATERIAL LEGEND FOR MORE INFORMATION.
2. REFERENCE REFLECTED CEILING PLAN FOR ADDITIONAL CEILING INFO.
3. PREPARE ALL FLOOR AND WALL CONSTRUCTION, NEW AND/OR EXISTING, TO RECEIVE NEW FINISHES IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDED INSTALLATION METHODS AND MATERIALS FOR ALL FINISHES.
4. PRIOR TO INSTALLATION OF NEW FINISHES, CONTRACTOR SHALL INSPECT ALL SUBSTRATES. IF A SUBSTRATE IS DEEMED UNACCEPTABLE, THE CONTRACTOR SHALL TAKE THE NECESSARY STEPS TO RECTIFY THE SITUATION OR CONTACT THE VA COR WITH THE CONCERN. PROCEEDING WITH THE INSTALLATION OF FINISHES WILL BE INDICATION THAT THE INSTALLER / FINISHER ACCEPTS CONDITION OF SUBSTRATE.
5. USE MANUFACTURER'S RECOMMENDED INSTALLATION METHODS AND MATERIALS FOR ALL FINISHES.
6. ALL NECESSARY TILE FLOORING UNDERLAYMENT TO BE PROVIDED AND INSTALLED BY FLOORING CONTRACTOR
7. ALL FLOORING TRANSITIONS SHALL COMPLY WITH ADA GUIDELINES. FLOORING CONTRACTOR TO SUBMIT A DIAGRAM SHOWING FLOORING TRANSITION LOCATIONS FOR DESIGNERS APPROVAL PRIOR TO INSTALLATION.
8. ALIGN FLOORING TRANSITIONS WITH FINISH BASE EXCEPT AT DOORS, U.N.O.
9. FINISH LEVEL OF GYP. BD. WALLS AND SOFFITS TO BE LEVEL 4, U.N.O.
10. ALL PAINTED SURFACES SHALL RECEIVE A MINIMUM OF (1) ONE BASE COAT AND (2) TWO FINISH COATS
11. PAINTED SHEEN LEVEL TO BE EGG-SHELL FOR ALL WALLS, U.N.O. SHEEN FOR ALL WET AREA WALLS, METAL DOORS AND METAL FRAMES TO BE SEMI-GLOSS.
12. PAINT ALL EXPOSED METAL SURFACES, SUCH AS GRILLES, FIRE EXTINGUISHER CABINETS, ETC. WITH PAINT TO MATCH ADJACENT SURFACE.
13. ALL HOLLOW METAL DOORS AND FRAMES TO BE PAINTED P-3 TO MATCH EXISTING.
14. EXTEND THE SDT-1 IN THE TELECOM AND DEMARK ROOMS UNDER DOOR TO THE CORRIDOR WITH A METAL TRANSITION BETWEEN NEW AND EXISTING. PROVIDE METAL FLOOR TRANSITION BETWEEN ALL TELECOM ROOM FLOORING AND ADJACENT FLOORING.
15. ALL ADJACENT AREAS TO TELECOM ROOMS AFFECTED BY INFILL OF DOORS, NEW DOORS, NEW WALLS SHALL HAVE CEILINGS, BASE, PAINT, WALL PROTECTION AND WALLS TO BE PATCHED TO MATCH EXISTING TO MATCH EXISTING TO RECEIVE NEW WORK. VA INTERIOR DESIGNER TO GIVE DIRECTION ON FINISHES TO MATCH OR NEW.
16. THE CONTRACTOR SHALL INSTALL WINDOW FILM (WF-1) ON ANY EXPOSED OR ENCLOSED WINDOWS WITHIN T THE TELECOM OR DEMARK SCOPE OF WORK.
17. PROVIDE 4'X8'X3/4" FIRE RETARDANT TREATED AC GRADE PLYWOOD BACK BOARDS IN TELECOM ROOMS. PLYWOOD SHALL BE MOUNTED WITH A-SIDE OUT AND PAINTED WITH (3 COATS TOTAL) OF FIRE RESETANT PAINT ON ALL SIDES PRIOR TO MOUNTING. AND SHALL MATCH P-2 COLOR, MASK OVER FIRE RETARDANT SEAL ON PLYWOOD BEFORE PAINTING TO ALLOW INSPECTION OF FIRE RATING SEAL. ALL DRYWALL SURROUNDING WALLS TO BE PAINTED WITH STANDARD PAINT P-1 TO MATCH PLYWOOD COLOR.
18. REPAIR AND FINISH WALLS AND/OR FLOORS WHERE CASEWORK HAS BEEN REMOVED.

SIGNAGE GENERAL NOTES

1. ALL SIGNAGE SHOULD MEET VA SIGNAGE GUIDELINES.
2. CONTRACTOR TO COORDINATE THE TEXT OF SIGN INSERTS WITH VA. VA TO GIVE

Docusign Envelope ID: 1F A1697-2B8F6-44 A0-980C-7B95F F50EEA5

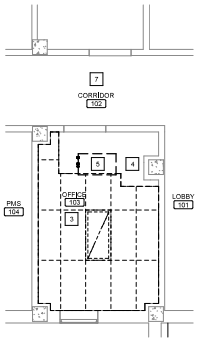

FIRST FLOOR REFLECTED CEILING DEMOLITION PLAN

Scale: 1/4" = 1'-0"

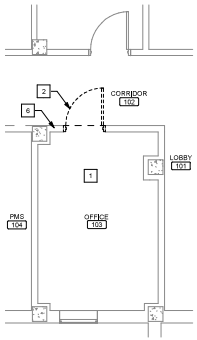

FIRST FLOOR DEMOLITION FLOOR PLAN

Scale: 1/4" = 1'-0"

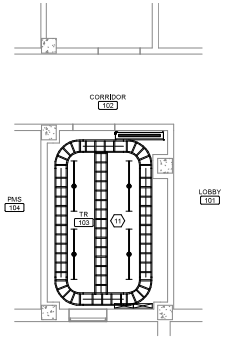

FIRST FLOOR REFLECTED CEILING PLAN

Scale: 1/4" = 1'-0"

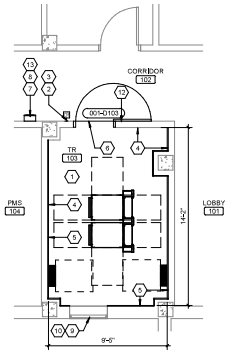

FIRST FLOOR PLAN

Scale: 1/4" = 1'-0"

SHEET NOTES:

A. ALL EXISTING CONDITIONS ARE BASED ON BEST AVAILABLE INFORMATION AT THE TIME OF SURVEY AND VISUAL INSPECTION. CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS.

B. ELEMENTS SHOWN WITH LIGHT, GRAY LINES ARE EXISTING TO REMAIN. ELEMENTS SHOWN WITH DARK DASHED LINES ARE EXISTING TO BE DEMOLISHED. DEMOLITION SHALL INCLUDE, BUT NOT BE LIMITED TO, THOSE ELEMENTS SHOWN.

C. ALL WORK SHALL BE COORDINATED BETWEEN TRADES.

D. ALL WORK SHALL BE COORDINATED WITH THE COR TO MINIMIZE DISRUPTION OF AREAS OUTSIDE OF THE PROJECT LIMITS OF WORK.

E. ALL CEILING DEMOLITION WORK TO BE COORDINATED WITH CHANGE OF EXISTING PENDANT SPRINKLER HEADS WITH NEW UPRIGHT SPRINKLERS SUCH THAT THERE IS NO EXTENDED LOSS OF SPRINKLER PROTECTION IN THE CONSTRUCTION AREA.

F. FOR FINISHES IN ALL NEW TR ROOMS - SEE ROOM FINISH SCHEDULE SHEET A-005.

G. ALL NEW TR ROOMS TO HAVE CARBON DIOXIDE EXTINGUISHER WITHIN 75' OF ROOM. SEE OVERALL OR ENLARGED PLANS FOR LOCATIONS

H. PATCH AND FILL ALL PENETRATIONSHOLES IN WALLS OF TR ROOMS TO MAINTAIN WALL RATINGS.

KEY NOTES:

1. REMOVE EXISTING FLOOR FINISH AND BASE.
2. DEMOLISH EXISTING DOOR AND FRAME IN MASONRY WALL. SALVAGE WOOD DOOR TRIM FOR RE-INSTALLATION. EXISTING OPENING TO REMAIN.
3. REMOVE EXISTING ACT CEILING, INCLUDING ELEC AND MECH FIXTURES.
4. DEMOLISH EXISTING GYPSUM BOARD AND METAL STUD SOFFIT AT 8'-0" AFF.
5. DEMOLISH EXISTING MECHANICAL UNIT - SEE MECHANICAL DRAWINGS.
6. REMOVE EXISTING SIGNAGE AND TURN OVER TO VA.
7. SEE MECHANICAL DRAWINGS FOR ABOVE CEILING WORK. FOLLOW ICRA MEASURES ON SHEET G-004.

KEY NOTES:

1. ROOM TO RECEIVE NEW FINISHES WALLS AND FLOORS. SEE ROOM FINISH SCHEDULE A-005.
2. NEW ROOM SIGNAGE. REF TO A-005 FOR REQUIREMENTS.
3. NEW CARD READER. REFER TO TECHNOLOGY DRAWINGS.
4. EXTEND EXISTING WALL TO UNDERSIDE OF DECK ABOVE (APPROX. 8'-0" TO 11'-0") WITH WALL TYPE Mw3 SEE SHEET A-602. SEAL ALL PENETRATIONS AND EXISTING VOIDS.
5. PROVIDE 4'X8'X3/4" FIRE RETARDANT TREATED AC GRADE PLYWOOD BACK BOARDS IN TELECOM ROOMS. PLYWOOD SHALL BE MOUNTED WITH A-SIDE OUT AND PAINTED WITH (3 COATS TOTAL) OF FIRE RESISTANT PAINT ON ALL SIDES PRIOR TO MOUNTING, AND SHALL MATCH P-2 COLOR. MASK OVER FIRE RETARDANT SEAL ON PLYWOOD BEFORE PAINTING TO ALLOW INSPECTION OF FIRE RATING SEAL. ALL DRYWALL SURROUNDING WALLS TO BE PAINTED WITH STANDARD PAINT P-1 TO MATCH PLYWOOD COLOR.
6. AT NEW DOOR, EXTEND STATIC DISSIPATIVE TILE FROM ROOM INTO CORRIDOR TO EXISTING FLOORING.
7. NEW FIRE EXTINGUISHER SIGNAGE ABOVE FIRE EXTINGUISHER CABINET. REFER TO A-005 FOR REQUIREMENTS.
8. INSTALL NEW SURFACE MOUNTED FIRE EXTINGUISHER CABINET.
9. INSTALL WINDOW FILM TO INTERIOR FACE OF 36 X 72 WINDOW GLAZING - SEE A-005.
10. CLEAN WINDOW. INSTALL NEW WINDOW LOCK. BASE OF DESIGN: PRIMUS LINE WINDOW LOCK #U9928 OR EQUAL.
11. EXPOSED CEILING.
12. INSTALL SALVAGED WOOD TRIM AFTER NEW DOOR INSTALLATION.
13. INSTALL NEW FIRE EXTINGUISHER.

KEY PLAN

SCALE: NO SCALE

AREA OF WORK



100% CONSTRUCTION DOCUMENTS

#	Revisions	Date

CONSULTANTS:

3/23/2026

PROJECT MANAGER

ACG Project Number: 20-398

APOGEE Engineers | Architects

© COPYRIGHT Apogee Consulting Group, P.A.

Headquarters:
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: ENLARGED PLANS, BUILDING 1, FIRST FLOOR, TELECOM ROOM 103

Location: ALEXANDRIA VA HEALTH CARE SYSTEM, 2495 SHREVEPORT HWY, 71N, PINEVILLE, LA 71360

Project Title: ELECTRONIC HEALTH RECORD MODERNIZATION (EHRM)

VA PROJECT NUMBER: 502-21-222

Building Number: # 1

Approved

Date: MARCH 24, 2026 | Checked: WVS | Drawn: MEL

Drawing Number: 001.A-401

Dwg. 5 of 51

C:\Users\mel\AppData\Local\Temp\Acad\Documents\A_20-398_VA_Alexandria EHRM_Bldg_01_v-MEF-R22.rvt
3/18/2026 1:25:02 PM
VA FORM 08-6231

Docusign Envelope ID: 1F A1187F-2B8F6-44 A0-96BC-7B95F F50EEA3

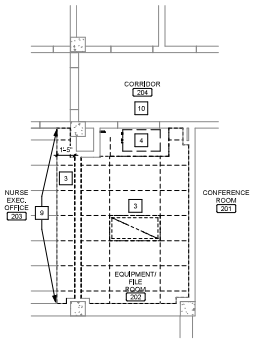

SECOND FLOOR REFLECTED CEILING DEMOLITION PLAN
Scale: 1/4" = 1'-0"

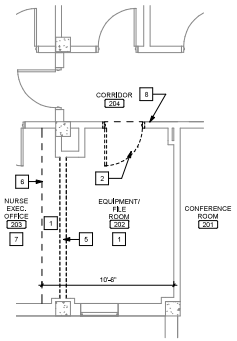

SECOND FLOOR DEMOLITION PLAN
Scale: 1/4" = 1'-0"

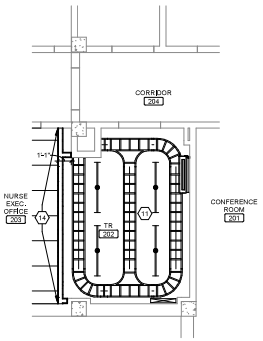

SECOND FLOOR REFLECTED CEILING PLAN
Scale: 1/4" = 1'-0"

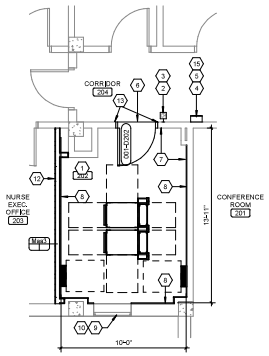

SECOND FLOOR PLAN
Scale: 1/4" = 1'-0"

SHEET NOTES:

A. ALL EXISTING CONDITIONS ARE BASED ON BEST AVAILABLE INFORMATION AT THE TIME OF SURVEY AND VISUAL INSPECTION. CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS.

B. ELEMENTS SHOWN WITH LIGHT, GRAY LINES ARE EXISTING TO REMAIN. ELEMENTS SHOWN WITH DARK DASHED LINES ARE EXISTING TO BE DEMOLISHED. DEMOLITION SHALL INCLUDE, BUT NOT BE LIMITED TO, THOSE ELEMENTS SHOWN.

C. ALL WORK SHALL BE COORDINATED BETWEEN TRADES.

D. ALL WORK SHALL BE COORDINATED WITH THE COR TO MINIMIZE DISRUPTION OF AREAS OUTSIDE OF THE PROJECT LIMITS OF WORK.

E. ALL CEILING DEMOLITION WORK TO BE COORDINATED WITH CHANGE OF EXISTING PENDANT SPRINKLER HEADS WITH NEW UPRIGHT SPRINKLERS SUCH THAT THERE IS NO EXTENDED LOSS OF SPRINKLER PROTECTION IN THE CONSTRUCTION AREA.

F. FOR FINISHES IN ALL NEW TR ROOMS - SEE ROOM FINISH SCHEDULE SHEET A-005.

G. ALL NEW TR ROOMS TO HAVE CARBON DIOXIDE EXTINGUISHER WITHIN 75' OF ROOM. SEE OVERALL OR ENLARGED PLANS FOR LOCATIONS

H. PATCH AND FILL ALL PENETRATIONS/HOLES IN WALLS OF TR ROOMS TO MAINTAIN WALL RATINGS.

KEY NOTES:

1. REMOVE EXISTING FLOOR FINISH AND BASE.
2. DEMOLISH EXISTING DOOR AND FRAME IN METAL STUD AND GYP BD WALL.
3. REMOVE EXISTING ACT CEILING, INCLUDING ELEC AND MECH FIXTURES.
4. DEMOLISH EXISTING MECHANICAL UNIT - SEE MECHANICAL DRAWINGS.
5. DEMOLISH EXISTING WALL.
6. FLOOR FINISH CUT LINE, PREP AREA TO RECEIVE NEW FLOORING.
7. EXISTING FLOOR FINISH TO REMAIN.
8. REMOVE EXISTING SIGNAGE AND TURN OVER TO VA.
9. REMOVE PORTION OF EXISTING ACT. COORDINATE WITH NEW.
10. SEE MECHANICAL DRAWINGS FOR ABOVE CEILING WORK. FOLLOW ICRA MEASURES ON SHEET G-004.

KEY NOTES:

1. ROOM TO RECEIVE NEW FINISHES WALLS AND FLOORS. SEE ROOM FINISH SCHEDULE A-005.
2. NEW CARD READER, REFER TO TECHNOLOGY DRAWINGS.
3. NEW ROOM SIGNAGE, REF TO A-005 FOR REQUIREMENTS.
4. NEW FIRE EXTINGUISHER SIGNAGE ABOVE FIRE EXTINGUISHER CABINET, REFER TO A-005 FOR REQUIREMENTS.
5. INSTALL NEW SURFACE MOUNTED FIRE EXTINGUISHER CABINET.
6. AT NEW DOOR, EXTEND STATIC DISSIPATIVE TILE FROM ROOM INTO CORRIDOR TO EXISTING FLOORING.
7. EXTEND EXISTING WALL TO UNDERSIDE OF DECK ABOVE (APPROX. 8'-0" TO 11'-0") WITH WALL TYPE Mas3 SEE SHEET A-002. SEAL ALL PENETRATIONS AND EXISTING VOIDS.
8. PROVIDE 4'X8'X3/4" FIRE RETARDANT TREATED AC GRADE PLYWOOD BACK BOARDS IN TELECOM ROOMS. PLYWOOD SHALL BE MOUNTED WITH A-SIDE OUT AND PAINTED WITH (3 COATS TOTAL) OF FIRE RESISTANT PAINT ON ALL SIDES PRIOR TO MOUNTING, AND SHALL MATCH F-2 COLOR. MASK OVER FIRE RETARDANT SEAL ON PLYWOOD BEFORE PAINTING TO ALLOW INSPECTION OF FIRE RATING SEAL. ALL DRYWALL SURROUNDING WALLS TO BE PAINTED WITH STANDARD PAINT P-1 TO MATCH PLYWOOD COLOR.
9. INSTALL WINDOW FILM TO INTERIOR FACE OF 36 X 72 WINDOW GLAZING - SEE A-005.
10. CLEAN WINDOW. INSTALL NEW WINDOW LOCK. BASIS OF DESIGN: PRIME-LINE WINDOW LOCK #J5928 OR EQUAL.
11. EXPOSED CEILING.
12. PAINT ENTIRE WALL, 2 COATS, AND INSTALL RB TO MATCH EXISTING MATERIALS ON ADJACENT WALLS.
13. PATCH PAINT AND BASE TO MATCH EXISTING MATERIALS.
14. NEW CEILING TRACK WALL ANGLE. CUT EXISTING TILE TO FIT NEW LENGTH AND REINSTALL.
15. INSTALL NEW FIRE EXTINGUISHER.

KEY PLAN

SCALE: NO SCALE

AREA OF WORK



100% CONSTRUCTION DOCUMENTS

#	Revisions	Date

CONSULTANTS:

3/23/2026

PROJECT MANAGER

ACG Project Number: 20-398

APOGEE Engineers | Architects

Headquarters:
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420

© COPYRIGHT Apogee Consulting Group, P.A.

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: ENLARGED PLANS, BUILDING 1, SECOND FLOOR, TELECOM ROOM 202

Location: ALEXANDRIA VA HEALTH CARE SYSTEM, 2495 SHREVEPORT HWY, 71N, PINEVILLE, LA 71360

Project Title: ELECTRONIC HEALTH RECORD MODERNIZATION (EHRM)

VA PROJECT NUMBER: 502-21-222

Building Number: # 1

Approved

Date: MARCH 24, 2026 | Checked: WVS | Drawn: MEL

Drawing Number: 001.A-402

Dwg. 6 of 51

C:\Users\mel\AppDocuments\A_20-398_VA_Alexandria EHRM_Bldg_01_celeAFC-R22.rvt
3/18/2026 1:25:03 PM
VA FORM 08-6231

Docusign Envelope ID: 1F A1E9F1-2E6F6-44-A0-96BC-7B95F F50EEA5



FIRST FLOOR REFLECTED CEILING DEMOLITION PLAN
Scale: 1/4" = 1'-0"



FIRST FLOOR DEMOLITION FLOOR PLAN
Scale: 1/4" = 1'-0"



FIRST FLOOR REFLECTED CEILING PLAN
Scale: 1/4" = 1'-0"

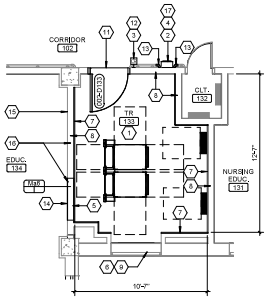

FIRST FLOOR PLAN
Scale: 1/4" = 1'-0"

SHEET NOTES:

A. ALL EXISTING CONDITIONS ARE BASED ON BEST AVAILABLE INFORMATION AT THE TIME OF SURVEY AND VISUAL INSPECTION. CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS.

B. ELEMENTS SHOWN WITH LIGHT, GRAY LINES ARE EXISTING TO REMAIN. ELEMENTS SHOWN WITH DARK DASHED LINES ARE EXISTING TO BE DEMOLISHED. DEMOLITION SHALL INCLUDE, BUT NOT BE LIMITED TO, THOSE ELEMENTS SHOWN.

C. ALL WORK SHALL BE COORDINATED BETWEEN TRADES.

D. ALL WORK SHALL BE COORDINATED WITH THE COR TO MINIMIZE DISRUPTION OF AREAS OUTSIDE OF THE PROJECT LIMITS OF WORK.

E. ALL CEILING DEMOLITION WORK TO BE COORDINATED WITH CHANGE OF EXISTING PENDANT SPRINKLER HEADS WITH NEW UPRIGHT SPRINKLERS SUCH THAT THERE IS NO EXTENDED LOSS OF SPRINKLER PROTECTION IN THE CONSTRUCTION AREA.

F. FOR FINISHES IN ALL NEW TR ROOMS - SEE ROOM FINISH SCHEDULE SHEET A-005.

G. ALL NEW TR ROOMS TO HAVE CARBON DIOXIDE EXTINGUISHER WITHIN 75' OF ROOM, SEE OVERALL OR ENLARGED PLANS FOR LOCATIONS

H. PATCH AND FILL ALL PENETRATIONS/HOLES IN WALLS OF TR ROOMS TO MAINTAIN WALL RATINGS.

KEY NOTES:

1. REMOVE EXISTING FLOOR FINISH AND BASE.
2. DEMOLISH EXISTING DOOR AND FRAME IN MASONRY WALL.
3. DEMOLISH HAT CHANNEL FURRING AND GYPSUM BOARD.
4. CUT BACK EXISTING BUMPER RAIL, HANDRAIL AND WALL PROTECTION 12" AWAY FROM EDGE OF EXISTING DOOR FRAME AND RE-INSTALL EDGE AND GUARD RETURNS.
5. DEMOLISH LATH AND PLASTER CEILING AT 10'-5" A.F.F.
6. DEMOLISH EXISTING MECHANICAL UNIT - SEE MECHANICAL DRAWINGS.
7. DEMOLISH EXISTING HANDRAIL ONLY FOR NEW SURFACE MOUNT FIRE EXTINGUISHER CABINET.
8. DEMOLISH ALL CEILING DEVICES.
9. REMOVE EXISTING SIGNAGE AND TURN OVER TO VA.
10. SEE MECHANICAL DRAWINGS FOR ABOVE CEILING WORK. FOLLOW ICRA MEASURES ON SHEET G-004.

KEY NOTES:

1. ROOM TO RECEIVE NEW FINISHES WALLS AND FLOORS. SEE ROOM FINISH SCHEDULE ON SHEET A-005.
2. NEW FIRE EXTINGUISHER SIGNAGE ABOVE FIRE EXTINGUISHER CABINET. REF TO A-005 FOR REQUIREMENTS.
3. NEW CARD READER, REFER TO TECHNOLOGY DRAWINGS.
4. INSTALL NEW SURFACE MOUNT FIRE EXTINGUISHER CABINET.
5. FILL IN OPENING WITH METAL STUD AND GYP. BD. BOTH SIDES.
6. INSTALL WINDOW FILM TO INTERIOR FACE OF 30 X 58 WINDOW GLAZING - SEE A-005.
7. PROVIDE 4'X8'X3/4" FIRE RETARDANT TREATED AC GRADE PLYWOOD BACK BOARDS IN TELECOM ROOMS. PLYWOOD SHALL BE MOUNTED WITH A-SIDE OUT AND PAINTED WITH (3 COATS TOTAL) OF FIRE RESISTANT PAINT ON ALL SIDES PRIOR TO MOUNTING, AND SHALL MATCH P-2 COLOR. MASK OVER FIRE RETARDANT SEAL ON PLYWOOD BEFORE PAINTING TO ALLOW INSPECTION OF FIRE RATING SEAL. ALL DRYWALL SURROUNDING WALLS TO BE PAINTED WITH STANDARD PAINT P-1 TO MATCH PLYWOOD COLOR.
8. EXTEND EXISTING WALL (+10-5") TO UNDERSIDE OF DECK ABOVE (APPROX. +12'-0") WITH WALL TYPE Mas3 SEE SHEET A-002. SEAL ALL PENETRATIONS AND EXISTING VOIDS.
9. CLEAN WINDOW. INSTALL NEW WINDOW LOCK. BASIS OF DESIGN: PRIME-LINE WINDOW LOCK #U8024 OR EQUAL.
10. EXPOSED CEILING.
11. AT NEW DOOR, EXTEND STATIC DISSIPATIVE TILE FROM ROOM INTO CORRIDOR TO EXISTING FLOORING.
12. NEW ROOM SIGNAGE, REF TO A-005 FOR REQUIREMENTS.
13. INSTALL NEW HANDRAIL RETURNS. COLOR TO MATCH EXISTING.
14. FINISH OF INFILL TO MATCH ADJACENT FINISHES.
15. PAINT ENTIRE WALL - 2 COATS. SEE FINISH SCHEDULE AND NOTES.
16. ALIGN.
17. INSTALL NEW FIRE EXTINGUISHER.

KEY PLAN

SCALE: NO SCALE

AREA OF WORK



FULLY SPRINKLERED

100% CONSTRUCTION DOCUMENTS

#	Revisions	Date

CONSULTANTS:

3/23/2026

PROJECT MANAGER

ACG Project Number 20-398

APOGEE Engineers | Architects

Headquarters:
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420

© COPYRIGHT Apogee Consulting Group, P.A.

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: ENLARGED PLANS, BUILDING 2, FIRST FLOOR, TELECOM ROOM 133

Location: ALEXANDRIA VA HEALTH CARE SYSTEM, 2495 SHREVEPORT HWY, 71N, PINEVILLE, LA 71360

Project Title: ELECTRONIC HEALTH RECORD MODERNIZATION (EHRM)

VA PROJECT NUMBER: 502-21-222

Building Number: # 2

Approved

Date: MARCH 24, 2026 | Checked: WVS | Drawn: MEL

Drawing Number: 002.A-401

Dwg. 7 of 51

C:\Users\mel\AppData\Local\Temp\AcPublish_20408\Drawings\Alexandria EHRM_Bldg_02_Level1FC-002.dwg
3/18/2026 1:28:46 PM
VA FORM 08-6231

Docusign Envelope ID: 1F A1697-2B8F6-44-A0-980C-7B95F F50EEA3



SECOND FLOOR REFLECTED CEILING DEMOLITION PLAN

Scale: 1/4" = 1'-0"



SECOND FLOOR DEMOLITION PLAN

Scale: 1/4" = 1'-0"



SECOND FLOOR REFLECTED CEILING PLAN

Scale: 1/4" = 1'-0"



SECOND FLOOR PLAN

Scale: 1/4" = 1'-0"

SHEET NOTES:

A. ALL EXISTING CONDITIONS ARE BASED ON BEST AVAILABLE INFORMATION AT THE TIME OF SURVEY AND VISUAL INSPECTION. CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS.

B. ELEMENTS SHOWN WITH LIGHT, GRAY LINES ARE EXISTING TO REMAIN. ELEMENTS SHOWN WITH DARK DASHED LINES ARE EXISTING TO BE DEMOLISHED. DEMOLITION SHALL INCLUDE, BUT NOT BE LIMITED TO, THOSE ELEMENTS SHOWN.

C. ALL WORK SHALL BE COORDINATED BETWEEN TRADES.

D. ALL WORK SHALL BE COORDINATED WITH THE COR TO MINIMIZE DISRUPTION OF AREAS OUTSIDE OF THE PROJECT LIMITS OF WORK.

E. ALL CEILING DEMOLITION WORK TO BE COORDINATED WITH CHANGE OF EXISTING PENDANT SPRINKLER HEADS WITH NEW UPRIGHT SPRINKLERS SUCH THAT THERE IS NO EXTENDED LOSS OF SPRINKLER PROTECTION IN THE CONSTRUCTION AREA.

F. FOR FINISHES IN ALL NEW TR ROOMS - SEE ROOM FINISH SCHEDULE SHEET A-005.

G. ALL NEW TR ROOMS TO HAVE CARBON DIOXIDE EXTINGUISHER WITHIN 75' OF ROOM, SEE OVERALL OR ENLARGED PLANS FOR LOCATIONS

H. PATCH AND FILL ALL PENETRATIONS/HOLES IN WALLS OF TR ROOMS TO MAINTAIN WALL RATINGS.

KEY NOTES:

1 REMOVE EXISTING FLOOR FINISH AND BASE.
2 DEMOLISH EXISTING DOOR AND FRAME IN MASONRY WALL.
3 REMOVE EXISTING ACT CEILING, INCLUDING ELEC AND MECH FIXTURES.
4 DEMOLISH EXISTING MECHANICAL UNIT - SEE MECHANICAL DRAWINGS.
5 REMOVE EXISTING SIGNAGE AND TURN OVER TO VA.
6 SEE MECHANICAL DRAWINGS FOR ABOVE CEILING WORK, FOLLOW EPA MEASURES ON SHEET G-004.

KEY NOTES:

1 ROOM TO RECEIVE NEW FINISHES WALLS AND FLOORS. SEE ROOM FINISH SCHEDULE ON SHEET A-005.
2 NEW FIRE EXTINGUISHER SIGNAGE ABOVE FIRE EXTINGUISHER CABINET. REF TO A-005 FOR REQUIREMENTS.
3 NEW CARD READER. REFER TO TECHNOLOGY DRAWINGS.
4 INSTALL NEW SURFACE MOUNT FIRE EXTINGUISHER CABINET.
5 INSTALL WINDOW FILM TO INTERIOR FACE OF 35" X 65" WINDOW GLAZING - SEE A-005.
6 PROVIDE 4'X8'X3/4" FIRE RETARDANT TREATED AC GRADE PLYWOOD BACK BOARDS IN TELECOM ROOMS. PLYWOOD SHALL BE MOUNTED WITH A-SIDE OUT AND PAINTED WITH (3 COATS TOTAL) OF FIRE RESISTANT PAINT ON ALL SIDES PRIOR TO MOUNTING, AND SHALL MATCH P-2 COLOR. MASK OVER FIRE RETARDANT SEAL ON PLYWOOD BEFORE PAINTING TO ALLOW INSPECTION OF FIRE RATING SEAL. ALL DRYWALL SURROUNDING WALLS TO BE PAINTED WITH STANDARD PAINT P-1 TO MATCH PLYWOOD COLOR.
7 EXTEND EXISTING WALL (+10'-0") TO UNDERSIDE OF DECK ABOVE (APPROX. +1'-0") WITH WALL TYPE Mw3 SEE SHEET A-002. SEAL ALL PENETRATIONS AND EXISTING VOIDS.
8 EXPOSED CEILING.
9 CLEAN WINDOW. INSTALL NEW WINDOW LOCK. BASIS OF DESIGN: PRIME-LINE WINDOW LOCK #U9926 OR EQUAL.
10 AT NEW DOOR, EXTEND STATIC DISSIPATIVE TILE FROM ROOM INTO CORRIDOR TO EXISTING FLOORING.
11 NEW ROOM SIGNAGE. REF TO A-005 FOR REQUIREMENTS.
12 INSTALL NEW FIRE EXTINGUISHER.
13 FINISH OF INFILL TO MATCH ADJACENT FINISHES.
14 PAINT ENTIRE WALL - 2 COATS.
15 PROVIDE GRACE ICE AND WATERSHIELD, SELF ADHERING, MEMBRANE 45 MIL THICK OR EQUAL. ENTIRE WALL FLOOR FINISH, BOTTOM OF MEMBRANE TO SEAL 1/4" TO FLOOR AND TURN UP. ADHERE TO METAL TRACK RUNNER AND METAL STUDS. INSIDE FACE, TR ROOM SIDE. REPLACE REMOVED GYPSUM BOARD.
16 CONDUIT THRU PENETRATION IN WALLS ABOVE CEILING. PATCH AND REPAIR CLAY TILE WALLS AROUND PENETRATION WITH MASONRY FOR FULL WIDTH OF WALL. FILL ALL VOIDS. FIRESTOP AROUND ALL CONDUIT PENETRATIONS.

KEY PLAN

SCALE: NO SCALE

AREA OF WORK



FULLY SPRINKLERED

100% CONSTRUCTION DOCUMENTS

#	Revisions	Date

CONSULTANTS:

3/23/2026

PROJECT MANAGER

ACG Project Number 20-398

APOGEE Engineers | Architects

Headquarters:
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420

© COPYRIGHT Apogee Consulting Group, P.A.

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: ENLARGED PLANS, BUILDING 2, SECOND FLOOR, TELECOM ROOM 256

Location: ALEXANDRIA VA HEALTH CARE SYSTEM, 2495 SHREVEPORT HWY, 71N, PINEVILLE, LA 71360

Project Title: ELECTRONIC HEALTH RECORD MODERNIZATION (EHRM)

VA PROJECT NUMBER: 502-21-222

Building Number: # 2

Approved

Date: MARCH 24, 2026 | Checked: WVS | Drawn: MEL

Drawing Number: 002.A-402

Dwg. 8 of 51

C:\Users\mel\AppData\Local\Temp\Apogee\Documents\A_20-398_VA Alexandria EHRM_Bldg_02_vaHCF-002.rvt
3/18/2026 1:26:46 PM
VA FORM 08-6231

Docusign Envelope ID: 1F A1E971-2E6F6-44 A0-B6C-7B95F F50EEA5



THIRD FLOOR REFLECTED CEILING DEMOLITION PLAN
Scale: 1/4" = 1'-0"



THIRD FLOOR DEMOLITION PLAN
Scale: 1/4" = 1'-0"



THIRD FLOOR REFLECTED CEILING PLAN
Scale: 1/4" = 1'-0"



THIRD FLOOR PLAN
Scale: 1/4" = 1'-0"

SHEET NOTES:

A. ALL EXISTING CONDITIONS ARE BASED ON BEST AVAILABLE INFORMATION AT THE TIME OF SURVEY AND VISUAL INSPECTION. CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS.

B. ELEMENTS SHOWN WITH LIGHT, GRAY LINES ARE EXISTING TO REMAIN. ELEMENTS SHOWN WITH DARK DASHED LINES ARE EXISTING TO BE DEMOLISHED. DEMOLITION SHALL INCLUDE, BUT NOT BE LIMITED TO, THOSE ELEMENTS SHOWN.

C. ALL WORK SHALL BE COORDINATED BETWEEN TRADES.

D. ALL WORK SHALL BE COORDINATED WITH THE COR TO MINIMIZE DISRUPTION OF AREAS OUTSIDE OF THE PROJECT LIMITS OF WORK.

E. ALL CEILING DEMOLITION WORK TO BE COORDINATED WITH CHANGE OF EXISTING PENDANT SPRINKLER HEADS WITH NEW UPRIGHT SPRINKLERS SUCH THAT THERE IS NO EXTENDED LOSS OF SPRINKLER PROTECTION IN THE CONSTRUCTION AREA.

F. FOR FINISHES IN ALL NEW TR ROOMS - SEE ROOM FINISH SCHEDULE SHEET A-005.

G. ALL NEW TR ROOMS TO HAVE CARBON DIOXIDE EXTINGUISHER WITHIN 75' OF ROOM, SEE OVERALL OR ENLARGED PLANS FOR LOCATIONS

H. PATCH AND FILL ALL PENETRATIONS/HOLES IN WALLS OF TR ROOMS TO MAINTAIN WALL RATINGS.

KEY NOTES:

1. REMOVE EXISTING FLOOR FINISH AND BASE.
2. DEMOLISH EXISTING DOOR AND FRAME IN MASONRY WALL.
3. DEMOLISH EXISTING DOOR AND FRAME.
4. REMOVE EXISTING ACT CEILING, INCLUDING ELEC AND MECH FIXTURES.
5. DEMOLISH EXISTING MECHANICAL UNIT - SEE MECHANICAL DRAWINGS.
6. REMOVE EXISTING EXISTING SIGNAGE AND TURN OVER TO VA.
7. REMOVE GYPSUM BOARD TR SIDE IN PREPARATION FOR WATERSHIELD MEMBRANE.
8. SEE MECHANICAL DRAWINGS FOR ABOVE CEILING WORK. FOLLOW ICRA MEASURES ON SHEET G-004.

KEY NOTES:

1. ROOM TO RECEIVE NEW FINISHES WALLS AND FLOORS. SEE ROOM FINISH SCHEDULE ON SHEET A-005.
2. NEW FIRE EXTINGUISHER SIGNAGE ABOVE FIRE EXTINGUISHER CABINET. REF TO A-005 FOR REQUIREMENTS.
3. NEW CARD READER. REFER TO TECHNOLOGY DRAWINGS.
4. INSTALL WINDOW FILM TO INTERIOR FACE OF 35" X 65" WINDOW GLAZING - SEE A-005.
5. PROVIDE 4'X8'X3/4" FIRE RETARDANT TREATED AC GRADE PLYWOOD BACK BOARDS IN TELECOM ROOMS. PLYWOOD SHALL BE MOUNTED WITH A-SIDE OUT AND PAINTED WITH (3 COATS TOTAL) OF FIRE RESISTANT PAINT ON ALL SIDES PRIOR TO MOUNTING, AND SHALL MATCH P-2 COLOR. MASK OVER FIRE RETARDANT SEAL ON PLYWOOD BEFORE PAINTING TO ALLOW INSPECTION OF FIRE RATING SEAL. ALL DRYWALL SURROUNDING WALLS TO BE PAINTED WITH STANDARD PAINT P-1 TO MATCH PLYWOOD COLOR.
6. INSTALL NEW SURFACE MOUNT FIRE EXTINGUISHER CABINET.
7. EXTEND EXISTING WALL (+10'-5") TO UNDERSIDE OF DECK ABOVE (APPROX. +12'-0") WITH WALL TYPE Mw3. SEE SHEET A-002. SEAL ALL PENETRATIONS AND EXISTING VOIDS.
8. FILL IN OPENING WITH METAL STUD AND GYP. BD. BOTH SIDES.
9. EXPOSED CEILING.
10. CLEAN WINDOW. INSTALL NEW WINDOW LOCK. BASIS OF DESIGN: PRIME-LINE WINDOW LOCK #J5928 OR EQUAL.
11. AT NEW DOOR, EXTEND STATIC DISSIPATIVE TILE FROM ROOM INTO CORRIDOR TO EXISTING FLOORING.
12. NEW ROOM SIGNAGE. REF TO A-005 FOR REQUIREMENTS.
13. FINISH OF INFILL TO MATCH ADJACENT FINISHES.
14. PAINT ENTIRE WALL - 2 COATS.
15. PROVIDE GRACE, ICE AND WATERSHIELD, SELF ADHERING, MEMBRANE 45 MIL THICK OR EQUAL. ENTIRE WALL FLOOR FINISH. BOTTOM OF MEMBRANE TO SEAL 1/4" TO FLOOR AND TURN UP. ADHERE TO METAL TRACK RUNNER AND METAL STUDS. INSIDE FACE, TR ROOM SIDE. REPLACE REMOVED GYSPUM BOARD.
16. INSTALL NEW FIRE EXTINGUISHER.

KEY PLAN

SCALE: NO SCALE

AREA OF WORK



FULLY SPRINKLERED

100% CONSTRUCTION DOCUMENTS

#	Revisions	Date

CONSULTANTS:

3/23/2026

PROJECT MANAGER

ACG Project Number: 20-398

APOGEE Engineers | Architects

Headquarters:
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511

www.acg-pa.com 919-858-7420

© COPYRIGHT Apogee Consulting Group, P.A.

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: ENLARGED PLANS, BUILDING 2, THIRD FLOOR, TELECOM ROOM 359

Location: ALEXANDRIA VA HEALTH CARE SYSTEM
2495 SHREVEPORT HWY, 71N
PINEVILLE, LA 71360

Project Title: ELECTRONIC HEALTH RECORD MODERNIZATION (EHRM)

VA PROJECT NUMBER: 502-21-222

Building Number: # 2

Approved

Date: MARCH 24, 2026 | Checked: WVS | Drawn: MEL

Drawing Number: 002.A-403

Dwg. 9 of 51

C:\Users\mel\AppData\Local\Temp\Apogee\Documents\A_20-398_VA Alexandria EHRM_Bldg_02_v4-R21-R22.rvt
3/13/2026 1:26:46 PM
VA FORM 08-6231

Docusign Envelope ID: 1F A1697-2B8F6-44-A0-980C-7B95F F50EEA3



FORTH FLOOR REFLECTED CEILING DEMOLITION PLAN
Scale: 1/4" = 1'-0"



FOURTH FLOOR DEMOLITION PLAN
Scale: 1/4" = 1'-0"



FOURTH FLOOR REFLECTED CEILING PLAN
Scale: 1/4" = 1'-0"



FOURTH FLOOR PLAN
Scale: 1/4" = 1'-0"

SHEET NOTES:

A. ALL EXISTING CONDITIONS ARE BASED ON BEST AVAILABLE INFORMATION AT THE TIME OF SURVEY AND VISUAL INSPECTION. CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS.

B. ELEMENTS SHOWN WITH LIGHT, GRAY LINES ARE EXISTING TO REMAIN. ELEMENTS SHOWN WITH DARK DASHED LINES ARE EXISTING TO BE DEMOLISHED. DEMOLITION SHALL INCLUDE, BUT NOT BE LIMITED TO, THOSE ELEMENTS SHOWN.

C. ALL WORK SHALL BE COORDINATED BETWEEN TRADES.

D. ALL WORK SHALL BE COORDINATED WITH THE COR TO MINIMIZE DISRUPTION OF AREAS OUTSIDE OF THE PROJECT LIMITS OF WORK.

E. ALL CEILING DEMOLITION WORK TO BE COORDINATED WITH CHANGE OF EXISTING PENDANT SPRINKLER HEADS WITH NEW UPRIGHT SPRINKLERS SUCH THAT THERE IS NO EXTENDED LOSS OF SPRINKLER PROTECTION IN THE CONSTRUCTION AREA.

F. FOR FINISHES IN ALL NEW TR ROOMS - SEE ROOM FINISH SCHEDULE SHEET A-005.

G. ALL NEW TR ROOMS TO HAVE CARBON DIOXIDE EXTINGUISHER WITHIN 75' OF ROOM. SEE OVERALL OR ENLARGED PLANS FOR LOCATIONS

H. PATCH AND FILL ALL PENETRATIONS/HOLES IN WALLS OF TR ROOMS TO MAINTAIN WALL RATINGS.

KEY NOTES:

1. REMOVE EXISTING FLOOR FINISH AND BASE.
2. DEMOLISH EXISTING DOOR AND FRAME IN METAL STUD AND GYP. WALL.
3. DEMOLISH EXISTING DOOR AND FRAME.
4. DEMOLISH EXISTING COUNTERS, BASE CABINETS, AND WALL CABINETS.
5. DEMOLISH EXISTING HANDRAIL ONLY FOR NEW SURFACE MOUNT FIRE EXTINGUISHER CABINET.
6. DEMOLISH EXISTING GYP. BD SOFFIT.
7. REMOVE EXISTING ACT CEILING, INCLUDING ELEC AND MECH FIXTURES.
8. CUT BACK EXISTING BUMPER RAIL, HANDRAIL AND WALL PROTECTION 12" AWAY FROM EDGE OF EXISTING DOOR FRAME AND RE-INSTALL EDGE AND GUARD RETURNS.
9. REMOVE EXISTING SIGNAGE AND TURN OVER TO VA.
10. SEE MECHANICAL DRAWINGS FOR ABOVE CEILING WORK, FOLLOW ICRA MEASURES ON SHEET G-004.
11. WALL TO BE DEMOLISHED.

KEY NOTES:

1. ROOM TO RECEIVE NEW FINISHES (WALLS AND FLOORS. SEE ROOM FINISH SCHEDULE ON SHEET A-005.
2. NEW FIRE EXTINGUISHER SIGNAGE ABOVE FIRE EXTINGUISHER CABINET. REF TO A-005 FOR REQUIREMENTS.
3. NEW CARD READER. REFER TO TECHNOLOGY DRAWINGS.
4. INSTALL NEW SURFACE MOUNT FIRE EXTINGUISHER CABINET.
5. PROVIDE 4'X8'X3/4" FIRE RETARDANT TREATED AC GRADE PLYWOOD BACK BOARDS IN TELECOM ROOMS. PLYWOOD SHALL BE MOUNTED WITH A-SIDE OUT AND PAINTED WITH (3 COATS TOTAL) OF FIRE RESISTANT PAINT ON ALL SIDES PRIOR TO MOUNTING, AND SHALL MATCH P-2 COLOR. MASK OVER FIRE RETARDANT SEAL ON PLYWOOD BEFORE PAINTING TO ALLOW INSPECTION OF FIRE RATING SEAL. ALL DRYWALL SURROUNDING WALLS TO BE PAINTED WITH STANDARD PAINT P-1 TO MATCH PLYWOOD COLOR.
6. EXTEND EXISTING WALL (+10'-0") TO UNDERSIDE OF DECK ABOVE (APPROX. 8'-0" TO 11'-0") WITH WALL TYPE Mark1. SEE SHEET A-002. SEAL ALL PENETRATIONS AND EXISTING VOIDS.
7. FILL IN OPENING WITH METAL STUD AND GYP. BD. BOTH SIDES.
8. EXPOSED CEILING.
9. AT NEW DOOR, EXTEND STATIC DISSIPATIVE TILE FROM ROOM INTO CORRIDOR TO EXISTING FLOORING.
10. NEW ROOM SIGNAGE. REF TO A-005 FOR REQUIREMENTS.
11. INSTALL NEW HANDRAIL RETURNS, COLOR TO MATCH EXISTING.
12. FINISH OF INFILL TO MATCH ADJACENT FINISHES.
13. PAINT ENTIRE WALL - 2 COATS. SEE FINISH SCHEDULE ON SHEET A-005 AND NOTES.
14. INSTALL NEW FIRE EXTINGUISHER.

KEY PLAN

SCALE: NO SCALE

AREA OF WORK



FULLY SPRINKLERED

100% CONSTRUCTION DOCUMENTS

#	Revisions	Date

CONSULTANTS:

3/23/2026

PROJECT MANAGER

ACG Project Number: 20-398

APOGEE Engineers | Architects

© COPYRIGHT Apogee Consulting Group, P.A.

Headquarters:
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: ENLARGED PLANS, BUILDING 2, FOURTH FLOOR, TELECOM ROOM 424

Location: ALEXANDRIA VA HEALTH CARE SYSTEM, 2495 SHREVEPORT HWY, 71N, PINEVILLE, LA 71360

Project Title: ELECTRONIC HEALTH RECORD MODERNIZATION (EHRM)

VA PROJECT NUMBER: 502-21-222

Building Number: # 2

Approved

Date: MARCH 24, 2026 | Checked: WVS | Drawn: MEL

Drawing Number: 002.A-404

Dwg. 10 of 51

C:\Users\mel\AppDataLocal\Temp\Apogee\Documents\A_20-398_VA Alexandria EHRM_Bldg_02_v-MEL.rvt
3/19/2026 1:28:46 PM
VA FORM 08-6231

Docusign Envelope ID: 7F A1E971-2E6F6-44 A0-96BC-7B95F F50EEA5



FIRST FLOOR REFLECTED CEILING DEMOLITION PLAN
Scale: 1/4" = 1'-0"



FIRST FLOOR DEMOLITION FLOOR PLAN
Scale: 1/4" = 1'-0"



FIRST FLOOR REFLECTED CEILING PLAN
Scale: 1/4" = 1'-0"

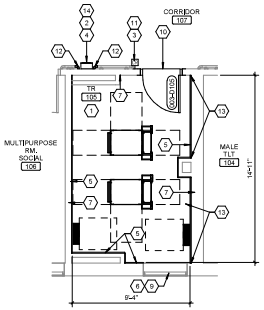

FIRST FLOOR PLAN
Scale: 1/4" = 1'-0"

SHEET NOTES:

A. ALL EXISTING CONDITIONS ARE BASED ON BEST AVAILABLE INFORMATION AT THE TIME OF SURVEY AND VISUAL INSPECTION. CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS.

B. ELEMENTS SHOWN WITH LIGHT, GRAY LINES ARE EXISTING TO REMAIN. ELEMENTS SHOWN WITH DARK DASHED LINES ARE EXISTING TO BE DEMOLISHED. DEMOLITION SHALL INCLUDE, BUT NOT BE LIMITED TO, THOSE ELEMENTS SHOWN.

C. ALL WORK SHALL BE COORDINATED BETWEEN TRADES.

D. ALL WORK SHALL BE COORDINATED WITH THE COR TO MINIMIZE DISRUPTION OF AREAS OUTSIDE OF THE PROJECT LIMITS OF WORK.

E. ALL CEILING DEMOLITION WORK TO BE COORDINATED WITH CHANGE OF EXISTING PENDANT SPRINKLER HEADS WITH NEW UPRIGHT SPRINKLERS SUCH THAT THERE IS NO EXTENDED LOSS OF SPRINKLER PROTECTION IN THE CONSTRUCTION AREA.

F. FOR FINISHES IN ALL NEW TR ROOMS - SEE ROOM FINISH SCHEDULE SHEET A-005.

G. ALL NEW TR ROOMS TO HAVE CARBON DIOXIDE EXTINGUISHER WITHIN 75' OF ROOM. SEE OVERALL OR ENLARGED PLANS FOR LOCATIONS.

H. PATCH AND FILL ALL PENETRATIONS/HOLES IN WALLS OF TR ROOMS TO MAINTAIN WALL RATINGS.

KEY NOTES:

1. REMOVE EXISTING FLOOR FINISH AND BASE.
2. DEMOLISH EXISTING DOOR AND FRAME IN MASONRY WALL.
3. DEMOLISH WALLPAPER.
4. DEMOLISH EXISTING BASE CABINET AND COUNTER.
5. DEMOLISH SINK - SEE PLUMBING DRAWINGS.
6. DEMOLISH LATH AND PLASTER CEILING. TEST FOR ASBESTOS PRIOR TO DEMOLIBHING.
7. CUT BACK EXISTING BUMPER RAIL, HANDRAIL AND WALL PROTECTION 1.2" AWAY FROM EDGE OF EXISTING DOOR FRAME AND RE-INSTALL EDGE AND GUARD RETURNS.
8. DEMOLISH EXISTING HANDRAIL ONLY FOR NEW SURFACE MOUNT FIRE EXTINGUISHER CABINET.
9. REMOVE EXISTING SIGNAGE AND TURN OVER TO VA.
10. REMOVE GYPSUM BOARD TR SIDE IN PREPARATION FOR WATERSHIELD MEMBRANE.
11. SEE MECHANICAL DRAWINGS FOR ABOVE CEILING WORK. FOLLOW ICRA MEASURES ON SHEET G-004.
12. DEMOLISH BUMP OUT AT 8'-3" ABOVE FLOOR.
13. REMOVE EXISTING ACT CEILING INCLUDING ELEC AND MECH FIXTURES.

KEY NOTES:

1. ROOM TO RECEIVE NEW FINISHES WALLS AND FLOORS. SEE ROOM FINISH SCHEDULE ON SHEET A-005.
2. NEW FIRE EXTINGUISHER SIGNAGE ABOVE FIRE EXTINGUISHER CABINET. REF TO A-005 FOR REQUIREMENTS.
3. NEW CARD READER. REFER TO TECHNOLOGY DRAWINGS.
4. INSTALL NEW SURFACE MOUNT FIRE EXTINGUISHER CABINET.
5. PROVIDE 4'X8'X3/4" FIRE RETARDANT TREATED AC GRADE PLYWOOD BACK BOARDS IN TELECOM ROOMS. PLYWOOD SHALL BE MOUNTED WITH A-SIDE OUT AND PAINTED WITH (3 COATS TOTAL) OF FIRE RESETANT PAINT ON ALL SIDES PRIOR TO MOUNTING, AND SHALL MATCH R-2 COLOR. MASK OVER FIRE RETARDANT SEAL ON PLYWOOD BEFORE PAINTING TO ALLOW INSPECTION OF FIRE RATING SEAL. ALL DRYWALL SURROUNDING WALLS TO BE PAINTED WITH STANDARD PAINT P-1 TO MATCH PLYWOOD COLOR.
6. INSTALL WINDOW FILM TO INTERIOR FACE OF 45" X 67" WINDOW GLAZING - SEE A-005.
7. EXTEND EXISTING WALL (+15-2") TO UNDERSIDE OF DECK ABOVE (APPROX. 2'-2") WITH WALL TYPE Mw3 SEE SHEET A-002. SEAL ALL PENETRATIONS AND EXISTING VOIDS.
8. EXPOSED CEILING.
9. CLEAN WINDOW. INSTALL NEW WINDOW LOCK. BASIS OF DESIGN: PRIME-LINE WINDOW LOCK #J9928 OR EQUAL.
10. AT NEW DOOR, EXTEND STATIC DISSIPATIVE TILE FROM ROOM INTO CORRIDOR TO EXISTING FLOORING.
11. NEW ROOM SIGNAGE. REF TO A-005 FOR REQUIREMENTS.
12. INSTALL NEW HANDRAIL RETURNS. COLOR TO MATCH.
13. PROVIDE GRACE, ICE AND WATERSHIELD, SELF ADHERING, MEMBRANE 45 MIL THICK OR EQUAL. ENTIRE WALL ABOVE FLOOR FINISH, BOTTOM OF MEMBRANE TO SEAL 1/4" TO FLOOR AND TURN UP. ADHERE TO METAL TRACK RUNNER AND METAL STUDS. INSIDE FACE TR ROOM SIDE. REPLACE REMOVED GYSPUM BOARD.
14. INSTALL NEW FIRE EXTINGUISHER.

KEY PLAN

SCALE: NO SCALE

AREA OF WORK



FULLY SPRINKLERED

100% CONSTRUCTION DOCUMENTS

#	Revisions	Date

CONSULTANTS:

3/23/2026

PROJECT MANAGER

ACG Project Number 20-398

APOGEE Engineers | Architects

Headquarters:
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420

© COPYRIGHT Apogee Consulting Group, P.A.

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: ENLARGED PLANS, BUILDING 3, FIRST FLOOR, TELECOM ROOM 105

Location: ALEXANDRIA VA HEALTH CARE SYSTEM, 2495 SHREVEPORT HWY, 71N, PINEVILLE, LA 71360

Project Title: ELECTRONIC HEALTH RECORD MODERNIZATION (EHRM)

VA PROJECT NUMBER: 502-21-222

Building Number: # 3

Approved

Date: MARCH 24, 2026 | Checked: WVS | Drawn: MEL

Drawing Number: 003.A-401

Dwg. 11 of 51

3/30/2026 4:08:21 PM C:\Users\mel\Documents\A_20-398_VA Alexandria EHRM_BAlg_03_melACF.rvt

Docusign Envelope ID: 1F A1697-2B8F6-44-A0-980C-7B95F F50EEA3



SECOND FLOOR REFLECTED CEILING DEMOLITION PLAN

Scale: 1/4" = 1'-0"



SECOND FLOOR DEMOLITION PLAN

Scale: 1/4" = 1'-0"



SECOND FLOOR REFLECTED CEILING PLAN

Scale: 1/4" = 1'-0"

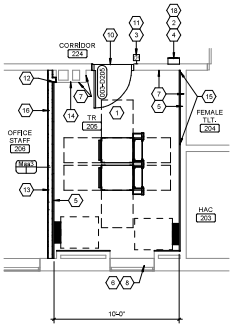

SECOND FLOOR PLAN

Scale: 1/4" = 1'-0"

SHEET NOTES:

A. ALL EXISTING CONDITIONS ARE BASED ON BEST AVAILABLE INFORMATION AT THE TIME OF SURVEY AND VISUAL INSPECTION. CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS.

B. ELEMENTS SHOWN WITH LIGHT, GRAY LINES ARE EXISTING TO REMAIN. ELEMENTS SHOWN WITH DARK DASHED LINES ARE EXISTING TO BE DEMOLISHED. DEMOLITION SHALL INCLUDE, BUT NOT BE LIMITED TO, THOSE ELEMENTS SHOWN.

C. ALL WORK SHALL BE COORDINATED BETWEEN TRADES.

D. ALL WORK SHALL BE COORDINATED WITH THE COR TO MINIMIZE DISRUPTION OF AREAS OUTSIDE OF THE PROJECT LIMITS OF WORK.

E. ALL CEILING DEMOLITION WORK TO BEE COORDINATED WITH CHANGE OF EXISTING PENDANT SPRINKLER HEADS WITH NEW UPRIGHT SPRINKLERS SUCH THAT THERE IS NO EXTENDED LOSS OF SPRINKLER PROTECTION IN THE CONSTRUCTION AREA.

F. FOR FINISHES IN ALL NEW TR ROOMS - SEE ROOM FINISH SCHEDULE SHEET A-005.

G. ALL NEW TR ROOMS TO HAVE CARBON DIOXIDE EXTINGUISHER WITHIN 75' OF ROOM. SEE OVERALL OR ENLARGED PLANS FOR LOCATIONS

H. PATCH AND FILL ALL PENETRATIONS/HOLES IN WALLS OF TR ROOMS TO MAINTAIN WALL RATINGS.

KEY NOTES:

1. REMOVE EXISTING FLOOR FINISH AND BASE.
2. DEMOLISH EXISTING DOOR AND FRAME IN MASONRY WALL.
3. DEMOLISH 12.X12 ACT ADHERED TO LATH AND PLASTER CEILING. DEMOLISH LATH AND PLASTER CEILING @ APPROX. 10'-0".
4. DEMOLISH PORTION OF EXISTING CEILING ASSEMBLY.
5. FLOOR FINISH CUT LINE. PREP AREA TO RECEIVE NEW FLOORING.
6. EXISTING FLOOR FINISH TO REMAIN.
7. DIMENSION EXISTING WALL.
8. REMOVE EXISTING SIGNAGE AND TURN OVER TO VA.
9. REMOVE GYPSUM BOARD TR SIDE IN PREPARATION FOR WATERSHIELD MEMBRANE.
10. SEE MECHANICAL DRAWINGS FOR ABOVE CEILING WORK. FOLLOW ICRA MEASURES ON SHEET G-004.
11. REMOVE PORTION OF EXISTING ACT. COORDINATE WITH NEW.
12. DEMOLISH DOUBLE SINK.

KEY NOTES:

1. ROOM TO RECEIVE NEW FINISHES WALLS AND FLOORS. SEE ROOM FINISH SCHEDULE ON SHEET A-005.
2. NEW FIRE EXTINGUISHER SIGNAGE ABOVE FIRE EXTINGUISHER CABINET. REF TO A-005 FOR REQUIREMENTS.
3. NEW CARD READER. REFER TO TECHNOLOGY DRAWINGS.
4. INSTALL NEW SURFACE MOUNT FIRE EXTINGUISHER CABINET.
5. PROVIDE 4'X8'X3/4" FIRE RETARDANT TREATED AC GRADE PLYWOOD BACK BOARDS IN TELECOM ROOMS. PLYWOOD SHALL BE MOUNTED WITH A-SIDE OUT AND PAINTED WITH (3 COATS TOTAL) OF FIRE RESISTANT PAINT ON ALL SIDES PRIOR TO MOUNTING, AND SHALL MATCH P-2 COLOR. MASK OVER FIRE RETARDANT SEAL ON PLYWOOD BEFORE PAINTING TO ALLOW INSPECTION OF FIRE RATING SEAL. ALL DRYWALL SURROUNDING WALLS TO BE PAINTED WITH STANDARD PAINT P-1 TO MATCH PLYWOOD COLOR.
6. INSTALL WINDOW FILM TO INTERIOR FACE OF 42" X 67" WINDOW GLAZING - SEE A-005.
7. EXTEND EXISTING WALL (+19-5") TO UNDERSIDE OF DECK ABOVE (APPROX. 2'-2") WITH WALL TYPE M6. SEE SHEET A-203. SEAL ALL PENETRATIONS AND EXISTING VOIDS.
8. CLEAN WINDOW. INSTALL NEW WINDOW LOCK, BASIS OF DESIGN: PRIME-LINE WINDOW LOCK #U9928 OR EQUAL.
9. EXPOSED CEILING.
10. AT NEW DOOR, EXTEND STATIC DISSIPATIVE TILE FROM ROOM INTO CORRIDOR TO EXISTING FLOORING.
11. NEW ROOM SIGNAGE, REF TO A-005 FOR REQUIREMENTS.
12. ALIGN WALLS.
13. PAINT ENTIRE WALL. 2 COATS. INTALL RB COLOR TO MATCH ADJACENT BASE.
14. PATCH AND REPAIR WALL.
15. PROVIDE GRACE ICE AND WATERSHIELD, SELF ADHERING, MEMBRANE 45 MIL THICK OR EQUAL. ENTIRE WALL ABOVE FLOOR FINISH, BOTTOM OF MEMBRANE TO SEAL 1/4" TO FLOOR AND TURN UP. ADHERE TO METAL TRACK RUNNER AND METAL STUDS. INSIDE FACE. TR ROOM SIDE. REPLACE REMOVED GYPSUM BOARD.
16. PROVIDE PAINT AND BASE FOR ENTIRE NEW WALL.
17. NEW CEILING TRACK WALL ANGLE. CUT EXISTING TILE TO FIT NEW LENGTH AND REINSTALL.
18. INSTALL NEW FIRE EXTINGUISHER.

KEY PLAN

SCALE: NO SCALE

AREA OF WORK



FULLY SPRINKLERED

100% CONSTRUCTION DOCUMENTS

#	Revisions	Date

CONSULTANTS:

3/23/2026

PROJECT MANAGER

ACG Project Number 20-398

APOGEE Engineers | Architects

Headquarters:
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420

© COPYRIGHT Apogee Consulting Group, P.A.

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: ENLARGED PLANS, BUILDING 3, SECOND FLOOR, TELECOM ROOM 205

Location: ALEXANDRIA VA HEALTH CARE SYSTEM, 2495 SHREVEPORT HWY, 71N, PINEVILLE, LA 71360

Project Title: ELECTRONIC HEALTH RECORD MODERNIZATION (EHRM)

VA PROJECT NUMBER: 502-21-222

Building Number: # 3

Approved

Date: MARCH 24, 2026 | Checked: WVS | Drawn: MEL

Drawing Number: 003.A-402

Dwg. 12 of 51

C:\Users\mel\AppData\Local\Temp\Apogee\Documents\A_20-398_VA Alexandria EHRM_BAg_03_mel-AFC-R22.rvt
3/18/2026 4:08:21 PM
VA FORM 08-6231

Docusign Envelope ID: 1F A1E971-2E6F-E44-A0-B6C-7B95F F50EEA5



THIRD FLOOR REFLECTED CEILING DEMOLITION PLAN

Scale: 1/4" = 1'-0"



THIRD FLOOR DEMOLITION PLAN

Scale: 1/4" = 1'-0"



THIRD FLOOR REFLECTED CEILING PLAN

Scale: 1/4" = 1'-0"

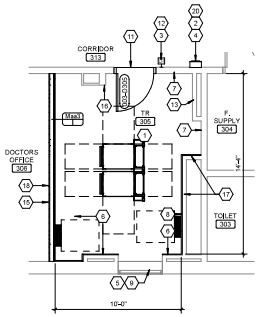

THIRD FLOOR PLAN

Scale: 1/4" = 1'-0"

SHEET NOTES:

A. ALL EXISTING CONDITIONS ARE BASED ON BEST AVAILABLE INFORMATION AT THE TIME OF SURVEY AND VISUAL INSPECTION. CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS.

B. ELEMENTS SHOWN WITH LIGHT, GRAY LINES ARE EXISTING TO REMAIN. ELEMENTS SHOWN WITH DARK DASHED LINES ARE EXISTING TO BE DEMOLISHED. DEMOLITION SHALL INCLUDE, BUT NOT BE LIMITED TO, THOSE ELEMENTS SHOWN.

C. ALL WORK SHALL BE COORDINATED BETWEEN TRADES.

D. ALL WORK SHALL BE COORDINATED WITH THE COR TO MINIMIZE DISRUPTION OF AREAS OUTSIDE OF THE PROJECT LIMITS OF WORK.

E. ALL CEILING DEMOLITION WORK TO BE COORDINATED WITH CHANGE OF EXISTING PENDANT SPRINKLER HEADS WITH NEW UPRIGHT SPRINKLERS SUCH THAT THERE IS NO EXTENDED LOSS OF SPRINKLER PROTECTION IN THE CONSTRUCTION AREA.

F. FOR FINISHES IN ALL NEW TR ROOMS - SEE ROOM FINISH SCHEDULE SHEET A-005.

G. ALL NEW TR ROOMS TO HAVE CARBON DIOXIDE EXTINGUISHER WITHIN 75' OF ROOM. SEE OVERALL OR ENLARGED PLANS FOR LOCATIONS

H. PATCH AND FILL ALL PENETRATIONS/HOLES IN WALLS OF TR ROOMS TO MAINTAIN WALL RATINGS.

KEY NOTES:

1. REMOVE EXISTING FLOOR FINISH AND BASE.
2. DEMOLISH EXISTING DOOR AND FRAME IN MASONRY WALL.
3. DEMOLISH WALL TILE TO 52" AFF.
4. EXISTING DOUBLE SINK.
5. EXPOSED CEILING.
6. DEMOLISH PORTION OF EXISTING CEILING ASSEMBLY.
7. EXISTING FLOOR FINISH TO REMAIN.
8. FLOOR FINISH CUT LINE. PREP AREA TO RECEIVE NEW FLOORING.
9. DEMOLISH EXISTING WALL.
10. REMOVE EXISTING SIGNAGE AND TURN OVER TO VA.
11. REMOVE GYPSUM BOARD TR SIDE IN PREPARATION FOR WATERSHIELD MEMBRANE.
12. SEE MECHANICAL DRAWINGS FOR ABOVE CEILING WORK. FOLLOW ICRA MEASURES ON SHEET G-004.
13. REMOVE PORTION OF EXISTING ACT. COORDINATE WITH NEW.

KEY NOTES:

1. ROOM TO RECEIVE NEW FINISHES WALLS AND FLOORS. SEE ROOM FINISH SCHEDULE ON SHEET A-005.
2. NEW FIRE EXTINGUISHER SIGNAGE ABOVE FIRE EXTINGUISHER CABINET. REF TO A-005 FOR REQUIREMENTS.
3. NEW CARD READER. REFER TO TECHNOLOGY DRAWINGS.
4. INSTALL NEW SURFACE MOUNT FIRE EXTINGUISHER CABINET.
5. INSTALL WINDOW FILM TO INTERIOR FACE OF 42" X 65" WINDOW GLAZING - SEE A-205.
6. PROVIDE 4'X8'X3/4" FIRE RETARDANT TREATED AC GRADE PLYWOOD BACK BOARDS IN TELECOM ROOMS. PLYWOOD SHALL BE MOUNTED WITH A-SIDE OUT AND PAINTED WITH (3 COATS TOTAL) OF FIRE RESISTANT PAINT ON ALL SIDES PRIOR TO MOUNTING. AND SHALL MATCH PQ COLOR. MASK OVER FIRE RETARDANT SEAL ON PLYWOOD BEFORE PAINTING TO ALLOW INSPECTION OF FIRE RATING SEAL. ALL DRYWALL SURROUNDING WALLS TO BE PAINTED WITH STANDARD PAINT P-1 TO MATCH PLYWOOD COLOR.
7. EXTEND EXISTING WALL (+10'-0") TO UNDERSIDE OF DECK ABOVE (APPROX. 2'-0") WITH WALL TYPE M6. SEE SHEET A-403. SEAL ALL PENETRATIONS AND EXISTING VOIDS.
8. FILL IN WALL VOIDS WITH MASONRY.
9. CLEAN WINDOW. INSTALL NEW WINDOW LOCK. BASIS OF DESIGN: PRIME-LINE WINDOW LOCK #U9628 OR EQUAL.
10. EXPOSED CEILING.
11. AT NEW DOOR, EXTEND STATIC DISSIPATIVE TILE FROM ROOM INTO CORRIDOR TO EXISTING FLOORING.
12. NEW ROOM SIGNAGE. REF TO A-005 FOR REQUIREMENTS.
13. REPAIR OR REPLACE WALL SHEATHING DAMAGED BY TILE REMOVAL.
15. PAINT ENTIRE WALL, 2 COATS. INTALL RB-1 COLOR TO MATCH ADJACENT BASE.
16. PATCH AND REPAIR WALL.
17. PROVIDE GRACE, ICE AND WATERSHIELD, SELF AHDHERING, MEMBRANE 45 MIL THICK OR EQUAL. ENTIRE WALL ABOVE FLOOR FINISH. BOTTOM OF MEMBRANE TO SEAL 1/4" TO FLOOR AND TURN UP, ADHERE TO METAL TRACK RUNNER AND METAL STUDS. INSIDE FACE, TR ROOM SIDE. REPLACE REMOVED GYSPUM BOARD.
18. PROVIDE PAINT AND BASE ON NEW WALL TO MATCH ROOM FINISHES.
19. NEW CEILING TRACK WALL ANGLE. CUT EXISTING TILE TO FIT NEW LENGTH AND REINSTALL.
20. INSTALL NEW FIRE EXTINGUISHER.

KEY PLAN

SCALE: NO SCALE

AREA OF WORK



FULLY SPRINKLERED

100% CONSTRUCTION DOCUMENTS

#	Revisions	Date

CONSULTANTS:

3/23/2026

PROJECT MANAGER

ACG Project Number 20-398

APOGEE Engineers | Architects

Headquarters:
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420

© COPYRIGHT Apogee Consulting Group, P.A.

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: ENLARGED PLANS, BUILDING 3, THIRD FLOOR, TELECOM ROOM 305

Location: ALEXANDRIA VA HEALTH CARE SYSTEM, 2495 SHREVEPORT HWY, 71N, PINEVILLE, LA 71360

Project Title: ELECTRONIC HEALTH RECORD MODERNIZATION (EHRM)

VA PROJECT NUMBER: 502-21-222

Building Number: # 3

Approved

Date: MARCH 24, 2026 | Checked: WVS | Drawn: MEL

Drawing Number: 003.A-403

Dwg. 13 of 51

C:\Users\mel\AppDataLocal\Temp\Autodesk\Revit\2026\20-398_VA Alexandria EHRM_BldG_03_melAFC-R24.rvt

3/19/2026 4:08:22 PM

VA FORM 08-6231

Docusign Envelope ID: 7F A1697F-2B7F-44 A0-96C-7B95F F50EEA3



FIRST FLOOR REFLECTED CEILING DEMOLITION PLAN
Scale: 1/4" = 1'-0"



FIRST FLOOR DEMOLITION FLOOR PLAN
Scale: 1/4" = 1'-0"



FIRST FLOOR REFLECTED CEILING PLAN
Scale: 1/4" = 1'-0"



FIRST FLOOR PLAN
Scale: 1/4" = 1'-0"

SHEET NOTES:

A. ALL EXISTING CONDITIONS ARE BASED ON BEST AVAILABLE INFORMATION AT THE TIME OF SURVEY AND VISUAL INSPECTION. CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS.

B. ELEMENTS SHOWN WITH LIGHT, GRAY LINES ARE EXISTING TO REMAIN. ELEMENTS SHOWN WITH DARK DASHED LINES ARE EXISTING TO BE DEMOLISHED. DEMOLITION SHALL INCLUDE, BUT NOT BE LIMITED TO, THOSE ELEMENTS SHOWN.

C. ALL WORK SHALL BE COORDINATED BETWEEN TRADES.

D. ALL WORK SHALL BE COORDINATED WITH THE COR TO MINIMIZE DERUPTION OF AREAS OUTSIDE OF THE PROJECT LIMITS OF WORK.

E. FOR FINISHES IN ALL NEW TR ROOMS– SEE ROOM FINISH SCHEDULE SHEET A-005.

F. ALL NEW TR ROOMS TO HAVE CARBON DIOXIDE EXTINGUISHER WITHIN 75' OF ROOM, SEE OVERALL OR ENLARGED PLANS FOR LOCATIONS

G. PATCH AND FILL ALL PENETRATIONSHOLES IN WALLS OF TR ROOMS TO MAINTAIN WALL RATINGS.

KEY NOTES:

1 REMOVE EXISTING FLOOR FINISH AND BASE.
2 DEMOLISH EXISTING DOOR AND FRAME IN METAL STUD AND GYP BD WALL.
3 DEMOLISH EXISTING ACT CEILING, INCLUDING ELEC AND MECH FIXTURES.
4 REMOVE EXISTING SIGNAGE AND TURN OVER TO VA.
5 SEE MECHANICAL DRAWINGS FOR ABOVE CEILING WORK. FOLLOW ICRA MEASURES ON SHEET G-004.

⟨#⟩ KEY NOTES:

1 ROOM TO RECEIVE NEW FINISHES WALLS AND FLOORS. SEE ROOM FINISH SCHEDULE ON SHEET A-005.
2 NEW FIRE EXTINGUISHER SIGNAGE ABOVE FIRE EXTINGUISHER CABINET. REF TO A-005 FOR REQUIREMENTS.
3 NEW CARD READER. REFER TO TECHNOLOGY DRAWINGS.
4 INSTALL NEW SURFACE MOUNTED FIRE EXTINGUISHER CABINET.
5 PROVIDE 4'X8'X3/4" FIRE RETARDANT TREATED AC GRADE PLYWOOD BACK BOARDS IN TELECOM ROOMS. PLYWOOD SHALL BE MOUNTED WITH A-SIDE OUT AND PAINTED WITH (3 COATS TOTAL) OF FIRE RESISTANT PAINT ON ALL SIDES PRIOR TO MOUNTING, AND SHALL MATCH P-2 COLOR. MASK OVER FIRE RETARDANT SEAL ON PLYWOOD BEFORE PAINTING TO ALLOW INSPECTION OF FIRE RATING SEAL. ALL DRYWALL SURROUNDING WALLS TO BE PAINTED WITH STANDARD PAINT P-1 TO MATCH PLYWOOD COLOR.
6 EXTEND EXISTING WALL TO UNDERSIDE OF DECK ABOVE (APPROX. 3-0) WITH WALL TYPE Mas3 SEE SHEET A-202. SEAL ALL PENETRATIONS AND EXISTING VOIDS.
7 EXPOSED CEILING.
8 NEW ROOM SIGNAGE. REF TO A-005 FOR REQUIREMENTS.
9 AT NEW DOOR, EXTEND STATIC DISSIPATIVE TILE FROM ROOM INTO CORRIDOR TO EXISTING FLOORING.
10 INSTALL NEW FIRE EXTINGUISHER.

KEY PLAN

SCALE: NO SCALE

AREA OF WORK



FULLY SPRINKLERED

100% CONSTRUCTION DOCUMENTS

#	Revisions	Date

CONSULTANTS:

3/23/2026

PROJECT MANAGER

ACG Project Number: 20-398

APOGEE Engineers | Architects

Headquarters:
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420

© COPYRIGHT Apogee Consulting Group, P.A.

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: ENLARGED PLANS, BUILDING 4, FIRST FLOOR, TELECOM ROOM 102E

Location: ALEXANDRIA VA HEALTH CARE SYSTEM, 2495 SHREVEPORT HWY, 71N, PINEVILLE, LA 71360

Project Title: ELECTRONIC HEALTH RECORD MODERNIZATION (EHRM)

VA PROJECT NUMBER: 502-21-222

Building Number: # 4

Approved

Date: MARCH 24, 2026 | Checked: WVS | Drawn: MEL

Drawing Number: 004.A-401

Dwg. 14 of 51

C:\Users\mel\AppDocuments\A_20-398_VA_Alexandria EHRM_Bldg_04_uMaPCF-R22.rvt
3/18/2026 1:39:58 PM
VA FORM 08-6231

Docusign Envelope ID: 1F A1697-2B8F6-44-A0-B6C-7B95F F50EEA3

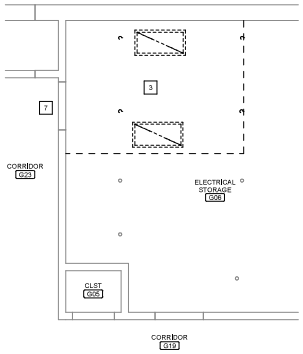

GROUND FLOOR REFLECTED CEILING DEMOLITION PLAN
Scale: 1/4" = 1'-0"

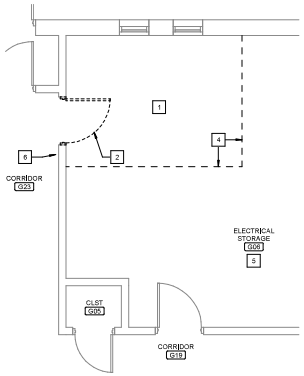

GROUND FLOOR DEMOLITION PLAN
Scale: 1/4" = 1'-0"

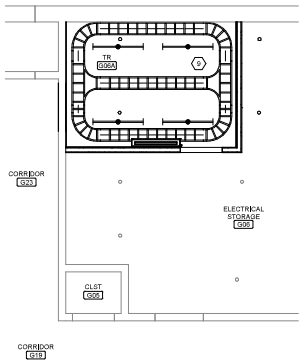

GROUND FLOOR REFLECTED CEILING PLAN
Scale: 1/4" = 1'-0"

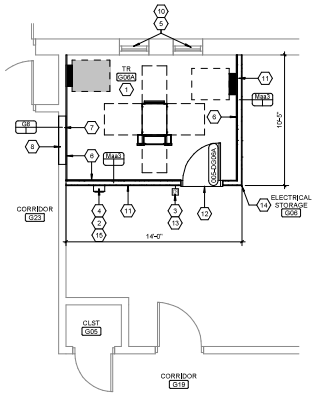

GROUND FLOOR PLAN
Scale: 1/4" = 1'-0"

SHEET NOTES:

A. ALL EXISTING CONDITIONS ARE BASED ON BEST AVAILABLE INFORMATION AT THE TIME OF SURVEY AND VISUAL INSPECTION. CONTRACTOR SHALL FIELD VERIFY EXISTING CONDITIONS.

B. ELEMENTS SHOWN WITH LIGHT, GRAY LINES ARE EXISTING TO REMAIN. ELEMENTS SHOWN WITH DARK DASHED LINES ARE EXISTING TO BE DEMOLISHED. DEMOLITION SHALL INCLUDE, BUT NOT BE LIMITED TO, THOSE ELEMENTS SHOWN.

C. ALL WORK SHALL BE COORDINATED BETWEEN TRADES.

D. ALL WORK SHALL BE COORDINATED WITH THE COR TO MINIMIZE DISRUPTION OF AREAS OUTSIDE OF THE PROJECT LIMITS OF WORK.

E. ALL CEILING DEMOLITION WORK TO BE COORDINATED WITH CHANGE OF EXISTING PENDANT SPRINKLER HEADS WITH NEW UPRIGHT SPRINKLERS SUCH THAT THERE IS NO EXTENDED LOSS OF SPRINKLER PROTECTION IN THE CONSTRUCTION AREA.

F. FOR FINISHES IN ALL NEW TR ROOMS– SEE ROOM FINISH SCHEDULE SHEET A-005.

G. ALL NEW TR ROOMS TO HAVE CARBON DIOXIDE EXTINGUISHER WITHIN 75' OF ROOM. SEE OVERALL OR ENLARGED PLANS FOR LOCATIONS

H. PATCH AND FILL ALL PENETRATIONSHOLES IN WALLS OF TR ROOMS TO MAINTAIN WALL RATINGS.

KEY NOTES:

1. REMOVE EXISTING FLOOR FINISH AND BASE.
2. DEMOLISH EXISTING DOOR AND FRAME IN MASONRY WALL AND REMOVE METAL PLASTER EDGE AROUND DOOR.
3. EXISTING EXPOSED CEILING TO REMAIN, APPROX. HEIGHT 10'-8" TO UNDERSIDE OF STRUCTURE.
4. FLOOR FINISH CUT LINE. PREP AREA TO RECEIVE NEW FLOORING.
5. EXISTING FLOOR FINISH TO REMAIN.
6. REMOVE EXISTING SIGNAGE AND TURN OVER TO THE VA.
7. SEE MECHANICAL DRAWINGS FOR ABOVE CEILING WORK IN CORRIDOR AREA. FOLLOW ICRA MEASURES ON SHEET G-004.

KEY NOTES:

1. ROOM TO RECEIVE NEW FINISHES WALLS AND FLOORS. SEE ROOM FINISH SCHEDULE ON SHEET A-005.
2. NEW FIRE EXTINGUISHER SIGNAGE ABOVE FIRE EXTINGUISHER CABINET. REF TO A-005 FOR REQUIREMENTS.
3. NEW CARD READER, REFER TO TECHNOLOGY DRAWINGS.
4. INSTALL NEW SURFACE MOUNT FIRE EXTINGUISHER CABINET.
5. INSTALL WINDOW FILM TO INTERIOR FACE OF 28" X 30" WINDOW GLAZING – SEE A-005.
6. PROVIDE 4'X8'X3/4" FIRE RETARDANT TREATED AC GRADE PLYWOOD BACK BOARDS IN TELECOM ROOMS. PLYWOOD SHALL BE MOUNTED WITH A-SIDE OUT AND PAINTED WITH (3 COATS TOTAL) OF FIRE RESISTANT PAINT ON ALL SIDES PRIOR TO MOUNTING, AND SHALL MATCH P-2 COLOR. MASK OVER FIRE RETARDANT SEAL ON PLYWOOD BEFORE PAINTING TO ALLOW INSPECTION OF FIRE RATING SEAL. ALL DRYWALL SURROUNDING WALLS TO BE PAINTED WITH STANDARD PAINT P-1 TO MATCH PLYWOOD COLOR.
7. INFILL WALL OPENING ABOVE DOOR HEIGHT WITH MASONRY MATCH WALL WIDTH AS POSSIBLE.
8. INFILL DOOR OPENING WITH MASONRY MATCH WALL WIDTH AS POSSIBLE. WALL TO BE FLUSH WITH CORRIDOR SIDE PLASTER FINISH. MATCH COVE CONDITION AT BASE. PAINT TO MATCH SURROUNDING WALL COLOR AND PAINT BASE TO MATCH ADJACENT BASE.
9. EXPOSED CEILING.
10. EXISTING OPERABLE STEEL MESH SECURITY GATES TO REMAIN. CLEAN AND PREP WINDOWS FOR WINDOW FILM INSTALLATION.
11. PAINT AND PROVIDE RB ON BOTH SIDES OF NEW PARTITIONS.
12. AT NEW DOOR, EXTEND STATIC DISSIPATIVE TILE FROM ROOM INTO CORRIDOR TO EXISTING FLOORING.
13. NEW ROOM SIGNAGE, REF TO A-005 FOR REQUIREMENTS.
14. PROVIDE CORNER GUARD TO MATCH EXISTING SIZE AND COLOR.
15. INSTALL NEW FIRE EXTINGUISHER.

KEY PLAN

SCALE: NO SCALE

AREA OF WORK

FULLY SPRINKLERED

100% CONSTRUCTION DOCUMENTS

#	Revisions	Date

CONSULTANTS:

3/23/2026

PROJECT MANAGER

ACG Project Number: 20-398

APOGEE Engineers | Architects

Headquarters:
Apogee Consulting Group, P.A.
1151 Kildaire Farm Road, Suite 120
Cary, North Carolina 27511
www.acg-pa.com 919-858-7420

© COPYRIGHT Apogee Consulting Group, P.A.

Office of Construction and Facilities Management

VA U.S. Department of Veterans Affairs

Drawing Title: ENLARGED PLANS, BUILDING 5, GROUND FLOOR, TELECOM ROOM G06A

Project Title: ELECTRONIC HEALTH RECORD MODERNIZATION (EHRM)

VA PROJECT NUMBER: 502-21-222

Building Number: # 5

Location: ALEXANDRIA VA HEALTH CARE SYSTEM, 2495 SHREVEPORT HWY, 71N, PINEVILLE, LA 71360

Approved

Date: MARCH 24, 2026 | Checked: WVS | Drawn: MEL

Drawing Number: 005.A-400

Dwg. 15 of 51

C:\Users\mel\Documents\A_20-398_VA_Alexandria EHRM_Bldg_05_v4a-FCF-R22.rvt
3/18/2026 1:43:25 PM
VA FORM 08-6231