Abandoned in place Sanitary Sewer main

Added water under New DHS ICE Facility project

New Sanitary Sewer under New DHS ICE Facility project

Added water under Bldg 2294 Fire Hydrant project

Abandoned in place water main.

Bldg # 2390

Bldg # 2391

Bldg # 2284

Bldg # 2294

Bldg # 2291

Bldg # 2393

Bldg # 2394 6100 GOLTRA COURT

Bldg # 2448 6127 INDIANHEAD ROAD

GOLTRA AVE

JECELIN RD

INDIANHEAD RD

BELFREY ST

COLUMBUS WATER WORKS ASSUMES
NO RESPONSIBILITY
FOR ACCURACY OF WATER AND/OR SEWER UTILITY LOCATIONS SHOWN ON THIS DOCUMENT. ALL UTILITY LOCATIONS MUST BE FIELD VERIFIED.

CWW Alkeno Area Bldg 2294 Utiliti

Date: 7/8/2026

1 inch = 188 feet

Columbus Water Works

Serving our Community
Protecting the Environment

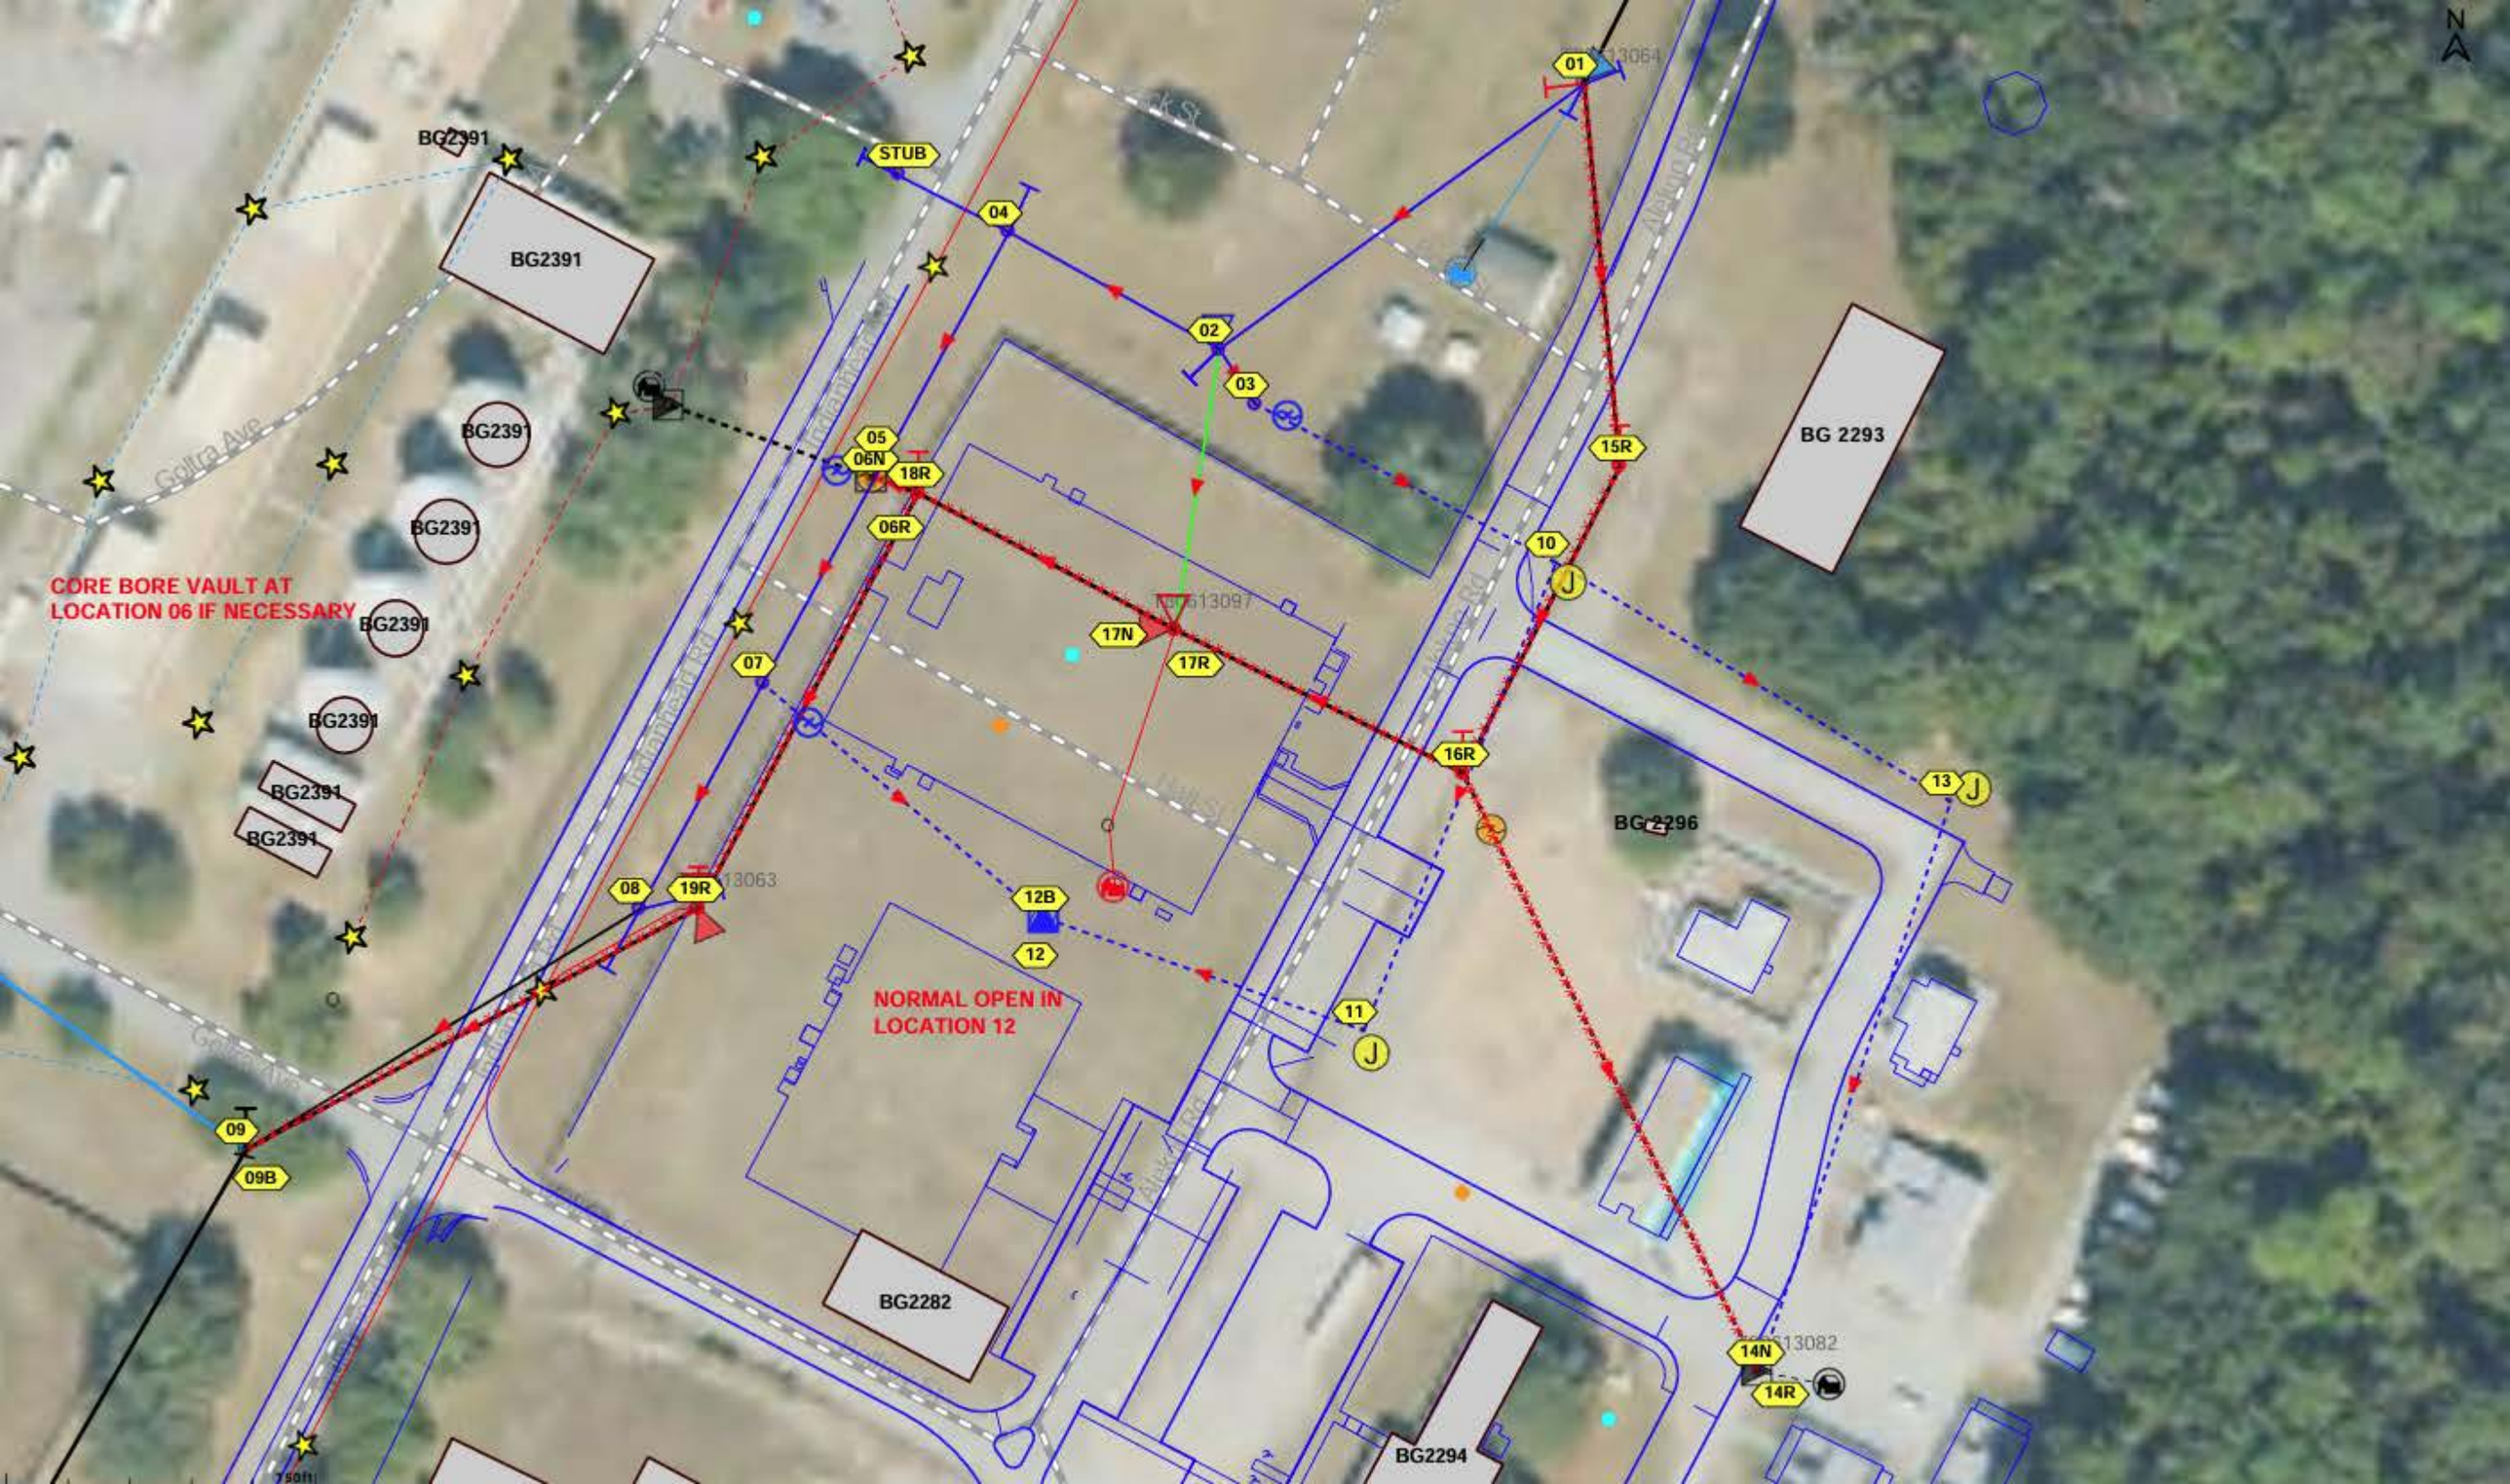
N
BG2391
BG2391
BG2391
BG2391
BG2391
BG2391
BG2391
BG2391
BG2391
Gollra Ave
CORE BORE VAULT AT
LOCATION 06 IF NECESSARY
STUB
04
01
02
03
05
06N
18R
06R
15R
10
J
17N
17R
07
16R
13
J
BG 2293
BG2296
08
19R
12B
12
NORMAL OPEN IN
LOCATION 12
11
J
09
09B
BG2282
14N
14R
BG2294

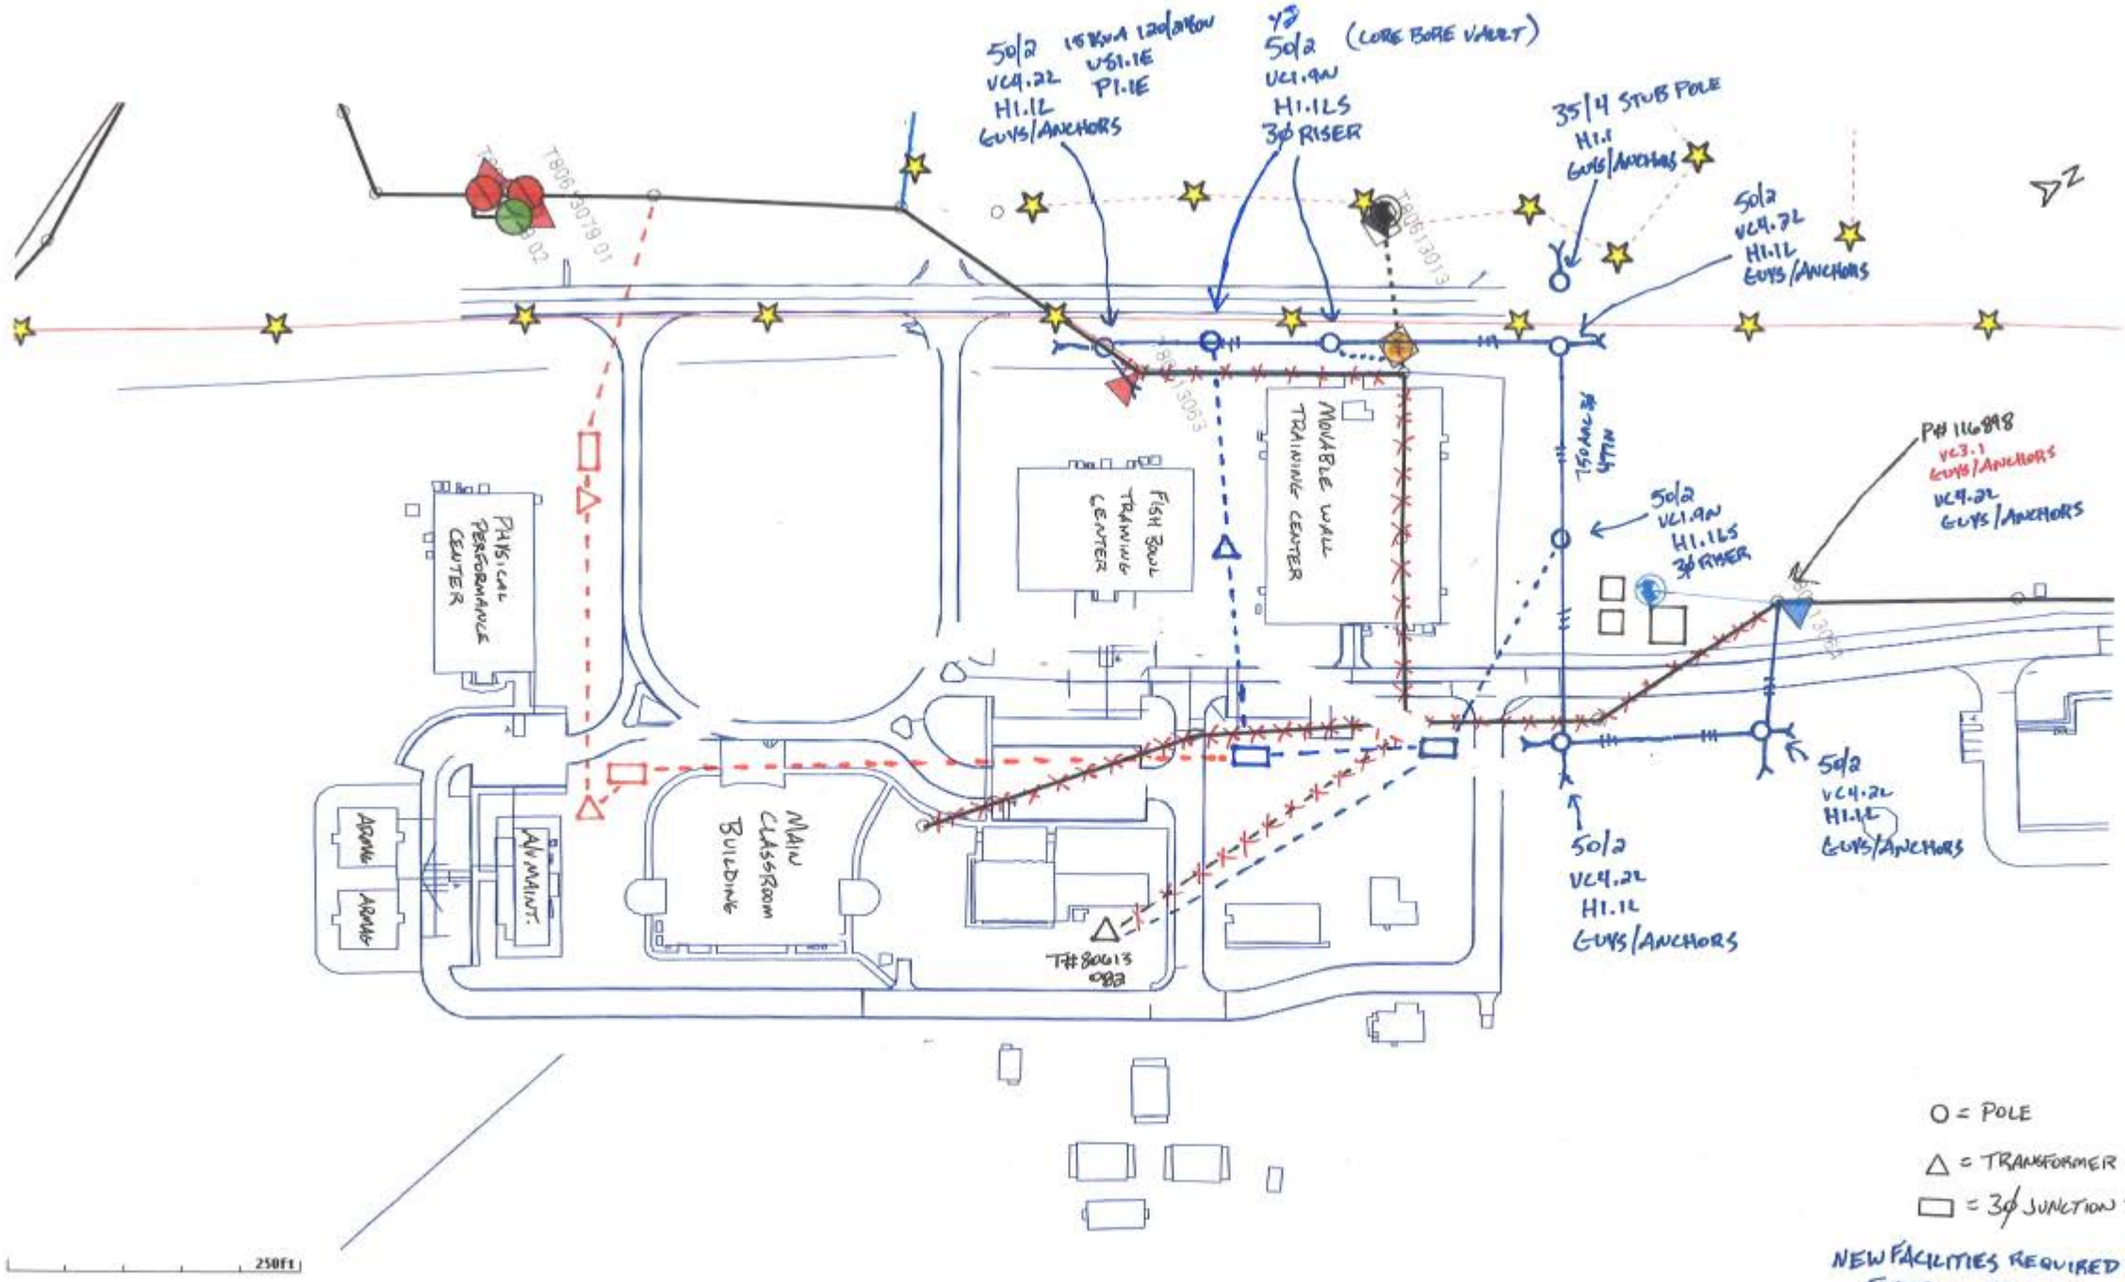
50/2
VC4.22
H1.1L
GUYS/ANCHORS
15KVA 120/240V
VS1.1E
P1.1E
Y2
50/2
VC1.9N
H1.1LS
3Ø RISER
(LORE BORE VAULT)
35/4 STUB POLE
H1.1
GUYS/ANCHORS
50/2
VC4.2L
H1.1L
GUYS/ANCHORS
T806 3079 01
T806 3013
T806 3063
T806 3064
PHYSICAL PERFORMANCE CENTER
FISH BOWL TRAINING CENTER
MOVABLE WALL TRAINING CENTER
750 AHC #4 TIN
P# 116898
VC3.1
GUYS/ANCHORS
VC4.22
GUYS/ANCHORS
50/2
VC1.9N
H1.1LS
3Ø RISER
ARMY
ARMY
AV MAINT.
MAIN CLASSROOM BUILDING
T# 80613 083
50/2
VC4.22
H1.1L
GUYS/ANCHORS
50/2
VC4.22
H1.1L
GUYS/ANCHORS
250 FT
O = POLE
△ = TRANSFORMER
▭ = 3Ø JUNCTION BOX
NEW FACILITIES REQUIRED FOR FISHBOWL PROJECT
FUTURE ADDITIONS
RETIREMENT XXX